

# TOSHIBA

E15-005

## Leading Innovation >>>

Model name:

**MMY-MAP\_6HT8P-E**

**SMMS**  
SUPER MODULAR MULTI SYSTEM



**Engineering  
Data Book**

< Full version >



Notice: Toshiba is committed to continuously improving its products to ensure the highest quality and reliability standards, and to meet local regulations and market requirements. All features and specifications are subject to change without prior notice.




Safety caution .....	2
<b>1 System overview .....</b>	<b>5</b>
1-1. Allocation standard of model name .....	5
1-2. Summary of system equipments .....	6
<b>2 Equipment selection procedure .....</b>	<b>11</b>
2-1. Selection flow chart.....	11
2-2. Combination conditions for indoor unit and outdoor unit .....	12
2-3. Cooling/heating capacity characteristics.....	12
2-4. Operational temperature range.....	18
<b>3 Refrigerant piping design.....</b>	<b>19</b>
3-1. Free branching system .....	19
3-2. Allowable length/height difference of refrigerant piping .....	20
3-3. Selection of refrigerant piping .....	21
3-4. Charging requirement with additional refrigerant .....	22
<b>4 Wiring design.....</b>	<b>23</b>
4-1. General .....	23
4-2. Summary of wiring design .....	23
4-3. Electrical wiring design .....	23
4-4. Outdoor unit power supply.....	24
4-5. Indoor unit power supply.....	26
4-6. Design of control wiring .....	29
<b>5 Outdoor unit.....</b>	<b>31</b>
5-1. Specifications.....	31
5-2. Dimensional drawing .....	42
5-3. Center of gravity.....	56
5-4. Branch header / Branch joint.....	57
5-5. Refrigerant cycle diagram.....	60
5-6. Wiring diagram.....	63
5-7. Connecting diagram.....	66
5-8. Applied control for Outdoor Unit .....	69
5-9. Optional printed circuit board (PCB) of outdoor unit.....	72
5-10. Part load performance.....	81
5-11. Sound pressure level data.....	116
<b>Appendix.....</b>	<b>126</b>



- Before use, read carefully through the “Safety caution” section to ensure correct operation.
- The important contents concerned to the safety are described in the “Safety cautions”. Be sure to keep them. For Indications and their meanings, see the following description.

## ■ Warning Indications on the Air Conditioner Unit

Warning indication	Description
 <b>WARNING</b> <b>ELECTRICAL SHOCK HAZARD</b> Disconnect all remote electric power supplies	<b>WARNING</b>  <b>ELECTRICAL SHOCK HAZARD</b> Disconnect all remote electric power supplies before servicing.
 <b>WARNING</b> Moving parts. Do not operate unit with grille removed.	<b>WARNING</b>  Moving parts. Do not operate unit with grille removed. Stop the unit before the servicing.
 <b>CAUTION</b> High temperature parts. You might get burned when removing this panel.	<b>CAUTION</b>  High temperature parts. You might get burned when removing this panel.
 <b>CAUTION</b> Do not touch the aluminum fins of the unit. Doing so may result in injury.	<b>CAUTION</b>  Do not touch the aluminium fins of the unit. Doing so may result in injury.
 <b>CAUTION</b> <b>BURST HAZARD</b> Open the service valves before the operation,	<b>CAUTION</b>  <b>BURST HAZARD</b> Open the service valves before the operation, otherwise there might be the burst.
 <b>CAUTION</b> Do not climb onto the fan guard. Doing so may result in	<b>CAUTION</b>  <b>Do not climb onto the fan guard.</b> Doing so may result in injury.



## ■ Explanation of indications

### **WARNING**

Indicates possibilities that a death or serious injury of personnel is caused by an incorrect handling.

### **CAUTION**

Indicates contents that an injury (\*1) or property damage (\*2) only may be caused when an incorrect work has been executed.

\*1: "Injury" means a hurt, a burn, or an electric shock which does not require hospitalization or a long-term going to the hospital.

\*2: "Property damage means an enlarged damage concerned to property, or breakage of materials.

- **After installation work has finished, check there is no trouble by a test operation, and explain using method and maintenance method to the customers based on the Owner's Manual.**

**Please ask the customers to keep this Installation Manual together with the Owner's Manual.**

### **WARNING**

**Ask a shop or a professional dealer to install the air conditioner.**

If you will install by yourself, a fire, an electric shock, or water leak is caused.

**Take measures so that the refrigerant does not exceed the limit concentration even if it leaks when installing the air conditioner in a small room.**

For the measures not to exceed the limit of concentration, contact the dealer. If the refrigerant leaks and it exceeds the limit of concentration, an accident of oxygen shortage is caused.

**Install the air conditioner at a place which is satisfactorily bearable to weight.**

If strength is insufficient, the unit may fall down resulting in human injury.

**Perform a specified installation work against a strong wind such as typhoon or earthquake.**

If the air conditioner is imperfectly installed, an accident by falling or dropping may be caused.

**If refrigerant gas leaks during installation work, ventilate the room.**

If the leaked refrigerant gas approaches to fire, noxious gas may generate.

**After installation work, confirm that refrigerant gas does not leak.**

If refrigerant gas leaks in the room, and approaches to fire such as fan heater, stove or kitchen range, generation of noxious gas may be caused.

**Never recover refrigerant in the outdoor unit.**

Be sure to use a refrigerant recovery device to recover refrigerant in reinstallation or repair work.

Recovery of refrigerant in the outdoor unit is unavailable; otherwise a serious accident such as crack or human injury is caused.

**A person qualified for the electric work should deal with the electric construction conforming to the regulations of the local electric company and the Installation Manual. Be sure to use the exclusive circuit.**

If there is capacity shortage of the power supply circuit or incomplete installation, a fire or an electric shock is caused.

**For cabling, use the specified cables and connect them securely so that external force of cable does not transmit to the terminal connecting section.**

If connection or fixing is incomplete, a fire, etc. may be caused.

**Be sure to connect earth wire.**

Do not connect earth wire to gas pipe, water pipe, lightning rod, nor earth wire of telephone.

If grounding is incomplete, an electric shock is caused.

### **CAUTION**

**Do not install the air conditioner at a place where combustible gas may leak.**

If gas leaks and is collected at surrounding the unit, the production of fire may be caused.

**Be sure to attach an earth leakage breaker; otherwise an electric shock may be caused.**

**Using a torque wrench, tighten the flare nut in the specified method.**

If the flare nut is exceedingly tightened, the flare nut is broken and a refrigerant leakage may be caused after a long time has passed.



## WARNINGS ON REFRIGERANT LEAKAGE

### Check of Concentration Limit

The room in which the air conditioner is to be installed requires a design that in the event of refrigerant gas leaking out, its concentration will not exceed a set limit.

The refrigerant R410A which is used in the air conditioner is safe, without the toxicity or combustibility of ammonia, and is not restricted by laws to be imposed which protect the ozone layer. However, since it contains more than air, it poses the risk of suffocation if its concentration should rise excessively.

Suffocation from leakage of R410A is almost nonexistent. With the recent increase in the number of high concentration buildings, however, the installation of multi air conditioner systems is on the increase because of the need for effective use of floor space, individual control, energy conservation by curtailing heat and carrying power etc.

Most importantly, the multi air conditioner system is able to replenish a large amount of refrigerant compared with conventional individual air conditioners. If a single unit of the multi conditioner system is to be installed in a small room, select a suitable model and installation procedure so that if the refrigerant accidentally leaks out, its concentration does not reach the limit (and in the event of an emergency, measures can be made before injury can occur).

In a room where the concentration may exceed the limit, create an opening with adjacent rooms, or install mechanical ventilation combined with a gas leak detection device.

The concentration is as given below.

Total amount of refrigerant (kg)


$$\frac{\text{Min. volume of the indoor unit installed room (m}^3\text{)}}{\leq \text{Concentration limit (kg/m}^3\text{)}}$$

Concentration limit

Compliance to the local applicable regulations and standards for the concentration limit is required.

#### NOTE 1:

If there are 2 or more refrigerating systems in a single refrigerating device, the amounts of refrigerant should be as charged in each independent device.

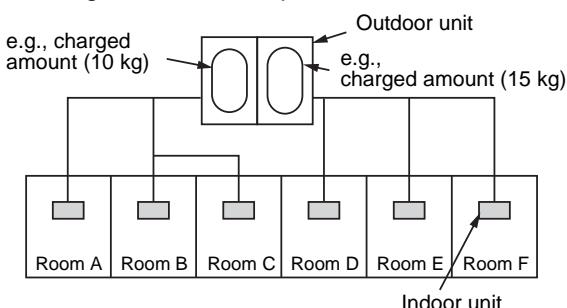

For the amount of charge in this example:

The possible amount of leaked refrigerant gas in rooms A, B and C is 10 kg.


The possible amount of leaked refrigerant gas in rooms D, E and F is 15 kg.

### Important


#### NOTE 2:

The standards for minimum room volume are as follows.


- (1) No partition (shaded portion)

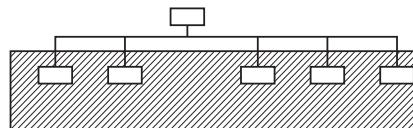

- (2) When there is an effective opening with the adjacent room for ventilation of leaking refrigerant gas (opening without a door, or an opening 0.15 % or larger than the respective floor spaces at the top or bottom of the door).

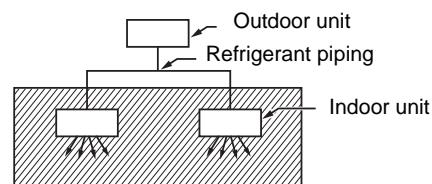


- (3) If an indoor unit is installed in each partitioned room and the refrigerant tubing is interconnected, the smallest room of course becomes the object. But when a mechanical ventilation is installed interlocked with a gas leakage detector in the smallest room where the density limit is exceeded, the volume of the next smallest room becomes the object.

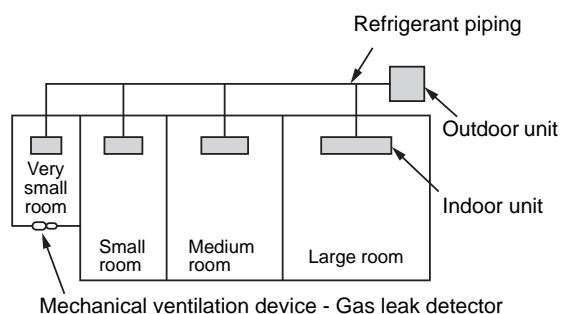



## 1-1. Allocation standard of model name

### SMMS-e

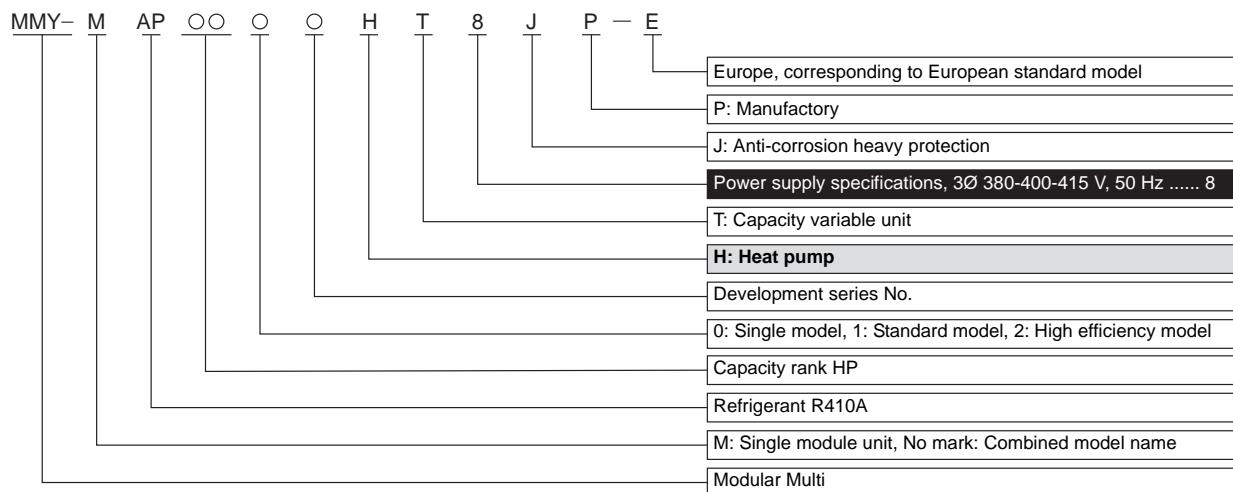



## 1-2. Summary of system equipments

### 1-2-1. Outdoor units

Corresponding HP			Inverter unit							
			8HP	10HP	12HP	14HP	16HP	18HP	20HP	22HP
Model name	Heat pump	MMY-	MAP0806HT8P-E	MAP1006HT8P-E	MAP1206HT8P-E	MAP1406HT8P-E	MAP1606HT8P-E	MAP1806HT8P-E	MAP2006HT8P-E	MAP2206HT8P-E
Cooling capacity (kW)			22.4	28.0	33.5	40.0	45.0	50.4	56.0	61.5
Heating capacity (kW)			25.0	31.5	37.5	45.0	50.0	56.0	63.0	64.0
No. of connectable indoor units			18	22	27	31	36	40	45	49

#### ■ Combination of outdoor units

Standard model

Corresponding HP		24HP	26HP	28HP	30HP	32HP	34HP	36HP	38HP
Combined Model	MMY-	AP2416HT8P-E	AP2616HT8P-E	AP2816HT8P-E	AP3016HT8P-E	AP3216HT8P-E	AP3416HT8P-E	AP3616HT8P-E	AP3816HT8P-E
Cooling capacity (kW)		67.0	73.5	78.5	85.0	90.0	95.4	101.0	106.5
Heating capacity (kW)		75.0	82.5	87.5	95.0	100.0	106.0	113.0	114.0
Combined outdoor units	12HP	14HP	16HP	16HP	16HP	18HP	20HP	22HP	
	12HP	12HP	12HP	14HP	16HP	16HP	16HP	16HP	
	-	-	-	-	-	-	-	-	
No. of connectable indoor units		54	58	63	64	64	64	64	64

Corresponding HP		40HP	42HP	44HP	46HP	48HP	50HP	52HP	54HP
Combined Model	MMY-	AP4016HT8P-E	AP4216HT8P-E	AP4416HT8P-E	AP4616HT8P-E	AP4816HT8P-E	AP5016HT8P-E	AP5216HT8P-E	AP5416HT8P-E
Cooling capacity (kW)		112.0	117.5	123.0	130.0	135.0	140.4	146.0	151.5
Heating capacity (kW)		126.0	127.0	128.0	145.0	150.0	156.0	163.0	164.0
Combined outdoor units	20HP	22HP	22HP	16HP	16HP	18HP	20HP	22HP	
	20HP	20HP	22HP	16HP	16HP	16HP	16HP	16HP	
	-	-	-	14HP	16HP	16HP	16HP	16HP	
No. of connectable indoor units		64	64	64	64	64	64	64	64

Corresponding HP		56HP	58HP	60HP
Combined Model	MMY-	AP5616HT8P-E	AP5816HT8P-E	AP6016HT8P-E
Cooling capacity (kW)		157.0	162.5	168.0
Heating capacity (kW)		176.0	177.0	178.0
Combined outdoor units	20HP	22HP	22HP	
	20HP	20HP	22HP	
	16HP	16HP	16HP	
No. of connectable indoor units		64	64	64

#### High efficiency / Heating capacity priority model

Corresponding HP		20HP	22HP	36HP	38HP	40HP	42HP	44HP	54HP
Combined Model	MMY-	AP2026HT8P-E	AP2226HT8P-E	AP3626HT8P-E	AP3826HT8P-E	AP4026HT8P-E	AP4226HT8P-E	AP4426HT8P-E	AP5426HT8P-E
Cooling capacity (kW)		56.0	61.5	100.5	107.0	113.5	120.0	125.0	152.0
Heating capacity (kW)		63.0	69.0	112.5	120.0	127.5	135.0	140.0	171.0
Combined outdoor units	10HP	12HP	12HP	14HP	14HP	14HP	16HP	20HP	
	10HP	10HP	12HP	12HP	14HP	14HP	14HP	20HP	
	-	-	12HP	12HP	12HP	14HP	14HP	14HP	
No. of connectable indoor units		45	49	64	64	64	64	64	64



## 1-2-2. Indoor unit

Type	Appearance	Model name	Capacity rank	Capacity code	Cooling capacity (kW)	Heating capacity (kW)
4-way Air Discharge Cassette Type		MMU-AP0094HP-E	009 type	1.00	2.8	3.2
		MMU-AP0124HP-E	012 type	1.25	3.6	4.0
		MMU-AP0154HP-E	015 type	1.70	4.5	5.0
		MMU-AP0184HP-E	018 type	2.00	5.6	6.3
		MMU-AP0244HP-E	024 type	2.50	7.1	8.0
		MMU-AP0274HP-E	027 type	3.00	8.0	9.0
		MMU-AP0304HP-E	030 type	3.20	9.0	10.0
		MMU-AP0364HP-E	036 type	4.00	11.2	12.5
		MMU-AP0484HP-E	048 type	5.00	14.0	16.0
		MMU-AP0564HP-E	056 type	6.00	16.0	18.0
Compact 4-way Cassette (600 x 600) Type		MMU-AP0056MH-E	005 type	0.60	1.7	1.9
		MMU-AP0074MH-E	007 type	0.80	2.2	2.5
		MMU-AP0094MH-E	009 type	1.00	2.8	3.2
		MMU-AP0124MH-E	012 type	1.25	3.6	4.0
		MMU-AP0154MH-E	015 type	1.70	4.5	5.0
		MMU-AP0184MH-E	018 type	2.00	5.6	6.3
2-way Air Discharge Cassette Type		MMU-AP0072WH	007 type	0.80	2.2	2.5
		MMU-AP0092WH	009 type	1.00	2.8	3.2
		MMU-AP0122WH	012 type	1.25	3.6	4.0
		MMU-AP0152WH	015 type	1.70	4.5	5.0
		MMU-AP0182WH	018 type	2.00	5.6	6.3
		MMU-AP0242WH	024 type	2.50	7.1	8.0
		MMU-AP0272WH	027 type	3.00	8.0	9.0
		MMU-AP0302WH	030 type	3.20	9.0	10.0
		MMU-AP0362WH	036 type	4.00	11.2	12.5
		MMU-AP0482WH	048 type	5.00	14.0	16.0
1-way Air Discharge Cassette Type		MMU-AP0562WH	056 type	6.00	16.0	18.0
		MMU-AP0074YH-E	007 type	0.80	2.2	2.5
		MMU-AP0094YH-E	009 type	1.00	2.8	3.2
		MMU-AP0124YH-E	012 type	1.25	3.6	4.0
		MMU-AP0154SH-E	015 type	1.70	4.5	5.0
		MMU-AP0184SH-E	018 type	2.00	5.6	6.3
Concealed Duct Type		MMU-AP0244SH-E	024 type	2.50	7.1	8.0
		MMD-AP0076BHP-E	007 type	0.80	2.2	2.5
		MMD-AP0096BHP-E	009 type	1.00	2.8	3.2
		MMD-AP0126BHP-E	012 type	1.25	3.6	4.0
		MMD-AP0156BHP-E	015 type	1.70	4.5	5.0
		MMD-AP0186BHP-E	018 type	2.00	5.6	6.3
		MMD-AP0246BHP-E	024 type	2.50	7.1	8.0
		MMD-AP0276BHP-E	027 type	3.00	8.0	9.0
		MMD-AP0306BHP-E	030 type	3.20	9.0	10.0
		MMD-AP0366BHP-E	036 type	4.00	11.2	12.5
Concealed Duct High Static Pressure Type		MMD-AP0486BHP-E	048 type	5.00	14.0	16.0
		MMD-AP0566BHP-E	056 type	6.00	16.0	18.0
		MMD-AP0186HP-E	018 type	2.00	5.6	6.3
		MMD-AP0246HP-E	024 type	2.50	7.1	8.0
		MMD-AP0276HP-E	027 type	3.00	8.0	9.0
		MMD-AP0366HP-E	036 type	4.00	11.2	10.0
		MMD-AP0486HP-E	048 type	5.00	14.0	16.0
		MMD-AP0566HP-E	056 type	6.00	16.0	18.0
		MMD-AP0724H-E	072 type	8.00	22.4	25.0
		MMD-AP0964H-E	096 type	10.00	28.0	31.5

# 1 System overview



Type	Appearance	Model name	Capacity rank	Capacity code	Cooling capacity (kW)	Heating capacity (kW)
Slim Duct Type		MMD-AP0054SPH-E	005 type	0.60	1.70	1.90
		MMD-AP0074SPH-E	007 type	0.80	2.2	2.5
		MMD-AP0094SPH-E	009 type	1.00	2.8	3.2
		MMD-AP0124SPH-E	012 type	1.25	3.6	4.0
		MMD-AP0154SPH-E	015 type	1.70	4.5	5.0
		MMD-AP0184SPH-E	018 type	2.00	5.6	6.3
		MMD-AP0244SPH-E	024 type	2.50	7.1	8.0
		MMD-AP0274SPH-E	027 type	3.00	8.0	9.0
Ceiling Type		MMC-AP0157HP-E	015 type	1.70	4.5	5.0
		MMC-AP0187HP-E	018 type	2.00	5.6	6.3
		MMC-AP0247HP-E	024 type	2.50	7.1	8.0
		MMC-AP0277HP-E	027 type	3.00	8.0	9.0
		MMC-AP0367HP-E	036 type	4.00	11.2	12.5
		MMC-AP0487HP-E	048 type	5.00	14.0	16.0
		MMC-AP0567HP-E	056 type	6.00	16.0	18.0
High-wall Type 3 series		MMK-AP0073H	007 type	0.80	2.2	2.5
		MMK-AP0093H	009 type	1.00	2.8	3.2
		MMK-AP0123H	012 type	1.25	3.6	4.0
		MMK-AP0153H	015 type	1.70	4.5	5.0
		MMK-AP0183H	018 type	2.00	5.6	6.3
		MMK-AP0243H	024 type	2.50	7.1	8.0
High-wall Type 4 series		MMK-AP0054MHP-E	005 type	0.60	1.7	1.9
		MMK-AP0074MH-E	007 type	0.80	2.2	2.5
		MMK-AP0094MH-E	009 type	1.00	2.8	3.2
		MMK-AP0124MH-E	012 type	1.25	3.6	4.0
Floor Standing Concealed Type		MML-AP0074BH-E	007 type	0.80	2.2	2.5
		MML-AP0094BH-E	009 type	1.00	2.8	3.2
		MML-AP0124BH-E	012 type	1.25	3.6	4.0
		MML-AP0154BH-E	015 type	1.70	4.5	5.0
		MML-AP0184BH-E	018 type	2.00	5.6	6.3
		MML-AP0244BH-E	024 type	2.50	7.1	8.0
Floor Standing Cabinet Type		MML-AP0074H-E	007 type	0.80	2.2	2.5
		MML-AP0094H-E	009 type	1.00	2.8	3.2
		MML-AP0124H-E	012 type	1.25	3.6	4.0
		MML-AP0154H-E	015 type	1.70	4.5	5.0
		MML-AP0184H-E	018 type	2.00	5.6	6.3
		MML-AP0244H-E	024 type	2.50	7.1	8.0
Console Type		MML-AP0074NH-E	007 type	0.80	2.2	2.5
		MML-AP0094NH-E	009 type	1.00	2.8	3.2
		MML-AP0124NH-E	012 type	1.25	3.6	4.0
		MML-AP0154NH-E	015 type	1.70	4.5	5.0
		MML-AP0184NH-E	018 type	2.00	5.6	6.3
Floor Standing Type		MMF-AP0156H-E	015 type	1.70	4.5	5.0
		MMF-AP0186H-E	018 type	2.00	5.6	6.3
		MMF-AP0246H-E	024 type	2.50	7.1	8.0
		MMF-AP0276H-E	027 type	3.00	8.0	9.0
		MMF-AP0366H-E	036 type	4.00	11.2	10.0
		MMF-AP0486H-E	048 type	5.00	14.0	16.0
		MMF-AP0566H-E	056 type	6.00	16.0	18.0



## 1-2-3. Branching joints and headers

Name	Model name	Appearance
Y-shape branching joint	RBM-BY55E	
	RBM-BY105E	
	RBM-BY205E	
	RBM-BY305E	
4-branching header	RBM-HY1043E	
	RBM-HY2043E	
8-branching header	RBM-HY1083E	
	RBM-HY2083E	
Branching joint for connection of outdoor units	RBM-BT14E	
	RBM-BT24E	

## 1-2-4. Remote controllers

Name	Model Name	Remarks
Wired remote controller	RBC-AMT32E	
Simple wired remote controller	RBC-AS41E	
Wireless remote controller kit	RBC-AX32U(W)-E RBC-AX32U(WS)-E	For 4-way Air Discharge Cassette
	RBC-AX32CE2	For Under Ceiling, 1-way Air Discharge Cassette SH
	TCB-AX32E2	For Compact 4-way Cassette, 1-way Air Discharge Cassette YH, Concealed Duct Standard, Slim Duct, Floor Standing Cabinet, Floor Standing
	RBC-AX23UW(W)-E	For 2-way Air Discharge Cassette
ON-OFF controller	TCB-CC163TLE2	
Central remote controller	BMS-CM1280TLE	
Schedule timer	TCB-EXS21TLE	
Remote controller with schedule timer (7-day timer function)	RBC-AMS41E	
Lite-Vision plus Remote Controller	RBC-AMS51E-EN/ES	-EN : English, Italian, Polish, Greece, Russian, Turkish -ES : English, Spanish, Portuguese, French, Dutch, German
Wired remote controller for Air to Air Heat Exchanger with DX coil unit	NRC-01HE	For Air to Air Heat Exchanger with DX coil type

## 1-2-5. Optional PCB of outdoor unit


Name	Model Name	Remarks
Power peak-cut control board	TCB-PCDM4E	
External master ON/OFF control board	TCB-PCMO4E	
Output control board	TCB-PCIN4E	

## 1-2-6. Controls

Name	Model Name	Remarks
Touch Screen Controller	BMS-TP0641ACE BMS-TP5121ACE BMS-TP0641PWE BMS-TP5121PWE BMS-CT5120E	ACE: Without energy monitoring function PWE:With energy monitoring function 0641:Maximum 64 indoor units connectable 5121:Maximum 512 indoor units connectable
Smart BMS manager	BMS-SM1280HTLE	
Smart BMS manager with data analyzer	BMS-SM1280ETLE	
WEB Based Controller	BMS-WB2561PWE BMS-WB01GTE	
TCS-NET Relay Interface	BMS-IFLSV4E	
Energy Monitoring Relay Interface	BMS-IFWH5E	
Digital I/O Relay Interface	BMS-IFDD03E	
LonWorks LN Interface	TCB-IFLN642TLE	
BACnet Server	BMS-LSV9E BMS-STBN10E	
Modbus Interface	TCB-IFMB641TLE	
Analog Interface	TCB-IFCB640TLE	
BN Interface	BMS-IFBN640TLE	



## 2-1. Selection flow chart

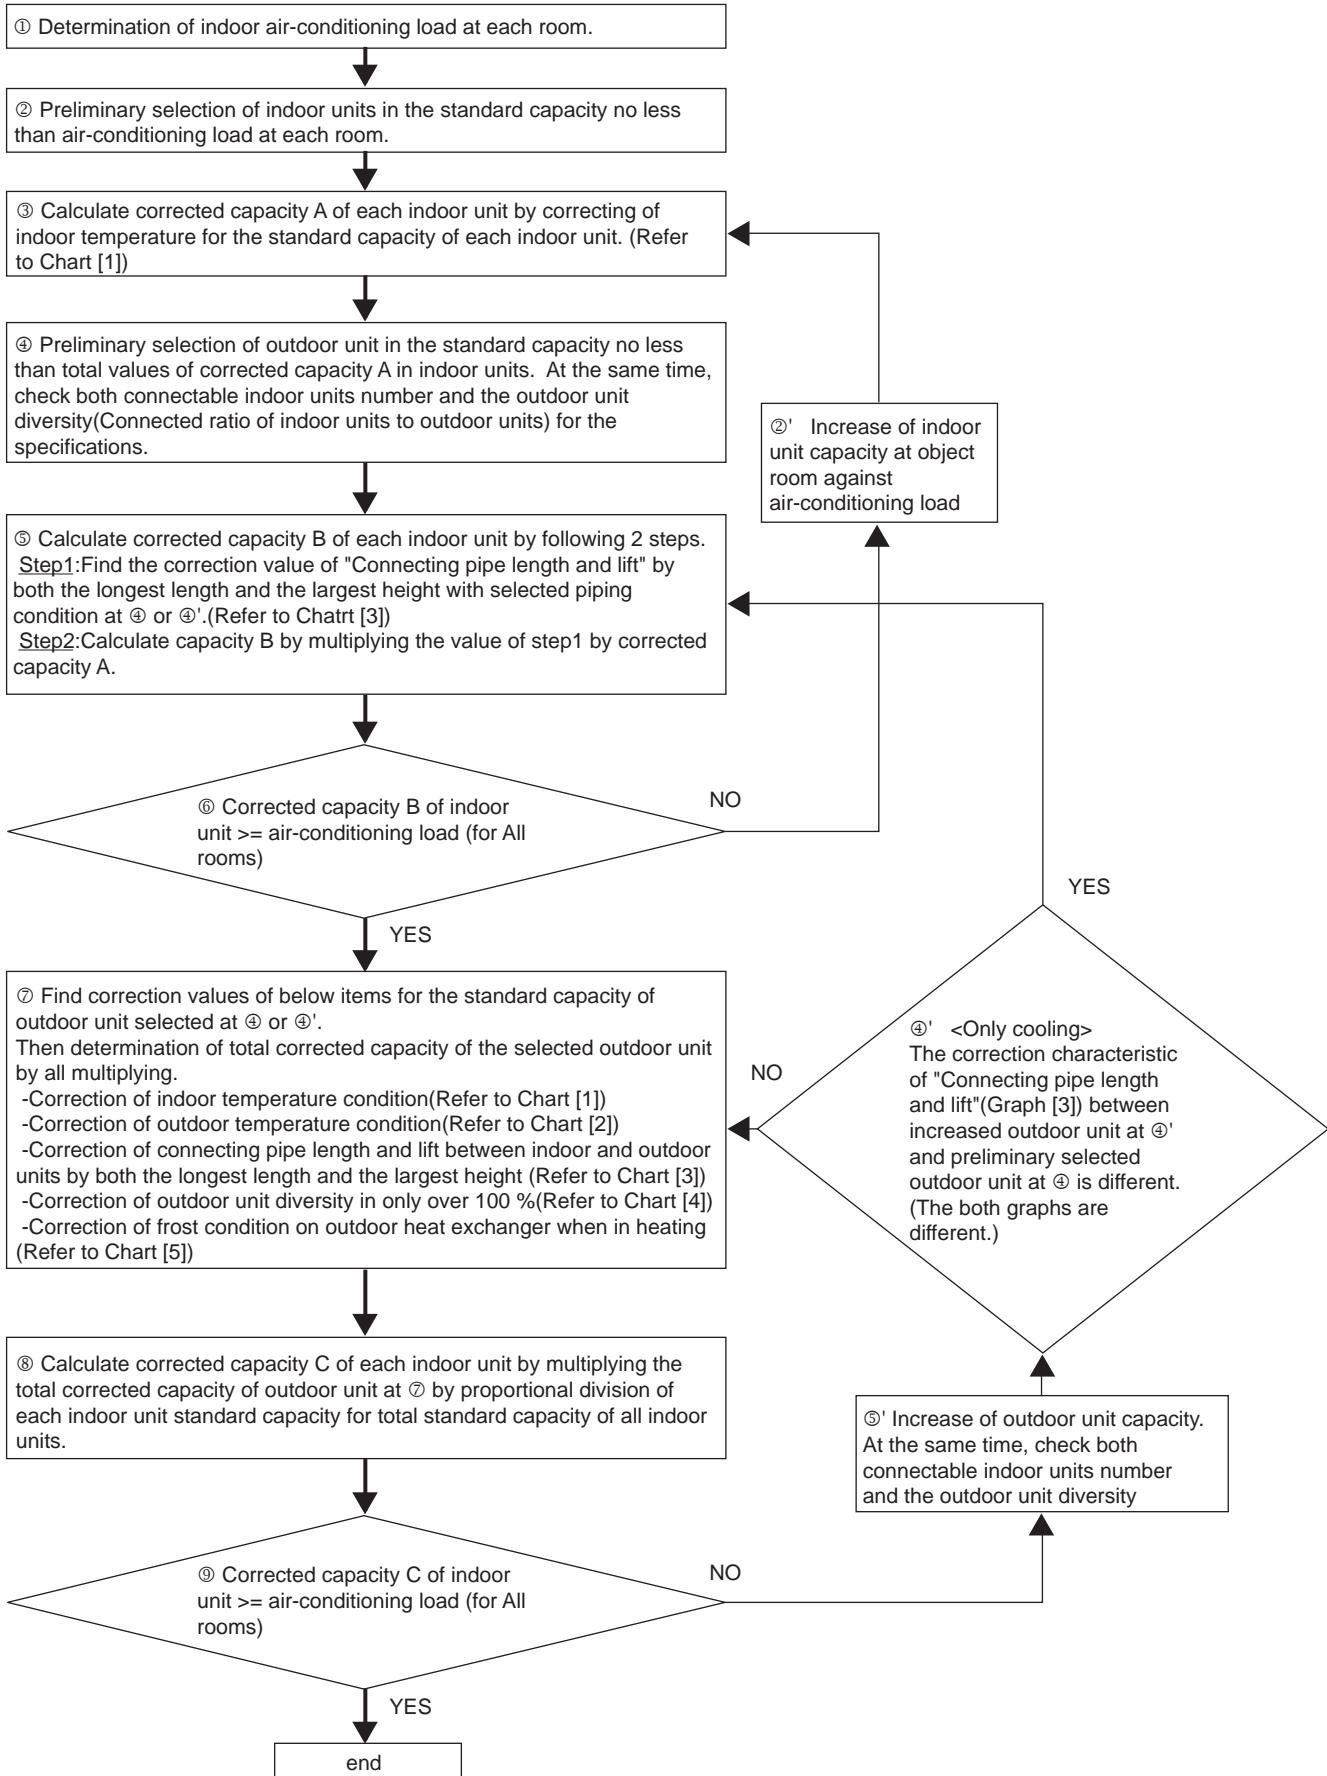

## 2-2. Combination conditions for indoor unit and outdoor unit

Indoor unit can connect 50 % to 135 % of Outdoor unit capacity.


**NOTE:**

Height difference between indoor unit over 15 m, combination conditions for indoor and outdoor unit is 50 % to 105 %.


## 2-3. Cooling/heating capacity characteristics

### 2-3-1. Correction charts for cooling capacity calculation


- [1] Indoor air wet bulb temperature vs. capacity correction value

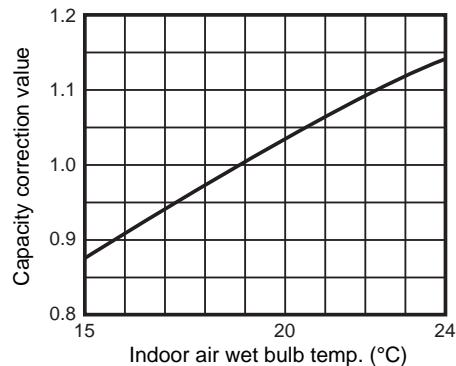

- [2] Outdoor air dry bulb temperature vs. capacity correction value

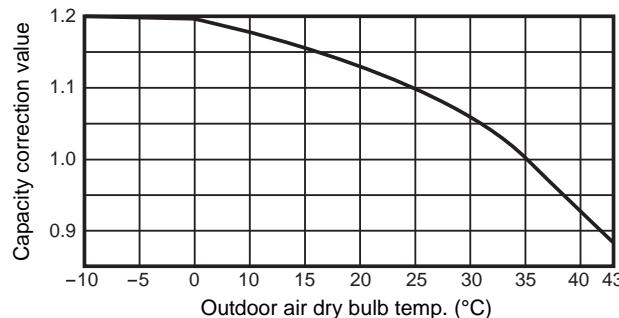





- [3] Connecting pipe length and lift difference between indoor and outdoor units vs. capacity correction value

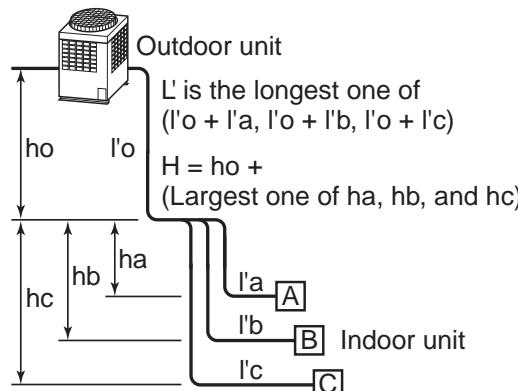


HP	Graph	EU and Asia standard		EU and Asia high efficiency	
		combination	Pipe length [m]	combination	Pipe length [m]
8	D	8	210		
10	C	10	210		
12	A	12	210		
14	A	14	210		
16	B	16	210		
18	C	18	210		
20	C	20	210	10+10	220
22	C	22	210	12+10	220
24	A	12+12	220		
26	B	14+12	220		
28	B	16+12	220		
30	B	16+14	220		
32	C	16+16	220		
34	C	18+16	220		
36	A	20+16	220	12+12+12	235
38	A	22+16	220	14+12+12	235
40	B	20+20	220	14+14+12	235
42	B	22+20	220	14+14+14	235
44	B	22+22	220	16+14+14	235
46	B	16+16+14	185		
48	C	16+16+16	185		
50	C	18+16+16	185		
52	C	20+16+16	185		
54	E	22+16+16	185	20+20+14	185
56	E	20+20+16	185		
58	E	22+20+16	185		
60	E	22+22+16	185		




## 2 Equipment selection procedure

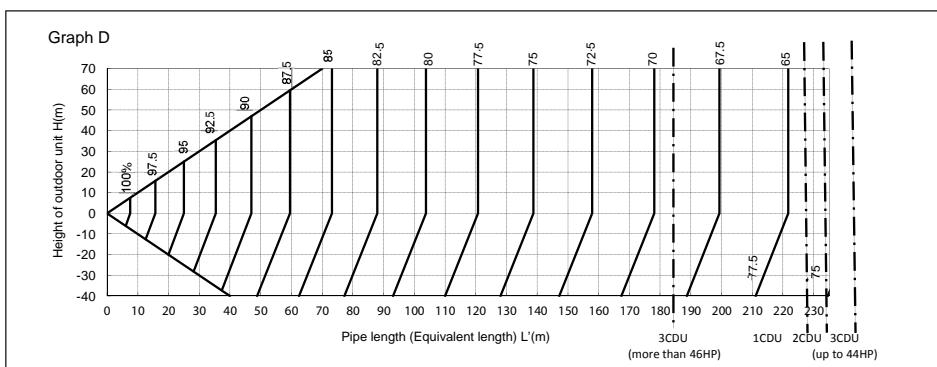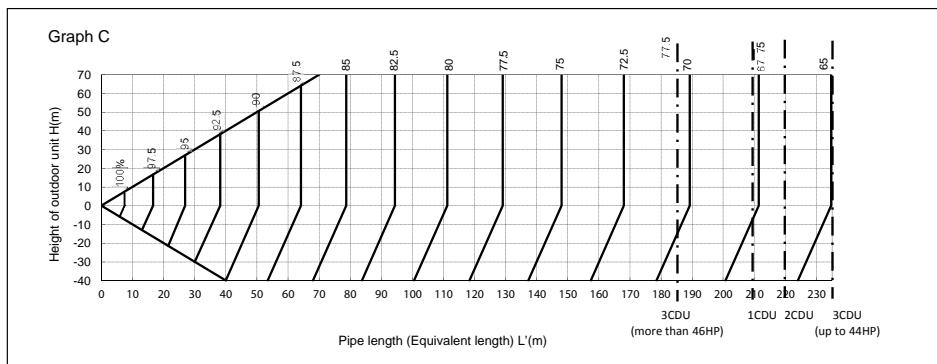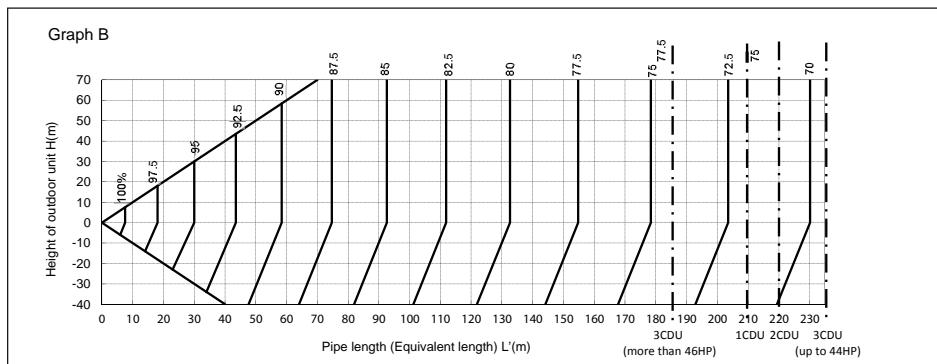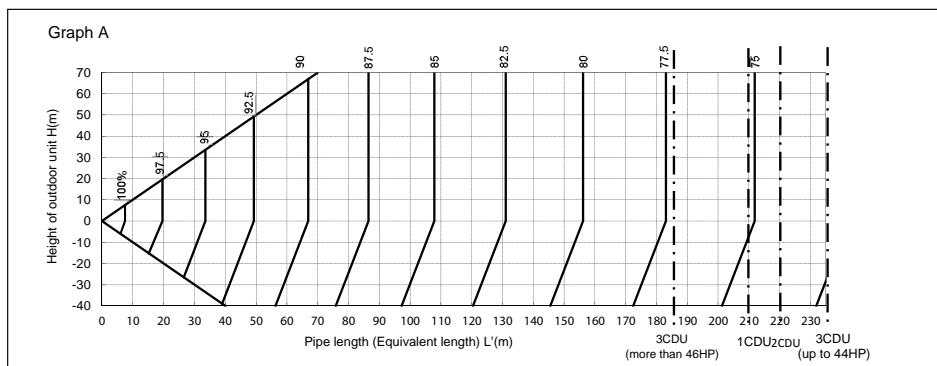

## 2 Equipment selection procedure

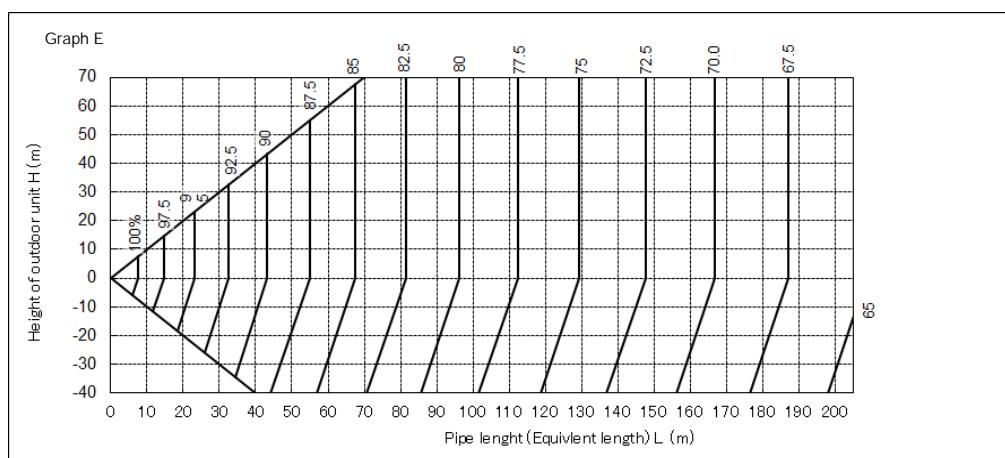

[4]\* Correction of outdoor unit diversity

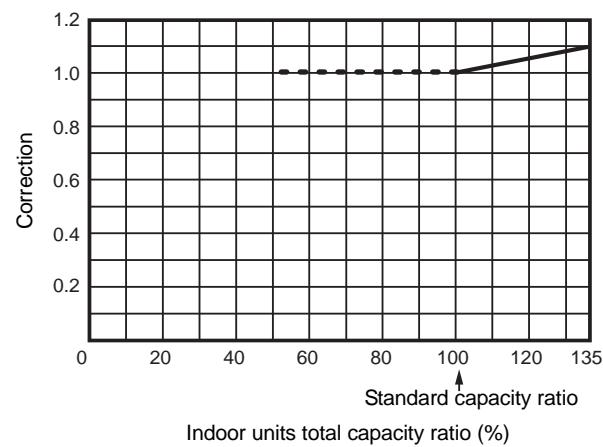


\*: Coefficient to use for the correction of the outdoor unit capacity when the total capacity of the indoor units are not equal to the outdoor unit capacity.




### 2-3-2. Correction charts for heating capacity calculation

[1] Indoor air dry bulb temperature vs. capacity correction value

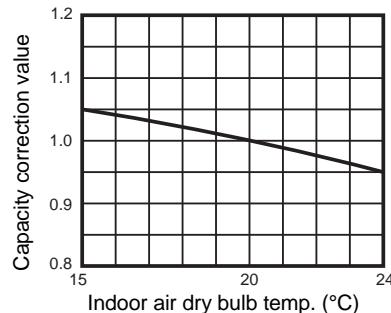

[2] Outdoor air wet bulb temperature vs. capacity correction value


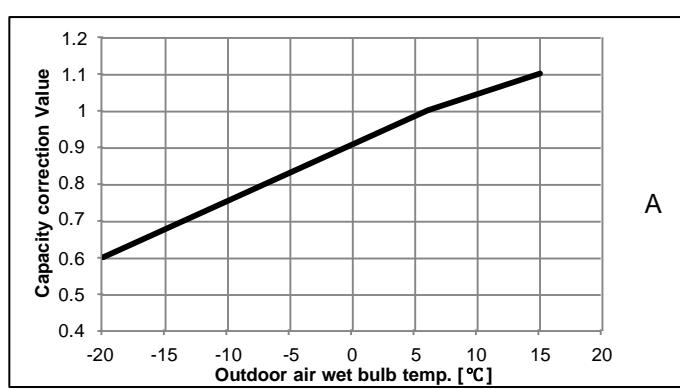


Standard model

HP	combination	Graph
8	8	A
10	10	B
12	12	C
14	14	B
16	16	C
18	18	B
20	20	C
22	22	C
24	12+12	C
26	14+12	C
28	16+12	C
30	16+14	C
32	16+16	C
34	18+16	C
36	20+16	C
38	22+16	C
40	20+20	C
42	22+20	C
44	22+22	C
46	16+16+14	C
48	16+16+16	C
50	18+16+16	C
52	20+16+16	C
54	22+16+16	C
56	20+20+16	C
58	22+20+16	C
60	22+22+16	C

High efficiency model



HP	combination	Graph
20	10+10	B
22	12+10	C
36	12+12+12	C
38	14+12+12	C
40	14+14+12	B
42	14+14+14	B
44	16+14+14	B
54	20+20+14	C

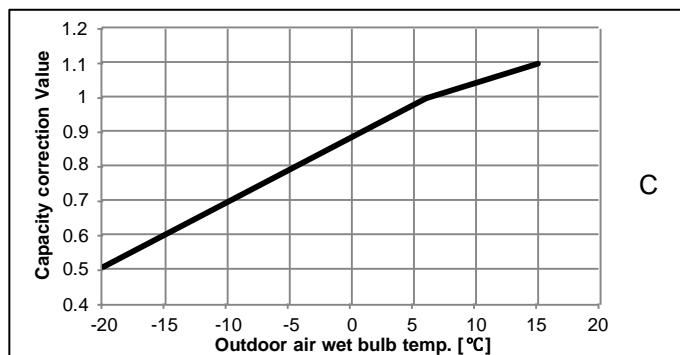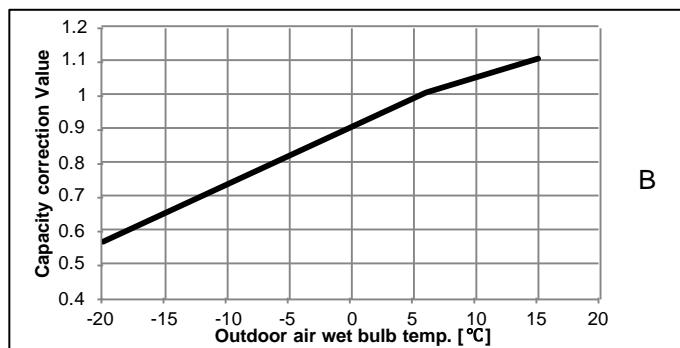




### 2-3-2. Correction charts for heating capacity calculation

[3] Connecting pipe length and lift difference between indoor and outdoor units vs. capacity correction value

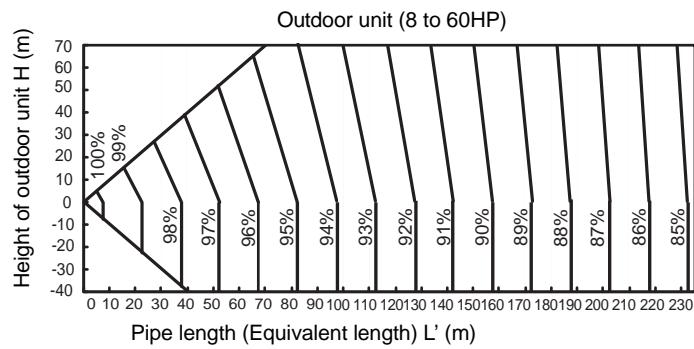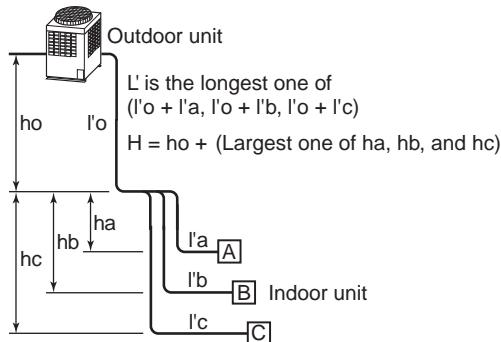



[4]\* Correction of outdoor unit diversity

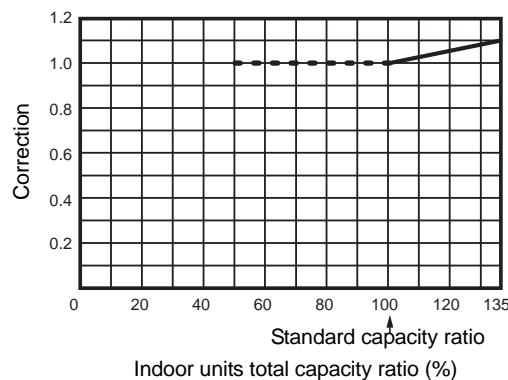


\*: Coefficient to use for the correction of the outdoor unit capacity when the total capacity of the indoor units are not equal to the outdoor unit capacity.

### 2-3-3. Capacity correction in case of frost on the outdoor heat exchanger when in heating

Correct the heating capacity when frost can be found on the outdoor heat exchanger.

Heating capacity = Capacity after correction of outdoor unit x Correction value of capacity resulted from frost  
(Capacity after correction of outdoor unit: Heating capacity calculated in the above item 2.)

[5] Capacity correction in case of frost on the outdoor heat exchanger

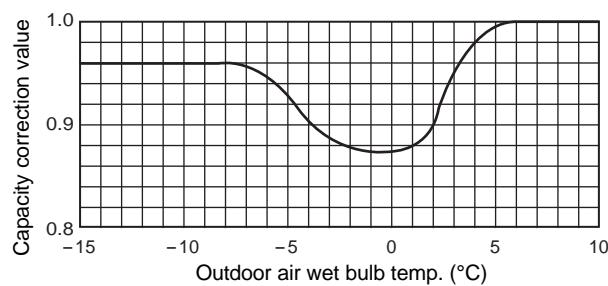


### 2-3-4. Rated conditions

Cooling: Indoor air temperature 27 °C DB / 19 °C WB, Outdoor air temperature 35 °C DB

Heating: Indoor air temperature 20 °C DB, Outdoor air temperature 7 °C DB / 6 °C WB



## 2-4. Operational temperature range

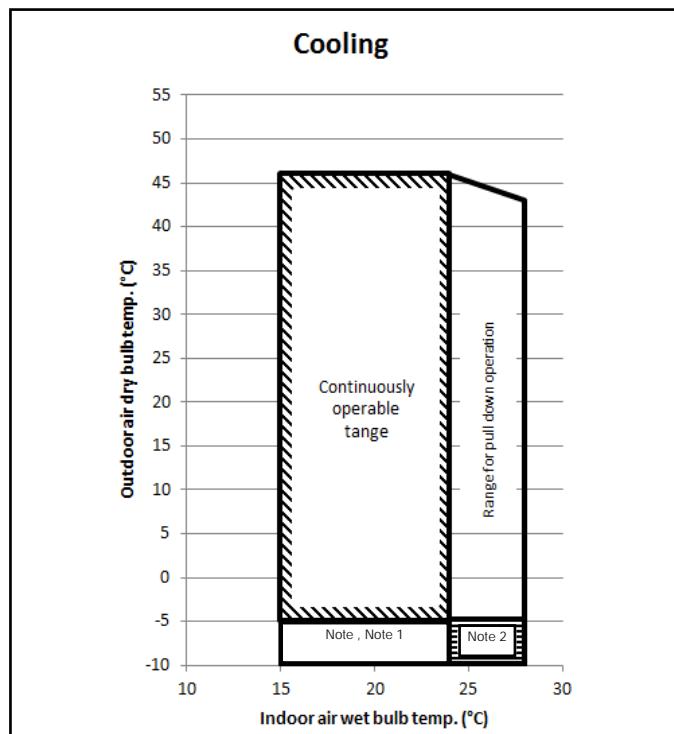


Note 1: Continuously operable range of specific condition

Note 2: Range for pull down of specific condition

Note

1. NOT SUITABLE FOR APPLICATIONS, WHICH REQUIRE PRECISE ROOM TEMPERATURE CONTROL, DUE TO INCREASED RISK OF INDOOR ON/OFF CONTROL AND POTENTIAL LOW AIR OFF TEMPERATURES.
2. FOR AREAS THAT DO DEMAND A PRECISE ROOM TEMPERATURE CONTROL, WE WOULD RECOMMEND THE INSTALLATION OF A SECONDARY SYSTEM, WHICH HAS BEEN DESIGNED SOLELY FOR THE PURPOSE OF LOW AMBIENT COOLING.
3. SINGLE OUTDOOR UNIT ONLY.
4. NO HEIGHT DIFFERENCE BETWEEN UNITS.
5. THE COOLING PERFORMANCE MAY DECLINE CONSIDERABLY WHEN TOTAL OPERATION CAPACITY OF COOLING INDOOR UNITS IS LESS THAN 4HP WHILE AMBIENT TEMPERATURE IS BELOW -5°C.

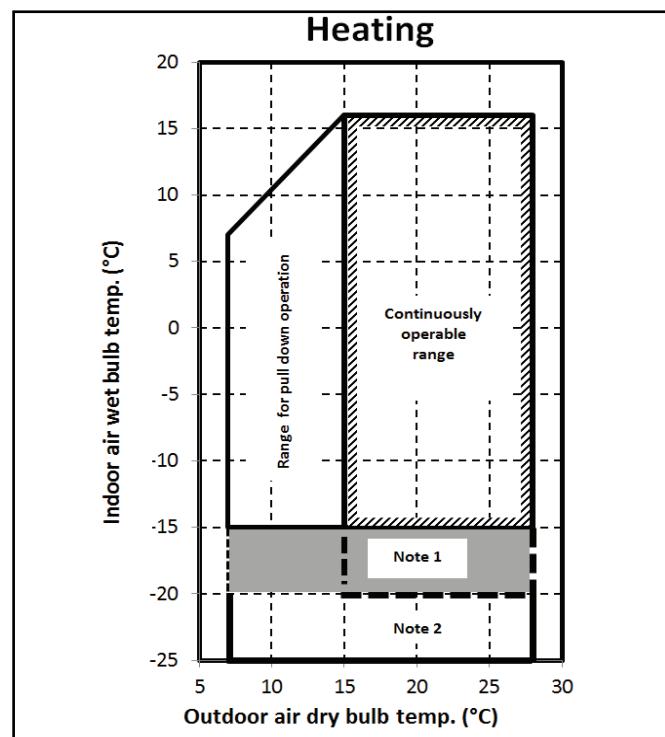

Note 1: The unit will operate down to an outdoor temperature of -25°C, however considerable performance decrease will be expected below -15°C. Therefore please consider installation location/surroundings and system design when expected to operate between -15°C and -20°C.

Note 2: Low ambient heating (-20°C or less) for extended periods of time is not allowed.



### 3-1. Free branching system


- [1] Line branching system
- [2] Header branching system
- [3] Header branching system after line branching
- [4] Line branching system after header branching
- [5] Header branching system after header branching

The above five branching systems enable to dramatically increase the flexibility of refrigerant piping design.

Line branching system	
Header branching system	
Header branching system after line branching	
Line branching system after header branching	
Header branching system after header branching	



## 3-2. Allowable length/height difference of refrigerant piping

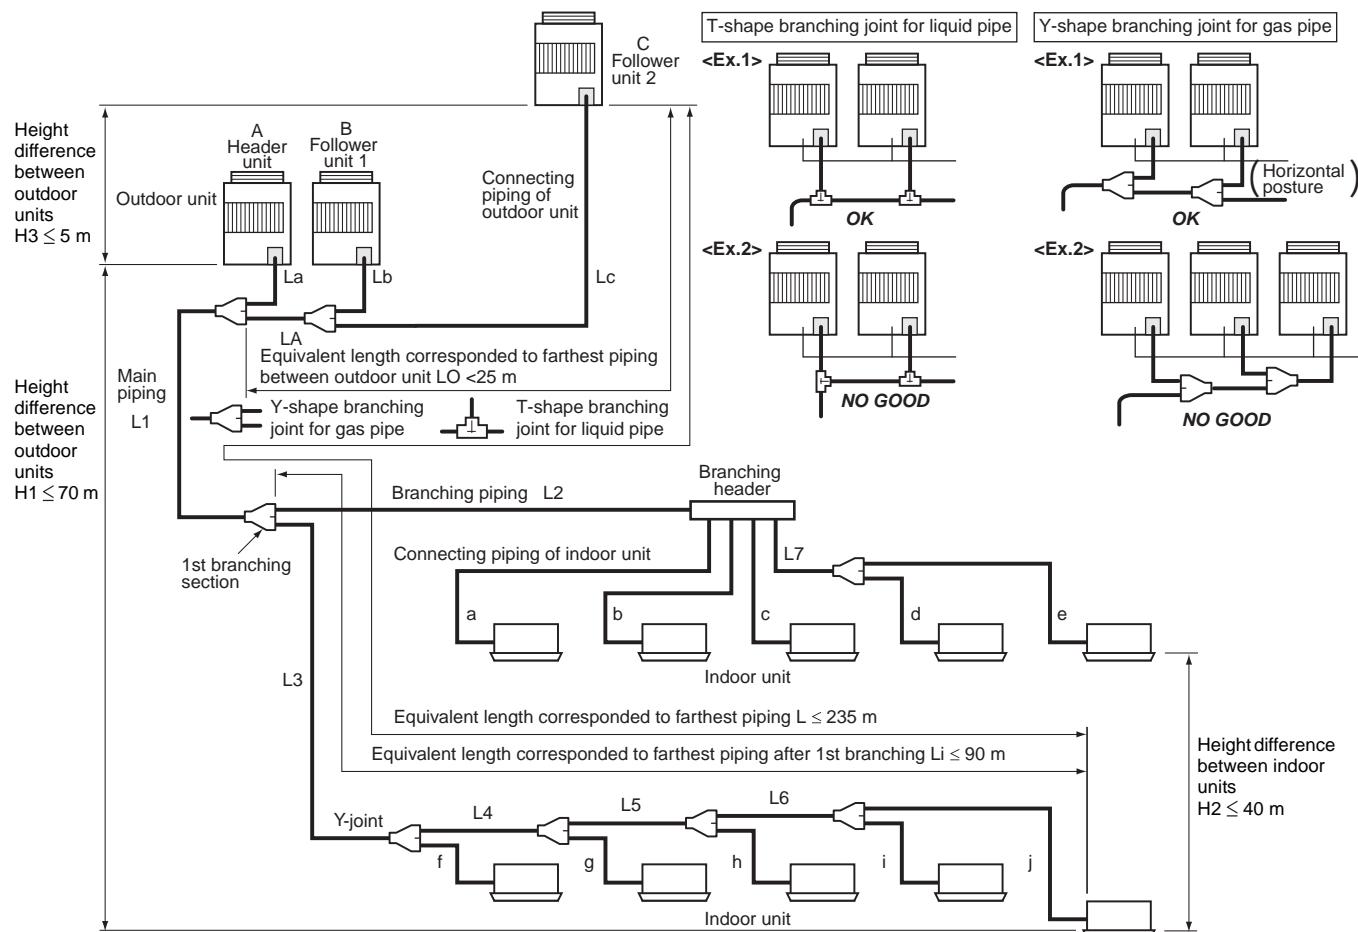

### System restrictions

Max. No. of combined outdoor units	3 units
Max. capacity of combined outdoor units	60 HP
Max. No. of connected indoor units	64 units
Max. capacity of combined indoor units	H2 ≤ 15 135 % H2 > 15 105 %

**Note 1)** Combination of outdoor units: Header unit (1 unit) + Follower units (0 to 2 units).  
Header unit is the outdoor unit nearest to the connected indoor units.

**Note 2)** Install the outdoor units in order of capacity.  
(Header unit ≥ Follower unit 1 ≥ Follower unit 2)

**Note 3)** Use Y-shape branching joint in connecting of gas pipe for outdoor unit, and install horizontally.

**Note 4)** Piping to indoor units shall be perpendicular to piping to the header outdoor unit as <Ex.1>. Do not connect piping to indoor units in the same direction of header outdoor unit as T-shape branching joint for liquid pipe of <Ex.2>.

### Farthest piping length L(\*1) by capacity of outdoor units

Capacity (HP)	Standard model			High efficiency model			
	8 ~ 22	24 ~ 44	46 ~ 52	54 ~ 60	20 ~ 22	36 ~ 44	54
Equivalent length (m)	210	220	185	185	220	235	185
Real length (m)	170	180	145	145	180	190	145

Note: All values of above table decrease 25 m when H1 exceeds 3 m.

### Allowable length and height difference of refrigerant piping

Piping length	Allowable value		Piping section	
	Total extension of pipe (Liquid pipe, real length)	Farthest piping Length L (*1)		
	Below 34HP 34HP or more	300 m 1000 m (*6)	LA + LB + La + Lb + Lc + L1 + L2 + L3 + L4+ L5 + L6 + L7 + a + b + c + d + e + f + g + h + i + j	
	Equivalent length	235 m	LA + L1 + L3 + L4 + L5 + L6 + j	
	Real length	190 m	L3 + L4 + L5 + L6 + j	
	Equivalent length of farthest piping from 1st branching Li (*1)	90 m (*2)	LA + Lc (LA + Lb)	
	Equivalent length of farthest piping between outdoor units LO (*1)	25 m	LA + Lc (LA + Lb)	
	Max. equivalent length of main piping	Equivalent length Real length	120 m (*3) 100 m (*3)	L1
	Max. equivalent length of outdoor unit connecting piping	10 m	Lc (La, Lb, )	
	Max. real length of indoor unit connecting piping	30 m	a, b, c, d, e, f, g, h, i, j	
	Max. equivalent length between branches	50 m	L2, L3, L4, L5, L6, L7	
Difference in height	Height between indoor and outdoor units H1	Upper outdoor unit Lower outdoor unit	70 m (*4)(*7) 40 m (*5)	
	Height between indoor units H2	40 m	—	
	Height between outdoor units H3	5 m	—	

(\*1) : (D) is outdoor unit furthest from the 1st branch and (j) is the indoor unit furthest from the 1st branch.

(\*2) : If the height difference (H1) between indoor and outdoor unit exceeds 3 m, set 65 m or less.

(\*3) : If the max. combined outdoor unit capacity is 54HP or more, then max. equivalent length is 70 m or less (real length is 50 m or less).

(\*4) : If the height difference (H2) between indoor units exceeds 3 m, set 50 m or less.

(\*5) : If the height difference (H2) between indoor units exceeds 3 m, set 30 m or less.

(\*6) : Total charging refrigerant is 140kg or less.

(\*7) : Extension up till 90m is possible with conditions below

- Outdoor Temperature Cooling : 10 - 46 (DB)

Heating : -5 - 15.5 (WB)

- Equivalent length of farthest piping from 1st branching Li < 50m

- Real length of main piping L1 < 100m

- Height difference between indoor units H2 < 3M


- Total capacity of combined indoor units : 90% - 105%

- Single CDU, and up to 20HP

- Minimum capacity of connectable indoor unit 4HP or Larger



## 3-3. Selection of refrigerant piping

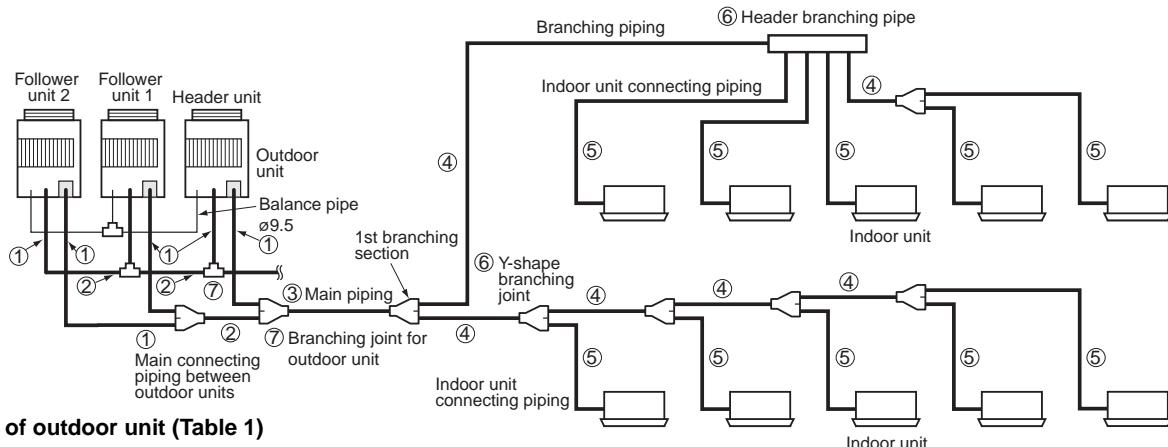

① Pipe size of outdoor unit (Table 1)

Model name MMY-	Gas side	Liquid side
MAP0806*	ø19.1	ø12.7
MAP1006*	ø22.2	ø12.7
MAP1206*	ø28.6	ø12.7
MAP1406*	ø28.6	ø15.9
MAP1606*	ø28.6	ø15.9
MAP1806*	ø28.6	ø15.9
MAP2006*	ø28.6	ø15.9
MAP2206*	ø28.6	ø19.1

② Connecting pipe size between outdoor units (Table 2)

Total capacity code of outdoor units at downstream side *1	Gas side	Liquid side	Balance pipe
16 to below 22	ø28.6	ø15.9	ø9.5
22 to below 24	ø28.6	ø19.1	
24 to below 26	ø34.9	ø19.1	
26 to below 36	ø34.9	ø19.1	
36 or more	ø41.3	ø22.2	

③ Size of main pipe (Table 3)

Total capacity code of all outdoor units *1	Gas side	Liquid side
8 below 10	ø 19.1	ø12.7
10 to below 12	ø 22.2	ø12.7
12 to below 14	ø 28.6	ø12.7
14 to below 22	ø 28.6	ø15.9
22 to below 24	ø 28.6	ø19.1
24 to below 26	ø 34.9	ø19.1
26 to below 36	ø 34.9	ø19.1
36 or more	ø 41.3	ø22.2

Determine thickness of the main pipe according to capacity of the outdoor units.

④ Pipe size between branching sections (Table 4)\*5

Total capacity code of indoor units at downstream side *1	Gas side	Liquid side
2.4 or less	ø 12.7	ø9.5
2.4 to below 6.4	ø 15.9	ø9.5
6.4 to below 12.2	ø 22.2	ø12.7
12.2 to below 20.2	ø 28.6	ø15.9
20.2 to below 22.4	ø 28.6	ø19.1
22.4 to below 25.2	ø 34.9	ø19.1
25.2 to below 35.2	ø 34.9	ø19.1
32.2 or more	ø 41.3	ø22.2

If the total capacity code value of indoor units exceeds that of the outdoor units, apply the capacity code of outdoor units.

⑤ Piping of indoor unit (Table 5)

Capacity rank	Gas side	Liquid side
005 type to Actual length 15 m or less	ø9.5	ø6.4
012 type Actual length exceeds 15 m	ø12.7	ø6.4
015 type to 018 type	ø12.7	ø6.4
024 type to 056 type	ø15.9	ø9.5
072 type to 096 type	ø22.2	ø12.7

\*1 Code is determined according to the capacity rank.

\*2 When using a branching joint for the 1st branch, select according to capacity code of the outdoor unit.

\*3 For 1 line after branching header indoor units with a maximum capacity code of 6.0 in total can be connected.


\*4 If the pipe size is ø19.0 or more, use a suitable material as detailed in the installation manual.

\*5 If the piping size becomes over main piping size, select the size same as main piping.

\*6 When the first branch is a header with the outdoor total capacity codes of 12 to 26, apply the model RBM-HY2043E(4-branch) or RBM-HY2083E(8-branch) regardless of the total capacity codes of the down-stream indoor units.

\*7 The maximum equivalent length of main pipe should be 70m or shorter.

\*8 When the sum of capacity code of indoor units exceeds the capacity code of outdoor units, select according to capacity code of the outdoor units.

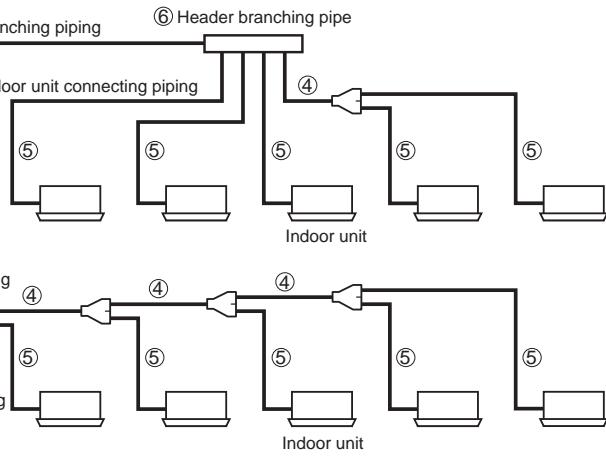

⑥ Selection of branching section (Table 6)

	Total capacity code of indoor unit *1	Model name
Y-shape branching joint *2 *3 *8	Below 6.4	RBM-BY55E
	6.4 to below 14.2	RBM-BY105E
	14.2 to below 25.2	RBM-BY205E
	25.2 or more	RBM-BY305E
Branching header branching *2 *3 *6 *8	For 4 branching	Below 14.2 RBM-HY1043E
	14.2 to below 25.2	RBM-HY2043E
	For 8 branching	Below 14.2 RBM-HY1083E
	14.2 to below 25.2	RBM-HY2083E

⑦ Selection of branching joint for outdoor unit (Table 7)

	Total capacity code of outdoor unit	Joints			Model name
		Gas (Y-shape)	Liquid (T-shape)	Balance (T-shape)	
Branching joint for outdoor unit	Below 26	ø31.8 ø28.6 ø25.4	ø19.1 ø19.1	ø9.5 ø9.5	RBM-BT14E
	26 or more	ø38.1 ø38.1 ø28.6	ø22.2 ø22.2	ø9.5 ø9.5	RBM-BT24E

⑧ Minimum wall thickness for R410A application (Table 8)

Soft	Half hard or hard	OD (inch)	OD (mm)	Minimum wall thickness (mm)
OK	OK	1/4"	6.35	0.80
OK	OK	3/8"	9.52	0.80
OK	OK	1/2"	12.70	0.80
OK	OK	5/8"	15.88	1.00
No Good*4	OK	3/4"	19.05	1.00
No Good*4	OK	7/8"	22.20	1.00
No Good*4	OK	1.1/8"	28.58	1.00
No Good*4	OK	1.3/8"	34.92	1.20
No Good*4	OK	1.5/8"	41.28	1.40



### 3-4. Charging requirement with additional refrigerant

#### Calculating the amount of additional refrigerant required

##### Refrigerant in the system when shipped from the factory

		8HP	10HP	12HP	14HP	16HP	18HP	20HP	22HP
Refrigerant amount charged in factory	Heat pump model	11.5 kg							

When the system is charged with refrigerant at the factory, the amount of refrigerant needed for the pipes at the site is not included. Therefore, calculate the additional amount needed and add the required amount to the system.

##### (Calculation)

Additional refrigerant charge amount is calculated based on the size of liquid pipe at site and its real length.

Additional refrigerant charge amount at site = [1]+[2]+([3] × 1.2)

[1]. Compensation by system HP(Table 1)

[2]. Additional refrigerant charge amount indoor unit (Table 2)

[3]. Real length of liquid pipe × Additional refrigerant charge amount per liquid pipe (Table 3)

Example: Additional charge amount R (kg) = [1] + [2] + ([3] × 1.2) = 2.5 + 24 + (39.1×1.2) = 73.4

System HP : 60HP

Indoor unit (Standard Indoor units) : 60HP

Liquid pipe : 22.2 100m

19.1 10m

15.9 10m

[1]. Compensation by system HP = 2.5kg

[2]. Additional refrigerant charge amount Indoor unit = 0.4 kg × 60 = 24kg

[3]. Real length of liquid pipe × Additional refrigerant charge amount per liquid pipe

= (0.350 × 100) + (0.250 × 10) + (0.160 × 10) = 35 + 2.5 + 1.6 = 39.1kg

**Table 1**

Standard model

System	Combination		Compensation by System HP
HP	HP	kg	
8	8	-3.5	
10	10	-3.5	
12	12	-1.5	
14	14	-1.0	
16	16	-0.5	
18	18	1.5	
20	20	1.5	
22	22	1.5	
24	12	12	-3.0
26	14	12	-2.5
28	16	12	-2.0
30	16	14	-1.5
32	16	16	-1.0
34	18	16	1.0
36	20	16	1.0
38	22	16	1.0
40	20	20	3.0
42	22	20	3.0
44	22	22	3.0
46	16	16	14
48	16	16	16
50	18	16	16
52	20	16	16
54	22	16	16
56	20	20	16
58	22	20	16
60	22	22	16

High efficiency model

System	Combination		Compensation by System HP
HP	HP	kg	
20	10	10	-7.0
22	12	10	-7.0
36	12	12	-12.5
38	14	12	-10.5
40	14	14	-8.5
42	14	14	-4.5
44	16	14	-4.5
54	20	20	1.5

Table 2

Additional refrigerant charge amount Indoor unit		Standard Indoor unit	Hot Water Module	Fresh Air Intake Indoor Unit	Air to Air Heat exchanger with DX-coil
Additional refrigerant charge amount	kg/HP	0.4	0	0.2	0.2

Table 3


Pipe dia. at liquid side	mm	ø6.4	ø9.5	ø12.7	ø15.9	ø19.0	ø22.2
Additional refrigerant amount/1m	kg/m	0.025	0.055	0.105	0.16	0.25	0.35




## 4-1.General

- Perform wiring of the power supply in conformance with the regulations of the local electric company.
- For cabling of the power supply of the indoor unit and the inter-unit cabling between indoor and outdoor units, refer to the Installation Manual of indoor unit.
- Never connect power supply to the terminal block (U1, U2, U3, U4, U5, U6) for control wiring.  
(The equipment breaks down.)
- Arrange the cables so that the electric wires do not come to contact with high-temperature part of the pipe; otherwise coating melts and an accident may be caused.
- After connecting cable to the terminal block, take off the trap and then fix the cable with cable clamp.
- Do not turn on power of the indoor unit until vacuuming of the refrigerant pipe will finish.

## 4-2.Summary of wiring design

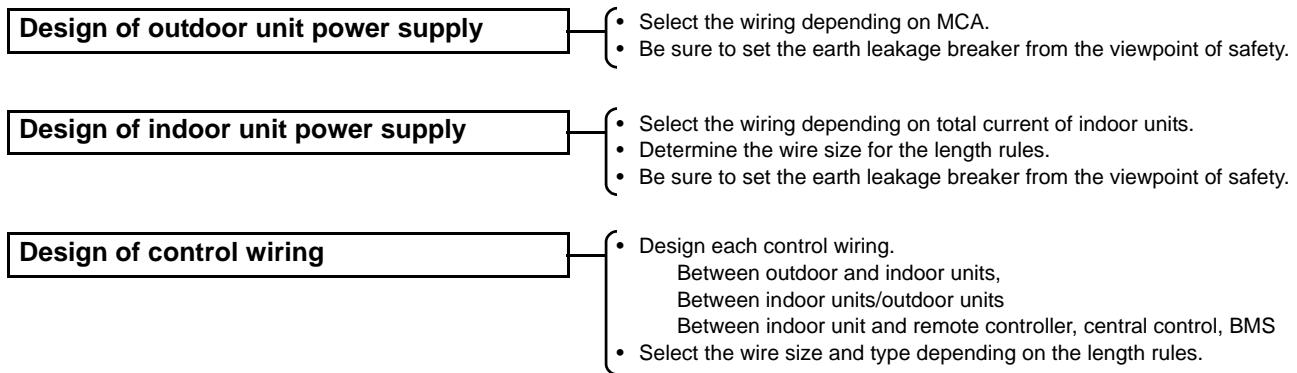

## 4-3.Electrical wiring design

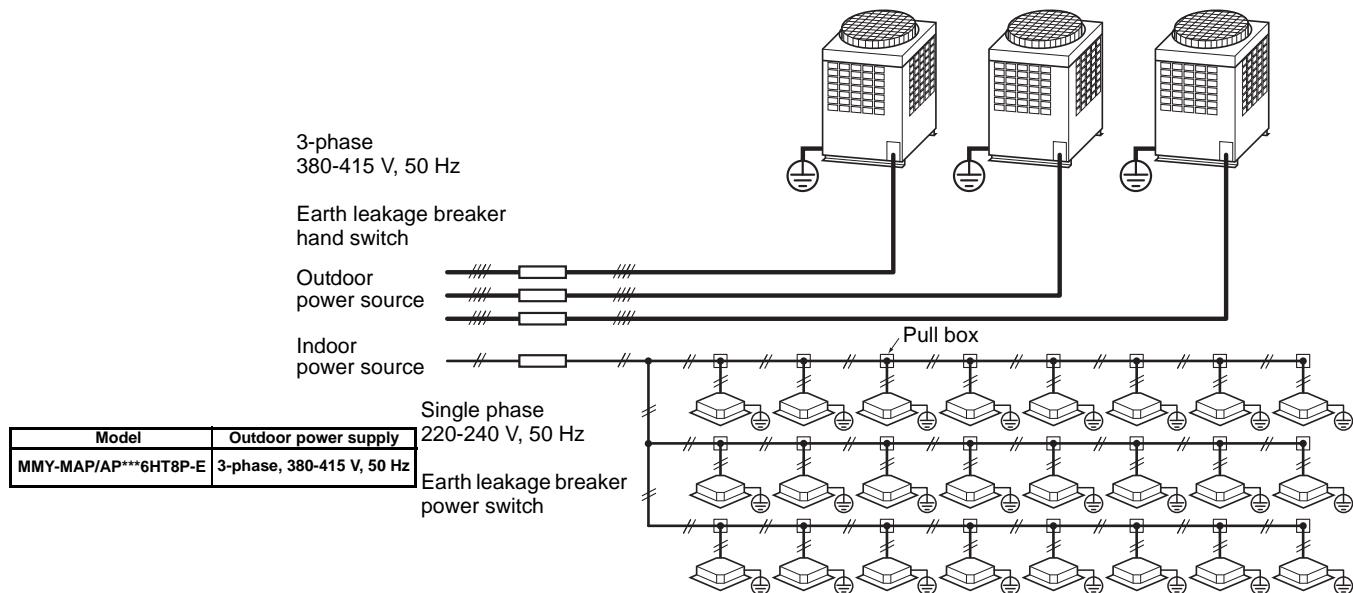



## 4-4. Outdoor unit power supply


### 4-4-1.

- Select the power supply cabling and fuse of each outdoor unit from the following specifications:  
cable 4-core, in conformance with Design 60245  
IEC 66
- Do not connect the outdoor units by crossing outside of them, but connect them via the terminal block (L1, L2, L3, N).

Model	Outdoor power supply
MMY-MAP/AP***6HT8P-E	3-phase, 380-415 V, 50 Hz

Outdoor power supply  
3-phase  
380-415 V, 50 Hz

**NO GOOD**

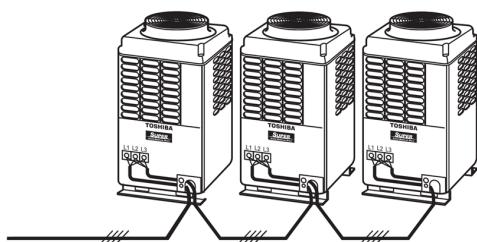



## Outdoor unit data

Standard model

Type	HP	Heat Pump Model MMY-	Power Supply		Voltage Range		Compressor			Fan Motor (kW)	MCA (A)	MOCP (A)
			Phase and frequency	Nominal Voltage	Min. (V)	Max (V)	Unit No.1 (kW)	Unit No.2 (kW)	Unit No.3 (kW)			
Single unit	8	MMY-MAP0806HT8P-E	3N~ 50 Hz	380-400-415 V	342	456	2.1x2	-	-	1.0	20.5	25
	10	MMY-MAP1006HT8P-E	3N~ 50 Hz	380-400-415 V	342	456	3.1x2	-	-	1.0	21.5	25
	12	MMY-MAP1206HT8P-E	3N~ 50 Hz	380-400-415 V	342	456	3.9x2	-	-	1.0	26.1	32
	14	MMY-MAP1406HT8P-E	3N~ 50 Hz	380-400-415 V	342	456	4.8x2	-	-	1.0	31.0	40
	16	MMY-MAP1606HT8P-E	3N~ 50 Hz	380-400-415 V	342	456	5.8x2	-	-	1.0	35.8	40
	18	MMY-MAP1806HT8P-E	3N~ 50 Hz	380-400-415 V	342	456	6.5x2	-	-	2.0	40.6	50
	20	MMY-MAP2006HT8P-E	3N~ 50 Hz	380-400-415 V	342	456	7.6x2	-	-	2.0	44.9	63
	22	MMY-MAP2206HT8P-E	3N~ 50 Hz	380-400-415 V	342	456	9.0x2	-	-	2.0	49.3	63
Combination of outdoor unit	24	MMY-AP2416HT8P-E	3N~ 50 Hz	380-400-415 V	342	456	3.9x2	3.9x2	-	1.0+ 1.0	52.2	63
	26	MMY-AP2616HT8P-E	3N~ 50 Hz	380-400-415 V	342	456	4.8x2	3.9x2	-	1.0+ 1.0	57.1	63
	28	MMY-AP2816HT8P-E	3N~ 50 Hz	380-400-415 V	342	456	5.8x2	3.9x2	-	1.0+ 1.0	61.9	80
	30	MMY-AP3016HT8P-E	3N~ 50 Hz	380-400-415 V	342	456	5.8x2	4.8x2	-	1.0+ 1.0	66.8	80
	32	MMY-AP3216HT8P-E	3N~ 50 Hz	380-400-415 V	342	456	5.8x2	5.8x2	-	1.0+ 1.0	71.6	80
	34	MMY-AP3416HT8P-E	3N~ 50 Hz	380-400-415 V	342	456	6.5x2	5.8x2	-	2.0+ 1.0	76.4	100
	36	MMY-AP3616HT8P-E	3N~ 50 Hz	380-400-415 V	342	456	7.6x2	5.8x2	-	2.0+ 1.0	80.7	100
	38	MMY-AP3816HT8P-E	3N~ 50 Hz	380-400-415 V	342	456	9.0x2	5.8x2	-	2.0+ 1.0	85.1	100
	40	MMY-AP4016HT8P-E	3N~ 50 Hz	380-400-415 V	342	456	7.6x2	7.6x2	-	2.0+ 2.0	89.8	100
	42	MMY-AP4216HT8P-E	3N~ 50 Hz	380-400-415 V	342	456	9.0x2	7.6x2	-	2.0+ 2.0	94.2	125
	44	MMY-AP4416HT8P-E	3N~ 50 Hz	380-400-415 V	342	456	9.0x2	9.0x2	-	2.0+ 2.0	98.6	125
	46	MMY-AP4616HT8P-E	3N~ 50 Hz	380-400-415 V	342	456	5.8x2	5.8x2	4.8x2	1.0+ 1.0+1.0	102.6	125
	48	MMY-AP4816HT8P-E	3N~ 50 Hz	380-400-415 V	342	456	5.8x2	5.8x2	5.8x2	1.0+ 1.0+1.0	107.4	125
	50	MMY-AP5016HT8P-E	3N~ 50 Hz	380-400-415 V	342	456	6.5x2	5.8x2	5.8x2	2.0+ 1.0+1.0	112.2	125
	52	MMY-AP5216HT8P-E	3N~ 50 Hz	380-400-415 V	342	456	7.6x2	5.8x2	5.8x2	2.0+ 1.0+1.0	116.5	160
	54	MMY-AP5416HT8P-E	3N~ 50 Hz	380-400-415 V	342	456	9.0x2	5.8x2	5.8x2	2.0+ 1.0+1.0	120.9	160
	56	MMY-AP5616HT8P-E	3N~ 50 Hz	380-400-415 V	342	456	7.6x2	7.6x2	5.8x2	2.0+ 2.0+ 1.0	125.6	160
	58	MMY-AP5816HT8P-E	3N~ 50 Hz	380-400-415 V	342	456	9.0x2	7.6x2	5.8x2	2.0+ 2.0+ 1.0	130.0	160
	60	MMY-AP6016HT8P-E	3N~ 50 Hz	380-400-415 V	342	456	9.0x2	9.0x2	5.8x2	2.0+ 2.0+ 1.0	134.4	160

## High efficiency / Heating capacity priority model

Type	HP	Heat Pump Model MMY-	Power Supply		Voltage Range		Compressor			Fan Motor (kW)	MCA (A)	MOCP (A)
			Phase and frequency	Nominal Voltage	Min. (V)	Max (V)	Unit No.1 (kW)	Unit No.2 (kW)	Unit No.3 (kW)			
Combination of outdoor unit	20	MMY-AP2026HT8P-E	3N~ 50 Hz	380-400-415 V	342	456	3.1x2	3.1x2	-	1.0+ 1.0	43.0	63
	22	MMY-AP2226HT8P-E	3N~ 50 Hz	380-400-415 V	342	456	3.9x2	3.1x2	-	1.0+ 1.0	47.6	63
	36	MMY-AP3626HT8P-E	3N~ 50 Hz	380-400-415 V	342	456	3.9x2	3.9x2	3.9x2	1.0+ 1.0+1.0	78.3	100
	38	MMY-AP3826HT8P-E	3N~ 50 Hz	380-400-415 V	342	456	4.8x2	3.9x2	3.9x2	1.0+ 1.0+1.0	83.2	100
	40	MMY-AP4026HT8P-E	3N~ 50 Hz	380-400-415 V	342	456	4.8x2	4.8x2	3.9x2	1.0+ 1.0+1.0	88.1	100
	42	MMY-AP4226HT8P-E	3N~ 50 Hz	380-400-415 V	342	456	4.8x2	4.8x2	4.8x2	1.0+ 1.0+1.0	93.0	125
	44	MMY-AP4426HT8P-E	3N~ 50 Hz	380-400-415 V	342	456	5.8x2	4.8x2	4.8x2	1.0+ 1.0+1.0	97.8	125
	54	MMY-AP5426HT8P-E	3N~ 50 Hz	380-400-415 V	342	456	7.6x2	7.6x2	4.8x2	2.0+ 2.0+1.0	120.8	160

Note MCA : Minimum Circuit Amps

MCOP : Maximum Overcurrent Protection (Amps)



## 4-5. Indoor unit power supply

### • Electrical characteristics for 50Hz outdoor units

Type	Model	Nominal Voltage	Voltage Range		Fan Motor		Power Supply	
		(V-Ph-Hz)	Min	Max	kW	FLA	MCA	MOCP
4-Way Air Discharge Cassette Type	MMU-AP0094HP-E	230-1-50	198	264	0.014	0.63	0.79	15
	MMU-AP0124HP-E	230-1-50	198	264	0.014	0.63	0.79	15
	MMU-AP0154HP-E	230-1-50	198	264	0.014	0.80	1.00	15
	MMU-AP0184HP-E	230-1-50	198	264	0.014	0.80	1.00	15
	MMU-AP0244HP-E	230-1-50	198	264	0.020	0.87	1.09	15
	MMU-AP0274HP-E	230-1-50	198	264	0.020	0.87	1.09	15
	MMU-AP0304HP-E	230-1-50	198	264	0.020	0.87	1.09	15
	MMU-AP0364HP-E	230-1-50	198	264	0.068	1.15	1.44	15
	MMU-AP0484HP-E	230-1-50	198	264	0.072	1.15	1.44	15
	MMU-AP0564HP-E	230-1-50	198	264	0.072	1.15	1.44	15
Compact 4-way Cassette (600 x 600) Type	MMU-AP0056MH-E	230-1-50	198	264	0.060	0.32	0.40	15
	MMU-AP0074MH-E	230-1-50	198	264	0.060	0.32	0.40	15
	MMU-AP0094MH-E	230-1-50	198	264	0.060	0.35	0.44	15
	MMU-AP0124MH-E	230-1-50	198	264	0.060	0.36	0.45	15
	MMU-AP0154MH-E	230-1-50	198	264	0.060	0.48	0.60	15
	MMU-AP0184MH-E	230-1-50	198	264	0.060	0.48	0.60	15
2-Way Air Discharge Cassette Type	MMU-AP0072WH	230-1-50	198	264	0.020	0.32	0.40	15
	MMU-AP0092WH	230-1-50	198	264	0.020	0.32	0.40	15
	MMU-AP0122WH	230-1-50	198	264	0.020	0.32	0.40	15
	MMU-AP0152WH	230-1-50	198	264	0.020	0.32	0.40	15
	MMU-AP0182WH	230-1-50	198	264	0.030	0.70	0.88	15
	MMU-AP0242WH	230-1-50	198	264	0.040	0.81	1.01	15
	MMU-AP0272WH	230-1-50	198	264	0.040	0.81	1.01	15
	MMU-AP0302WH	230-1-50	198	264	0.050	0.81	1.01	15
	MMU-AP0362WH	230-1-50	198	264	0.070	0.87	1.09	15
	MMU-AP0485WH	230-1-50	198	264	0.070	0.87	1.09	15
1-Way Air Discharge Cassette Type	MMU-AP0562WH	230-1-50	198	264	0.070	0.87	1.09	15
	MMU-AP0074YH-E	230-1-50	198	264	0.022	0.28	0.35	15
	MMU-AP0094YH-E	230-1-50	198	264	0.022	0.28	0.35	15
	MMU-AP0124YH-E	230-1-50	198	264	0.022	0.28	0.35	15
	MMU-AP0154SH-E	230-1-50	198	264	0.030	0.40	0.49	15
	MMU-AP0184SH-E	230-1-50	198	264	0.030	0.42	0.53	15
Concealed Duct Type	MMU-AP0244SH-E	230-1-50	198	264	0.030	0.71	0.88	15
	MMD-AP0076BHP-E	230-1-50	198	264	0.150	0.30	0.37	15
	MMD-AP0096BHP-E	230-1-50	198	264	0.150	0.34	0.42	15
	MMD-AP0126BHP-E	230-1-50	198	264	0.150	0.34	0.42	15
	MMD-AP0156BHP-E	230-1-50	198	264	0.150	0.48	0.61	15
	MMD-AP0186BHP-E	230-1-50	198	264	0.150	0.48	0.61	15
	MMD-AP0246BHP-E	230-1-50	198	264	0.150	0.60	0.75	15
	MMD-AP0276BHP-E	230-1-50	198	264	0.150	0.60	0.75	15
	MMD-AP0306BHP-E	230-1-50	198	264	0.150	0.70	0.88	15
	MMD-AP0366BHP-E	230-1-50	198	264	0.250	1.23	1.54	15
Concealed Duct High Static Pressure Type	MMD-AP0486BHP-E	230-1-50	198	264	0.250	1.41	1.77	15
	MMD-AP0566BHP-E	230-1-50	198	264	0.250	1.41	1.77	15
	MMD-AP0186HP-E	230-1-50	198	264	0.25	1.02	1.28	15
	MMD-AP0246HP-E	230-1-50	198	264	0.25	1.33	1.66	15
	MMD-AP0276HP-E	230-1-50	198	264	0.25	1.33	1.66	15
	MMD-AP0366HP-E	230-1-50	198	264	0.35	2.22	2.78	15
	MMD-AP0486HP-E	230-1-50	198	264	0.35	2.40	2.99	15
	MMD-AP0566HP-E	230-1-50	198	264	0.35	2.57	3.22	15
	MMD-AP0724H-E	230-1-50	198	264	0.370x3	6.04	7.55	15
	MMD-AP0964H-E	230-1-50	198	264	0.370x3	6.35	7.94	15

## 4 Wiring design



Slim Duct Type	MMD-AP0056SPH-E	230-1-50	198	264	0.060	0.35	0.44	15
	MMD-AP0074SPH-E	230-1-50	198	264	0.060	0.35	0.44	15
	MMD-AP0094SPH-E	230-1-50	198	264	0.060	0.35	0.44	15
	MMD-AP0124SPH-E	230-1-50	198	264	0.060	0.37	0.47	15
	MMD-AP0154SPH-E	230-1-50	198	264	0.060	0.38	0.48	15
	MMD-AP0184SPH-E	230-1-50	198	264	0.060	0.47	0.59	15
	MMD-AP0244SPH-E	230-1-50	198	264	0.120	0.86	1.08	15
	MMD-AP0274SPH-E	230-1-50	198	264	0.120	0.86	1.08	15
CeilingType	MMC-AP0157HP-E	230-1-50	198	264	0.030	0.33	0.41	15
	MMC-AP0187HP-E	230-1-50	198	264	0.030	0.37	0.46	15
	MMC-AP0247HP-E	230-1-50	198	264	0.040	0.48	0.60	15
	MMC-AP0277HP-E	230-1-50	198	264	0.040	0.48	0.60	15
	MMC-AP0367HP-E	230-1-50	198	264	0.080	0.90	1.13	15
	MMC-AP0487HP-E	230-1-50	198	264	0.080	0.96	1.20	15
	MMC-AP0587HP-E	230-1-50	198	264	0.139	1.14	1.43	15
High-wall Type (3 series)	MMK-AP0073H	230-1-50	198	264	0.03	0.20	0.22	15
	MMK-AP0093H	230-1-50	198	264	0.03	0.22	0.24	15
	MMK-AP0123H	230-1-50	198	264	0.03	0.22	0.24	15
	MMK-AP0153H	230-1-50	198	264	0.03	0.37	0.4	15
	MMK-AP0183H	230-1-50	198	264	0.03	0.37	0.4	15
	MMK-AP0243H	230-1-50	198	264	0.03	0.43	0.47	15
High-wall Type (4 series)	MMK-AP0054MHP-E	230-1-50	198	264	0.03	0.20	0.24	15
	MMK-AP0074MH-E	230-1-50	198	264	0.03	0.20	0.24	15
	MMK-AP0094MH-E	230-1-50	198	264	0.03	0.21	0.26	15
	MMK-AP0124MH-E	230-1-50	198	264	0.03	0.22	0.27	15
Floor Standing Cabinet Type	MML-AP0074H-E	230-1-50	198	264	0.045	0.30	0.37	15
	MML-AP0094H-E	230-1-50	198	264	0.045	0.30	0.37	15
	MML-AP0124H-E	230-1-50	198	264	0.045	0.49	0.62	15
	MML-AP0154H-E	230-1-50	198	264	0.045	0.49	0.62	15
	MML-AP0184H-E	230-1-50	198	264	0.070	0.54	0.68	15
	MML-AP0244H-E	230-1-50	198	264	0.070	0.54	0.68	15
Floor Standing Concealed Type	MML-AP0074BH-E	230-1-50	198	264	0.019	0.29	0.36	15
	MML-AP0094BH-E	230-1-50	198	264	0.019	0.29	0.36	15
	MML-AP0124BH-E	230-1-50	198	264	0.019	0.29	0.36	15
	MML-AP0154BH-E	230-1-50	198	264	0.070	0.52	0.65	15
	MML-AP0184BH-E	230-1-50	198	264	0.070	0.52	0.65	15
	MML-AP0244BH-E	230-1-50	198	264	0.070	0.53	0.66	15
Floor Standing Type	MMF-AP0156H-E	230-1-50	198	264	0.062	0.44	0.55	15
	MMF-AP0186H-E	230-1-50	198	264	0.062	0.44	0.55	15
	MMF-AP0246H-E	230-1-50	198	264	0.062	0.69	0.86	15
	MMF-AP0276H-E	230-1-50	198	264	0.062	0.69	0.86	15
	MMF-AP0366H-E	230-1-50	198	264	0.109	1.04	1.29	15
	MMF-AP0486H-E	230-1-50	198	264	0.109	1.27	1.58	15
Console Type	MMF-AP0566H-E	230-1-50	198	264	0.109	1.27	1.58	15
	MML-AP0074NH-E	230-1-50	198	264	0.041	0.21	0.26	15
	MML-AP0094NH-E	230-1-50	198	264	0.041	0.21	0.26	15
	MML-AP0124NH-E	230-1-50	198	264	0.041	0.25	0.31	15
	MML-AP0154NH-E	230-1-50	198	264	0.041	0.32	0.40	15
	MML-AP0184NH-E	230-1-50	198	264	0.041	0.46	0.58	15



- **Wiring size**

**Must be independent from the outdoor unit power supply**

Model	Item		Power supply wiring	
			Wire size	
All models of indoor units	2.0 mm <sup>2</sup> (AWG#14)	Max. 20 m	3.5 mm <sup>2</sup> (AWG#12)	Max. 50 m


**NOTE:**

The above connecting lengths stated in the table, indicate the length from the isolator to the outdoor unit. When the power supply of the indoor units are connected in parallel, it is assumed that no more than a 2 % voltage drop will occur. If the connecting length is to exceed the stated lengths, select a suitable wire in accordance with the local wiring standards.



## 4-6.Design of control wiring

- Summary of control wiring

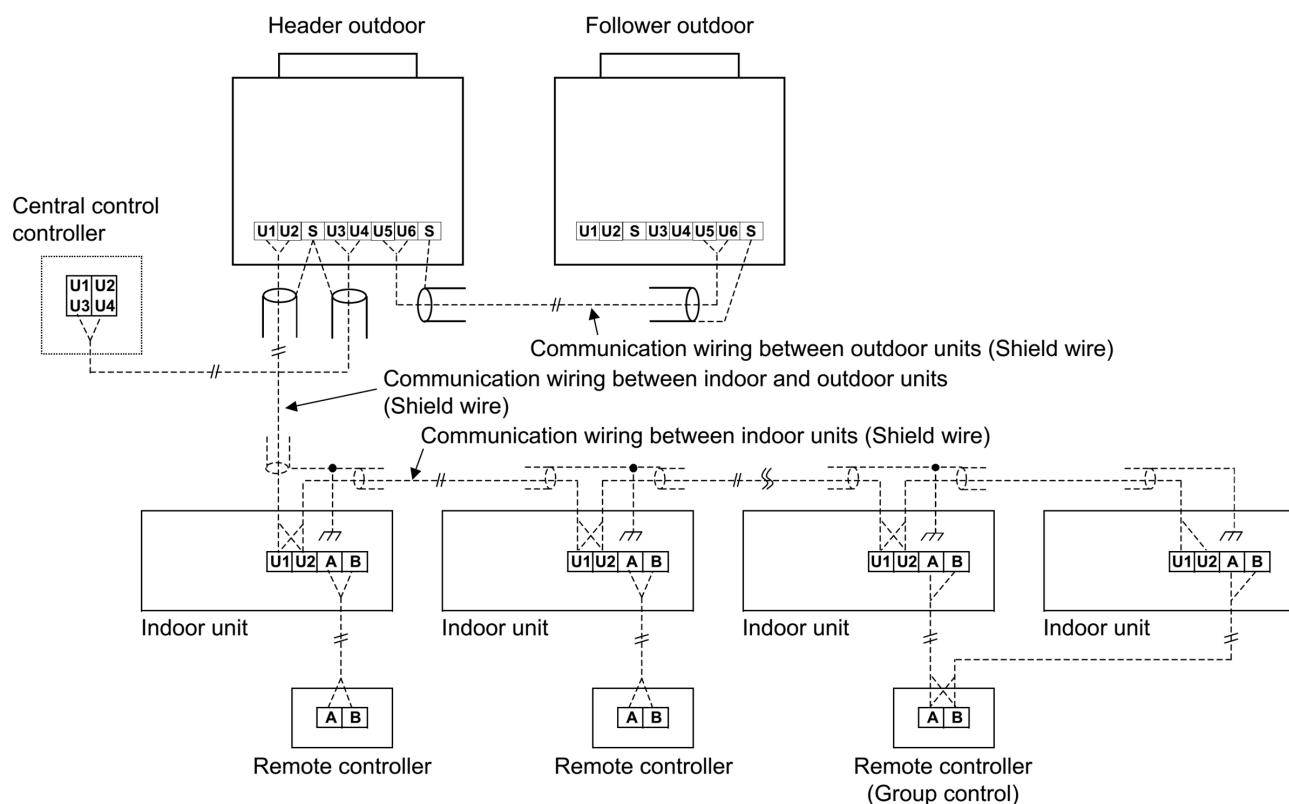


- Communication wiring and central control wiring use 2-core non-polarity wires.  
Use 2-core shield wires to prevent noise trouble.  
In this case, both ends of the communication wire must be grounded.
- Use 2-core non-polarity wire for remote controller. (A, B terminals)  
Use 2-core non-polarity wire for wiring of group control. (A, B terminals)



• **Restriction of control wiring**

Be sure to keep the rule of below tables about size and length of control wiring.

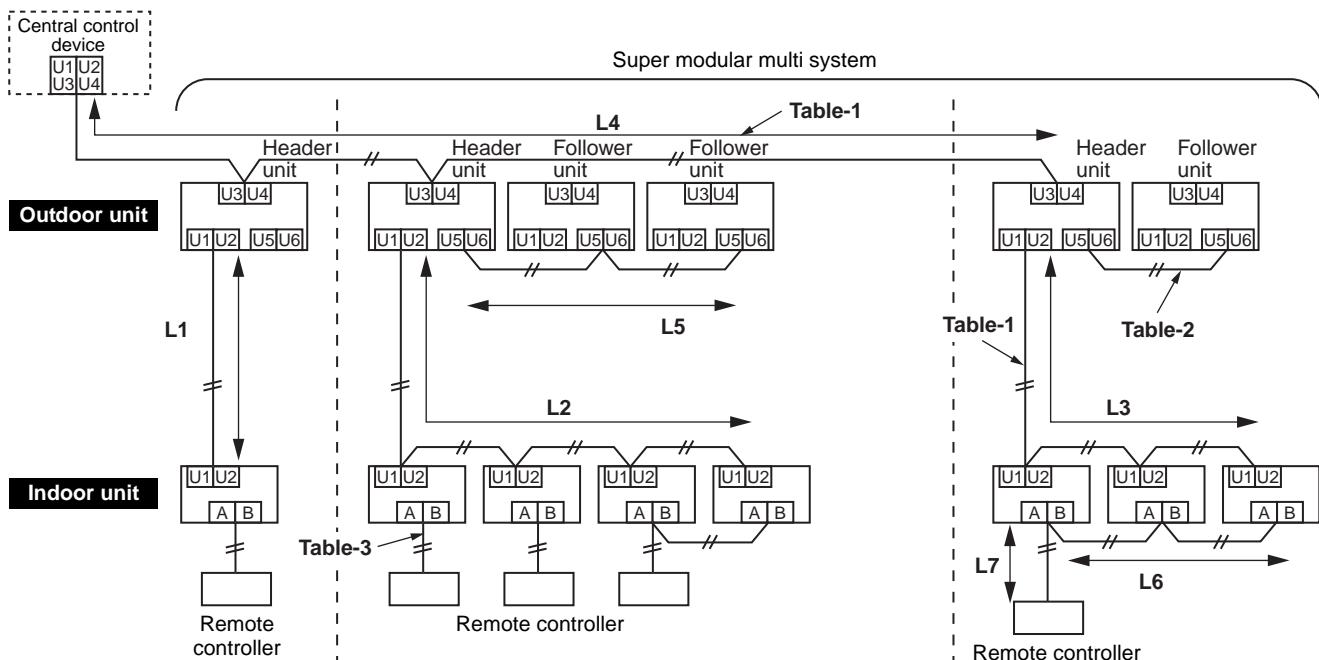

**Table-1 Control wiring between indoor and outdoor units (L1, L2, L3), Central control wiring (L4)**

<b>Wiring</b>	2-core, non-polarity
<b>Type</b>	Shield wire
<b>Size/Length</b>	1.25 mm <sup>2</sup> : Up to 1000 m/2.0 mm <sup>2</sup> : Up to 2000 m (*1)

Note (\*1): Total length of control wiring length for all refrigerant circuits (L1 + L2 + L3 + L4)

**Table-2 Control wiring between outdoor units (L5)**


<b>Wiring</b>	2-core, non-polarity
<b>Type</b>	Shield wire
<b>Size/Length</b>	1.25 mm <sup>2</sup> to 2.0 mm <sup>2</sup> /Up to 100 m (L5)

**Table-3 Remote controller wiring (L6, L7)**

<b>Wire</b>	2-core
<b>Size</b>	0.5 mm <sup>2</sup> to 2.0 mm <sup>2</sup>
<b>Length</b>	<ul style="list-style-type: none"> <li>Up to 500 m (L6 + L7)</li> <li>Up 400 m in case of wireless remote controller in group control.</li> <li>Up to 200 m total length of control wiring between indoor units (L6)</li> </ul>

• **Group Operation through a Remote Controller**

Group operation of multiple indoor units (8 units) through a single remote controller switch

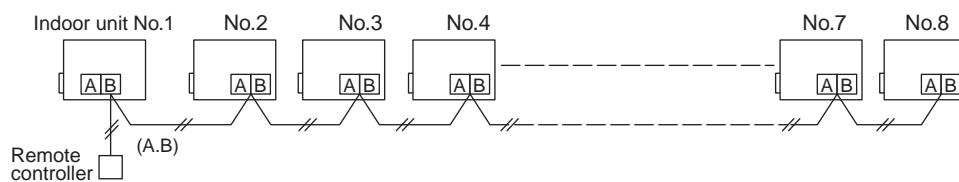



## 5-1. Specifications

### Standard model

Model name	Heat pump		MMY-MAP0806HT8P-E	MMY-MAP1006HT8P-E	MMY-MAP1206HT8P-E	MMY-MAP1406HT8P-E
Outdoor unit type			Inverter unit	Inverter unit	Inverter unit	Inverter unit
Cooling capacity (*1)	kW		22.4	28.0	33.5	40.0
Heating capacity (*1)	kW		25.0	31.5	37.5	45.0
Capacity range	HP		8	10	12	14
Power supply			3N- 50Hz 400V(380-415V)	3N- 50Hz 400V(380-415V)	3N- 50Hz 400V(380-415V)	3N- 50Hz 400V(380-415V)
Voltage range (*2)	Minimum	V	342	342	342	342
	Maximum	V	456	456	456	456
Electrical characteristic (*1)	Cooling	Running current	A	8.79	12.1	15.5
		Power input	kW	5.54	7.69	10.0
		EER	kW/kW	4.04	3.64	3.35
	Heating	Running current	A	8.77	11.6	15.0
		Power input	kW	5.53	7.41	9.65
		COP	kW/kW	4.52	4.25	3.89
	Starting current	A	Soft Start	Soft Start	Soft Start	Soft Start
Dimension	Height	mm	1830	1830	1830	1830
	Width	mm	990	990	990	1210
	Depth	mm	780	780	780	780
Weight	Heat pump	kg	242	242	242	300
Color			Silky shade (Munsell 1Y8.5/0.5)	Silky shade (Munsell 1Y8.5/0.5)	Silky shade (Munsell 1Y8.5/0.5)	Silky shade (Munsell 1Y8.5/0.5)
Compressor	Type		Hermetic twin rotary compressor			
	Motor output	kW	2.1x2	3.1x2	3.9x2	4.8x2
Fan unit	Type		Propeller fan	Propeller fan	Propeller fan	Propeller fan
	Motor output	W	1.0	1.0	1.0	1.0
	Air volume	m³/h	9700	9700	12200	12200
Max. external static pressure	Pa		60	60	50	50
Heat exchanger			Finned tube	Finned tube	Finned tube	Finned tube
Refrigerant	Name		R410A	R410A	R410A	R410A
	Charge	Heat pump	kg	11.5	11.5	11.5
High-pressure switch		Pa	OFF:3.2 ON:4.15	OFF:3.2 ON:4.15	OFF:3.2 ON:4.15	OFF:3.2 ON:4.15
Protective devices			(*3)	(*3)	(*3)	(*3)
Power supply wiring	MCA (*4)	A	20.5	21.5	26.1	31.0
	MOCP (*5)	A	25.0	25.0	32.0	40.0
Piping connections	Gas	Type	Brazing	Brazing	Brazing	Brazing
		Diameter	mm	19.1	22.2	28.6
	Liquid	Type	Flare	Flare	Flare	Flare
		Diameter	mm	12.7	12.7	12.7
	Balance	Type	Flare	Flare	Flare	Flare
		Diameter	mm	9.5	9.5	9.5
Max. number of connected indoor units			18	22	27	31
Sound pressure level	Cooling	dB(A)	55.0	57.0	59.0	60.0
	Heating	dB(A)	56.0	58.0	61.0	62.0
Sound power level	Cooling	dB(A)	74.0	74.0	80.0	80.0
	Heating	dB(A)	74.0	74.0	82.0	82.0
Operation temperature range	Cooling(*7)	CDB	-10.0 to 46.0	-10.0 to 46.0	-10.0 to 46.0	-10.0 to 46.0
	Heating(*6)	CWB	-25.0 to 15.5	-25.0 to 15.5	-25.0 to 15.5	-25.0 to 15.5

#### Note

(\*1) Rated conditions

Cooling : Indoor 27 degC Dry Bulb / 19 degC Wet Bulb , Outdoor 35 degC Dry Bulb.

Heating : Indoor 20 degC Dry Bulb , Outdoor 7 degC Dry Bulb / 6 degC Wet Bulb.

Based on equivalent piping length of 7.5m and piping height difference of 0m.

(\*2) Voltage range : Units are suitable for use on electrical systems where voltage supplied to unit terminal is not below or above listed range limits.

(\*3) Discharge temp. sensor / Suction temp. sensor / High-pressure sensor / Low-pressure sensor / Compressor case thermostat / PC board fuse

(\*4) Select wire size base on the larger value of MCA.

MCA : Minimum Circuit Amps

(\*5) MOCP : Maximum Overcurrent Protection(Amps)

(\*6) Low ambient heating (-20degC or less) for extended periods of time is not allowed

(\*7) Low ambient cooling (-5 deg C or less) is limited to application.

## 5 Outdoor Unit



Model name	Heat pump		MMY-MAP1606HT8P-E	MMY-MAP1806HT8P-E	MMY-MAP2006HT8P-E	MMY-MAP2206HT8P-E
Outdoor unit type			Inverter unit	Inverter unit	Inverter unit	Inverter unit
Cooling capacity (*1)	kW		45.0	50.4	56.0	61.5
Heating capacity (*1)	kW		50.0	56.0	63.0	64.0
Capacity range	HP		16	18	20	22
Power supply			3N~ 50Hz 400V(380-415V)	3N~ 50Hz 400V(380-415V)	3N~ 50Hz 400V(380-415V)	3N~ 50Hz 400V(380-415V)
Voltage range (*2)	Minimum	V	342	342	342	342
	Maximum	V	456	456	456	456
Electrical characteristic (*1)	Cooling	Running current	A	22.4	22.9	26.8
	Cooling	Power input	kW	14.3	14.6	17.3
	Cooling	EER	kW/kW	3.15	3.45	3.24
	Heating	Running current	A	20.2	22.1	26.1
	Heating	Power input	kW	12.9	14.1	17.0
	Heating	COP	kW/kW	3.88	3.97	3.71
Dimension	Starting current	A	Soft Start	Soft Start	Soft Start	Soft Start
	Height	mm	1830	1830	1830	1830
	Width	mm	1210	1600	1600	1600
Weight	Depth	mm	780	780	780	780
	Heat pump	kg	300	371	371	371
	Colour		Silky shade (Munsell 1Y8.5/0.5)	Silky shade (Munsell 1Y8.5/0.5)	Silky shade (Munsell 1Y8.5/0.5)	Silky shade (Munsell 1Y8.5/0.5)
Compressor	Type		Hermetic twin rotary compressor			
	Motor output	kW	5.8x2	6.5x2	7.6x2	9.0x2
Fan unit	Type		Propeller fan	Propeller fan	Propeller fan	Propeller fan
	Motor output	kW	1.0	2.0	2.0	2.0
	Air volume	m³/h	12600	17300	17900	18500
Max. external static pressure		Pa	40	50	40	40
Heat exchanger			Finned tube	Finned tube	Finned tube	Finned tube
Refrigerant	Name		R410A	R410A	R410A	R410A
	Charge	Heat pump	kg	11.5	11.5	11.5
High-pressure switch		Pa	OFF:3.2 ON:4.15	OFF:3.2 ON:4.15	OFF:3.2 ON:4.15	OFF:3.2 ON:4.15
Protective devices			(*3)	(*3)	(*3)	(*3)
Power supply wiring	MCA (*4)	A	35.8	40.6	44.9	49.3
	MOCP (*5)	A	40.0	50.0	63.0	63.0
Piping connections	Gas	Type	Brazing	Brazing	Brazing	Brazing
	Gas	Diameter	mm	28.6	28.6	28.6
	Liquid	Type	Flare	Flare	Flare	Flare
	Liquid	Diameter	mm	15.9	15.9	19.1
Balance	Type		Flare	Flare	Flare	Flare
	Balance	Diameter	mm	9.5	9.5	9.5
Max. number of connected indoor units			36	40	45	49
Sound pressure level	Cooling	dB(A)	62.0	60.0	61.0	61.0
	Heating	dB(A)	64.0	61.0	62.0	62.0
Sound power level	Cooling	dB(A)	81.0	81.0	82.0	83.0
	Heating	dB(A)	83.0	83.0	84.0	84.0
Operation temperature range	Cooling(*7)	CDB	-10.0 to 46.0	-10.0 to 46.0	-10.0 to 46.0	-10.0 to 46.0
	Heating(*6)	CWB	-25.0 to 15.5	-25.0 to 15.5	-25.0 to 15.5	-25.0 to 15.5

Note

(\*1) Rated conditions

Cooling : Indoor 27 degC Dry Bulb / 19 degC Wet Bulb , Outdoor 35 degC Dry Bulb.

Heating : Indoor 20 degC Dry Bulb , Outdoor 7 degC Dry Bulb / 6 degC WetBulb.

Based on equivalent piping length of 7.5m and piping height difference of 0m.

(\*2) Voltage range : Units are suitable for use on electrical systems where voltage supplied to unit terminal is not below or above listed range limits.

(\*3) Discharge temp. sensor / Suction temp. sensor / High-pressure sensor / Low-pressure sensor / Compressor case thermostat / PC board fuse

(\*4) Select wire size base on the larger value of MCA.

MCA : Minimum Circuit Amps

(\*5) MOCP : Maximum Overcurrent Protection(Amps)

(\*6) Low ambient heating (-20degC or less) for extended periods of time is not allowed

(\*7) Low ambient cooling (-5 deg C or less) is limited to application.

## 5 Outdoor Unit



Model	Name	Heat pump		MMY-AP2416HT8P-E	MMY-AP2616HT8P-E	MMY-AP2816HT8P-E	MMY-AP3016HT8P-E
	Combination	Heat pump		MMY-MAP1206HT8P-E	MMY-MAP1406HT8P-E	MMY-MAP1606HT8P-E	MMY-MAP1606HT8P-E
<b>Outdoor unit type</b>							
Cooling capacity (*1)	kW	67.0		73.5	78.5	85.0	
Heating capacity (*1)	kW	75.0		82.5	87.5	95.0	
Capacity range	HP	24		26	28	30	
Power supply		3N~ 50Hz 400V(380-415V)		3N~ 50Hz 400V(380-415V)	3N~ 50Hz 400V(380-415V)	3N~ 50Hz 400V(380-415V)	
Voltage range (*2)		Minimum V	342	342	342	342	
		Maximum V	456	456	456	456	
Electrical characteristic (*1)	Cooling	Running current A	31.0	35.0	37.9	41.9	
		Power input kW	20.0	22.3	24.3	26.6	
		EER kW/kW	3.35	3.3	3.23	3.2	
	Heating	Running current A	30.0	32.8	35.2	38.0	
		Power input kW	19.3	20.9	22.6	24.1	
		COP kW/kW	3.89	3.96	3.88	3.94	
Starting current	A	Soft Start					
Weight	Heat pump kg	242 + 242	300 + 242	300 + 242	300 + 300	300 + 300	
Colour		Silky shade (Munsell 1Y8.5/0.5)					
Compressor	Type		Hermetic twin rotary compressor				
	Motor output kW	3.9x2 + 3.9x2	4.8x2 + 3.9x2	5.8x2 + 3.9x2	5.8x2 + 4.8x2		
Fan unit	Fan		Propeller fan	Propeller fan	Propeller fan	Propeller fan	
	Motor output kW	1.0 + 1.0	1.0 + 1.0	1.0 + 1.0	1.0 + 1.0		
	Air volume m³/h	12200 + 12200	12200 + 12200	12600 + 12200	12600 + 12200		
Max. external static pressure	Pa	50	50	40	40		
Heat exchanger		Finned tube	Finned tube	Finned tube	Finned tube		
Refrigerant	Name	R410A	R410A	R410A	R410A		
	Charge kg	11.5 + 11.5	11.5 + 11.5	11.5 + 11.5	11.5 + 11.5		
High-pressure switch	Pa	OFF:3.2 ON:4.15	OFF:3.2 ON:4.15	OFF:3.2 ON:4.15	OFF:3.2 ON:4.15		
Protective devices		(*3)	(*3)	(*3)	(*3)		
Power supply wiring	MCA (*4)	A	52.2	57.1	61.9	66.8	
	MOCP (*5)	A	63.0	63.0	80.0	80.0	
Piping connections	Gas	Type	Brazing	Brazing	Brazing	Brazing	
		Diameter mm	34.9	34.9	34.9	34.9	
	Liquid	Type	Flare	Flare	Flare	Flare	
		Diameter mm	19.1	19.1	19.1	19.1	
	Balance	Type	Flare	Flare	Flare	Flare	
		Diameter mm	9.5	9.5	9.5	9.5	
Max. number of connected indoor units		54	58	63	64		
Sound pressure level	Cooling	dB(A)	62.0	62.5	64.0	64.5	
	Heating	dB(A)	64.0	64.5	66.0	66.5	
Sound power level	Cooling	dB(A)	83.0	83.0	83.5	83.5	
	Heating	dB(A)	85.0	85.0	85.5	85.5	
Operation temperature range	Cooling	CDB	-5.0 to 46.0	-5.0 to 46.0	-5.0 to 46.0	-5.0 to 46.0	
	Heating(*6)	CWB	-25.0 to 15.5	-25.0 to 15.5	-25.0 to 15.5	-25.0 to 15.5	

Note

(\*1) Rated conditions

Cooling : Indoor 27 degC Dry Bulb /19 degC Wet Bulb , Outdoor 35 degC Dry Bulb.

Heating : Indoor 20 degC Dry Bulb, Outdoor 7 degC Dry Bulb / 6 degC WetBulb.

Based on equivalent piping length of 7.5m and piping height difference of 0m.

(\*2) Voltage range : Units are suitable for use on electrical systems where voltage supplied to unit terminal is not below or above listed range limits.

(\*3) Discharge temp. sensor / Suction temp. sensor / High-pressure sensor / Low-pressure sensor / Compressor case thermostat / PC board fuse

(\*4) Select wire size base on the larger value of MCA.

MCA : Minimum Circuit Amps

(\*5) MOCP : Maximum Overcurrent Protection(Amps)

(\*6) Low ambient heating (-20degC or less) for extended periods of time is not allowed

## 5 Outdoor Unit



Model	Name	Heat pump		MMY-AP3216HT8P-E	MMY-AP3416HT8P-E	MMY-AP3616HT8P-E	MMY-AP3816HT8P-E
	Combination	Heat pump		MMY-MAP1606HT8P-E	MMY-MAP1806HT8P-E	MMY-MAP2006HT8P-E	MMY-MAP2206HT8P-E
<b>Outdoor unit type</b>							
Cooling capacity (*1)	kW	90.0		95.4	101.0	106.5	
Heating capacity (*1)	kW	100.0		106.0	113.0	114.0	
Capacity range	HP	32		34	36	38	
Power supply		3N~ 50Hz 400V(380-415V)		3N~ 50Hz 400V(380-415V)	3N~ 50Hz 400V(380-415V)	3N~ 50Hz 400V(380-415V)	
<b>Voltage range (*2)</b>		Minimum	V	342	342	342	342
		Maximum	V	456	456	456	456
<b>Electrical characteristic (*1)</b>	Cooling	Running current	A	44.8	45.3	49.2	58.0
		Power input	kW	28.6	28.9	31.6	37.5
		EER	kW/kW	3.15	3.3	3.2	2.84
	Heating	Running current	A	40.4	42.3	46.3	46.7
		Power input	kW	25.8	27.0	29.9	30.0
		COP	kW/kW	3.88	3.93	3.78	3.8
Starting current		A	Soft Start	Soft Start	Soft Start	Soft Start	
Weight	Heat pump	kg	300 + 300	371 + 300	371 + 300	371 + 300	
Colour			Silky shade (Munsell 1Y8.5/0.5)	Silky shade (Munsell 1Y8.5/0.5)	Silky shade (Munsell 1Y8.5/0.5)	Silky shade (Munsell 1Y8.5/0.5)	
Compressor	Type		Hermetic twin rotary compressor				
	Motor output	kW	5.8x2 + 5.8x2	6.5x2 + 5.8x2	7.6x2 + 5.8x2	9.0x2 + 5.8x2	
Fan unit	Fan		Propeller fan	Propeller fan	Propeller fan	Propeller fan	
	Motor output	kW	1.0 + 1.0	2.0 + 1.0	2.0 + 1.0	2.0 + 1.0	
	Air volume	m3/h	12600 + 12600	17300 + 12600	17900 + 12600	18500 + 12600	
Max. external static pressure		Pa	40	40	40	40	
Heat exchanger			Finned tube	Finned tube	Finned tube	Finned tube	
Refrigerant	Name		R410A	R410A	R410A	R410A	
	Charge	Heat pump	kg	11.5 + 11.5	11.5 + 11.5	11.5 + 11.5	11.5 + 11.5
High-pressure switch		Pa	OFF:3.2 ON:4.15	OFF:3.2 ON:4.15	OFF:3.2 ON:4.15	OFF:3.2 ON:4.15	
Protective devices			(*3)	(*3)	(*3)	(*3)	
Power supply wiring	MCA (*4)	A	71.6	76.4	80.7	85.1	
	MOCP (*5)	A	80.0	100.0	100.0	100.0	
Piping connections	Gas	Type	Brazing	Brazing	Brazing	Brazing	
		Diameter	mm	34.9	34.9	41.3	41.3
	Liquid	Type	Flare	Flare	Flare	Flare	
		Diameter	mm	19.1	19.1	22.2	22.2
	Balance	Type	Flare	Flare	Flare	Flare	
		Diameter	mm	9.5	9.5	9.5	9.5
Max. number of connected indoor units			64	64	64	64	
Sound pressure level	Cooling	dB(A)	65.0	64.5	64.5	64.5	
	Heating	dB(A)	67.0	66.0	66.5	66.5	
Sound power level	Cooling	dB(A)	84.0	84.0	84.5	85.5	
	Heating	dB(A)	86.0	86.0	86.5	86.5	
Operation temperature range	Cooling	CDB	-5.0 to 46.0	-5.0 to 46.0	-5.0 to 46.0	-5.0 to 46.0	
	Heating(*6)	CWB	-25.0 to 15.5	-25.0 to 15.5	-25.0 to 15.5	-25.0 to 15.5	

Note

(\*1) Rated conditions

Cooling : Indoor 27 degC Dry Bulb /19 degC Wet Bulb , Outdoor 35 degC Dry Bulb.

Heating : Indoor 20 degC Dry Bulb, Outdoor 7 degC Dry Bulb / 6 degC WetBulb.

Based on equivalent piping length of 7.5m and piping height difference of 0m.

(\*2) Voltage range : Units are suitable for use on electrical systems where voltage supplied to unit terminal is not below or above listed range limits.

(\*3) Discharge temp. sensor / Suction temp. sensor / High-pressure sensor / Low-pressure sensor / Compressor case thermostat / PC board fuse

(\*4) Select wire size base on the larger value of MCA.

MCA : Minimum Circuit Amps

(\*5) MOCP : Maximum Overcurrent Protection(Amps)

(\*6) Low ambient heating (-20degC or less) for extended periods of time is not allowed

## 5 Outdoor Unit



Model	Name	Heat pump		MMY-AP4016HT8P-E	MMY-AP4216HT8P-E	MMY-AP4416HT8P-E	
	Combination	Heat pump		MMY-MAP2006HT8P-E	MMY-MAP2206HT8P-E	MMY-MAP2206HT8P-E	
Outdoor unit type				Inverter unit	Inverter unit	Inverter unit	
Cooling capacity (*1)		kW		112.0	117.5	123.0	
Heating capacity (*1)		kW		126.0	127.0	128.0	
Capacity range		HP		40	42	44	
Power supply		3N~ 50Hz 400V(380-415V)		3N~ 50Hz 400V(380-415V)	3N~ 50Hz 400V(380-415V)	3N~ 50Hz 400V(380-415V)	
Voltage range (*2)		Minimum	V	342	342	342	
		Maximum	V	456	456	456	
Electrical characteristic (*1)	Cooling	Running current	A	53.6	62.4	71.2	
		Power input	kW	34.6	40.5	46.4	
		EER	kW/kW	3.24	2.9	2.65	
	Heating	Running current	A	52.2	52.6	53.0	
		Power input	kW	34.0	34.1	34.2	
		COP	kW/kW	3.71	3.72	3.74	
	Starting current		A	Soft Start	Soft Start	Soft Start	
Weight	Heat pump	kg		371 + 371	371 + 371	371 + 371	
Colour				Silky shade	Silky shade	Silky shade	
Compressor	Type			Hermetic twin rotary compressor	Hermetic twin rotary compressor	Hermetic twin rotary compressor	
	Motor output	kW		7.6x2 + 7.6x2	9.0x2 + 7.6x2	9.0x2 + 9.0x2	
Fan unit	Fan			Propeller fan	Propeller fan	Propeller fan	
	Motor output	kW		2.0 + 2.0	2.0 + 2.0	2.0 + 2.0	
	Air volume	m <sup>3</sup> /h		17900 + 17900	18500 + 17900	18500 + 18500	
Max. external static pressure		Pa		40	40	40	
Heat exchanger				Finned tube	Finned tube	Finned tube	
Refrigerant	Name			R410A	R410A	R410A	
	Charge	Heat pump	kg	11.5 + 11.5	11.5 + 11.5	11.5 + 11.5	
High-pressure switch		Pa		OFF:3.2 ON:4.15	OFF:3.2 ON:4.15	OFF:3.2 ON:4.15	
Protective devices				(*)3	(*)3	(*)3	
Power supply wiring		MCA (*4)	A	89.8	94.2	98.6	
		MOCP (*5)	A	100.0	125.0	125.0	
Piping connections	Gas	Type		Brazing	Brazing	Brazing	
		Diameter	mm	41.3	41.3	41.3	
	Liquid	Type		Flare	Flare	Flare	
		Diameter	mm	22.2	22.2	22.2	
	Balance	Type		Flare	Flare	Flare	
		Diameter	mm	9.5	9.5	9.5	
Max. number of connected indoor units				64	64	64	
Sound pressure level		Cooling	dB(A)	64.0	64.0	64.0	
		Heating	dB(A)	65.0	65.0	65.0	
Sound power level		Cooling	dB(A)	85.0	85.5	86.0	
		Heating	dB(A)	87.0	87.0	87.0	
Operation temperature range		Cooling	CDB	-5.0 to 46.0	-5.0 to 46.0	-5.0 to 46.0	
		Heating(*6)	CWB	-25.0 to 15.5	-25.0 to 15.5	-25.0 to 15.5	

### Note

(\*1) Rated conditions

Cooling : Indoor 27 degC Dry Bulb /19 degC Wet Bulb , Outdoor 35 degC Dry Bulb.

Heating : Indoor 20 degC Dry Bulb, Outdoor 7 degC Dry Bulb / 6 degC WetBulb.

Based on equivalent piping length of 7.5m and piping height difference of 0m.

(\*2) Voltage range : Units are suitable for use on electrical systems where voltage supplied to unit terminal is not below or above listed range limits.

(\*3) Discharge temp. sensor / Suction temp. sensor / High-pressure sensor / Low-pressure sensor / Compressor case thermostat / PC board fuse

(\*4) Select wire size base on the larger value of MCA.

MCA : Minimum Circuit Amps

(\*5) MOCP : Maximum Overcurrent Protection(Amps)

(\*6) Low ambient heating (-20degC or less) for extended periods of time is not allowed

## 5 Outdoor Unit



Model	Name	Heat pump		MMY-AP4616HT8P-E	MMY-AP4816HT8P-E	MMY-AP5016HT8P-E
	Combination	Heat pump		MMY-MAP1606HT8P-E	MMY-MAP1606HT8P-E	MMY-MAP1806HT8P-E
				MMY-MAP1606HT8P-E	MMY-MAP1606HT8P-E	MMY-MAP1606HT8P-E
				MMY-MAP1406HT8P-E	MMY-MAP1606HT8P-E	MMY-MAP1606HT8P-E
Outdoor unit type		Inverter unit		Inverter unit		Inverter unit
Cooling capacity (*1)		kW		130.0	135.0	140.4
Heating capacity (*1)		kW		145.0	150.0	156.0
Capacity range		HP		46	48	50
Power supply		3N~ 50Hz 400V(380-415V)		3N~ 50Hz 400V(380-415V)		3N~ 50Hz 400V(380-415V)
Voltage range (*2)	Minimum	V		342	342	342
	Maximum	V		456	456	456
Electrical characteristic (*1)	Cooling	Running current	A	64.3	67.2	67.7
		Power input	kW	40.9	42.9	43.2
		EER	kW/kW	3.18	3.15	3.25
	Heating	Running current	A	58.2	60.6	62.5
		Power input	kW	37.0	38.7	39.9
		COP	kW/kW	3.92	3.88	3.91
	Starting current		A	Soft Start	Soft Start	Soft Start
Weight	Heat pump	kg	300 + 300 + 300	300 + 300 + 300	371 + 300 + 300	
Colour		Silky shade (Munsell 1Y8.5/0.5)		Silky shade (Munsell 1Y8.5/0.5)		Silky shade (Munsell 1Y8.5/0.5)
Compressor	Type		Hermetic twin rotary compressor		Hermetic twin rotary compressor	
	Motor output	kW	5.8x2 + 5.8x2 + 4.8x2	5.8x2 + 5.8x2 + 5.8x2	6.5x2 + 5.8x2 + 5.8x2	
Fan unit	Fan		Propeller fan		Propeller fan	
	Motor output	kW	1.0 + 1.0 + 1.0	1.0 + 1.0 + 1.0	2.0 + 1.0 + 1.0	
	Air volume	m3/h	12600 + 12600 + 12200	12600 + 12600 + 12600	17300 + 12600 + 12600	
Max. external static pressure		Pa	40	40	40	
Heat exchanger		Finned tube		Finned tube		Finned tube
Refrigerant	Name		R410A	R410A	R410A	
	Charge	Heat pump	kg	11.5 + 11.5 + 11.5	11.5 + 11.5 + 11.5	11.5 + 11.5 + 11.5
High-pressure switch		Pa	OFF:3.2 ON:4.15	OFF:3.2 ON:4.15	OFF:3.2 ON:4.15	
Protective devices		(*3)		(*3)		(*3)
Power supply wiring		MCA (*4)	A	102.6	107.4	112.2
		MOCP (*5)	A	125.0	125.0	125.0
Piping connections	Gas	Type		Brazing	Brazing	Brazing
		Diameter	mm	41.3	41.3	41.3
	Liquid	Type		Flare	Flare	Flare
		Diameter	mm	22.2	22.2	22.2
	Balance	Type		Flare	Flare	Flare
		Diameter	mm	9.5	9.5	9.5
Max. number of connected indoor units		64		64		64
Sound pressure level		Cooling	dB(A)	66.5	67.0	66.5
		Heating	dB(A)	68.5	69.0	68.0
Sound power level		Cooling	dB(A)	85.5	86.0	86.0
		Heating	dB(A)	87.5	88.0	88.0
Operation temperature range		Cooling	CDB	-5.0 to 46.0	-5.0 to 46.0	-5.0 to 46.0
		Heating(*6)	CWB	-25.0 to 15.5	-25.0 to 15.5	-25.0 to 15.5

### Note

(\*)1) Rated conditions

Cooling : Indoor 27 degC Dry Bulb /19 degC Wet Bulb , Outdoor 35 degC Dry Bulb.

Heating : Indoor 20 degC Dry Bulb, Outdoor 7 degC Dry Bulb / 6 degC WetBulb.

Based on equivalent piping length of 7.5m and piping height difference of 0m.

(\*)2) Voltage range : Units are suitable for use on electrical systems where voltage supplied to unit terminal is not below or above listed range limits.

(\*)3) Discharge temp. sensor / Suction temp. sensor / High-pressure sensor / Low-pressure sensor / Compressor case thermostat / PC board fuse

(\*)4) Select wire size base on the larger value of MCA.

MCA : Minimum Circuit Amps

(\*)5) MOCP : Maximum Overcurrent Protection(Amps)

(\*)6) Low ambient heating (-20degC or less) for extended periods of time is not allowed

## 5 Outdoor Unit



Model	Name	Heat pump		MMY-AP5216HT8P-E	MMY-AP5416HT8P-E	MMY-AP5616HT8P-E		
	Combination	Heat pump		MMY-MAP2006HT8P-E	MMY-MAP2206HT8P-E	MMY-MAP2006HT8P-E		
				MMY-MAP1606HT8P-E	MMY-MAP1606HT8P-E	MMY-MAP2006HT8P-E		
				MMY-MAP1606HT8P-E	MMY-MAP1606HT8P-E	MMY-MAP1606HT8P-E		
Outdoor unit type			Inverter unit	Inverter unit	Inverter unit	Inverter unit		
Cooling capacity (*1)			kW	146.0	151.5	157.0		
Heating capacity (*1)			kW	163.0	164.0	176.0		
Capacity range			HP	52	54	56		
Power supply				3N~ 50Hz 400V(380-415V)	3N~ 50Hz 400V(380-415V)	3N~ 50Hz 400V(380-415V)		
Voltage range (*2)		Minimum	V	342	342	342		
		Maximum	V	456	456	456		
Electrical characteristic (*1)	Cooling	Running current	A	71.6	80.4	76.0		
		Power input	kW	45.9	51.8	48.9		
		EER	kW/kW	3.18	2.92	3.21		
	Heating	Running current	A	66.5	66.9	72.4		
		Power input	kW	42.8	42.9	46.9		
		COP	kW/kW	3.81	3.82	3.75		
	Starting current		A	Soft Start	Soft Start	Soft Start		
	Weight		kg	371 + 300 + 300	371 + 300 + 300	371 + 371 + 300		
Colour				Silky shade (Munsell 1Y8.5/0.5)	Silky shade (Munsell 1Y8.5/0.5)	Silky shade (Munsell 1Y8.5/0.5)		
Compressor	Type			Hermetic twin rotary compressor	Hermetic twin rotary compressor	Hermetic twin rotary compressor		
	Motor output		kW	7.6x2 + 5.8x2 + 5.8x2	9.0x2 + 5.8x2 + 5.8x2	7.6x2 + 7.6x2 + 5.8x2		
Fan unit	Fan			Propeller fan	Propeller fan	Propeller fan		
	Motor output		kW	2.0 + 1.0 + 1.0	2.0 + 1.0 + 1.0	2.0 + 2.0 + 1.0		
	Air volume		m3/h	17900 + 12600 + 12600	18500 + 12600 + 12600	17900 + 17900 + 12600		
Max. external static pressure			Pa	40	40	40		
Heat exchanger				Finned tube	Finned tube	Finned tube		
Refrigerant	Name			R410A	R410A	R410A		
	Charge	Heat pump	kg	11.5 + 11.5 + 11.5	11.5 + 11.5 + 11.5	11.5 + 11.5 + 11.5		
High-pressure switch			Pa	OFF:3.2 ON:4.15	OFF:3.2 ON:4.15	OFF:3.2 ON:4.15		
Protective devices				(*)3	(*)3	(*)3		
Power supply wiring		MCA (*4)	A	116.5	120.9	125.6		
		MOCP (*5)	A	160.0	160.0	160.0		
Piping connections	Gas	Type		Brazing	Brazing	Brazing		
		Diameter	mm	41.3	41.3	41.3		
	Liquid	Type		Flare	Flare	Flare		
		Diameter	mm	22.2	22.2	22.2		
	Balance	Type		Flare	Flare	Flare		
		Diameter	mm	9.5	9.5	9.5		
Max. number of connected indoor units				64	64	64		
Sound pressure level		Cooling	dB(A)	66.5	66.5	66.5		
		Heating	dB(A)	68.5	68.5	67.5		
Sound power level		Cooling	dB(A)	86.5	86.5	86.5		
		Heating	dB(A)	88.5	88.5	88.5		
Operation temperature range		Cooling	CDB	-5.0 to 46.0	-5.0 to 46.0	-5.0 to 46.0		
		Heating(*6)	CWB	-25.0 to 15.5	-25.0 to 15.5	-25.0 to 15.5		

### Note

(\*1) Rated conditions

Cooling : Indoor 27 degC Dry Bulb /19 degC Wet Bulb , Outdoor 35 degC Dry Bulb.

Heating : Indoor 20 degC Dry Bulb, Outdoor 7 degC Dry Bulb / 6 degC WetBulb.

Based on equivalent piping length of 7.5m and piping height difference of 0m.

(\*2) Voltage range : Units are suitable for use on electrical systems where voltage supplied to unit terminal is not below or above listed range limits.

(\*3) Discharge temp. sensor / Suction temp. sensor / High-pressure sensor / Low-pressure sensor / Compressor case thermostat / PC board fuse

(\*4) Select wire size base on the larger value of MCA.

MCA : Minimum Circuit Amps

(\*5) MOCP : Maximum Overcurrent Protection(Amps)

(\*6) Low ambient heating (-20degC or less) for extended periods of time is not allowed

## 5 Outdoor Unit



Model	Name	Heat pump		MMY-AP5816HT8P-E	MMY-AP6016HT8P-E
	Combination	Heat pump		MMY-MAP2206HT8P-E	MMY-MAP2206HT8P-E
				MMY-MAP2006HT8P-E	MMY-MAP2206HT8P-E
				MMY-MAP1606HT8P-E	MMY-MAP1606HT8P-E
Outdoor unit type			Inverter unit	Inverter unit	
Cooling capacity (*1)		kW	162.5	168.0	
Heating capacity (*1)		kW	177.0	178.0	
Capacity range		HP	58	60	
Power supply			3N~ 50Hz 400V(380-415V)	3N~ 50Hz 400V(380-415V)	
Voltage range (*2)		Minimum	V	342	342
		Maximum	V	456	456
Electrical characteristic (*1)	Cooling	Running current	A	84.8	93.6
		Power input	kW	54.8	60.7
		EER	kW/kW	2.97	2.77
	Heating	Running current	A	72.8	73.2
		Power input	kW	47.0	47.1
		COP	kW/kW	3.77	3.78
	Starting current		A	Soft Start	Soft Start
	Weight	Heat pump	kg	371 + 371 + 300	371 + 371 + 300
Colour			Silky shade (Munsell 1Y8.5/0.5)	Silky shade (Munsell 1Y8.5/0.5)	
Compressor	Type		Hermetic twin rotary compressor	Hermetic twin rotary compressor	
	Motor output	kW	9.0x2 + 7.6x2 + 5.8x2	9.0x2 + 9.0x2 + 5.8x2	
Fan unit	Fan		Propeller fan	Propeller fan	
	Motor output	kW	2.0 + 2.0 + 1.0	2.0 + 2.0 + 1.0	
	Air volume	m3/h	18500 + 17900 + 12600	18500 + 18500 + 12600	
Max. external static pressure			Pa	40	40
Heat exchanger			Finned tube	Finned tube	
Refrigerant	Name		R410A	R410A	
	Charge	Heat pump	kg	11.5 + 11.5 + 11.5	11.5 + 11.5 + 11.5
High-pressure switch			Pa	OFF:3.2 ON:4.15	OFF:3.2 ON:4.15
Protective devices				(*3)	(*3)
Power supply wiring	MCA (*4)	A	130.0	134.4	
	MOCP (*5)	A	160.0	160.0	
Piping connections	Gas	Type	Brazing	Brazing	
		Diameter	mm	41.3	41.3
	Liquid	Type	Flare	Flare	
		Diameter	mm	22.2	22.2
	Balance	Type	Flare	Flare	
		Diameter	mm	9.5	9.5
Max. number of connected indoor units				64	64
Sound pressure level	Cooling	dB(A)	66.5	66.5	
	Heating	dB(A)	67.5	67.5	
Sound power level	Cooling	dB(A)	87.0	87.5	
	Heating	dB(A)	88.5	88.5	
Operation temperature range	Cooling	CDB	-5.0 to 46.0	-5.0 to 46.0	
	Heating(*6)	CWB	-25.0 to 15.5	-25.0 to 15.5	

### Note

(\*1) Rated conditions

Cooling : Indoor 27 degC Dry Bulb /19 degC Wet Bulb , Outdoor 35 degC Dry Bulb.

Heating : Indoor 20 degC Dry Bulb, Outdoor 7 degC Dry Bulb / 6 degC WetBulb.

Based on equivalent piping length of 7.5m and piping height difference of 0m.

(\*2) Voltage range : Units are suitable for use on electrical systems where voltage supplied to unit terminal is not below or above listed range limits.

(\*3) Discharge temp. sensor / Suction temp. sensor / High-pressure sensor / Low-pressure sensor / Compressor case thermostat / PC board fuse

(\*4) Select wire size base on the larger value of MCA.

MCA : Minimum Circuit Amps

(\*5) MOCP : Maximum Overcurrent Protection(Amps)

(\*6) Low ambient heating (-20degC or less) for extended periods of time is not allowed

## 5 Outdoor Unit



### High efficiency / Heating capacity priority model

Model	Name	Heat pump		MMY-AP2026HT8P-E	MMY-AP2226HT8P-E
	Combination	Heat pump		MMY-MAP1006HT8P-E	MMY-MAP1206HT8P-E
Outdoor unit type			Inverter unit	Inverter unit	
Cooling capacity (*1)		kW	56.0	61.5	
Heating capacity (*1)		kW	63.0	69.0	
Capacity range		HP	20	22	
Power supply			3N~ 50Hz 400V(380-415V)	3N~ 50Hz 400V(380-415V)	
Voltage range (*2)	Minimum	V	342	342	
	Maximum	V	456	456	
Electrical characteristic (*1)	Cooling	Running current	A	24.2	27.6
		Power input	kW	15.4	17.7
		EER	kW/kW	3.64	3.48
	Heating	Running current	A	23.2	26.6
		Power input	kW	14.8	17.1
		COP	kW/kW	4.25	4.04
Starting current		A	Soft Start	Soft Start	
Weight	Heat pump	kg	242 + 242	242 + 242	
Colour			Silky shade (Munsell 1Y8.5/0.5)	Silky shade (Munsell 1Y8.5/0.5)	
Compressor	Type		Hermetic twin rotary compressor	Hermetic twin rotary compressor	
	Motor output	kW	3.1x2 + 3.1x2	3.9x2 + 3.1x2	
Fan unit	Fan		Propeller fan	Propeller fan	
	Motor output	kW	1.0 + 1.0	1.0 + 1.0	
	Air volume	m3/h	9700 + 9700	12200 + 9700	
Max. external static pressure		Pa	60	50	
Heat exchanger			Finned tube	Finned tube	
Refrigerant	Name		R410A	R410A	
	Charge	Heat pump	kg	11.5 + 11.5	11.5 + 11.5
High-pressure switch		Pa	OFF:3.2 ON:4.15	OFF:3.2 ON:4.15	
Protective devices			(*3)	(*3)	
Power supply wiring	MCA (*4)	A	43.0	47.6	
	MOCP (*5)	A	50.0	63.0	
Piping connections	Gas	Type	Brazing	Brazing	
		Diameter	mm	28.6	28.6
	Liquid	Type	Flare	Flare	
		Diameter	mm	15.9	19.1
	Balance	Type	Flare	Flare	
		Diameter	mm	9.5	9.5
Max. number of connected indoor units			45	49	
Sound pressure level	Cooling	dB(A)	60.0	61.5	
	Heating	dB(A)	61.0	63.0	
Sound power level	Cooling	dB(A)	77.0	81.0	
	Heating	dB(A)	77.0	83.0	
Operation temperature range	Cooling	CDB	-5.0 to 46.0	-5.0 to 46.0	
	Heating(*6)	CWB	-25.0 to 15.5	-25.0 to 15.5	

Note

(\*1) Rated conditions

Cooling : Indoor 27 degC Dry Bulb /19 degC Wet Bulb , Outdoor 35 degC Dry Bulb.

Heating : Indoor 20 degC Dry Bulb, Outdoor 7 degC Dry Bulb / 6 degC WetBulb.

Based on equivalent piping length of 7.5m and piping height difference of 0m.

(\*2) Voltage range : Units are suitable for use on electrical systems where voltage supplied to unit terminal is not below or above listed range limits.

(\*3) Discharge temp. sensor / Suction temp. sensor / High-pressure sensor / Low-pressure sensor / Compressor case thermostat / PC board fuse

(\*4) Select wire size base on the larger value of MCA.

MCA : Minimum Circuit Amps

(\*5) MOCP : Maximum Overcurrent Protection(Amps)

(\*6) Low ambient heating (-20degC or less) for extended periods of time is not allowed

## 5 Outdoor Unit



Model	Name	Heat pump		MMY-AP3626HT8P-E	MMY-AP3826HT8P-E	MMY-AP4026HT8P-E	
	Combination	Heat pump		MMY-MAP1206HT8P-E	MMY-MAP1406HT8P-E	MMY-MAP1406HT8P-E	
				MMY-MAP1206HT8P-E	MMY-MAP1206HT8P-E	MMY-MAP1406HT8P-E	
				MMY-MAP1206HT8P-E	MMY-MAP1206HT8P-E	MMY-MAP1206HT8P-E	
Outdoor unit type		Inverter unit		Inverter unit		Inverter unit	
Cooling capacity (*1)		kW		100.5	107.0	113.5	
Heating capacity (*1)		kW		112.5	120.0	127.5	
Capacity range		HP		36	38	40	
Power supply				3N~ 50Hz 400V(380-415V)	3N~ 50Hz 400V(380-415V)	3N~ 50Hz 400V(380-415V)	
Voltage range (*2)	Minimum	V		342	342	342	
	Maximum	V		456	456	456	
Electrical characteristic (*1)	Cooling	Running current	A	46.5	50.5	54.5	
		Power input	kW	30.0	32.3	34.6	
		EER	kW/kW	3.35	3.31	3.28	
	Heating	Running current	A	45.0	47.8	50.6	
		Power input	kW	29.0	30.5	32.1	
		COP	kW/kW	3.89	3.93	3.98	
	Starting current		A	Soft Start	Soft Start	Soft Start	
	Weight	Heat pump	kg	242 + 242 + 242	300 + 242 + 242	300 + 300 + 242	
Colour				Silky shade (Munsell 1Y8.5/0.5)	Silky shade (Munsell 1Y8.5/0.5)	Silky shade (Munsell 1Y8.5/0.5)	
Compressor	Type			Hermetic twin rotary compressor	Hermetic twin rotary compressor	Hermetic twin rotary compressor	
	Motor output	kW	3.9x2 + 3.9x2 + 3.9x2	4.8x2 + 3.9x2 + 3.9x2	4.8x2 + 4.8x2 + 3.9x2		
Fan unit	Fan			Propeller fan	Propeller fan	Propeller fan	
	Motor output	kW	1.0 + 1.0 + 1.0	1.0 + 1.0 + 1.0	1.0 + 1.0 + 1.0		
	Air volume	m3/h	12200 + 12200 + 12200	12200 + 12200 + 12200	12200 + 12200 + 12200		
Max. external static pressure		Pa		50	50	50	
Heat exchanger				Finned tube	Finned tube	Finned tube	
Refrigerant	Name			R410A	R410A	R410A	
	Charge	Heat pump	kg	11.5 + 11.5 + 11.5	11.5 + 11.5 + 11.5	11.5 + 11.5 + 11.5	
High-pressure switch			Pa	OFF:3.2 ON:4.15	OFF:3.2 ON:4.15	OFF:3.2 ON:4.15	
Protective devices				(*)3	(*)3	(*)3	
Power supply wiring	MCA (*4)	A		78.3	83.2	88.1	
	MOCP (*5)	A		100.0	100.0	100.0	
Piping connections	Gas	Type		Brazing	Brazing	Brazing	
		Diameter	mm	41.3	41.3	41.3	
	Liquid	Type		Flare	Flare	Flare	
		Diameter	mm	22.2	22.2	22.2	
	Balance	Type		Flare	Flare	Flare	
		Diameter	mm	9.5	9.5	9.5	
Max. number of connected indoor units				64	64	64	
Sound pressure level	Cooling	dB(A)		64.0	64.5	64.5	
	Heating	dB(A)		66.0	66.5	66.5	
Sound power level	Cooling	dB(A)		85.0	85.0	85.0	
	Heating	dB(A)		87.0	87.0	87.0	
Operation temperature range	Cooling	CDB		-5.0 to 46.0	-5.0 to 46.0	-5.0 to 46.0	
	Heating(*6)	CWB		-25.0 to 15.5	-25.0 to 15.5	-25.0 to 15.5	

Note

(\*1) Rated conditions

Cooling : Indoor 27 degC Dry Bulb /19 degC Wet Bulb , Outdoor 35 degC Dry Bulb.

Heating : Indoor 20 degC Dry Bulb, Outdoor 7 degC Dry Bulb / 6 degC WetBulb.

Based on equivalent piping length of 7.5m and piping height difference of 0m.

(\*2) Voltage range : Units are suitable for use on electrical systems where voltage supplied to unit terminal is not below or above listed range limits.

(\*3) Discharge temp. sensor / Suction temp. sensor / High-pressure sensor / Low-pressure sensor / Compressor case thermostat / PC board fuse

(\*4) Select wire size base on the larger value of MCA.

MCA : Minimum Circuit Amps

(\*5) MOCP : Maximum Overcurrent Protection(Amps)

(\*6) Low ambient heating (-20degC or less) for extended periods of time is not allowed

## 5 Outdoor Unit



Model	Name	Heat pump		MMY-AP4226HT8P-E	MMY-AP4426HT8P-E	MMY-AP5426HT8P-E
	Combination	Heat pump		MMY-MAP1406HT8P-E	MMY-MAP1606HT8P-E	MMY-MAP2006HT8P-E
				MMY-MAP1406HT8P-E	MMY-MAP1406HT8P-E	MMY-MAP2006HT8P-E
				MMY-MAP1406HT8P-E	MMY-MAP1406HT8P-E	MMY-MAP1406HT8P-E
Outdoor unit type		Inverter unit		Inverter unit		Inverter unit
Cooling capacity (*1)		kW		120.0	125.0	152.0
Heating capacity (*1)		kW		135.0	140.0	171.0
Capacity range		HP		42	44	54
Power supply				3N~ 50Hz 400V(380-415V)	3N~ 50Hz 400V(380-415V)	3N~ 50Hz 400V(380-415V)
Voltage range (*2)	Minimum	V		342	342	342
	Maximum	V		456	456	456
Electrical characteristic (*1)	Cooling	Running current	A	58.5	61.4	73.1
		Power input	kW	36.9	38.9	46.9
		EER	kW/kW	3.25	3.21	3.24
	Heating	Running current	A	53.4	55.8	70.0
		Power input	kW	33.6	35.3	45.2
		COP	kW/kW	4.02	3.97	3.78
	Starting current		A	Soft Start	Soft Start	Soft Start
	Weight		kg	300 + 300 + 300	300 + 300 + 300	371 + 371 + 300
Colour				Silky shade (Munsell 1Y8.5/0.5)	Silky shade (Munsell 1Y8.5/0.5)	Silky shade (Munsell 1Y8.5/0.5)
Compressor	Type			Hermetic twin rotary compressor	Hermetic twin rotary compressor	Hermetic twin rotary compressor
	Motor output	kW		4.8x2 + 4.8x2 + 4.8x2	5.8x2 + 4.8x2 + 4.8x2	7.6x2 + 7.6x2 + 4.8x2
Fan unit	Fan			Propeller fan	Propeller fan	Propeller fan
	Motor output	kW		1.0 + 1.0 + 1.0	1.0 + 1.0 + 1.0	2.0 + 2.0 + 1.0
	Air volume	m3/h		12200 + 12200 + 12200	12600 + 12200 + 12200	17900 + 17900 + 12200
Max. external static pressure		Pa		50	40	40
Heat exchanger				Finned tube	Finned tube	Finned tube
Refrigerant	Name			R410A	R410A	R410A
	Charge	Heat pump	kg	11.5 + 11.5 + 11.5	11.5 + 11.5 + 11.5	11.5 + 11.5 + 11.5
High-pressure switch			Pa	OFF:3.2 ON:4.15	OFF:3.2 ON:4.15	OFF:3.2 ON:4.15
Protective devices				(*)3	(*)3	(*)3
Power supply wiring	MCA (*4)	A		93.0	97.8	120.8
	MOCP (*5)	A		125.0	125.0	160.0
Piping connections	Gas	Type		Brazing	Brazing	Brazing
		Diameter	mm	41.3	41.3	41.3
	Liquid	Type		Flare	Flare	Flare
		Diameter	mm	22.2	22.2	22.2
	Balance	Type		Flare	Flare	Flare
		Diameter	mm	9.5	9.5	9.5
Max. number of connected indoor units				64	64	64
Sound pressure level	Cooling	dB(A)		65.0	65.5	65.5
	Heating	dB(A)		67.0	67.5	67.0
Sound power level	Cooling	dB(A)		85.0	85.5	86.5
	Heating	dB(A)		87.0	87.5	88.5
Operation temperature range	Cooling	CDB		-5.0 to 46.0	-5.0 to 46.0	-5.0 to 46.0
	Heating(*6)	CWB		-25.0 to 15.5	-25.0 to 15.5	-25.0 to 15.5

### Note

(\*1) Rated conditions

Cooling : Indoor 27 degC Dry Bulb /19 degC Wet Bulb , Outdoor 35 degC Dry Bulb.

Heating : Indoor 20 degC Dry Bulb, Outdoor 7 degC Dry Bulb / 6 degC WetBulb.

Based on equivalent piping length of 7.5m and piping height difference of 0m.

(\*2) Voltage range : Units are suitable for use on electrical systems where voltage supplied to unit terminal is not below or above listed range limits.

(\*3) Discharge temp. sensor / Suction temp. sensor / High-pressure sensor / Low-pressure sensor / Compressor case thermostat / PC board fuse

(\*4) Select wire size base on the larger value of MCA.

MCA : Minimum Circuit Amps

(\*5) MOCP : Maximum Overcurrent Protection(Amps)


(\*6) Low ambient heating (-20degC or less) for extended periods of time is not allowed



## 5-2. Dimensional drawing


### Single unit

Model : MMY-MAP0806HT8P-E  
 MMY-MAP1006HT8P-E  
 MMY-MAP1206HT8P-E

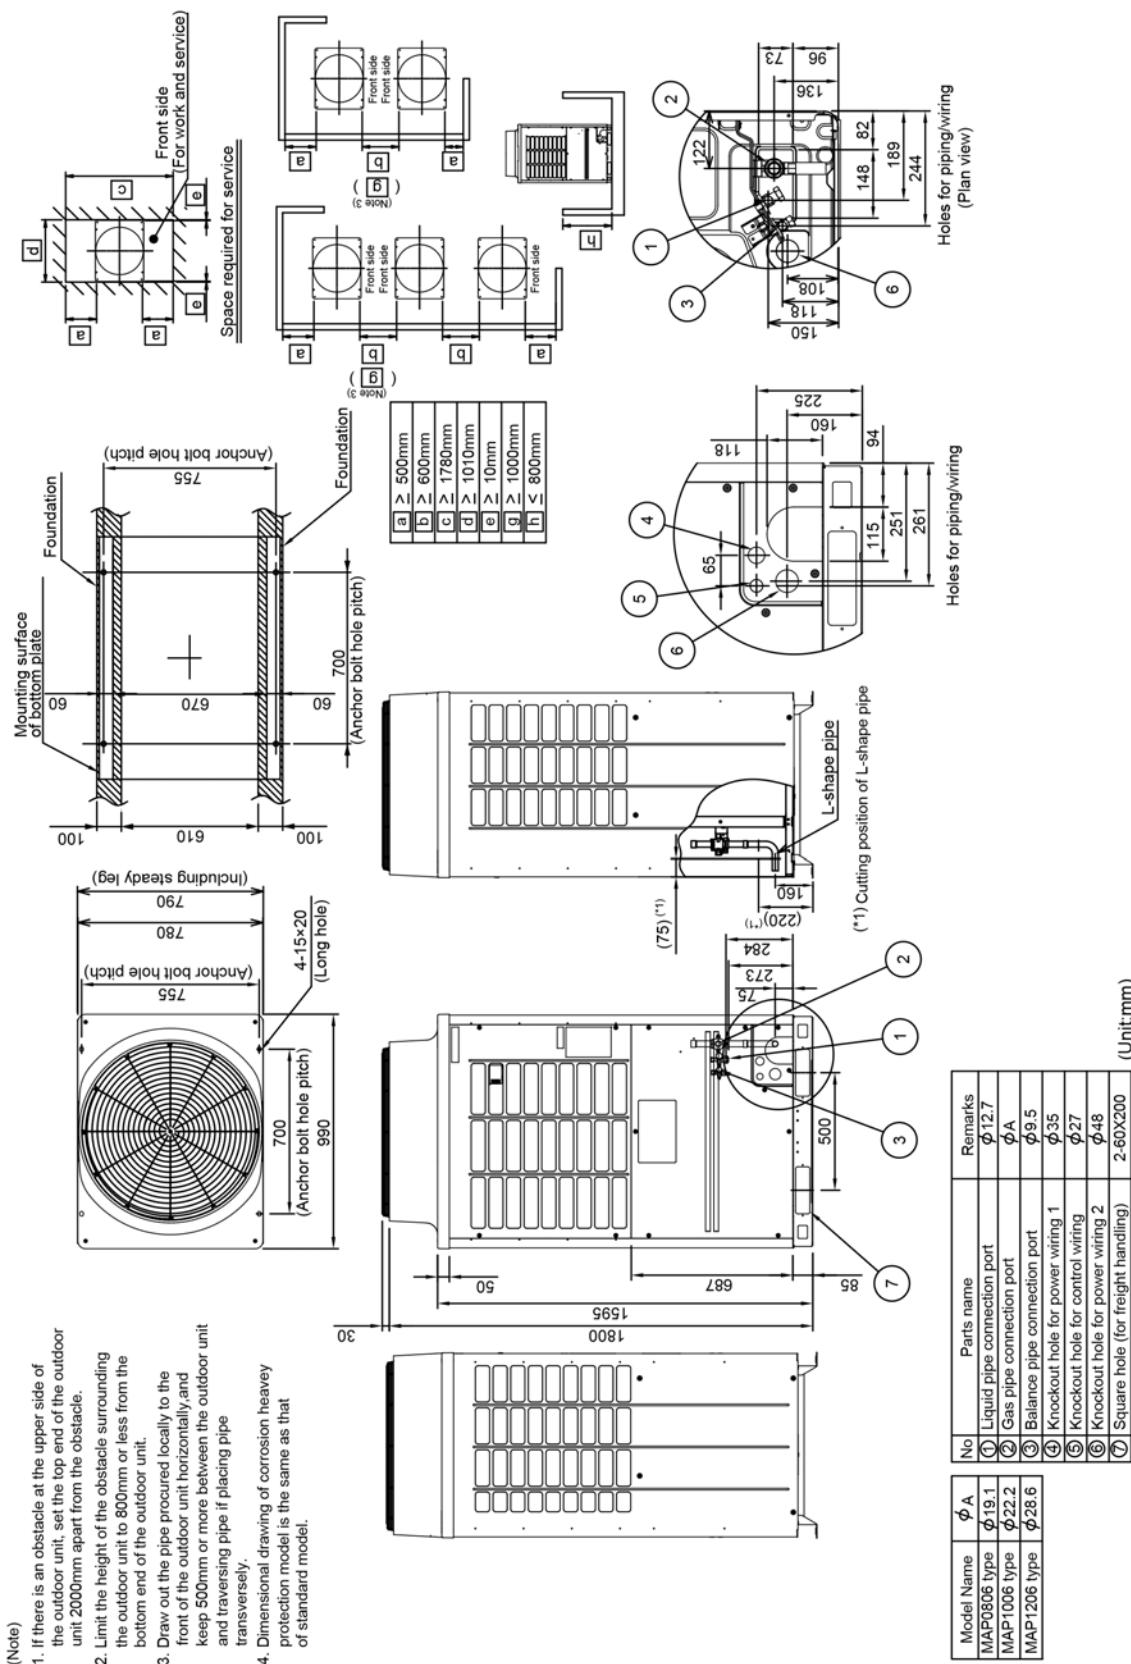




**Model : MMY-MAP1406HT8P-E  
MMY-MAP1606HT8P-E**

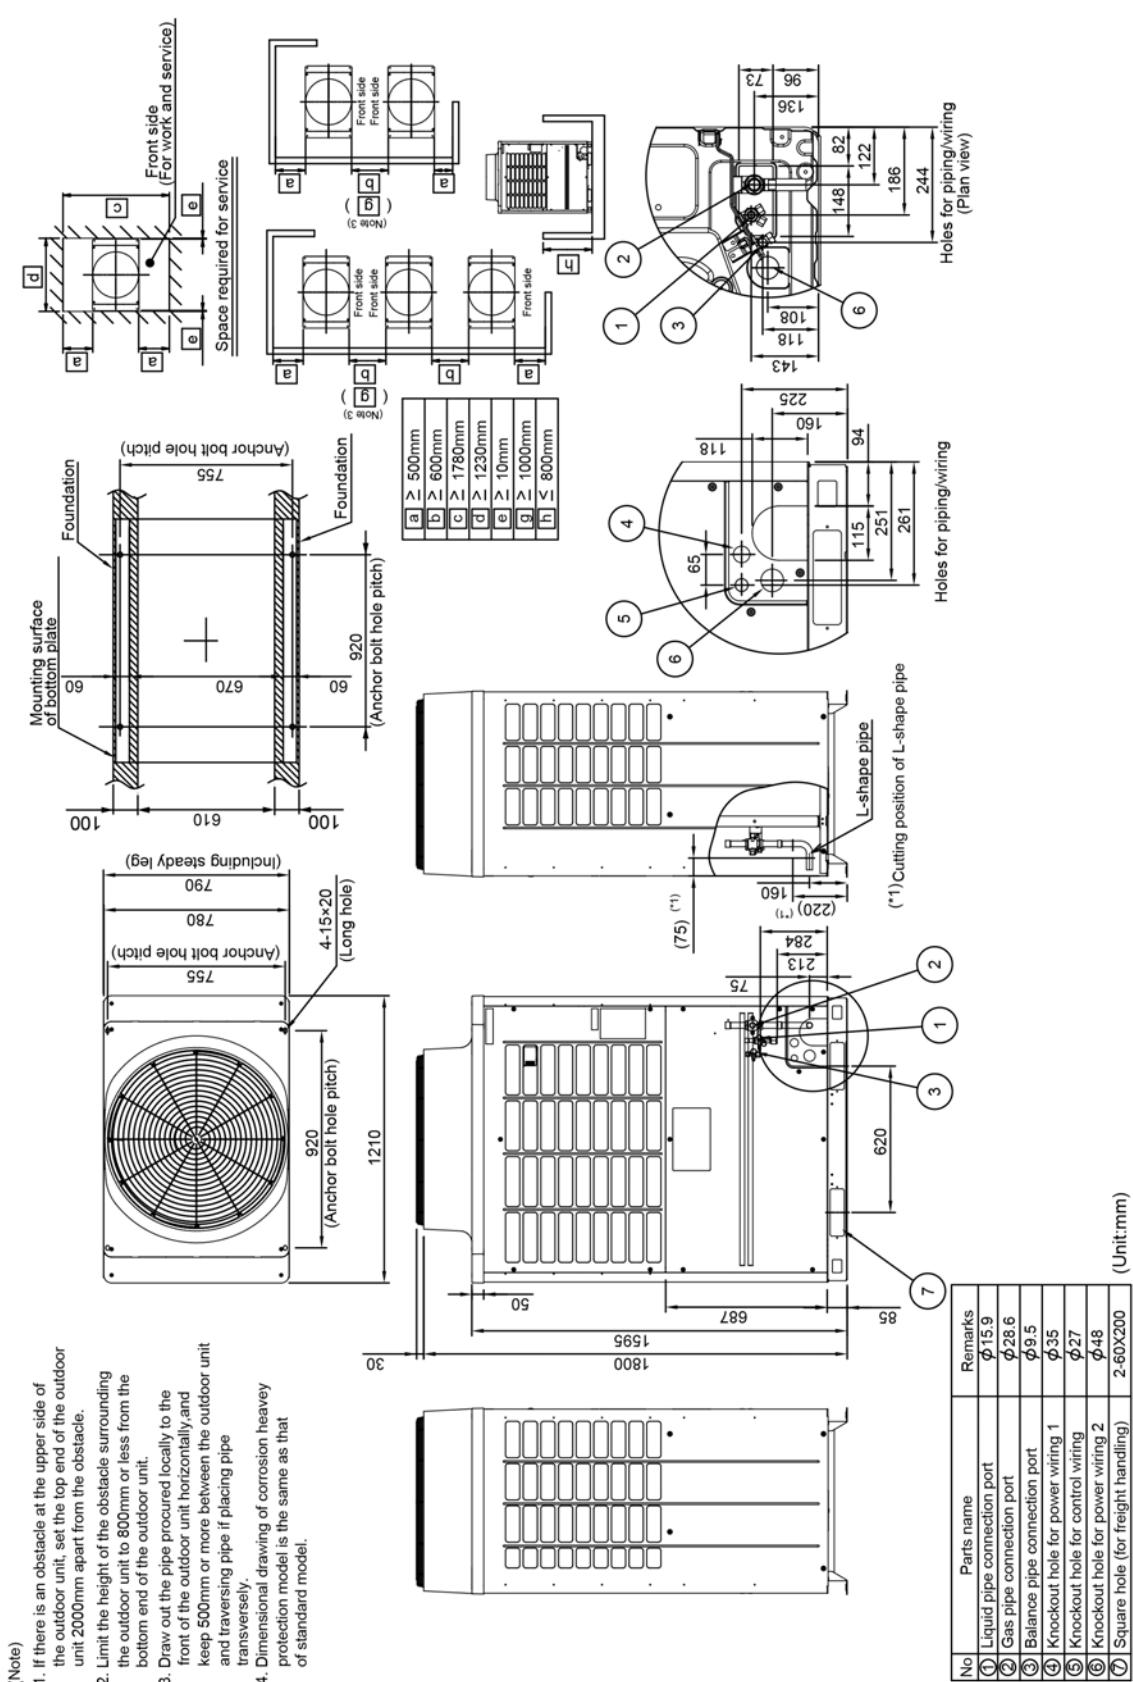

## 5 Outdoor unit

Model : MMY-MAP1806HT8P-E  
MMY-MAP2006HT8P-E  
MMY-MAP2206HT8P-E

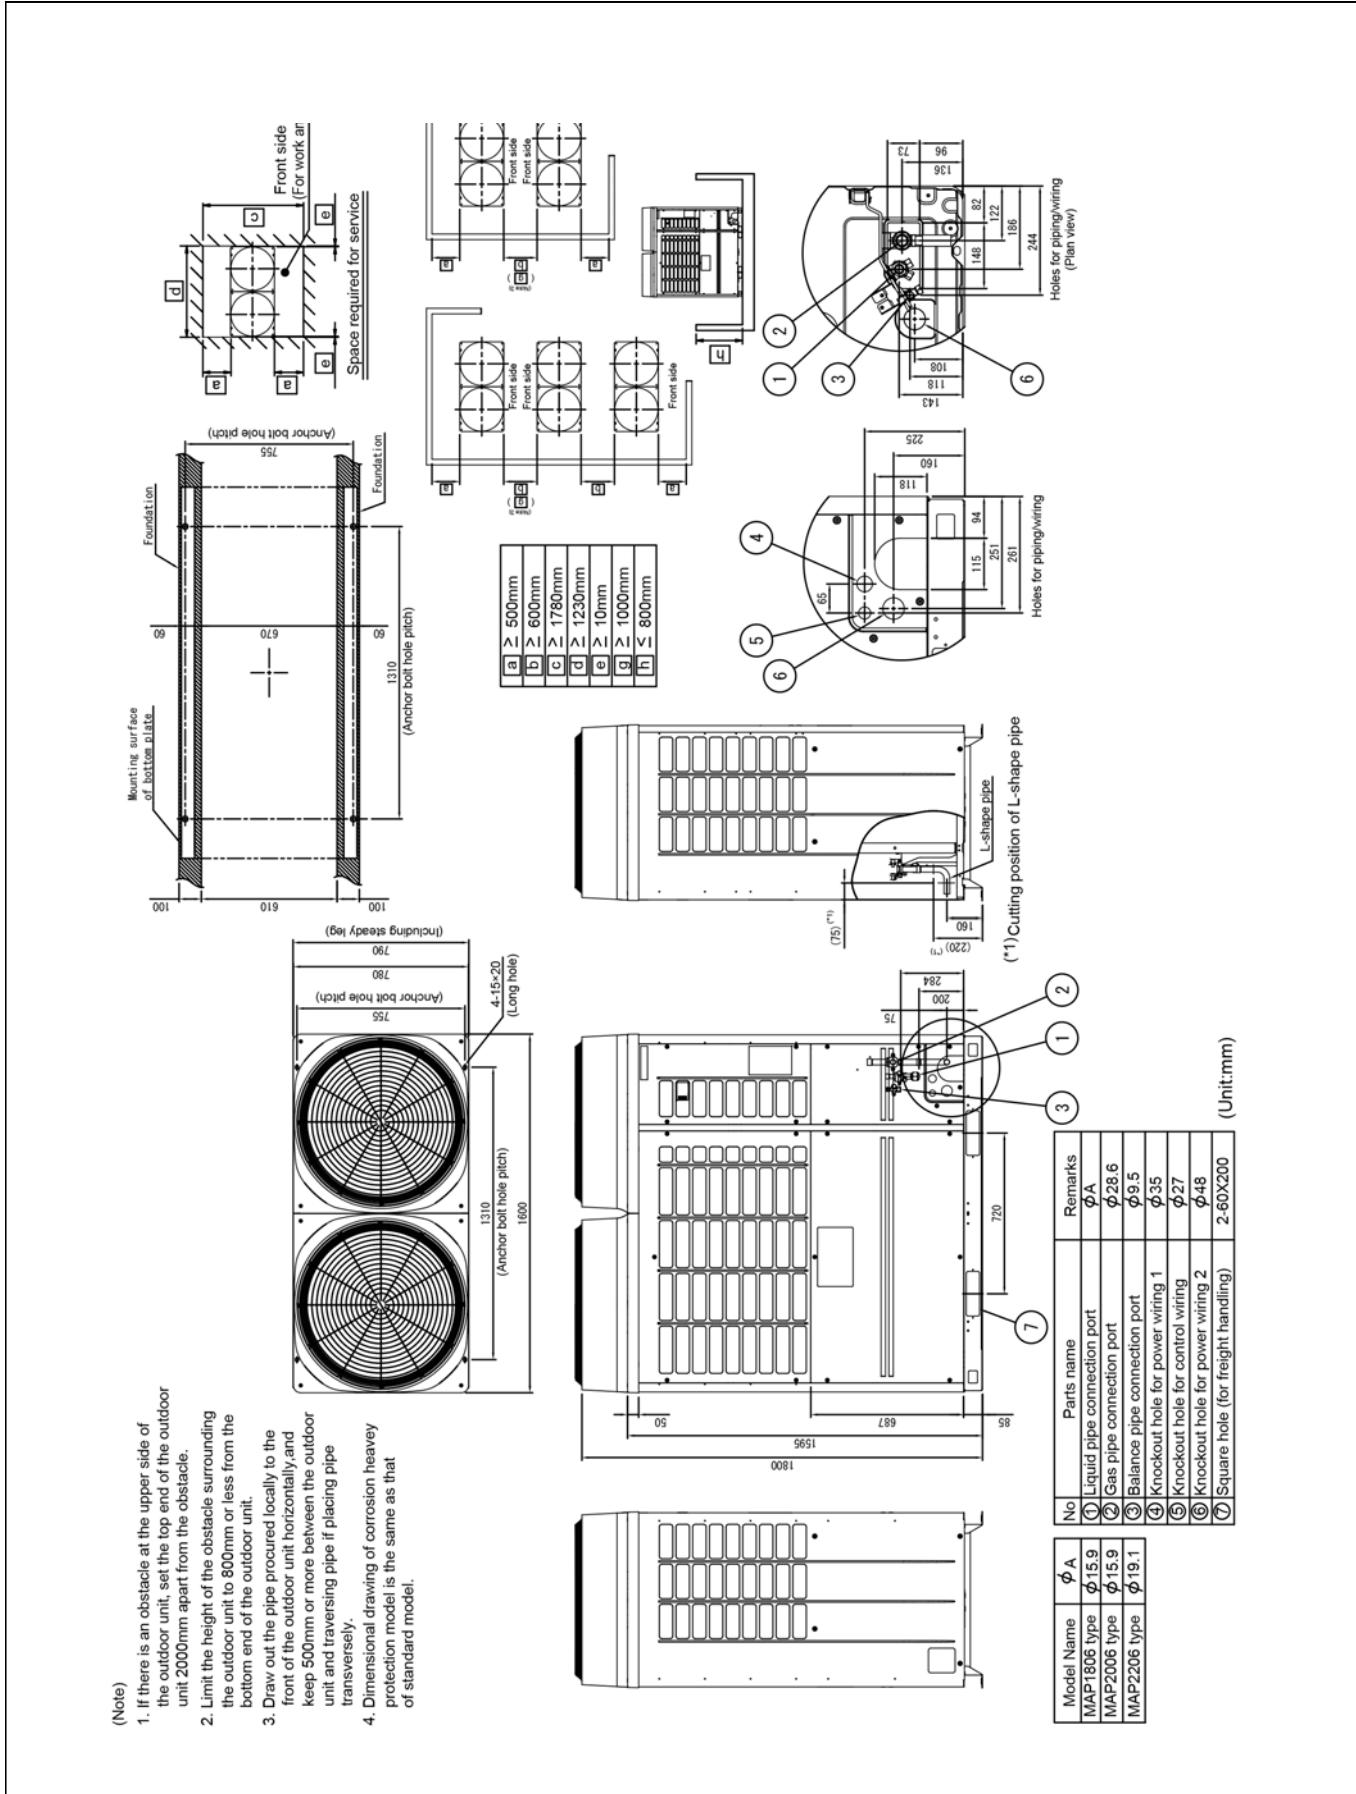

## 5 Outdoor unit





### Combination

(Note) All drawings are common with coding only model (MMY-AP-HT8P-E)

Two units connected

Model	Outdoor unit	
	(1) Header unit	(2) Follower unit
MMY-AP2026HT8P-E	MMY-MAP1006HT8P-E	MMY-MAP1006HT8P-E
MMY-AP2226HT8P-E	MMY-MAP1206HT8P-E	MMY-MAP1006HT8P-E
MMY-AP2416HT8P-E	MMY-MAP1206HT8P-E	MMY-MAP1206HT8P-E

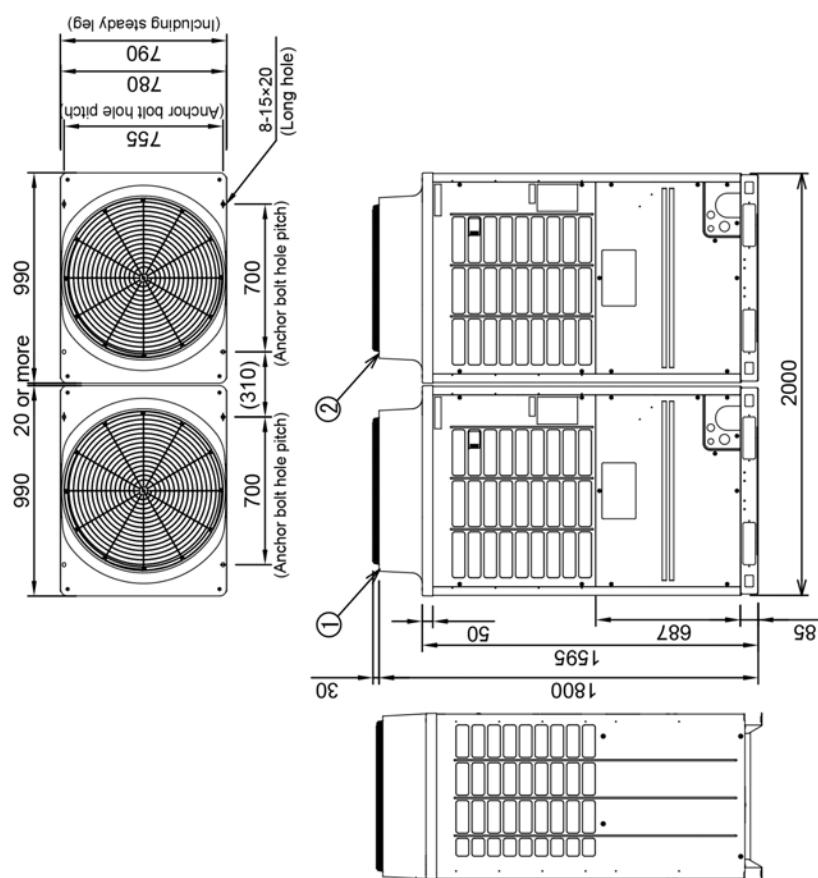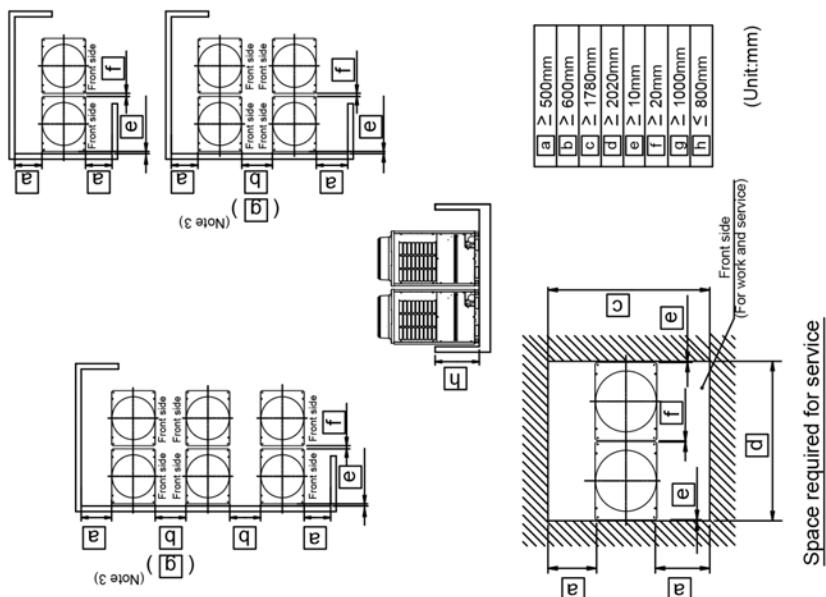


## 5 Outdoor unit



Model	Outdoor unit	
	(1) Header unit	(2) Follower unit
MMY-AP2616HT8P-E	MMY-MAP1406HT8P-E	MMY-MAP1206HT8P-E
MMY-AP2816HT8P-E	MMY-MAP1606HT8P-E	MMY-MAP1206HT8P-E

Two units connected

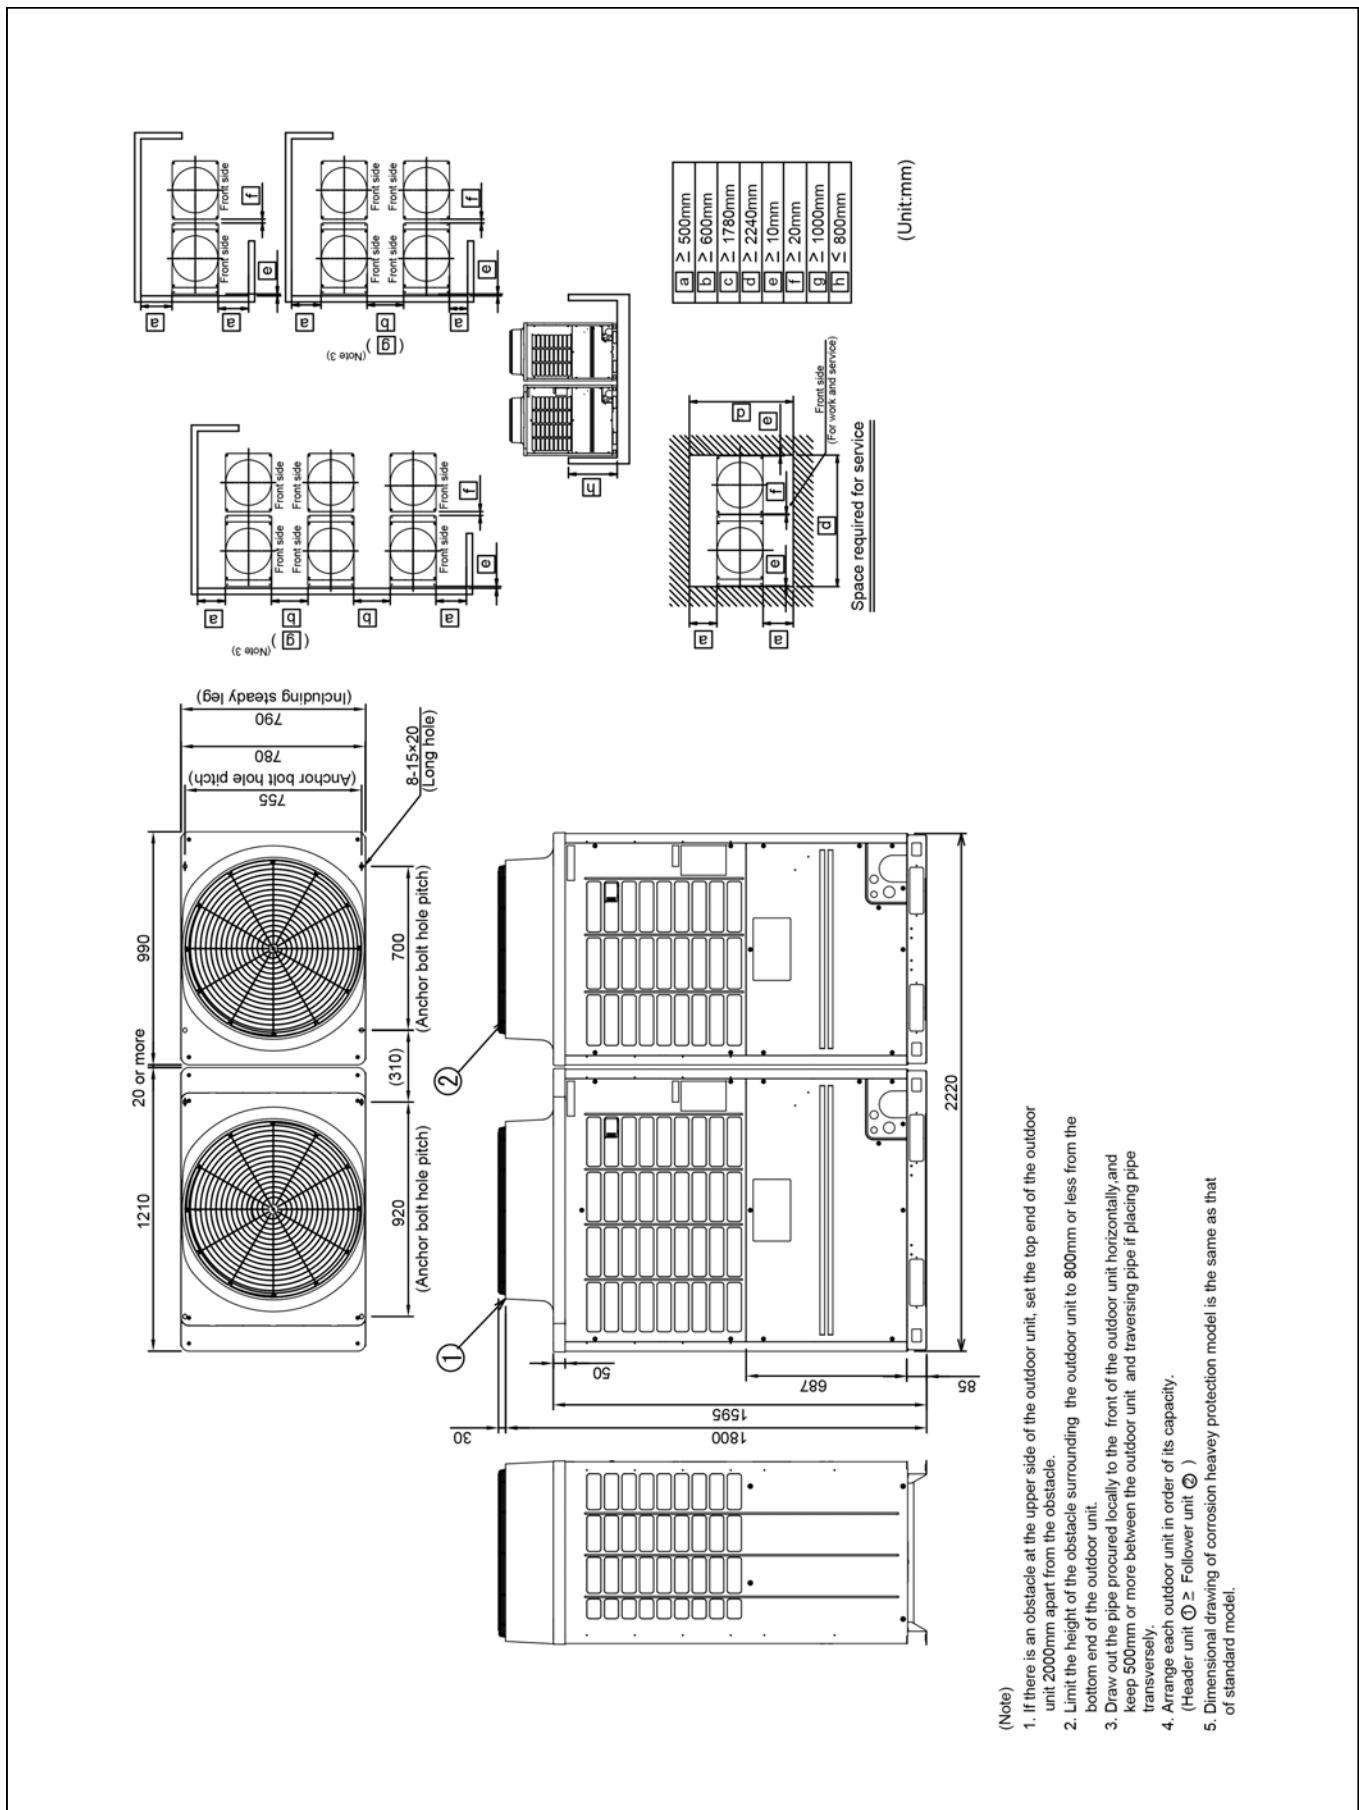


## 5 Outdoor unit



Model	Outdoor unit	
	(1) Header unit	(2) Follower unit
MMY-AP3016HT8P-E	MMY-MAP1606HT8P-E	MMY-MAP1406HT8P-E
MMY-AP3216HT8P-E	MMY-MAP1606HT8P-E	MMY-MAP1606HT8P-E

Two units connected

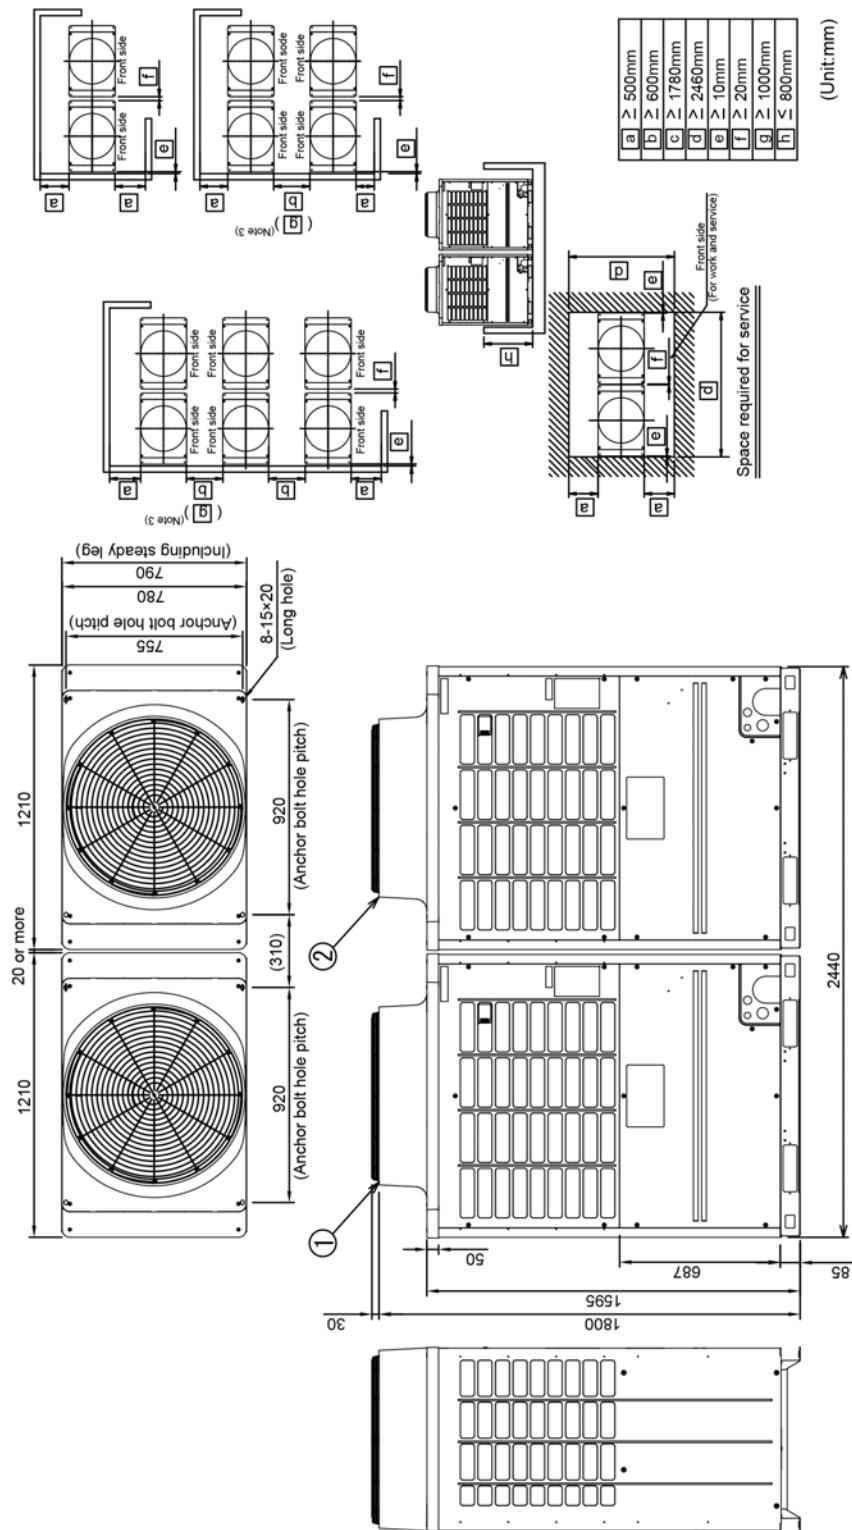

(Note)


- If there is an obstacle at the upper side of the outdoor unit, set the top end of the outdoor unit 2000mm apart from the obstacle.
- Limit the height of the obstacle surrounding the outdoor unit to 800mm or less from the bottom end of the outdoor unit.
- Draw out the pipe procured locally to the front of the outdoor unit horizontally and keep 500mm or more between the outdoor unit and traversing pipe if placing pipe transversely.
- Arrange each outdoor unit in order of its capacity.  
(Header unit ① ≥ Follower unit ②)
- Dimensional drawing of corrosion heavy protection model is the same as that of standard model.

## 5 *Outdoor unit*



Model	Outdoor unit	
	(1) Header unit	(2) Follower unit
MMY-AP3416HT8P-E	MMY-MAP1806HT8P-E	MMY-MAP1606HT8P-E
MMY-AP3616HT8P-E	MMY-MAP2006HT8P-E	MMY-MAP1606HT8P-E
MMY-AP3816HT8P-E	MMY-MAP2206HT8P-E	MMY-MAP1606HT8P-E

Two units connected

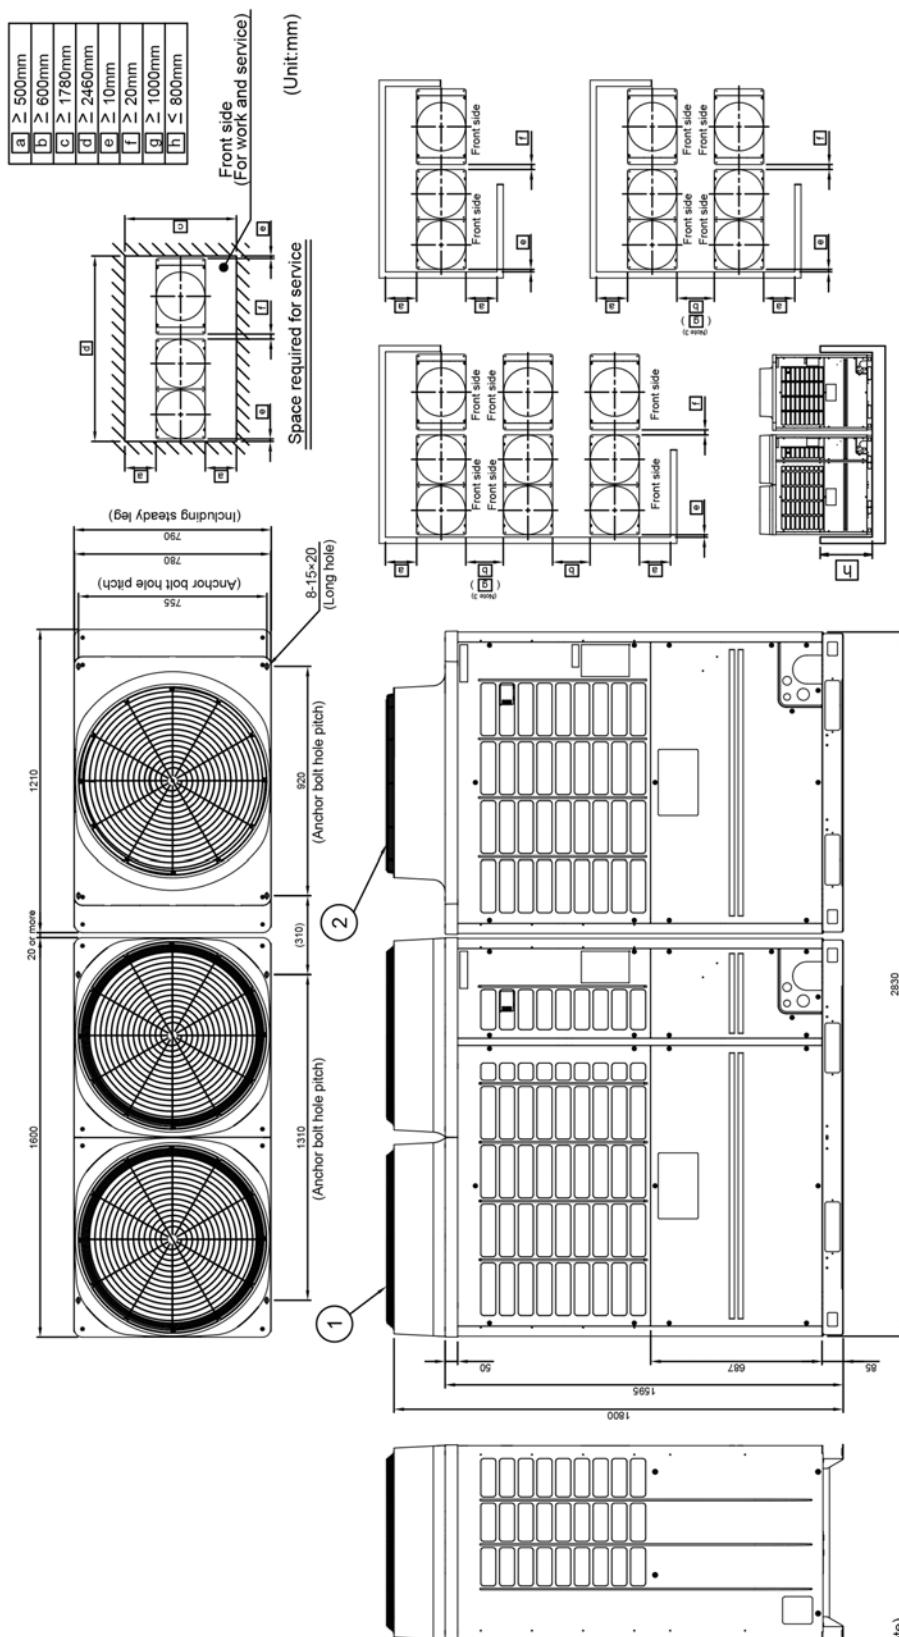

**(Note)** If there is an obstacle at the upper side of the outdoor unit, set the top end of the outdoor


- unit 2000mm apart from the obstacle.
  2. Limit the height of the obstacle surrounding the outdoor unit to 800mm or less from the bottom end of the outdoor unit.
  3. Draw out the pipe procured locally to the front of the outdoor unit horizontally and keep 500mm or more between the outdoor unit and traversing pipe if placing pipe transversely.
  4. Arrange each outdoor unit in order of its capacity.  
(Header unit  $\bigcirc \geq$  Follower unit  $\bigcirc$ )
  5. Dimensional drawing of corrosion heavy protection model is the same as that of standard model.

## 5 Outdoor unit



Model	Outdoor unit	
	(1) Header unit	(2) Follower unit
MMY-AP4016HT8P-E	MMY-MAP2006HT8P-E	MMY-MAP2006HT8P-E
MMY-AP4216HT8P-E	MMY-MAP2206HT8P-E	MMY-MAP2006HT8P-E
MMY-AP4416HT8P-E	MMY-MAP2206HT8P-E	MMY-MAP2206HT8P-E

Two units connected

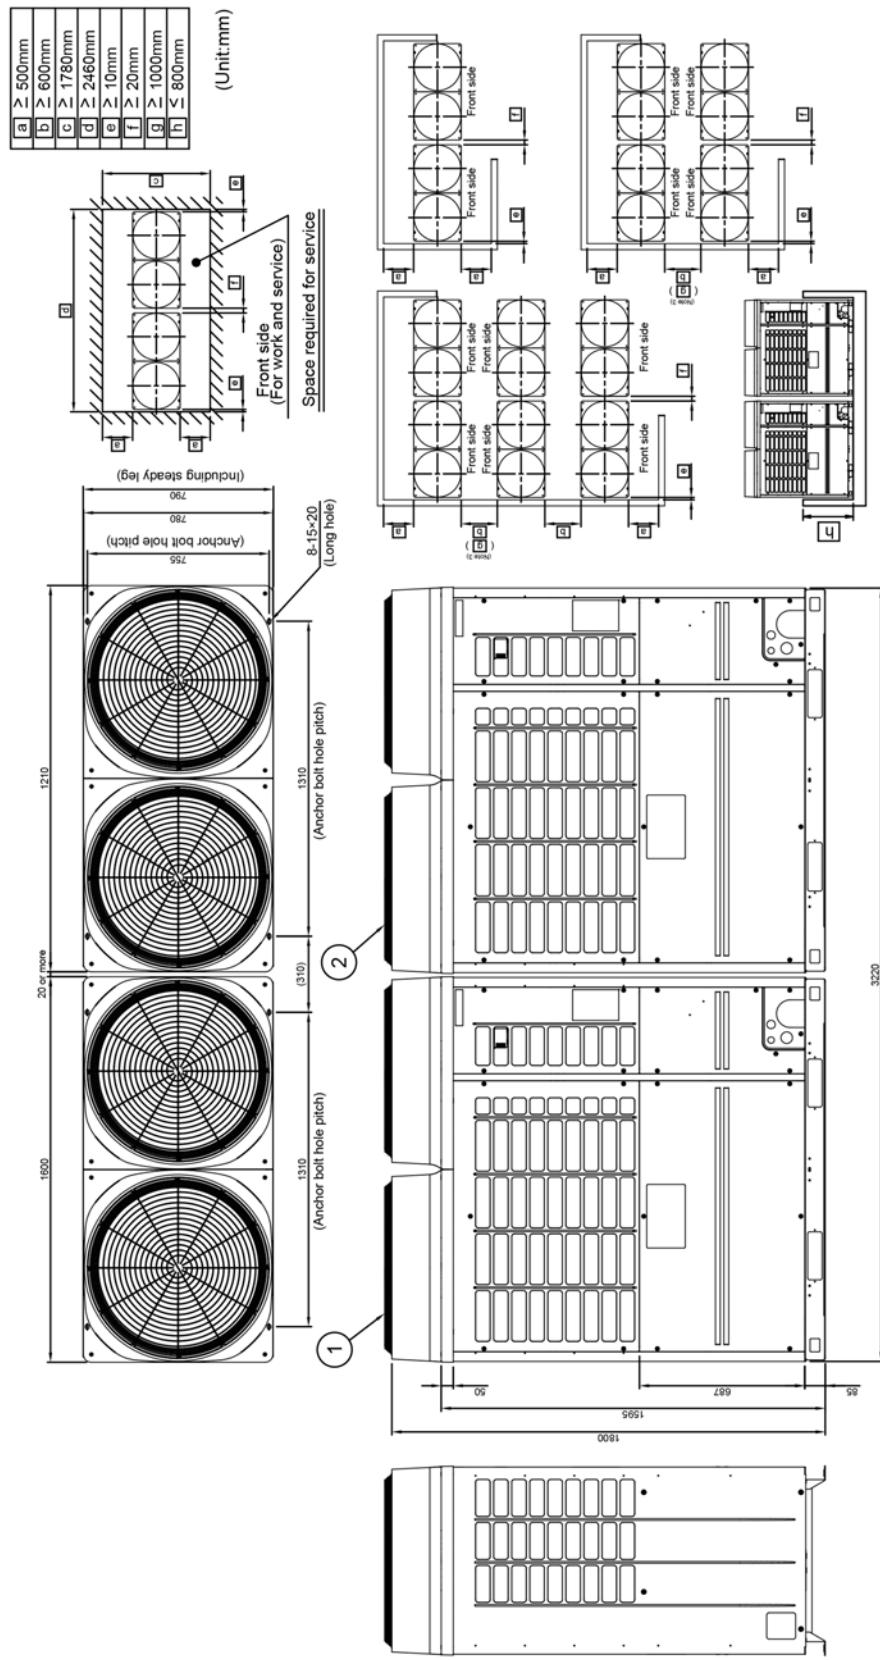


- (Note)
- If there is an obstacle at the upper side of the outdoor unit, set the top end of the outdoor unit 200mm apart from the obstacle.
  - Limit the height of the obstacle surrounding the outdoor unit to 800mm or less from the bottom end of the outdoor unit.
  - Draw out the pipe procured locally to the front of the outdoor unit horizontally and keep 500mm or more between the outdoor unit and traversing pipe if placing pipe transversely.
  - Arrange each outdoor unit in order of its capacity.  
(Header unit ① ≥ Follower unit ②)
  - Dimensional drawing of corrosion heavy protection model is the same as that of standard model.

## 5 Outdoor unit



Model	Outdoor unit			Three units connected
	(1) Header unit	(2) Follower unit	(3) Follower unit	
MMY-AP3626HT8P-E	MMY-MAP1206HT8P-E	MMY-MAP1206HT8P-E	MMY-MAP1206HT8P-E	

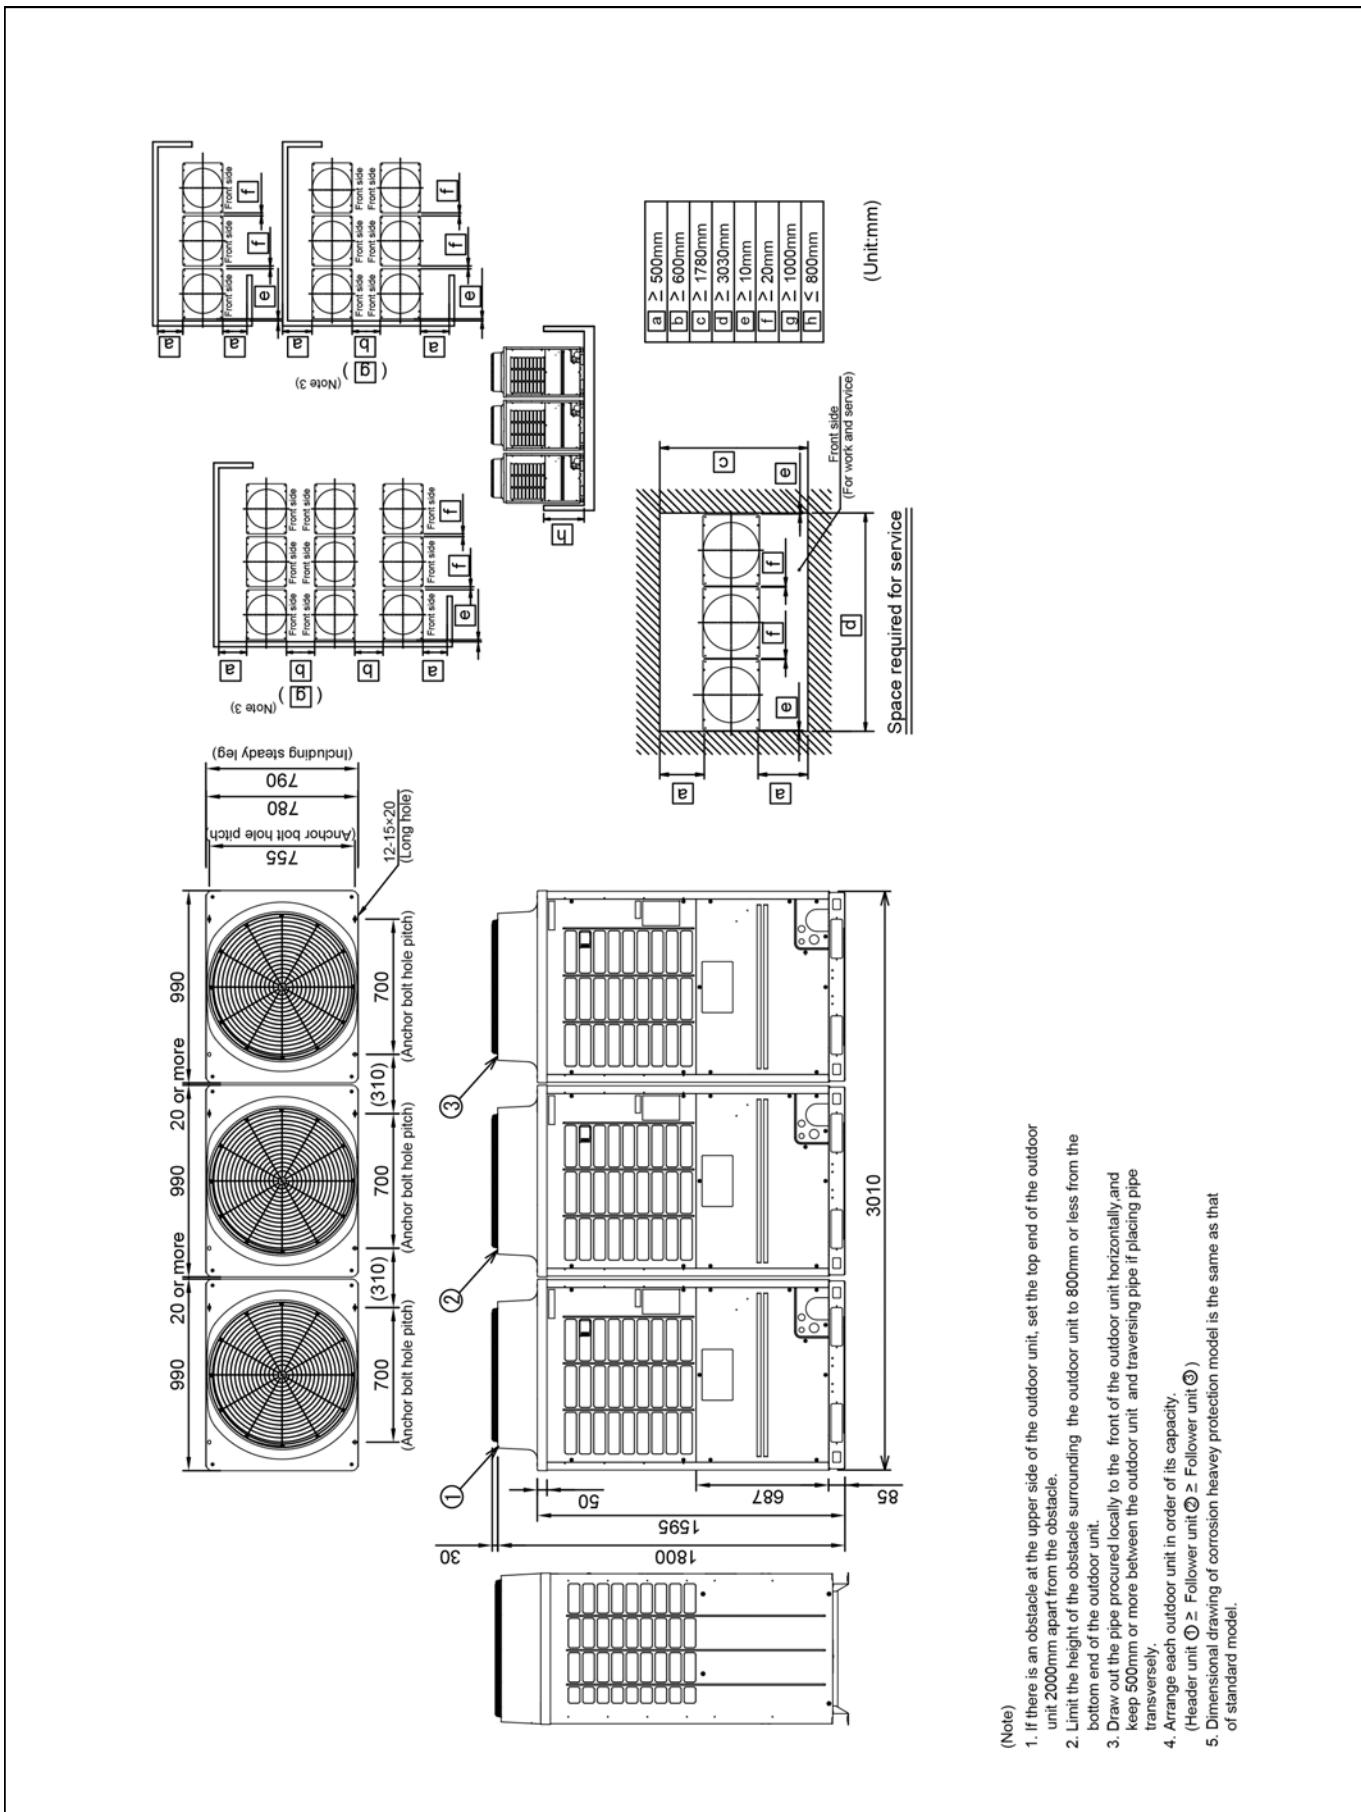


## 5 Outdoor unit



Model	Outdoor unit		
	(1) Header unit	(2) Follower unit	(3) Follower unit
MMY-AP3826HT8P-E	MMY-MAP1406HT8P-E	MMY-MAP1206HT8P-E	MMY-MAP1206HT8P-E

Three units connected

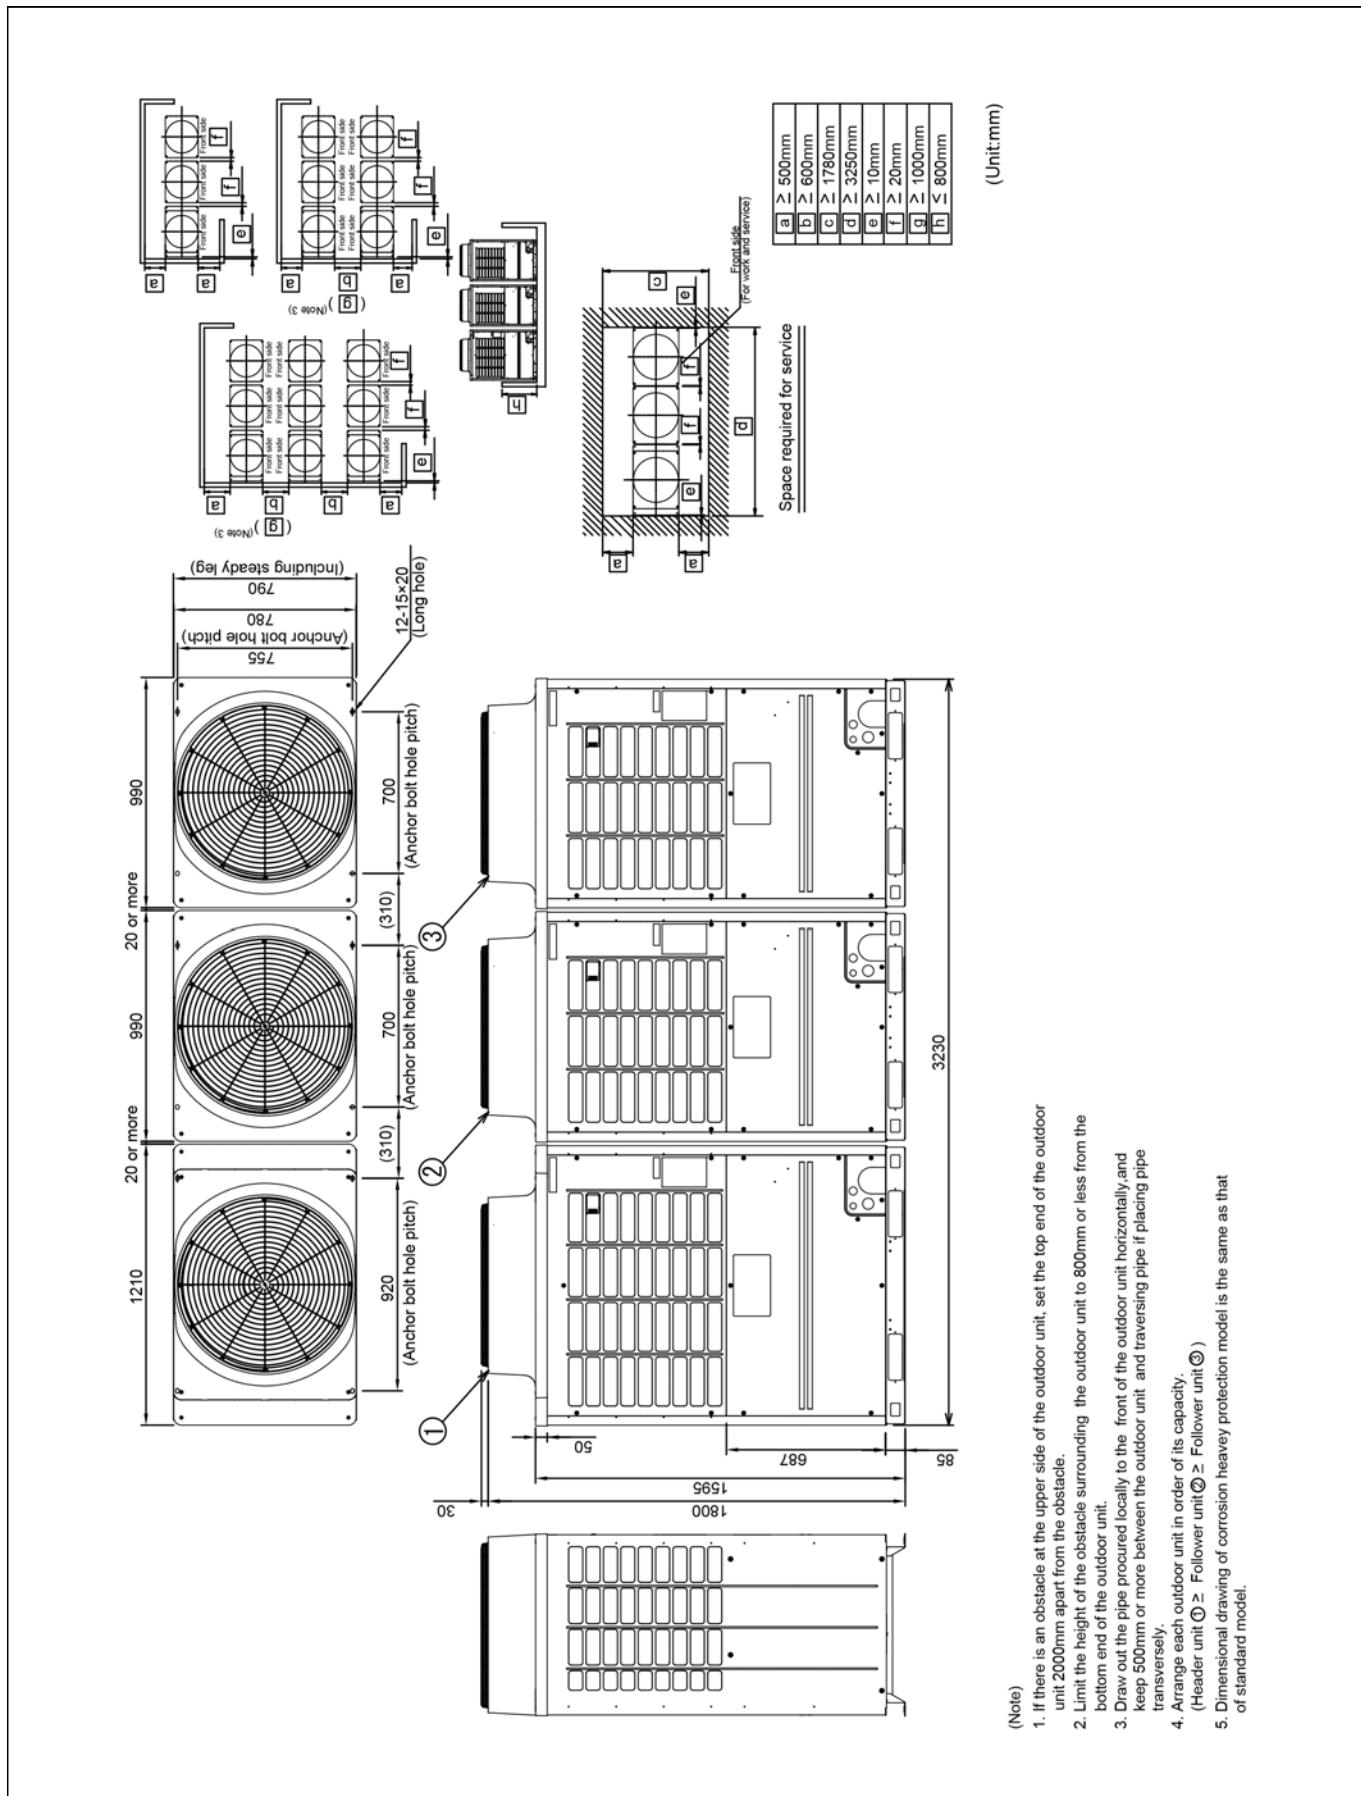

(Note)


- If there is an obstacle at the upper side of the outdoor unit, set the top end of the outdoor unit 200mm apart from the obstacle.
- Limit the height of the obstacle surrounding the outdoor unit to 800mm or less from the bottom end of the outdoor unit.
- Draw out the pipe provided locally to the front of the outdoor unit horizontally and keep 500mm or more between the outdoor unit and traversing pipe if placing pipe transversely.
- Arrange each outdoor unit in order of its capacity.  
(Header unit ① ≥ Follower unit ② ≥ Follower unit ③)
- Dimensional drawing of corrosion heavy protection model is the same as that of standard model.

## 5 *Outdoor unit*



Model	Outdoor unit		
	(1) Header unit	(2) Follower unit	(3) Follower unit
MMY-AP4026HT8P-E	MMY-MAP1406HT8P-E	MMY-MAP1406HT8P-E	MMY-MAP1206HT8P-E

Three units connected

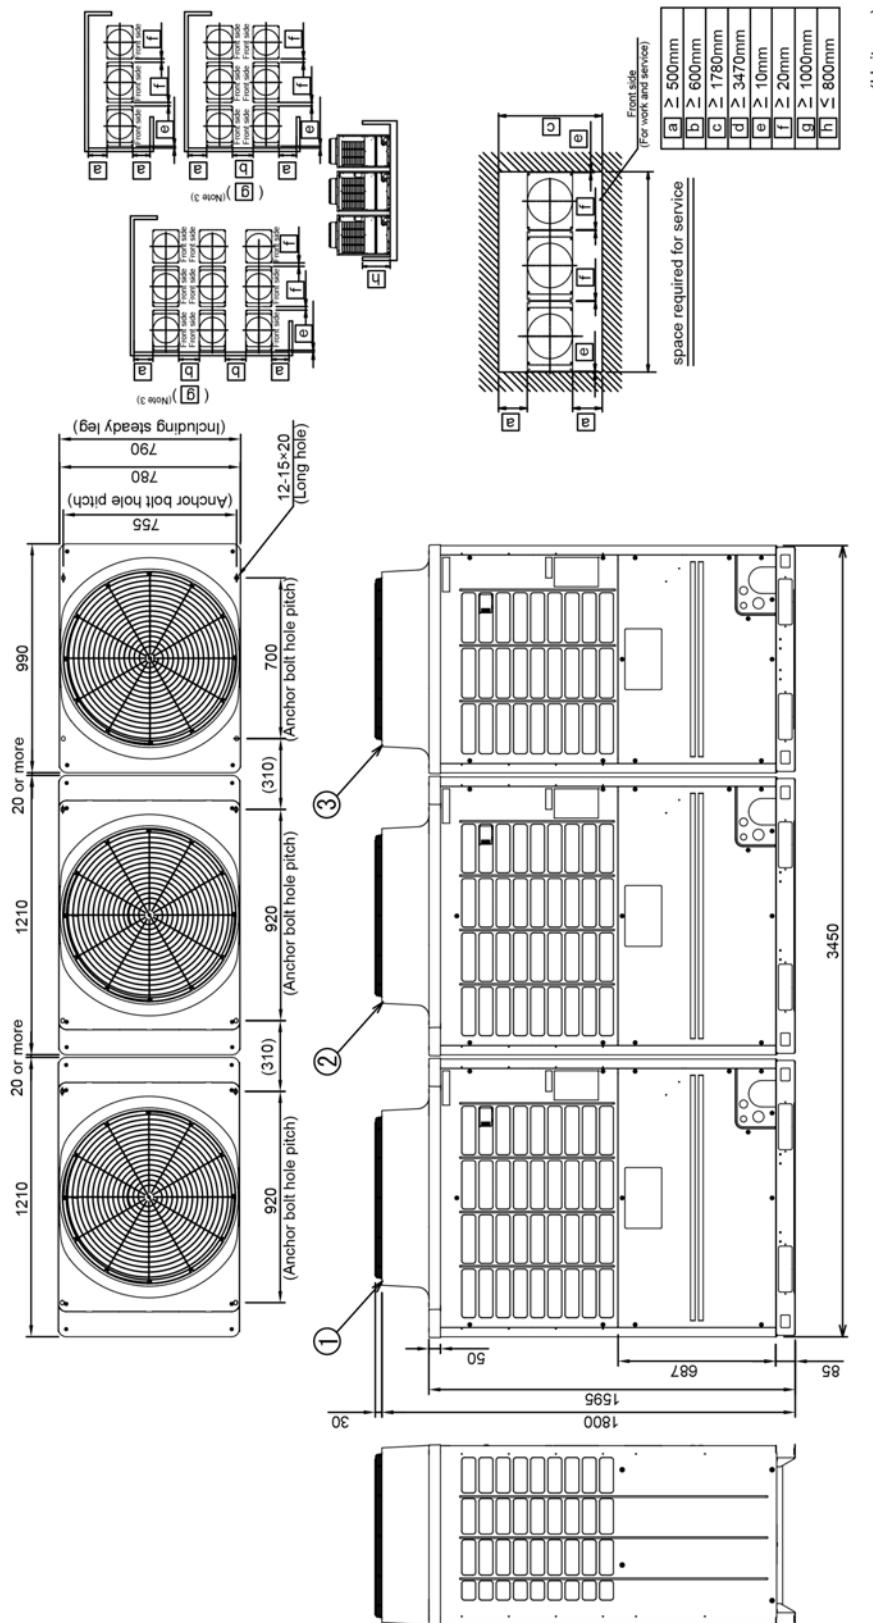

Note

- Note)**


  - If there is an obstacle at the upper side of the outdoor unit, set the top end of the outdoor unit 200mm apart from the obstacle.
  - Limit the height of the obstacle surrounding the outdoor unit to 800mm or less from the bottom end of the outdoor unit.
  - Draw out the pipe procured locally to the front of the outdoor unit horizontally, and keep 500mm or more between the outdoor unit and traversing pipe if placing pipe transversally.
  - Arrange each outdoor unit in order of its capacity.  
(Header unit ① ≥ Follower unit ② ≥ Follower unit ③)
  - Dimensional drawing of corrosion heavy protection model is the same as that of standard model.

## 5 Outdoor unit



Model	Outdoor unit		
	(1) Header unit	(2) Follower unit	(3) Follower unit
MMY-AP4226HT8P-E	MMY-MAP1406HT8P-E	MMY-MAP1406HT8P-E	MMY-MAP1406HT8P-E
MMY-AP4426HT8P-E	MMY-MAP1606HT8P-E	MMY-MAP1406HT8P-E	MMY-MAP1406HT8P-E
MMY-AP4616HT8P-E	MMY-MAP1606HT8P-E	MMY-MAP1606HT8P-E	MMY-MAP1406HT8P-E
MMY-AP4816HT8P-E	MMY-MAP1606HT8P-E	MMY-MAP1606HT8P-E	MMY-MAP1606HT8P-E

Three units connected

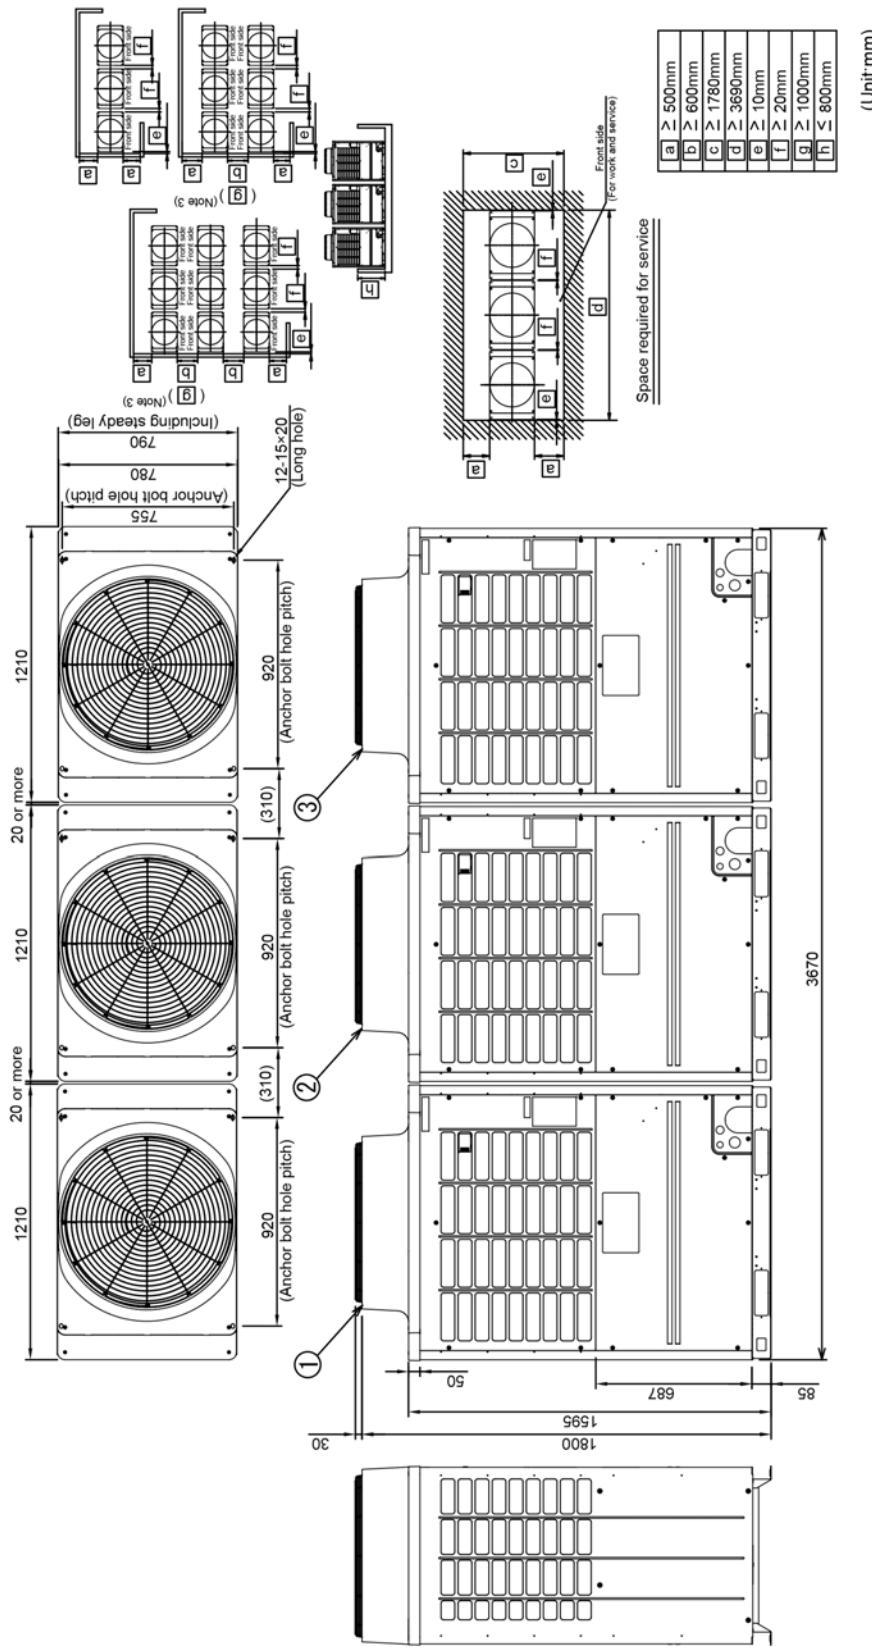


- (Note)
- If there is an obstacle at the upper side of the outdoor unit, set the top end of the outdoor unit 200mm apart from the obstacle.
  - Limit the height of the obstacle surrounding the outdoor unit to 800mm or less from the bottom end of the outdoor unit.
  - Draw out the pipe procured locally to the front of the outdoor unit horizontally and keep 50mm or more between the outdoor unit and traversing pipe if placing pipe transversely.
  - Arrange each outdoor unit in order of its capacity.  
(Header unit ① ≥ Follower unit ② ≥ Follower unit ③)
  - Dimensional drawing of corrosion heavy protection model is the same as that of standard model.

## 5 Outdoor unit



Model	Outdoor unit			Three units connected
	(1) Header unit	(2) Follower unit	(3) Follower unit	
MMY-AP5016HT8P-E	MMY-MAP1806HT8P-E	MMY-MAP1606HT8P-E	MMY-MAP1606HT8P-E	
MMY-AP5216HT8P-E	MMY-MAP2006HT8P-E	MMY-MAP1606HT8P-E	MMY-MAP1606HT8P-E	
MMY-AP5416HT8P-E	MMY-MAP2206HT8P-E	MMY-MAP1606HT8P-E	MMY-MAP1606HT8P-E	

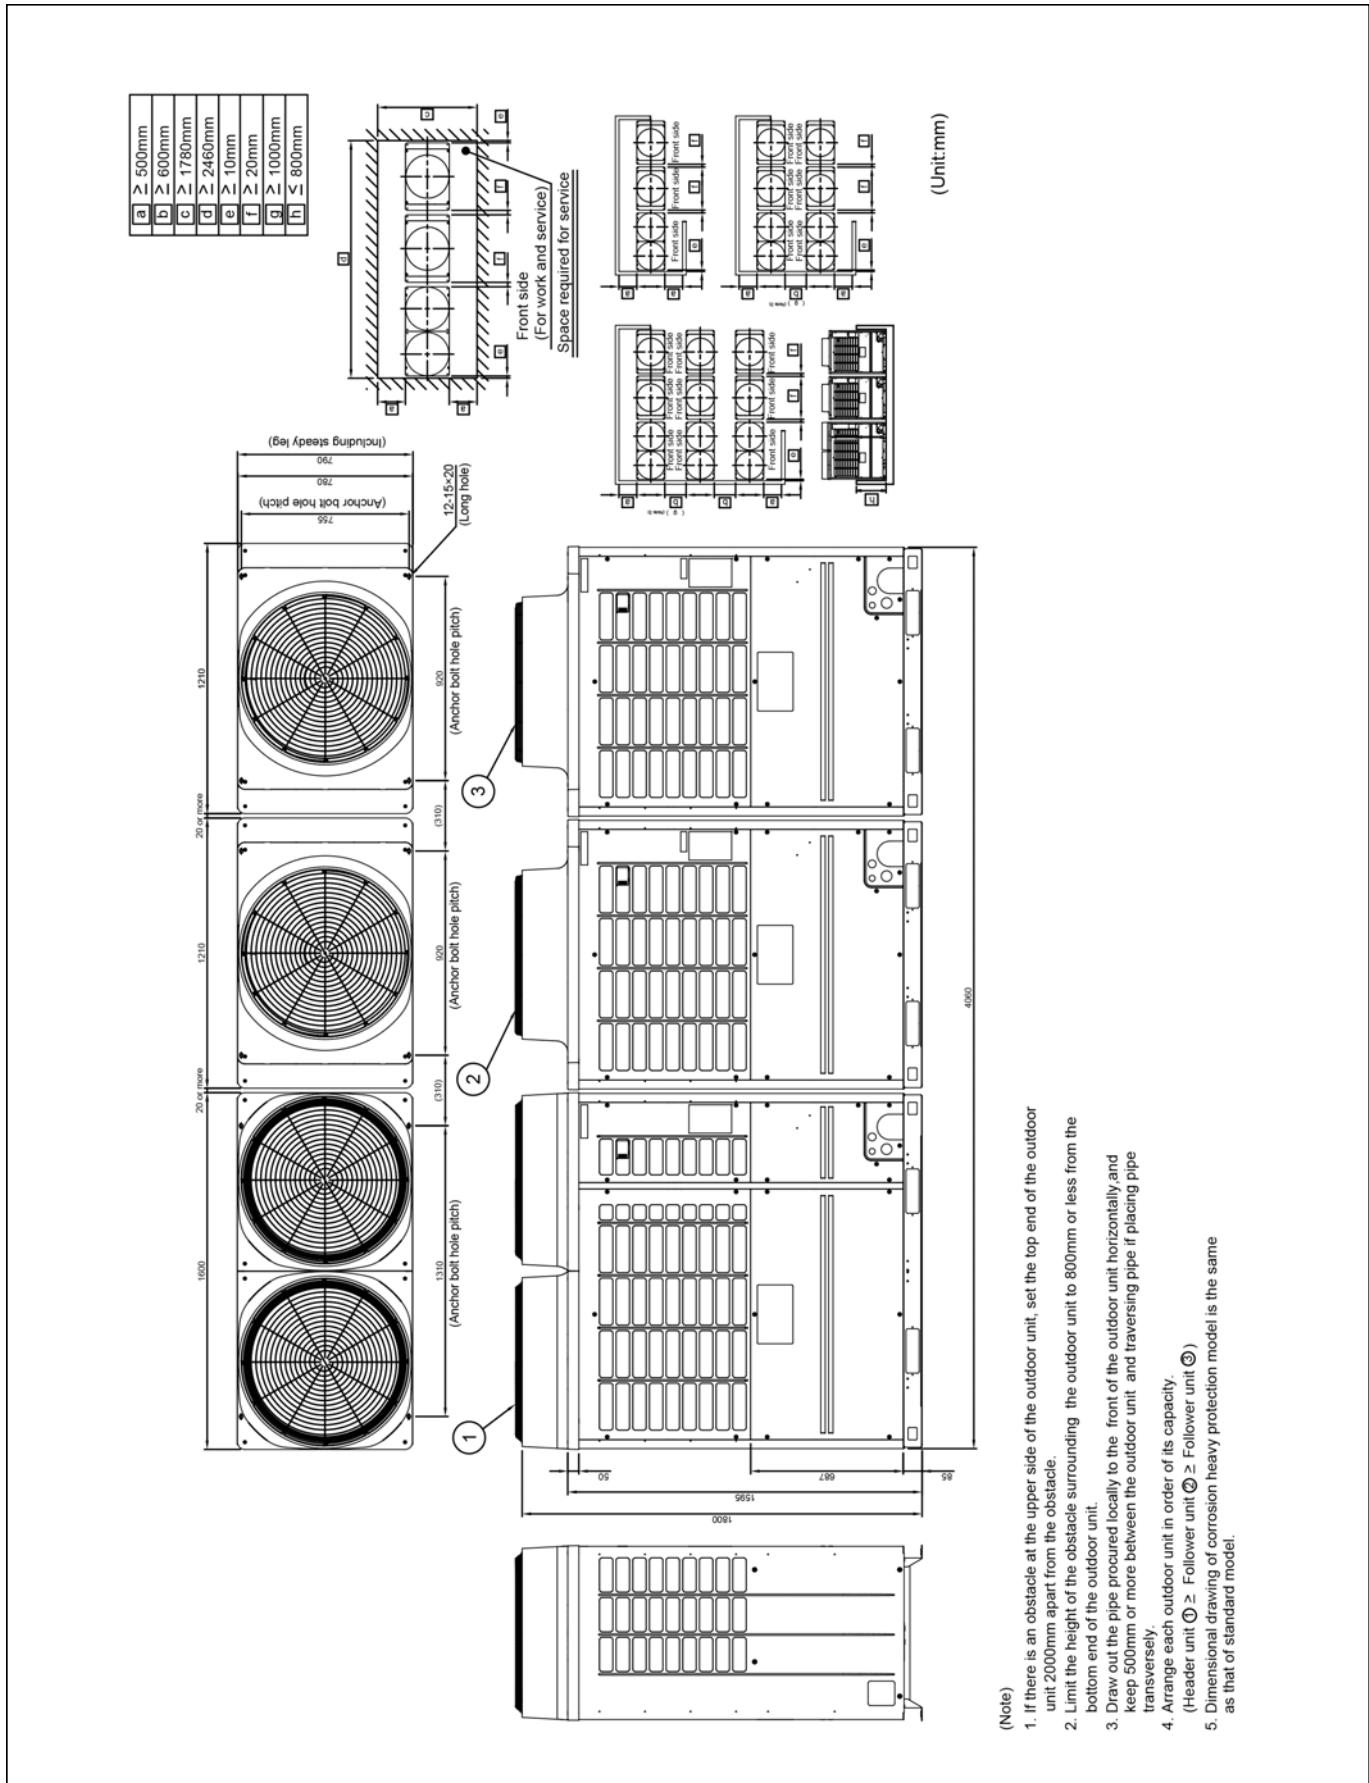


- (Note)
- If there is an obstacle at the upper side of the outdoor unit, set the top end of the outdoor unit 200mm apart from the obstacle.
  - Limit the height of the obstacle surrounding the outdoor unit to 800mm or less from the bottom end of the outdoor unit.
  - Draw out the pipe provided locally to the front of the outdoor unit horizontally and keep 500mm or more between the outdoor unit and traversing pipe if placing pipe transversely.
  - Arrange each outdoor unit in order of its capacity.  
(Header unit ① ≥ Follower unit ② ≥ Follower unit ③)
  - Dimensional drawing of corrosion heavy protection model is the same as that of standard model.

## 5 Outdoor unit



Model	Outdoor unit		
	(1) Header unit	(2) Follower unit	(3) Follower unit
MMY-AP5426HT8P-E	MMY-MAP2006HT8P-E	MMY-MAP2006HT8P-E	MMY-MAP1406HT8P-E
MMY-AP5616HT8P-E	MMY-MAP2006HT8P-E	MMY-MAP2006HT8P-E	MMY-MAP1606HT8P-E
MMY-AP5816HT8P-E	MMY-MAP2206HT8P-E	MMY-MAP2006HT8P-E	MMY-MAP1606HT8P-E
MMY-AP6016HT8P-E	MMY-MAP2206HT8P-E	MMY-MAP2206HT8P-E	MMY-MAP1606HT8P-E

Three units connected

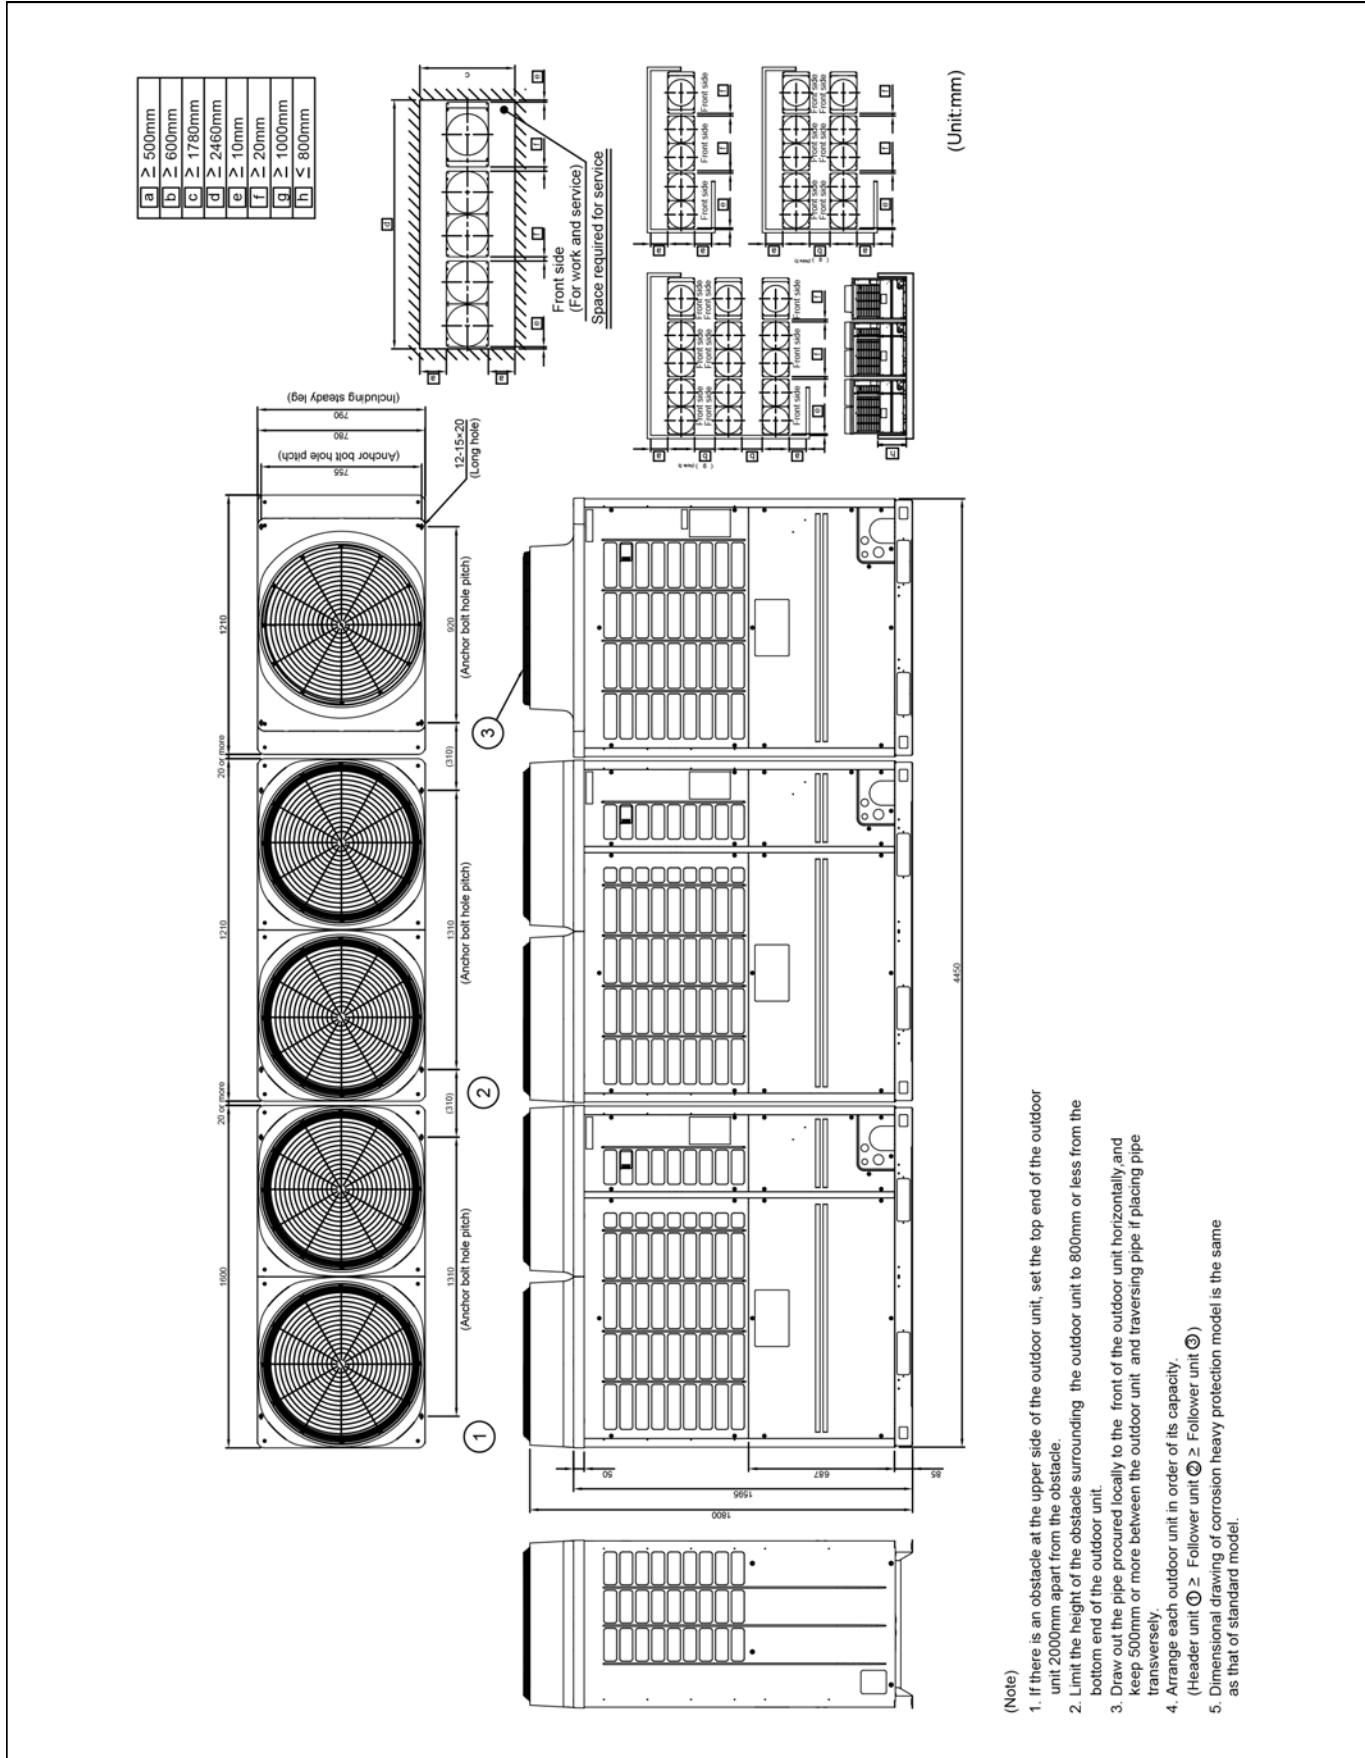


(Note)

1. If there is an obstacle at the upper side of the outdoor unit, set the top end of the outdoor unit 200mm apart from the obstacle.
2. Limit the height of the obstacle surrounding the outdoor unit to 800mm or less from the bottom end of the outdoor unit.
3. Draw out the pipe procured locally to the front of the outdoor unit horizontally and keep 500mm or more between the outdoor unit and traversing pipe if placing pipe transversely.
4. Arrange each outdoor unit in order of its capacity.  
(Header unit ① ≥ Follower unit ② ≥ Follower unit ③)
5. Dimensional drawing of corrosion heavy protection model is the same as that of standard model.



### 5-3. Center of gravity

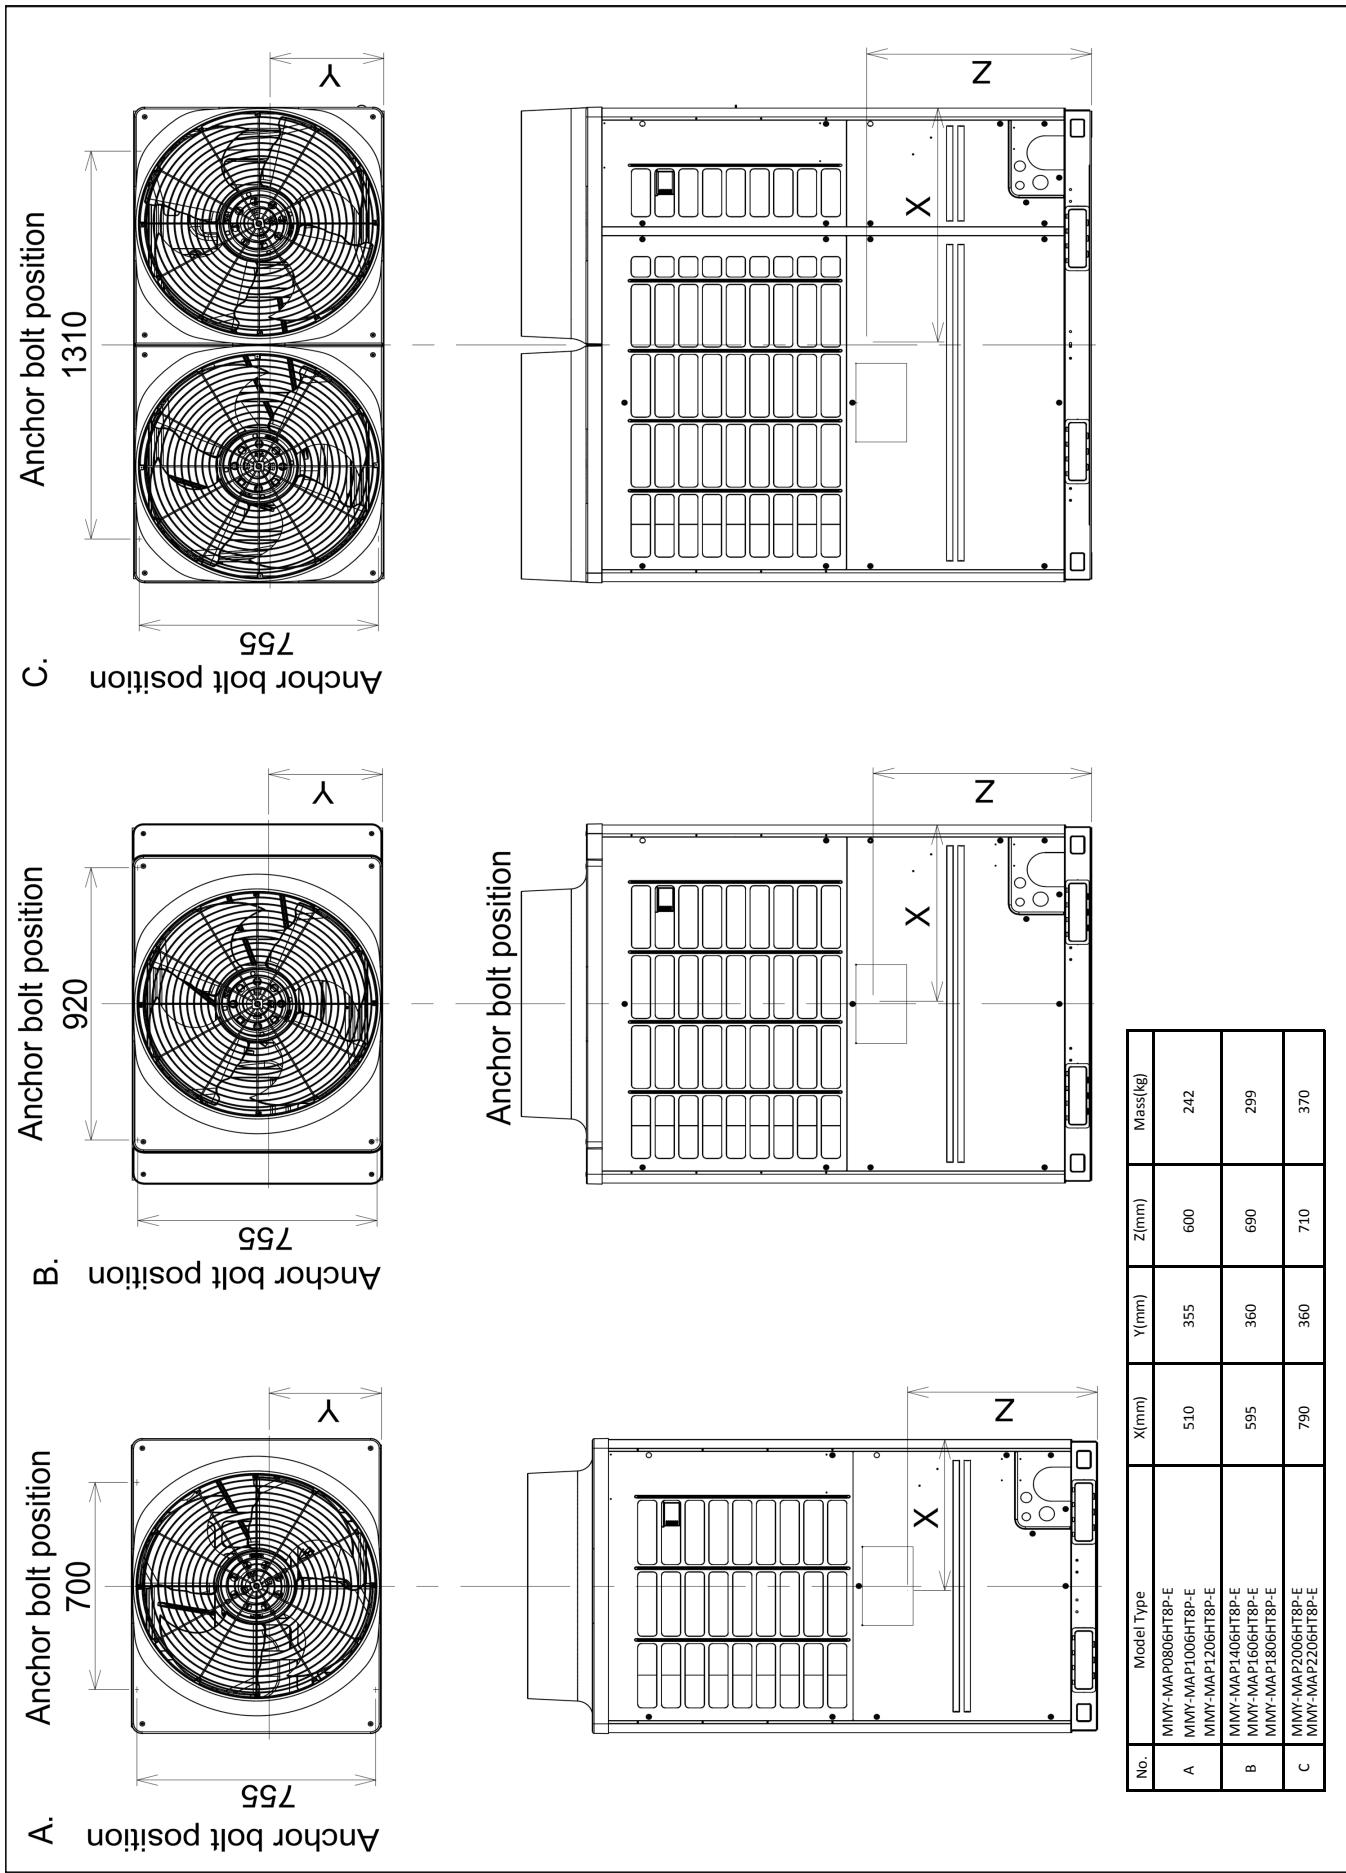




## 5-4. Branch header / branch joint


### • Branch header

RBM-HY1043E, HY1083E, HY2043E, HY2083E

#### Gas side

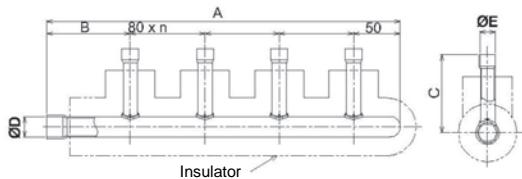

#### Liquid side

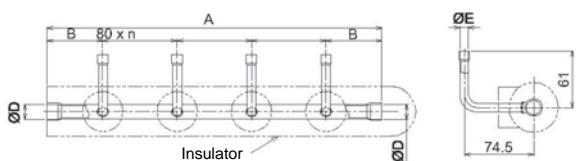


(Unit : mm)

Model		A	B	C	$\phi D$	$\phi E$	n	Accessory socket Qty
RBM-HY1043E	Gas side	380	90	83.6	22.2	15.9	3	⑥x 4, ⑨x 4, ⑭x 1, ⑯x 1, ⑰x 1
	Liquid side	360	60	-	15.9	9.5	3	①x 4, ⑥x 1, ⑨x 1
RBM-HY1083E	Gas side	700	90	83.6	22.2	15.9	7	⑥x 8, ⑨x 8, ⑭x 1, ⑯x 1, ⑰x 1
	Liquid side	680	60	-	15.9	9.5	7	①x 8, ⑥x 1, ⑨x 1
RBM-HY2043E	Gas side	385.5	95.5	89.3	31.8	15.9	3	⑥x 2, ⑨x 2, ⑯x 1, ⑮x 1
	Liquid side	360	60	-	15.9	9.5	3	①x 2, ⑮x 1
RBM-HY2083E	Gas side	705.5	95.5	89.3	31.8	15.9	7	⑥x 7, ⑨x 7, ⑯x 1, ⑮x 1
	Liquid side	680	60	-	15.9	9.5	7	①x 7, ⑮x 1


### • Y-shape branch joint

RBM-BY55E, BY105E, BY205E, BY305E

#### Gas side

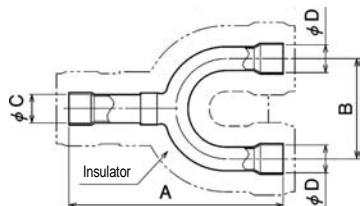

#### Liquid side

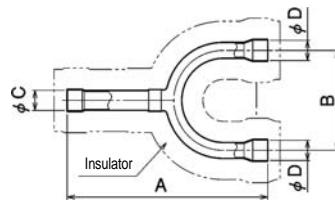

(Unit : mm)


RBM-		A	B	$\phi C$	$\phi D$	Accessory socket Qty
BY55E	Gas side	160	80	15.9	15.9	⑨x 1, ⑮x 2, ⑯x 2
	Liquid side	130	70	9.5	9.5	①x 2
BY105E	Gas side	170	80	22.2	22.2	⑭x 2, ⑰x 2, ⑯x 1
	Liquid side	160	80	15.9	15.9	⑨x 1, ⑯x 1, ⑫x 1
BY205E	Gas side	200	80	31.8	28.6	⑯x 1, ⑯x 1, ⑬x 2, ⑮x 1, ⑯x 1, ⑯x 1
	Liquid side	160	80	15.9	15.9	⑨x 1, ⑮x 2, ⑫x 1
BY305E	Gas side	220	80	38.1	38.1	⑬x 1, ⑯x 3, ⑫x 2, ⑯x 2, ⑯x 1, ⑯x 1
	Liquid side	170	80	22.2	22.2	⑫x 1, ⑯x 3, ⑰x 2

## 5 Outdoor unit




- Branching joint for connection of outdoor units (Set of three kinds of joint)  
RBM-BT14E


### Gas side

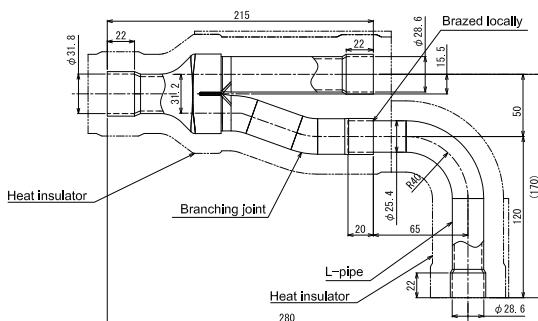

### Liquid side




### Balance pipe




RBM-BT14E	
Accessory socket Qty	
Gas side	(27) x 1, (43) x 2, (59) x 1
Liquid side	(10) x 2, (13) x 1

## RBM-BT24E


### Gas side

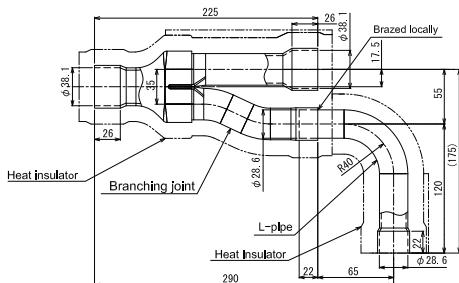

### Liquid side



### Balance pipe












RBM-BT24E	
Accessory socket Qty	
Gas side	(43)x1, (61)x2, (62)x2, (71)x1, (73)x1
Liquid side	(14)x2, (18)x2, (85)x1, (70)x1

(Unit : mm)


## 5 Outdoor unit



### • Accessory socket

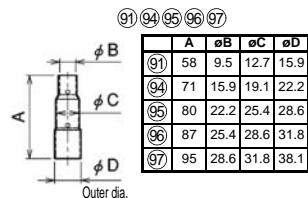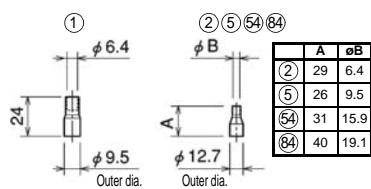

**Closure tube**




(Unit : mm)



## 5.5 Refrigerant cycle diagram

MMY-MAP0806HT8P-E, MMY-MAP1006HT8P-E, MMY-MAP1204HTP-E

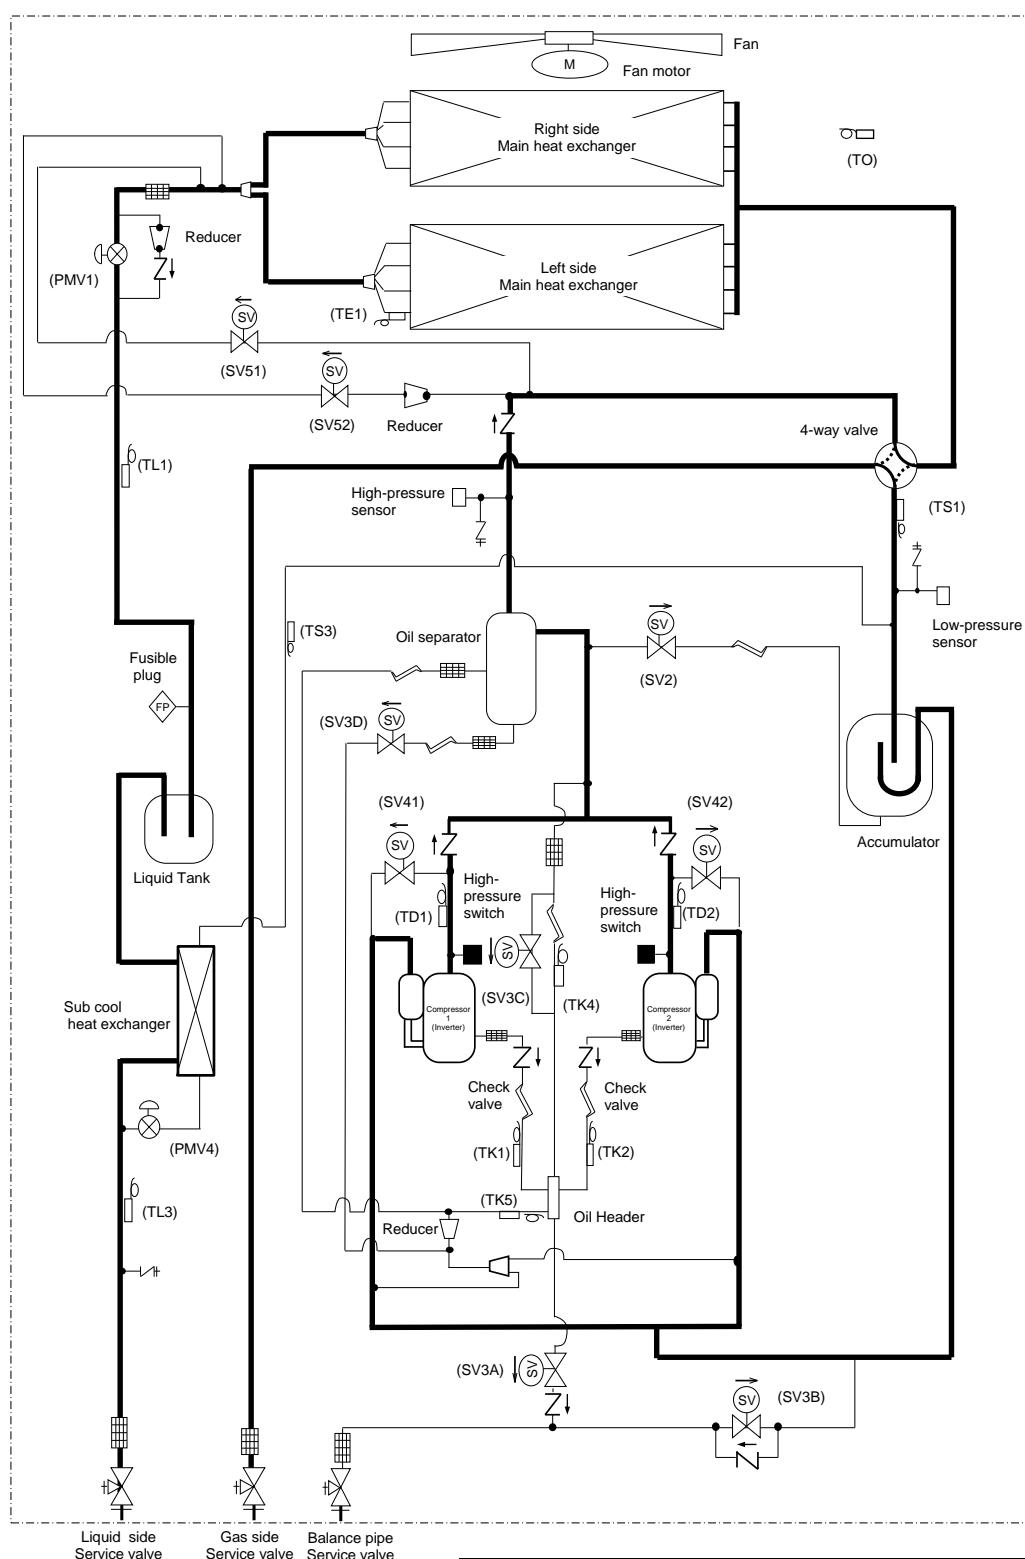


Symbol						
Solenoid valve	Capillary tube	Check valve	Check joint	Strainer	Temperature sensor	Distributor

## 5 Outdoor unit



MMY-MAP1406HT8P-E, MMY-MAP1606HTP-E

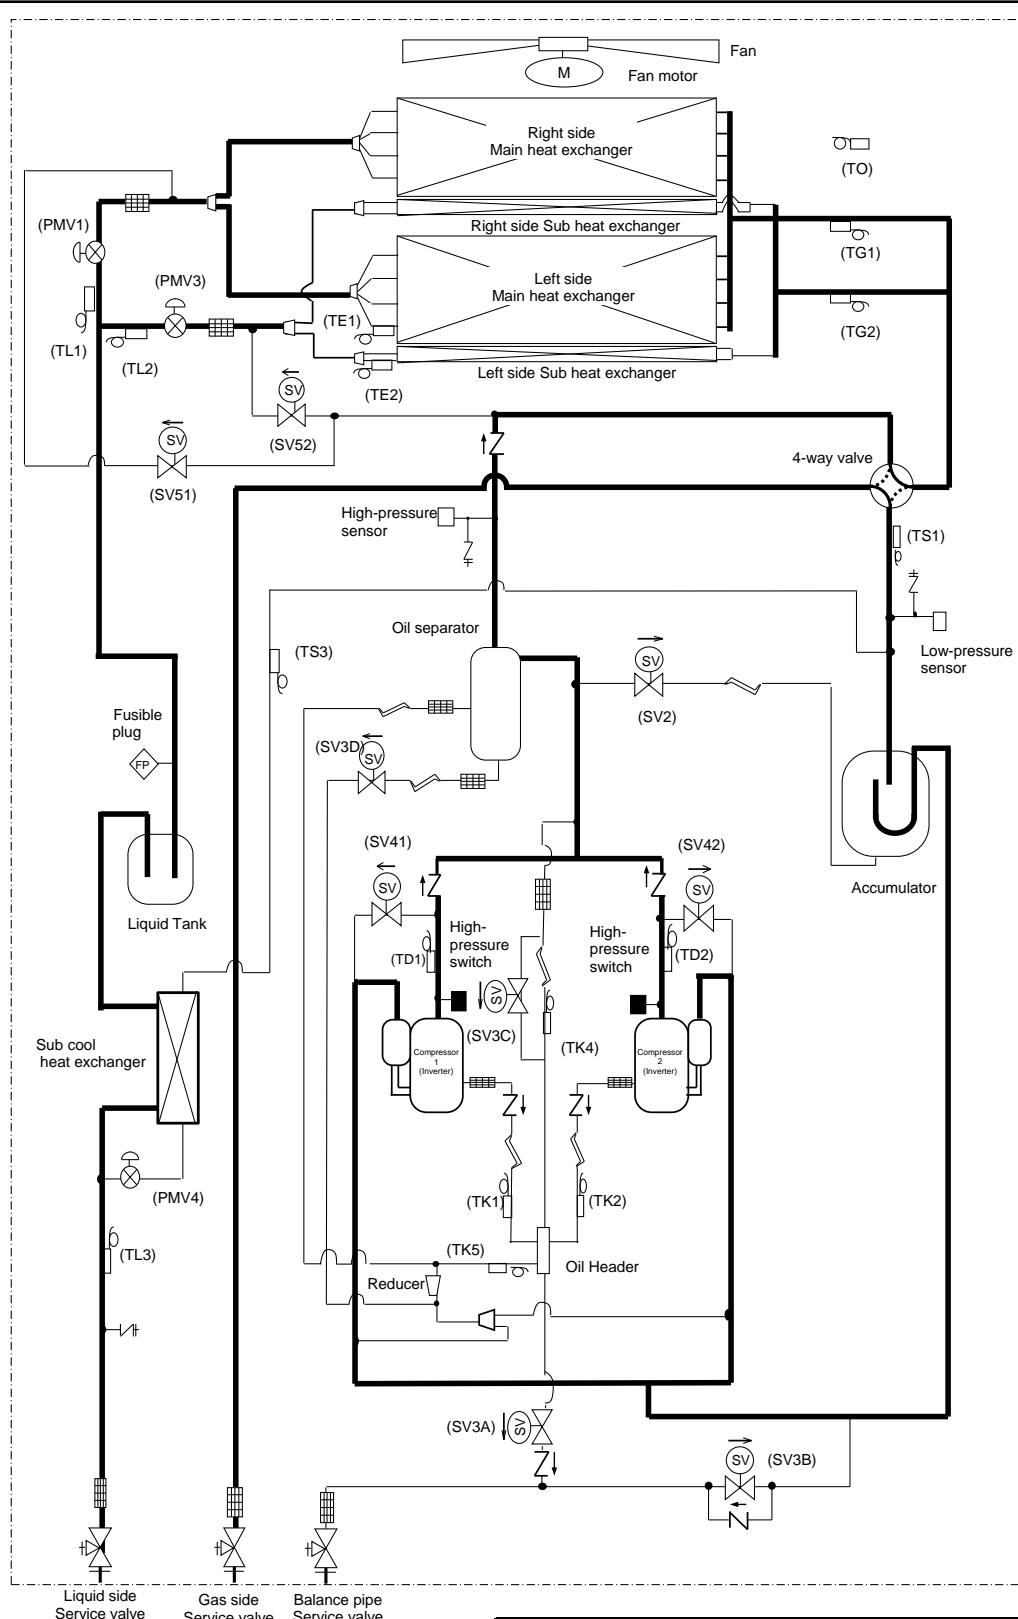


Liquid side Service valve      Gas side Service valve      Balance pipe Service valve

Symbol						

## 5 Outdoor unit




MMY-MAP1806HT8P-E, MMY-MAP2006HT8P-E, MMY-MAP2204HT8P-E

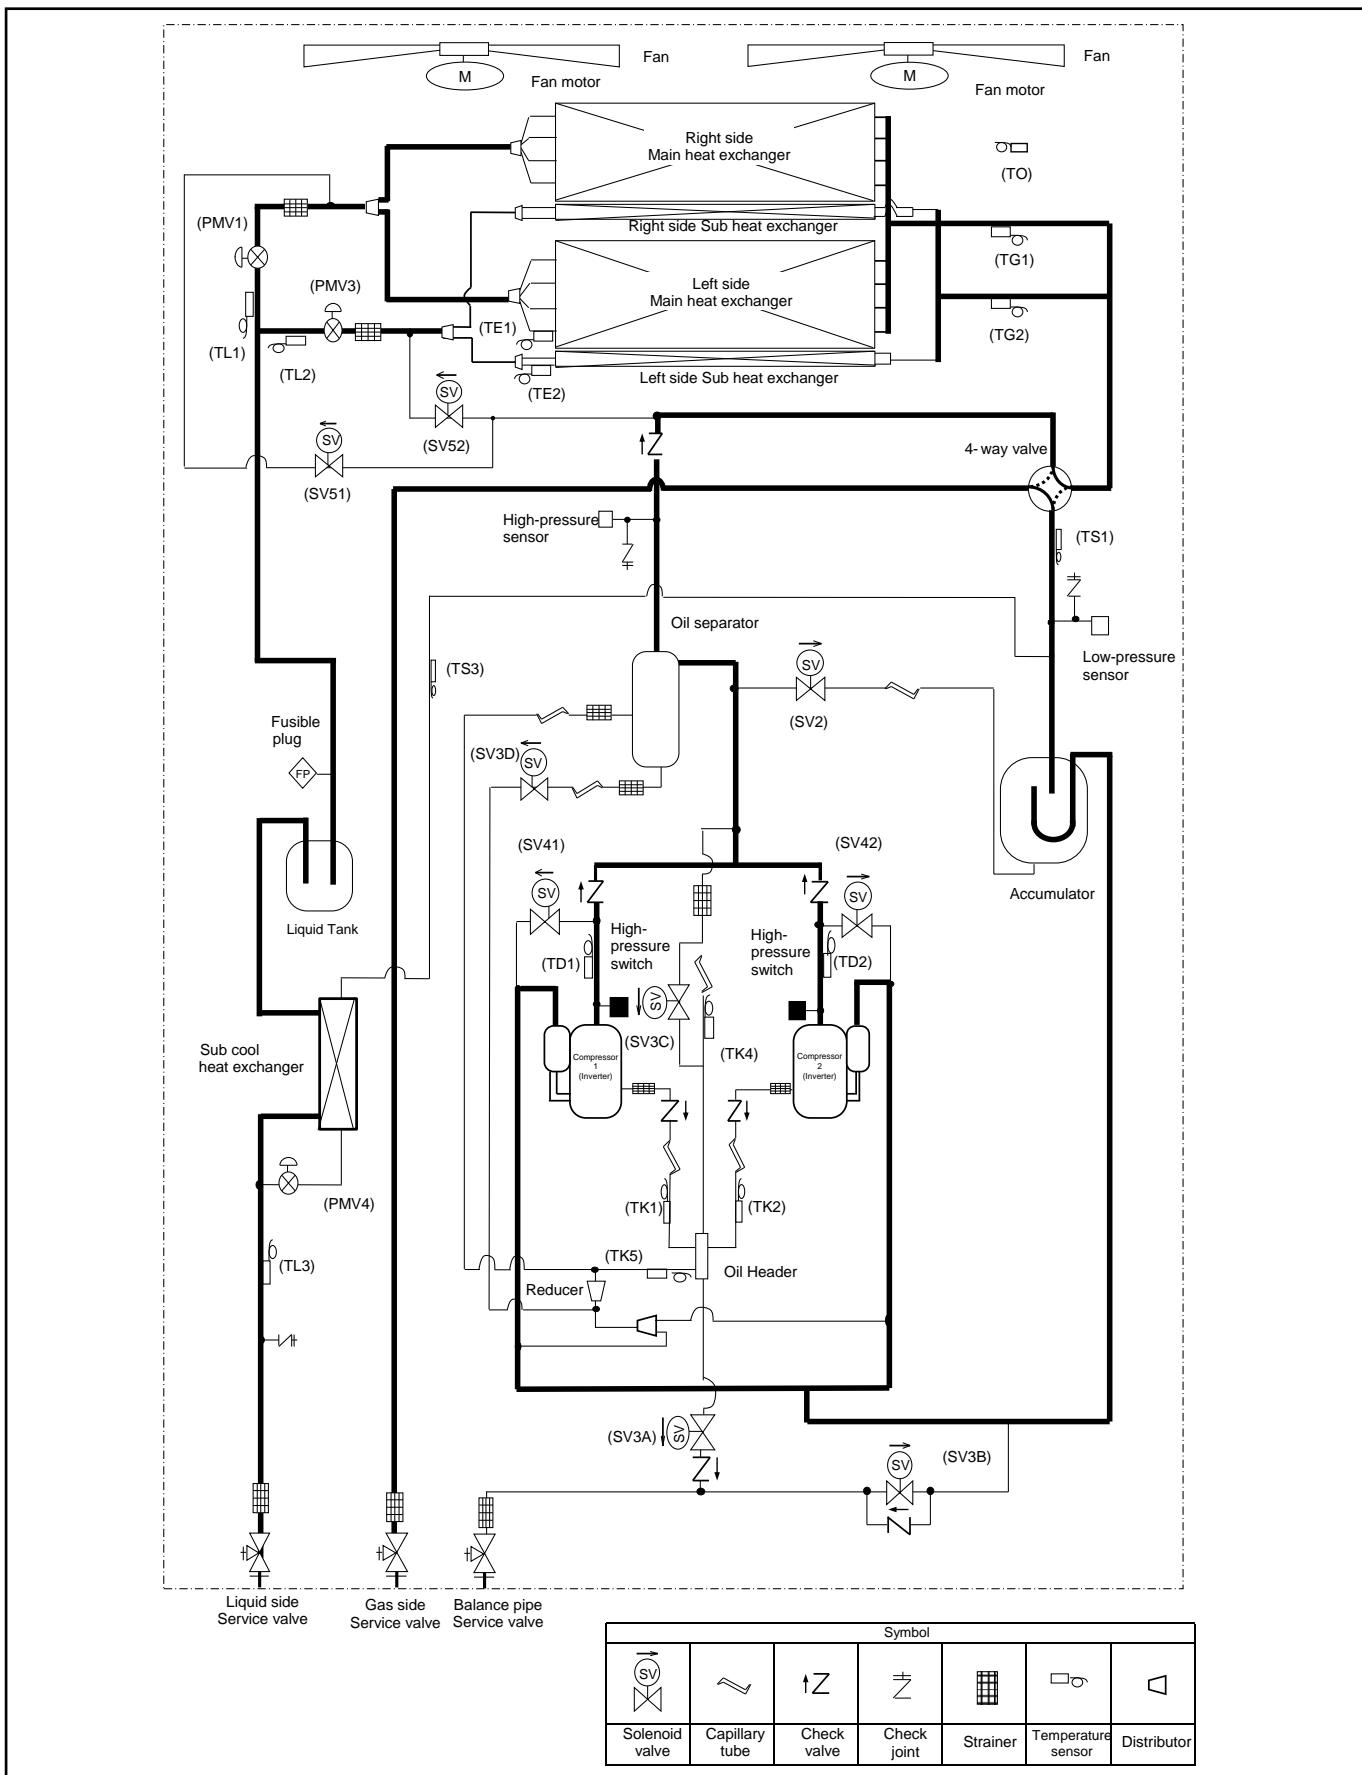

## **5** *Outdoor unit*

## 5-6. Wiring diagram


**MMY-MAP0806HT8P-E, MMY-MAP1006HT8P-E, MMY-MAP1206HT8P-E**

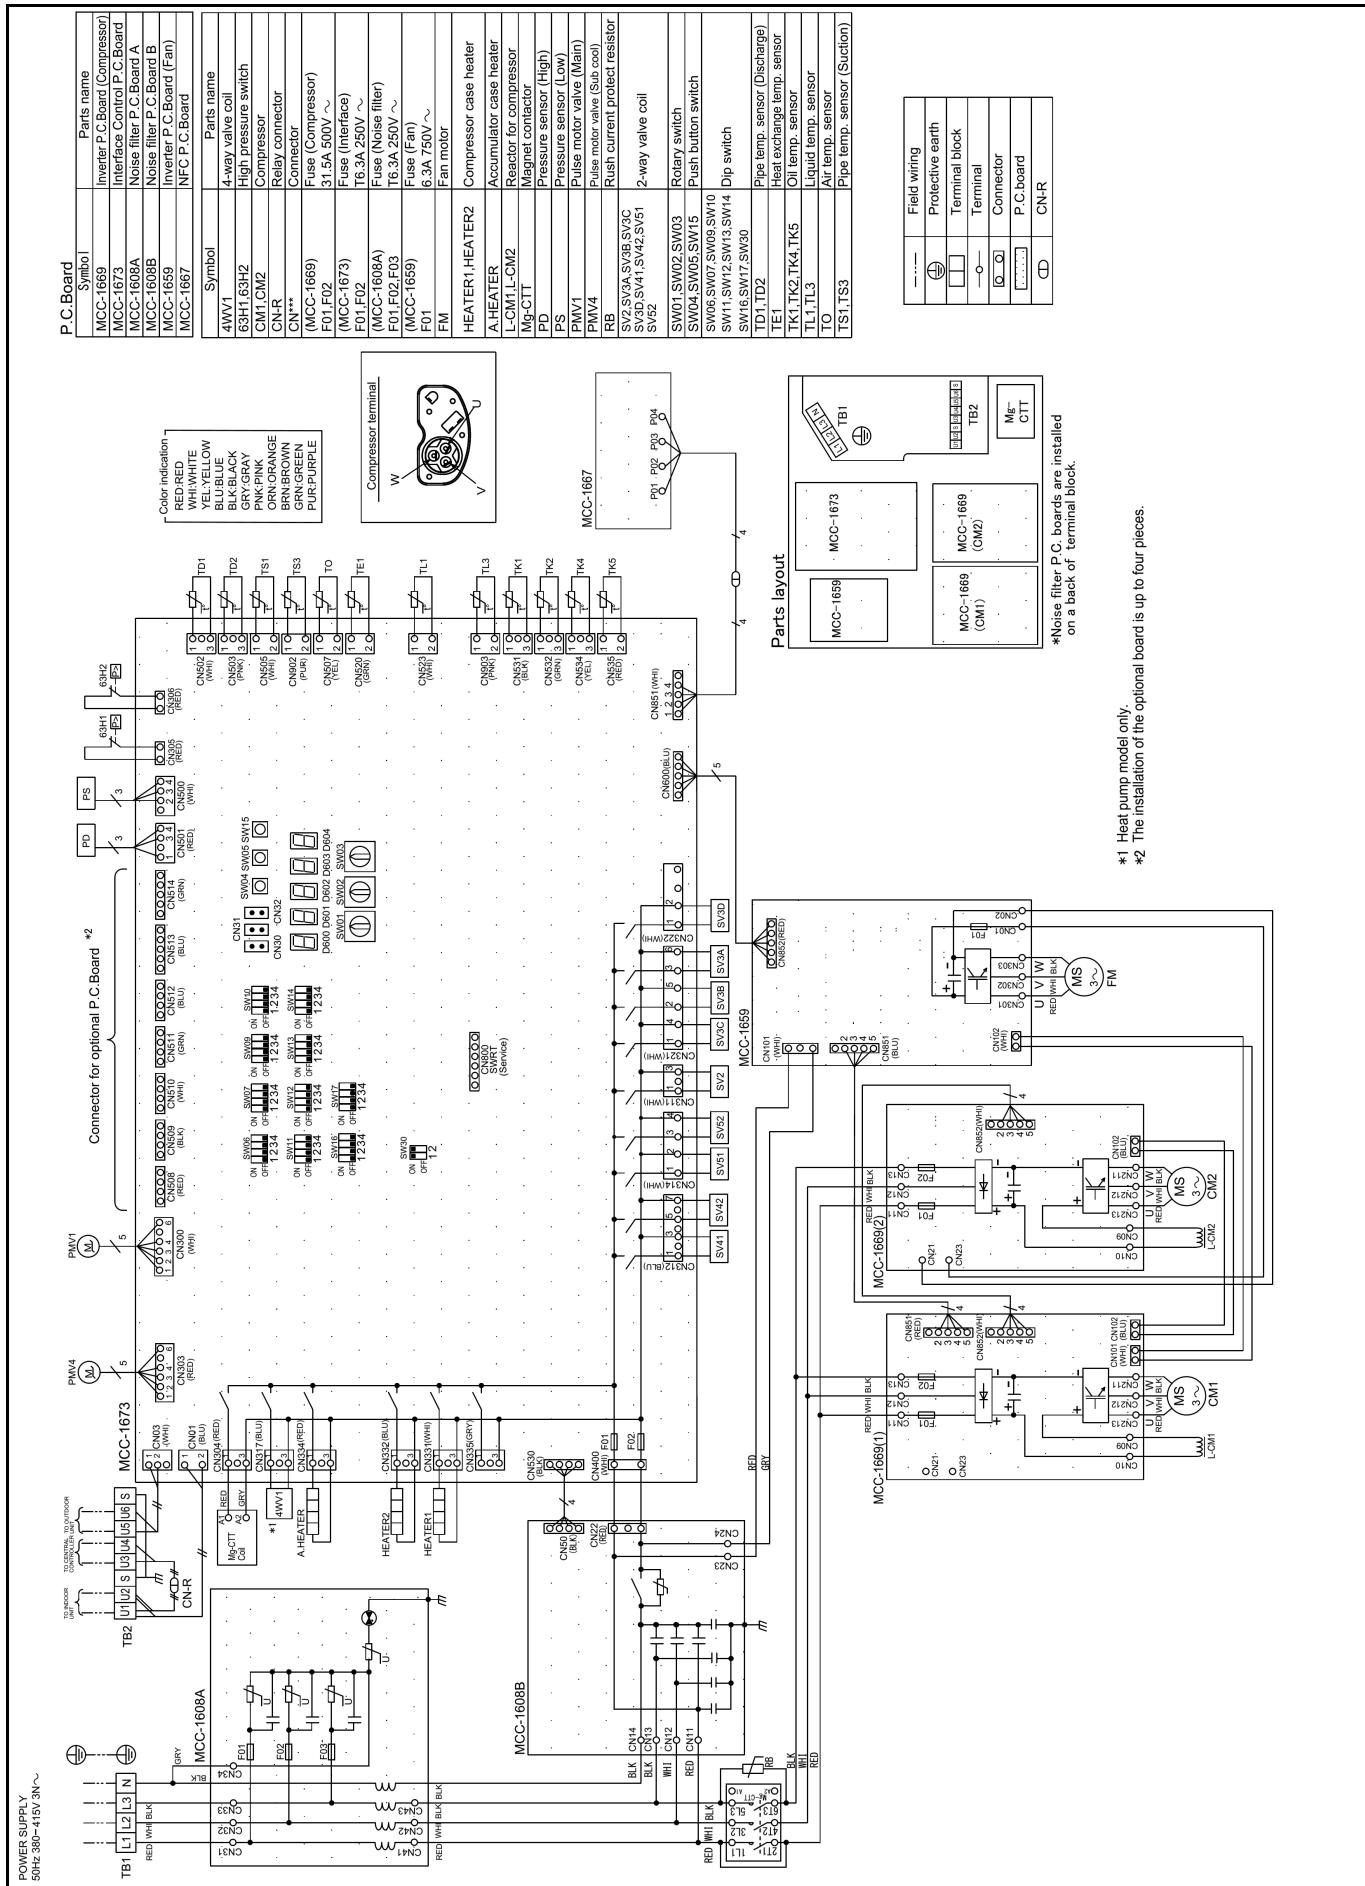

# 5 Outdoor unit




MMY-MAP1406HT8P-E, MMY-MAP1606HT8P-E

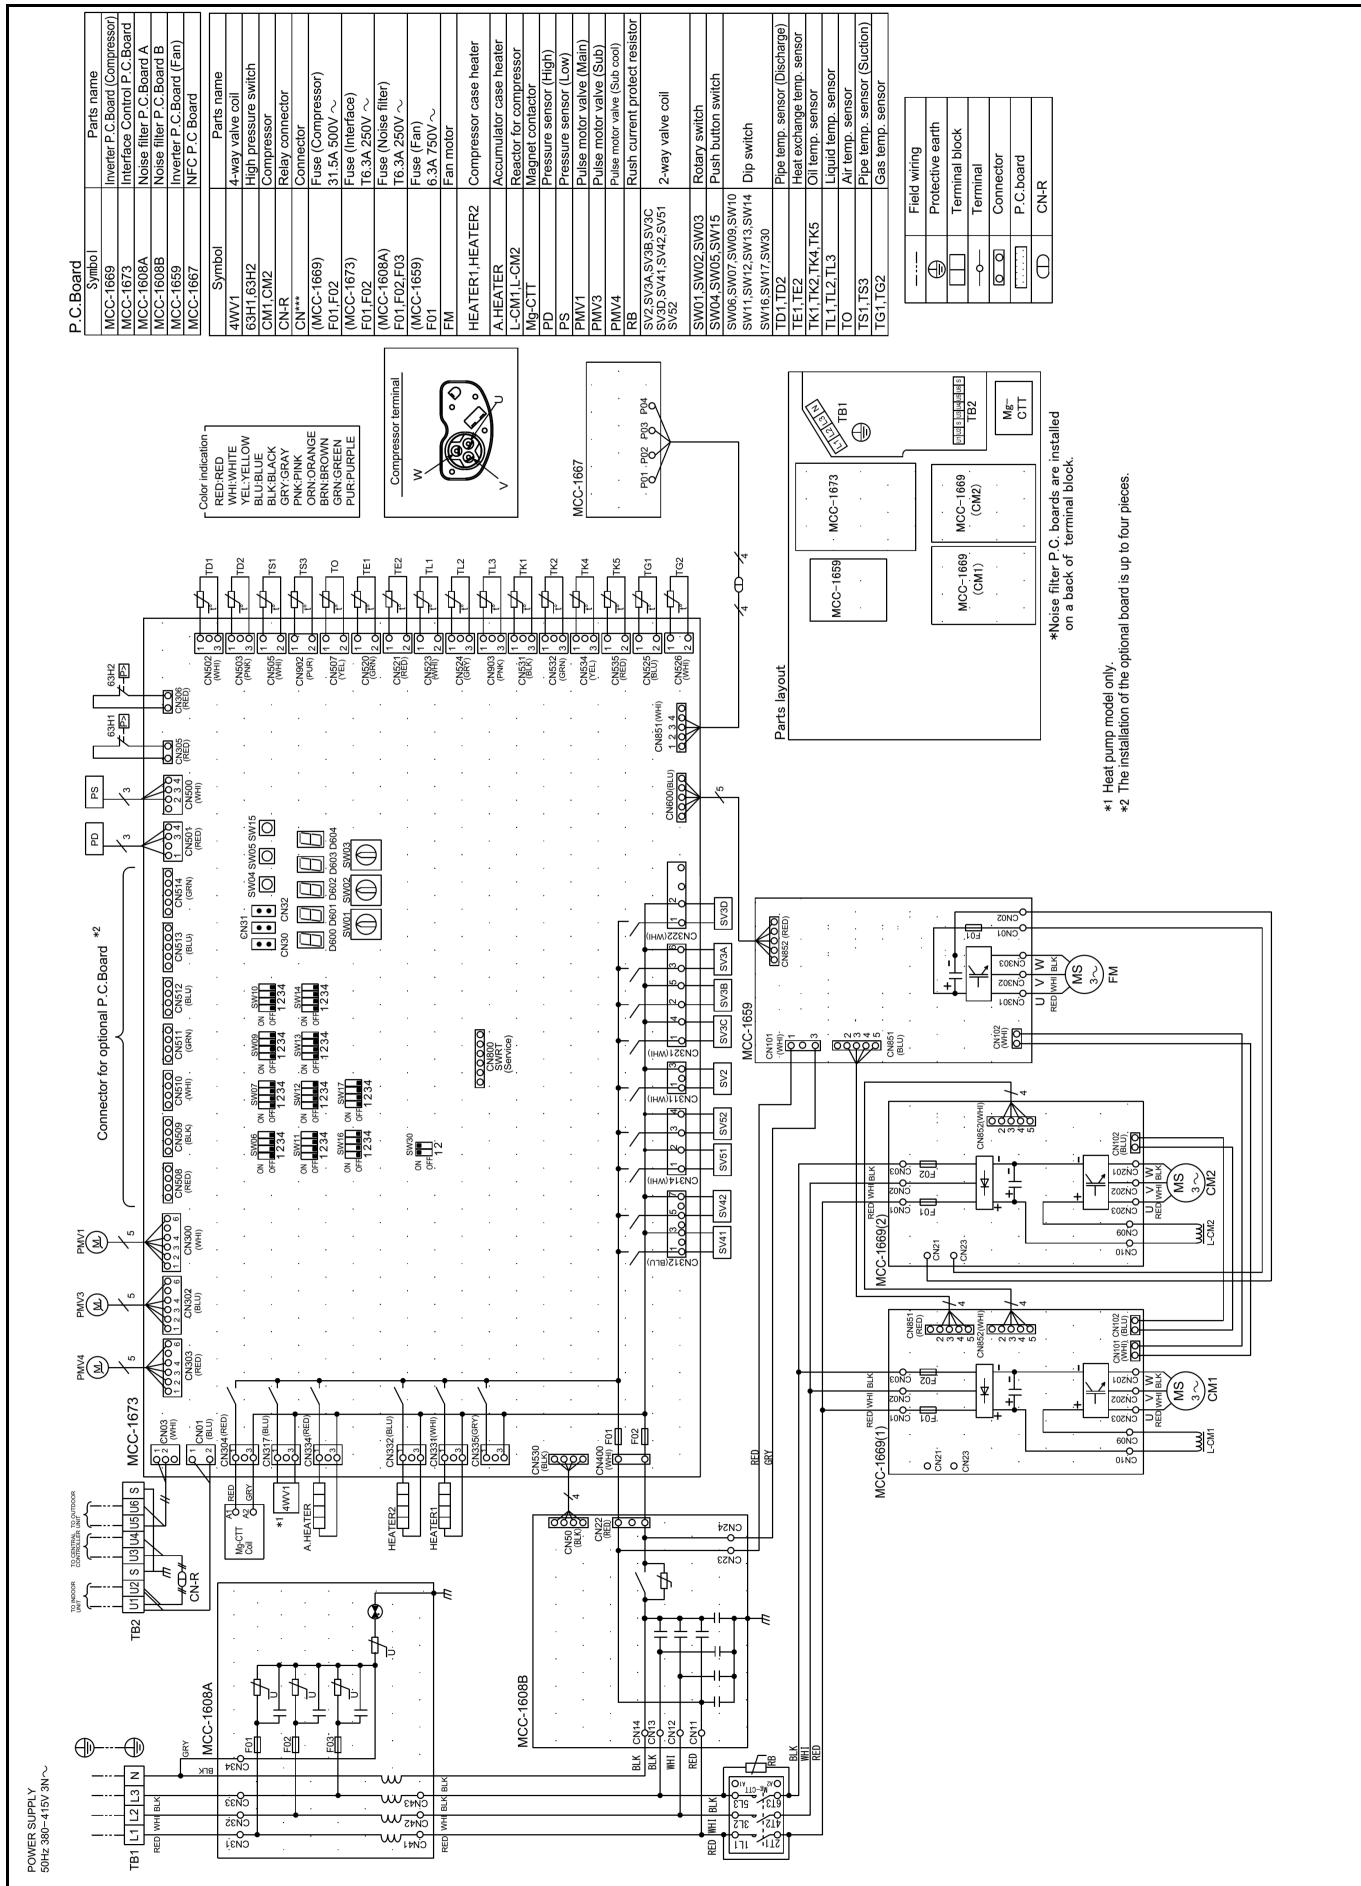

# 5 Outdoor unit



MMY-MAP1806HT8P-E, MMY-MAP2006HT8P-E, MMY-MAP2206HT8P-E

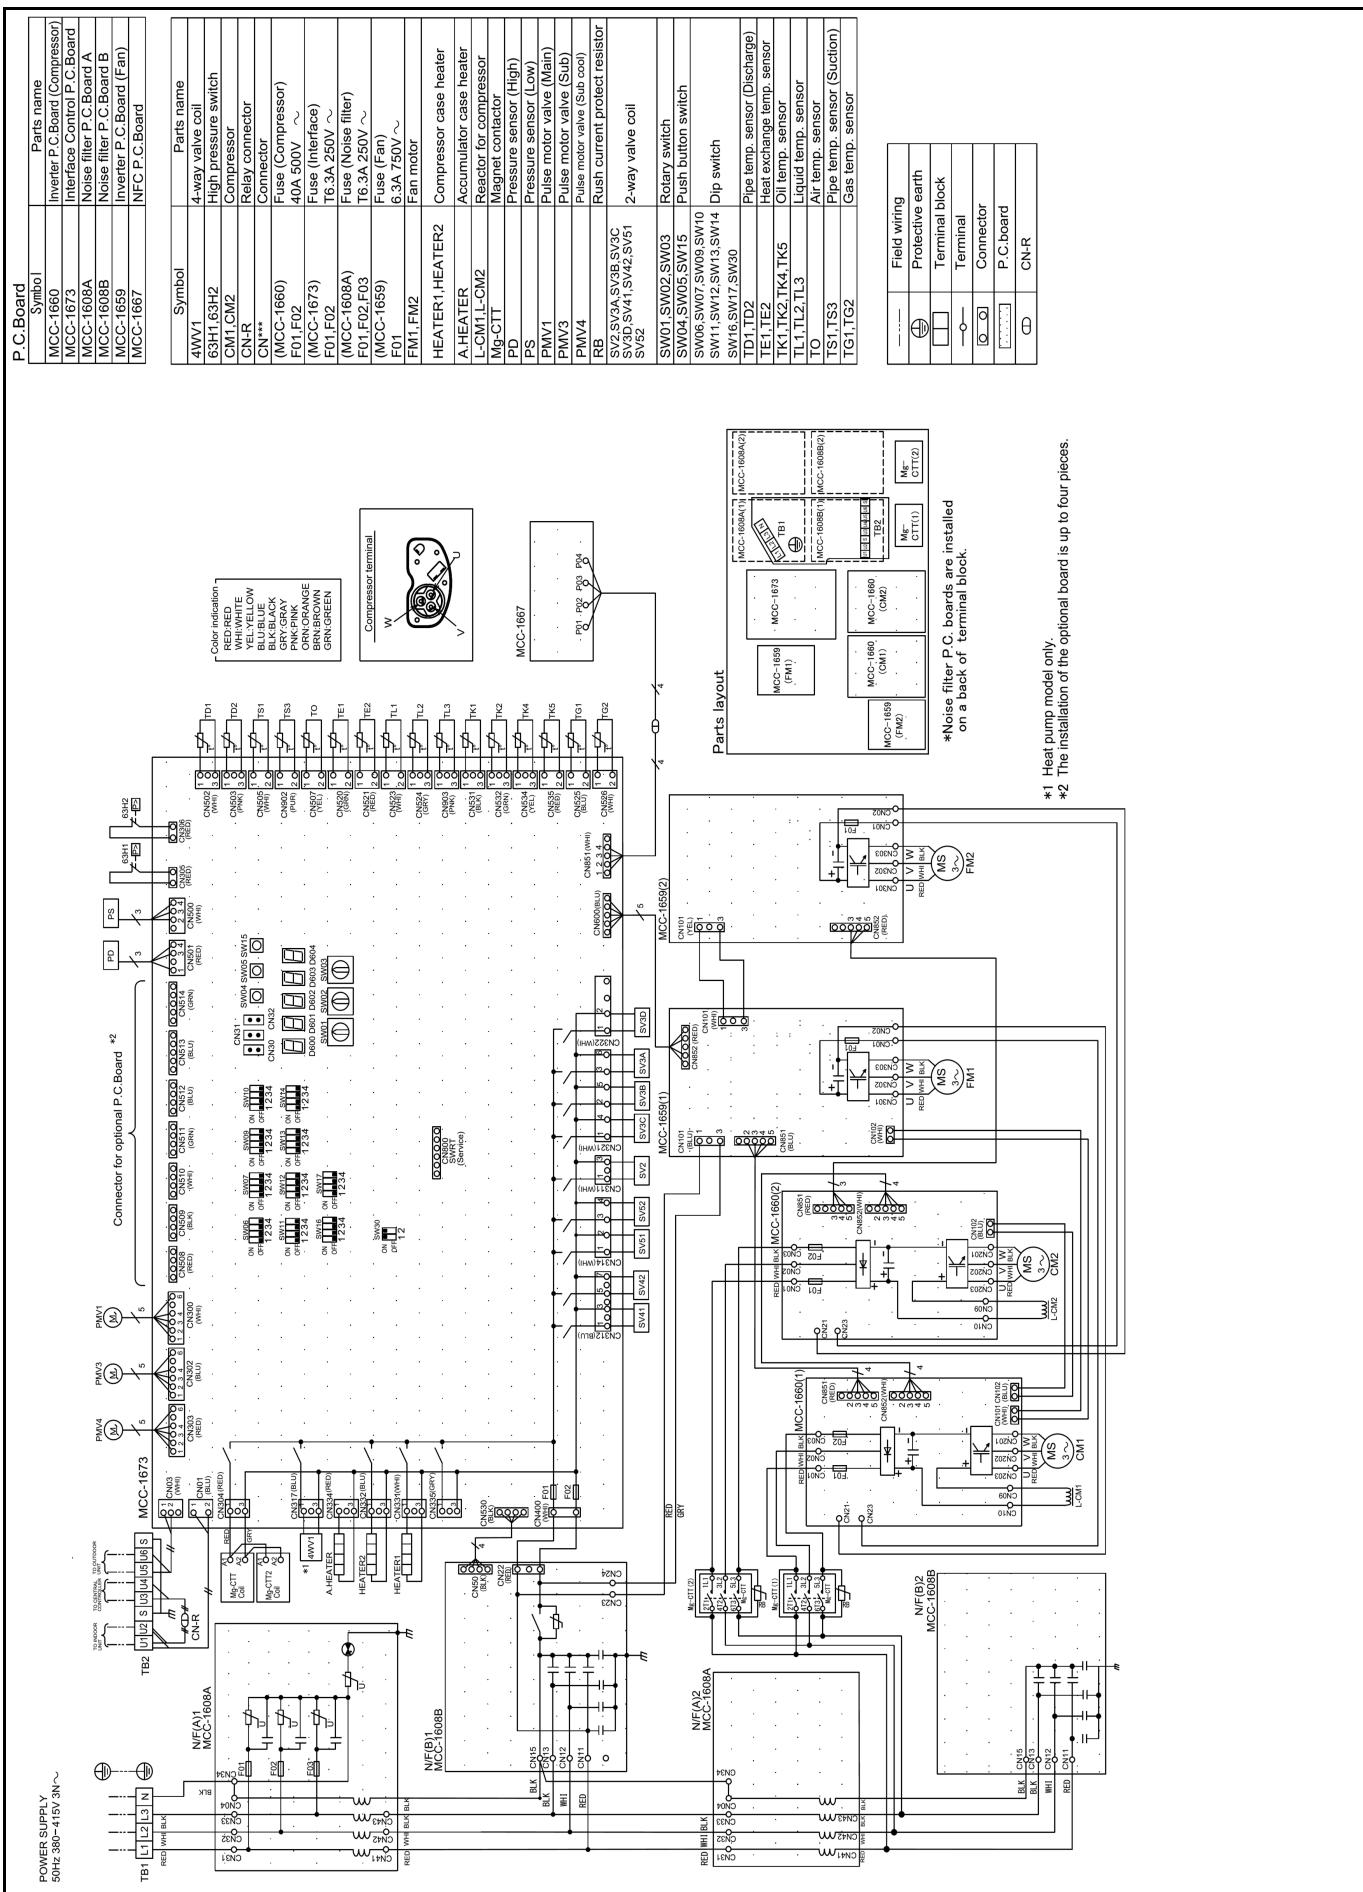




## 5-7. Connecting diagram

Single unit connected

Model : MMY-AP\*\*\*6HT8P-E

(1)	Outdoor unit (Header unit)
(2)	-
(3)	Indoor unit
(4)	Remote controller
(5)	Central remote controller (option)
(6)	Main switch (Fuse)
(7)	Circuit breaker (Earth leakage breaker)
(8)	Pull box

W1 : Control wiring between indoor and outdoor units  
W2 : Control wiring between indoor units

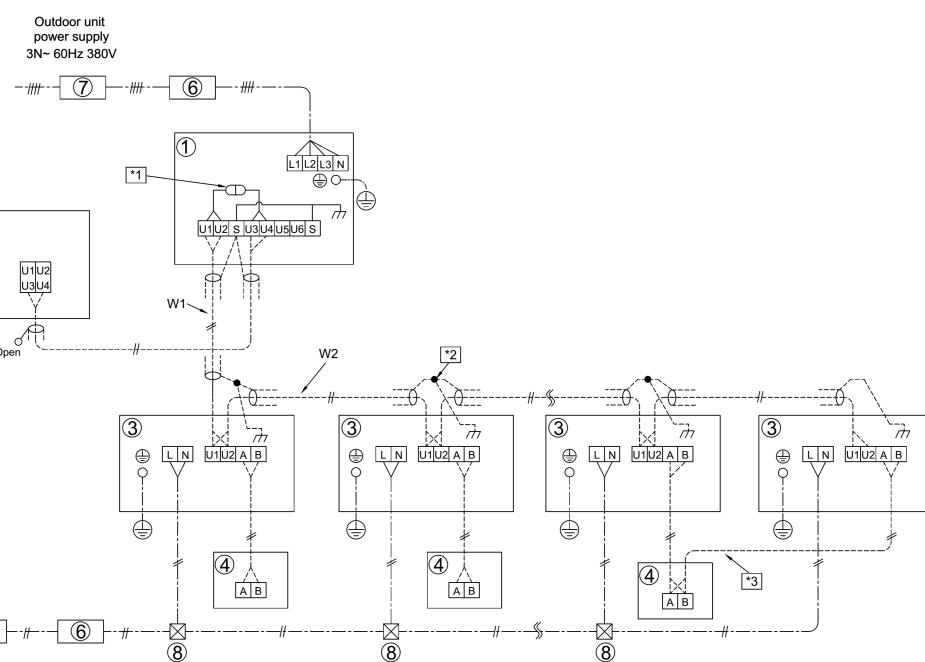

(Note)


- When perform a central control, connect the relay connector between [U1,U2] and [U3,U4] terminal of the header unit. (At shipment from factory : No connection)
- Connect the closed end terminal of shield wire.  
(Connected to all connecting sections in each unit)
- Group control.
- Select the power supply wiring and fuse of outdoor/indoor units according to each model's specification.  
Perform wiring of power supply complying with the rules and regulations of the local electric company.
- For the control wires connecting indoor units, outdoor units, and between indoor and outdoor units, use 2-core and non-polarity shield wires.
- As for details, see the wiring diagram of indoor/outdoor unit.
- Diagram of corrosion heavy protection model is the same as that of standard model.



## Two units connected

Model : MMY-AP\*\*\*6HT8P-E

(1)	Outdoor unit (Header unit)
(2)	Outdoor unit (Follower unit)
(3)	Indoor unit
(4)	Remote controller
(5)	Central remote controller (option)
(6)	Main switch (Fuse)
(7)	Circuit breaker (Earth leakage breaker)
(8)	Pull box
W1 :	Control wiring between indoor and outdoor units
W2 :	Control wiring between indoor units
W3 :	Control wiring between outdoor units

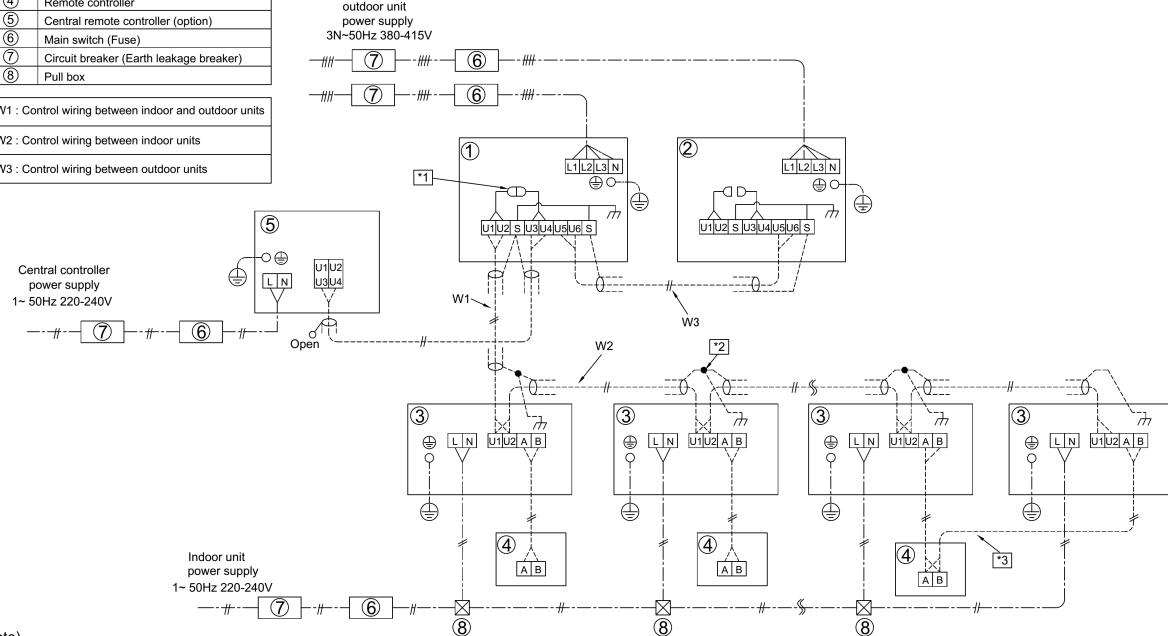

(Note)

- When perform a central control, connect the relay connector between [U1, U2] and [U3, U4] terminal of the header unit. (At shipment from factory : No connection)
- Connect the closed end terminal of shield wire. (Connected to all connecting sections in each unit)
- Group control.
- Select the power supply wiring and fuse of outdoor/indoor units according to each model's specification. Perform wiring of power supply complying with the rules and regulations of the local electric company.
- For the control wires connecting indoor units, outdoor units, and between indoor and outdoor units, use 2-core and non-polarity shield wires.
- As for details, see the wiring diagram of indoor/outdoor unit.
- Diagram of corrosion heavy protection model is the same as that of standard model.




### Three units connected



Model : MMY-AP\*\*\*6HT8P-E

(1)	Outdoor unit (Header unit)
(2)	Outdoor unit (Follower unit)
(3)	Indoor unit
(4)	Remote controller
(5)	Central remote controller (option)
(6)	Main switch (Fuse)
(7)	Circuit breaker (Earth leakage breaker)
(8)	Pull box
W1 :	Control wiring between indoor and outdoor units
W2 :	Control wiring between indoor units
W3 :	Control wiring between outdoor units

Outdoor unit power supply  
3N~ 50Hz 380-415V

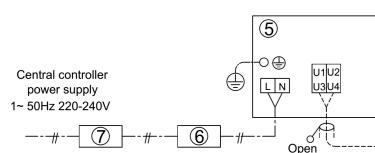

Indoor unit power supply  
1~ 50Hz 220-240V

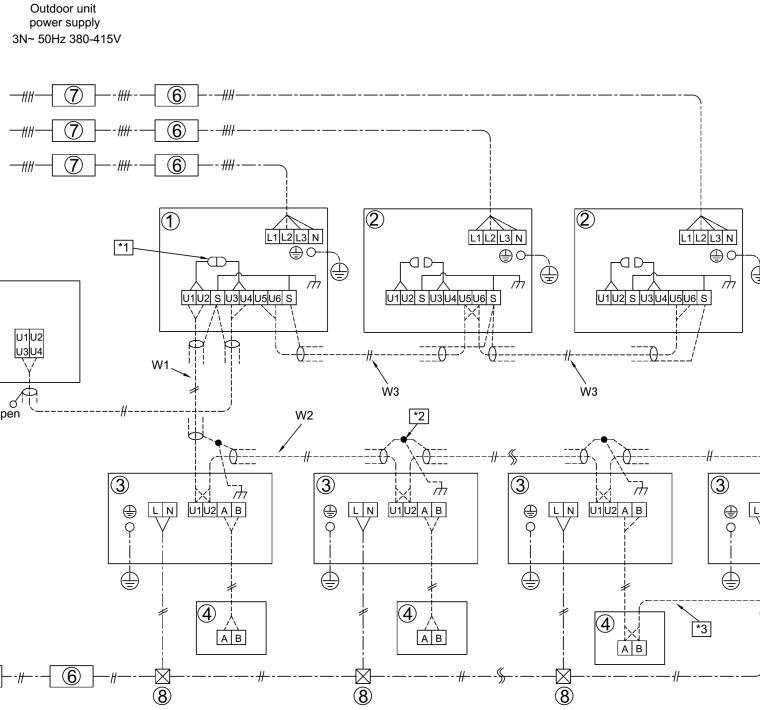

(Note)

- When perform a central control, connect the relay connector between [U1,U2] and [U3,U4] terminal of the header unit. (At shipment from factory : No connection)
- Connect the closed end terminal of shield wire.  
(Connected to all connecting sections in each unit)
- Ground control.
- Select the power supply wiring and fuse of outdoor/indoor units according to each model's specification.  
Perform wiring of power supply complying with the rules and regulations of the local electric company.
- For the control wires connecting indoor units, outdoor units, and between indoor and outdoor units,  
use 2-core and non-polarity shield wires.
- As for details, see the wiring diagram of indoor/outdoor unit.
- Diagram of corrosion heavy protection model is the same as that of standard model.



## 5-8. Applied control for Outdoor Unit

The outdoor fan high static pressure support and priority operation mode setting (cooling / heating / number of units / or priority indoor unit) functions are made available by setting relevant switches provided on the interface P.C. board of the outdoor unit.

### 5-8-1. Outdoor Fan High Static Pressure Shift

#### Purpose/characteristics

This function is used when connecting a duct to the discharge port of an outdoor unit (as part of, for example, unit installation on the floor by floor installation.)

#### Setup

Turn ON the DIP switch [SW10, Bit 2] provided on the interface P.C. board of the outdoor unit.

This function must be enabled with every discharge duct connected outdoor unit for both of the header and follower units.

#### Specification

Increase the speed of the propeller fan units on the outdoor fan to allow the installation of a duct with a maximum external static pressure not greater than specified in the table below. If a discharge duct with a resistance greater than 15 Pa (1.5 mmAq) is to be used, enable this function. The maximum external static pressures of base units are shown below (Table 1). In the case of combined use of multiple outdoor units, set all the units to the same maximum external static pressure as the one with the lowest maximum external static pressure (see Table 2).

Table 1: Maximum External Static Pressures of Base Outdoor Units

Model	MMY-	MAP0806*	MAP1006*	MAP1206*	MAP1406*	MAP1606*	MAP1806*	MAP2006*	MAP2206*
Maximum external static pressure	(Pa)	60	60	50	50	40	50	40	40
(* ) Outdoor unit air flow	(m <sup>3</sup> /h)	9700	9700	12200	12200	12600	17300	17900	18500

(\*) Calculate duct resistance from outdoor unit air flow.

Table 2: Maximum External Static Pressures for Combined Use of Base Units

(1) Standard models

System	Combination			Maximum external static pressure (Pa)
	HP			
8	8			60
10	10			60
12	12			50
14	14			50
16	16			40
18	18			50
20	20			40
22	22			40
24	12	12		50
26	14	12		50
28	16	12		40
30	16	14		40
32	16	16		40
34	18	16		40
36	20	16		40
38	22	16		40
40	20	20		40
42	22	20		40
44	22	22		40
46	16	16	14	40
48	16	16	16	40
50	18	16	16	40
52	20	16	16	40
54	22	16	16	40
56	20	20	16	40
58	22	20	16	40
60	22	22	16	40



## (2) High efficiency models

System	Combination			Maximum external static pressure (Pa)
	HP			
20	10	10		60
22	12	10		50
36	12	12	12	50
38	14	12	12	50
40	14	14	12	50
42	14	14	14	50
44	16	14	14	40
54	20	20	14	40

## 5-8-2. Priority Operation Mode Setting

### Purpose/characteristics

This function allows switching between priority cooling and priority heating.

Four patterns of priority operation mode setting are available as shown in the table below. Select a suitable priority mode according to the needs of the customer.

### Setup

#### CAUTION

In the case of the priority indoor unit mode, it is necessary to set up the specific indoor unit chosen for priority operation (a single unit only).

#### (1) Outdoor unit setup method (header unit)

SW11		Operation
Bit 1	Bit 2	
OFF	OFF	Priority heating (factory default)
ON	OFF	Priority cooling
OFF	ON	Priority operation based on No. of units in operation (priority given to the operation mode with the largest share of units in operation)
ON	ON	Priority indoor unit (priority given to the operation mode of the specific indoor unit set up for priority operation)



(2) Indoor unit setup method for priority indoor unit mode

The setting can be changed only when the system is at rest. (Be sure to turn off the system prior to this operation.)


- Push the **TEST** + **SET** + **CL** buttons simultaneously and hold for at least 4 seconds. The display window will start flashing in a little while.

Verify that the displayed CODE No. is 10.

- If the displayed CODE No. is not 10, press the **TEST** button to erase the display and repeat the procedure from the beginning.

(Note that the system does not respond to remote controller operation for about 1 minute after the **TEST** button is pushed.)

(In the case of group control, the indoor unit No. displayed first indicates the header unit.)

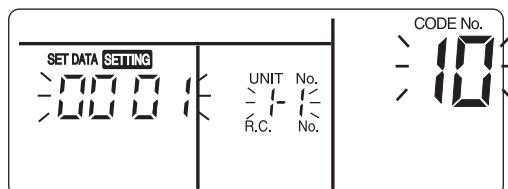

- Each time the **UNIT LOUVER** button is pushed, one of the indoor unit Nos. under group control is displayed in turn. Select the indoor unit whose setting is to be changed.

The fan and flap of the selected indoor unit then come on, so that the position of this unit can be confirmed.

- Use the **TEMP.** button to select the CODE No. 04.

- Use the **TIME** button to select the SET DATA 0001.

Priority set 0001      No priority set 0000




- Push the **SET** button.

The setup is finished when the display changes from flashing to steady.

- Upon finishing the setup, push the **TEST** button. (This finalizes the setting.)

When the **TEST** button is pushed, the display goes blank, and the system returns to normal off state.

(Note that the system does not respond to remote controller operation for about 1 minute after the **TEST** button is pushed.)

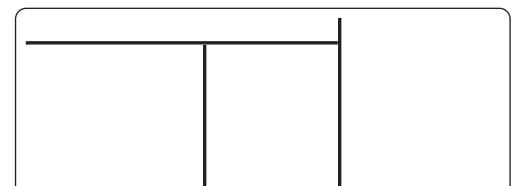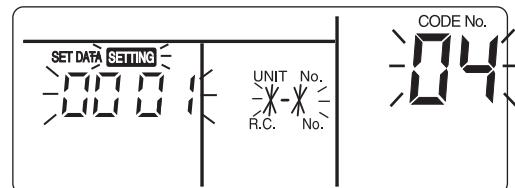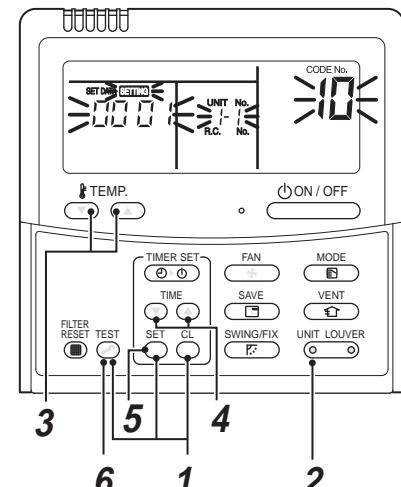

**NOTE**



Priority can be given to only one indoor unit. If more than one indoor unit is accidentally set to priority, an error code (L5 or L6: Duplicated indoor unit priority setting) will be displayed.

All units displaying L5 have been set to 0001 (priority). Keep the unit to which priority should be given as it is, and change the value back to 0000 (no priority) for all the rest.



Error code	Description
L5	Duplicated indoor unit priority setting (The unit is set to 0001.)
L6	Duplicated indoor unit priority setting (The unit is set to 0000.)









## 5-9. Optional printed circuit board (PCB) of outdoor unit

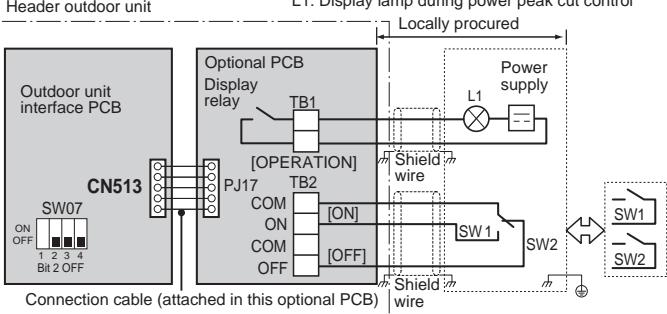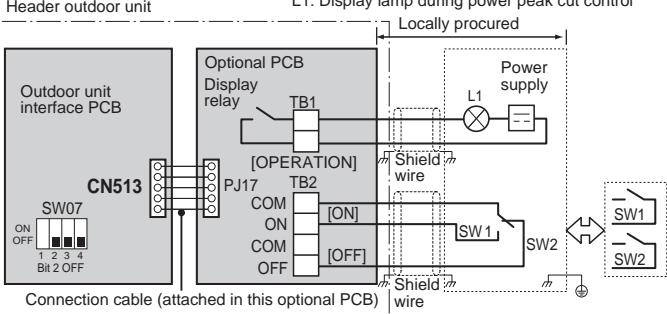Model name	Appearance	Function																			
TCB-PCDM4E	 Size: 71 x 85 (mm) <b>Application</b>   <p>MMY-MAP080 to 120      MMY-MAP140 to 220</p> <p>Optional PCB (max. number installed: 1 pc)</p> <p>* Install the optional PCB in the outdoor header unit.</p>	<p><b>[1] Power peak-cut Control</b></p> <ul style="list-style-type: none"> <li><b>Purpose:</b> Limiting air conditioning performance with external signals and decreasing the peak power consumption.</li> <li><b>Feature</b> The upper limit capacity of the outdoor unit is restricted based on the outdoor power peak selected setting.</li> </ul> <p><b>Standard Specifications</b> (Wiring example)</p>  <p>L1: Display lamp during power peak cut control Locally procured</p> <p>For SW1 and SW2, be sure to provide no-voltage contacts for each terminal. The input signals of SW1 and SW2 may be pulse input (100 msec or more) or continuous make. Do not turn on [SW1] and [SW2] simultaneously.</p> <p><b>&lt;SW07 (bit 2) OFF [2-stage switching]&gt;</b></p> <table border="1"> <thead> <tr> <th colspan="2">Input</th> <th colspan="2">SW07 (bit 1)</th> <th rowspan="2">Display relay (L1)</th> </tr> <tr> <th>SW1</th> <th>SW2</th> <th>Bit 1 OFF</th> <th>Bit 1 ON</th> </tr> </thead> <tbody> <tr> <td>OFF</td> <td>ON</td> <td>100 % (normal operation)</td> <td>100 % (normal operation)</td> <td>OFF</td> </tr> <tr> <td>ON</td> <td>OFF</td> <td>0 % (forced stop)</td> <td>Approx. 60 % (upper limit regulated)</td> <td>ON</td> </tr> </tbody> </table>	Input		SW07 (bit 1)		Display relay (L1)	SW1	SW2	Bit 1 OFF	Bit 1 ON	OFF	ON	100 % (normal operation)	100 % (normal operation)	OFF	ON	OFF	0 % (forced stop)	Approx. 60 % (upper limit regulated)	ON
Input		SW07 (bit 1)		Display relay (L1)																	
SW1	SW2	Bit 1 OFF	Bit 1 ON																		
OFF	ON	100 % (normal operation)	100 % (normal operation)	OFF																	
ON	OFF	0 % (forced stop)	Approx. 60 % (upper limit regulated)	ON																	



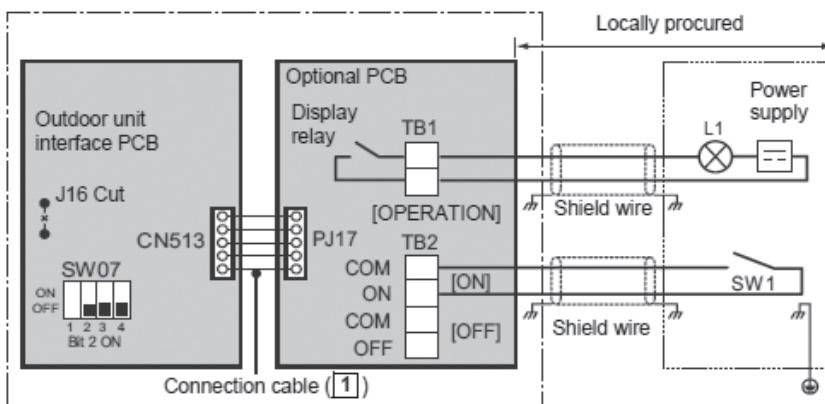
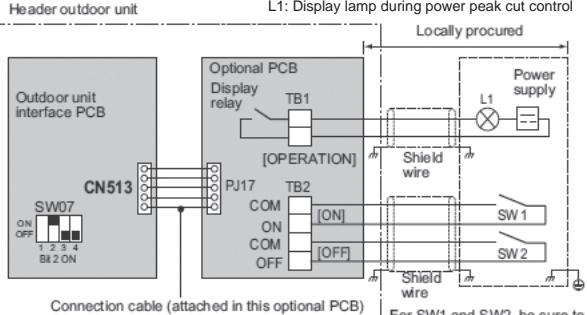


Model name	Appearance	Function																																															
TCB-PCM04E	 Size: 55.5 x 60 (mm) <b>Application</b>  <div style="display: flex; justify-content: space-around;"> <span>MMY-MAP080 to 120</span> <span>MMY-MAP140 to 220</span> </div> <div style="display: flex; justify-content: space-around;"> <span>Optional PCB</span> <span>(max. number installed: 1 pc)</span> </div> <p>* Install the optional PCB in the outdoor header unit.</p>	<p><b>For one input function</b></p> <p>Power peak-cut ON-OFF control is made possible on the SMMS-e on only the [ON] terminal input (SW1) by cutting the jumper lead (J16) of the center outdoor unit interface PCB.          (Wiring example)</p> <p>Header outdoor unit    L1: Display lamp during power peak cut control</p>  <p><b>&lt;SW07 (bit 2) OFF [2-stage switching]&gt;</b></p> <p>Power peak-cut control turns ON when SW1 in the wiring example is ON (continuous make).</p> <table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th rowspan="2">Jumper lead J16</th> <th rowspan="2">Input SW1</th> <th colspan="2">SW07 (bit 1)</th> <th rowspan="2">Display relay (L1)</th> </tr> <tr> <th>Bit 1 OFF</th> <th>Bit 1 ON</th> </tr> </thead> <tbody> <tr> <td>Cut</td> <td>OFF</td> <td>100% (normal operation)</td> <td>100% (normal operation)</td> <td>OFF</td> </tr> <tr> <td></td> <td>ON</td> <td>0% (forced stop)</td> <td>Approx. 60% (upper limit regulated)</td> <td>ON</td> </tr> </tbody> </table> <p><b>Enhanced Specifications</b>          (Wiring example)</p> <p>Header outdoor unit    L1: Display lamp during power peak cut control</p>  <p>For SW1 and SW2, be sure to provide no-voltage contacts for each terminal.</p> <p><b>&lt;SW07 (bit 2) ON [4-stage switching]&gt;</b></p> <table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th colspan="2">Input</th> <th colspan="2">SW07 (bit 1)</th> <th>Display relay (L1)</th> </tr> <tr> <th>SW1</th> <th>SW2</th> <th>Bit 1 OFF</th> <th>Bit 1 ON</th> <th></th> </tr> </thead> <tbody> <tr> <td>OFF</td> <td>OFF</td> <td>100% (normal operation)</td> <td>100% (normal operation)</td> <td>OFF</td> </tr> <tr> <td>ON</td> <td>OFF</td> <td>Approx. 80% (upper limit regulated)</td> <td>Approx. 85% (upper limit regulated)</td> <td>ON</td> </tr> <tr> <td>OFF</td> <td>ON</td> <td>Approx. 60% (upper limit regulated)</td> <td>Approx. 75% (upper limit regulated)</td> <td>ON</td> </tr> <tr> <td>ON</td> <td>ON</td> <td>0% (forced stop)</td> <td>Approx. 60% (upper limit regulated)</td> <td>ON</td> </tr> </tbody> </table>	Jumper lead J16	Input SW1	SW07 (bit 1)		Display relay (L1)	Bit 1 OFF	Bit 1 ON	Cut	OFF	100% (normal operation)	100% (normal operation)	OFF		ON	0% (forced stop)	Approx. 60% (upper limit regulated)	ON	Input		SW07 (bit 1)		Display relay (L1)	SW1	SW2	Bit 1 OFF	Bit 1 ON		OFF	OFF	100% (normal operation)	100% (normal operation)	OFF	ON	OFF	Approx. 80% (upper limit regulated)	Approx. 85% (upper limit regulated)	ON	OFF	ON	Approx. 60% (upper limit regulated)	Approx. 75% (upper limit regulated)	ON	ON	ON	0% (forced stop)	Approx. 60% (upper limit regulated)	ON
Jumper lead J16	Input SW1	SW07 (bit 1)			Display relay (L1)																																												
		Bit 1 OFF	Bit 1 ON																																														
Cut	OFF	100% (normal operation)	100% (normal operation)	OFF																																													
	ON	0% (forced stop)	Approx. 60% (upper limit regulated)	ON																																													
Input		SW07 (bit 1)		Display relay (L1)																																													
SW1	SW2	Bit 1 OFF	Bit 1 ON																																														
OFF	OFF	100% (normal operation)	100% (normal operation)	OFF																																													
ON	OFF	Approx. 80% (upper limit regulated)	Approx. 85% (upper limit regulated)	ON																																													
OFF	ON	Approx. 60% (upper limit regulated)	Approx. 75% (upper limit regulated)	ON																																													
ON	ON	0% (forced stop)	Approx. 60% (upper limit regulated)	ON																																													




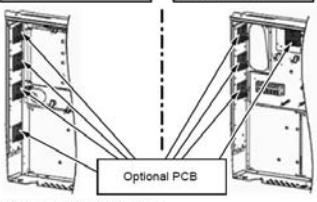
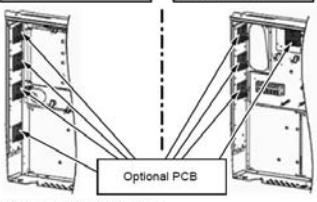
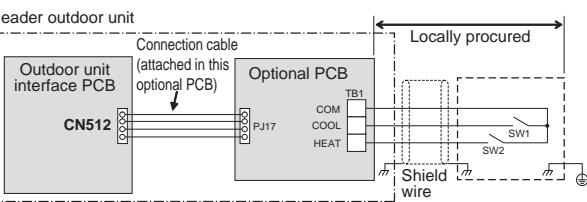
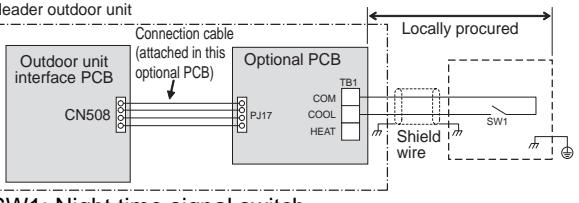
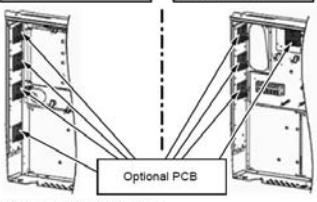


Model name	Appearance	Function																			
TCB-PCM04E	 <p>Size: 55.5 x 60 (mm)</p> <table border="1"> <thead> <tr> <th>Application</th> </tr> </thead> <tbody> <tr> <td>  <p>MMY-MAP080 to 120 MMY-MAP140 to 220    (max. number installed: 4 pcs)</p> <ul style="list-style-type: none"> <li>* Install the optional PCB in the outdoor header unit.</li> </ul> </td></tr> </tbody> </table>	Application	 <p>MMY-MAP080 to 120 MMY-MAP140 to 220    (max. number installed: 4 pcs)</p> <ul style="list-style-type: none"> <li>* Install the optional PCB in the outdoor header unit.</li> </ul>	<p><b>[2] External master ON/OFF control</b></p> <ul style="list-style-type: none"> <li>• Feature The outdoor unit starts or stop the system.</li> <li>• Function By connecting the cable (attached in this optional PCB) to the interface PC board on an outdoor unit, all indoor units connected to the outdoor unit enable to operate simultaneously.</li> <li>• Operation The outdoor unit connection is for the header unit (U1).</li> </ul> <p>Header outdoor unit</p>  <p>SW1: Operation input switch SW2: Stop input switch</p> <table border="1"> <thead> <tr> <th>Terminal</th> <th>Input signal</th> <th>Operation</th> </tr> </thead> <tbody> <tr> <td>COOL (SW1)</td> <td>ON OFF</td> <td>All indoor units operate together</td> </tr> <tr> <td>HEAT (SW2)</td> <td>ON OFF</td> <td>All indoor units stop together</td> </tr> </tbody> </table> <p>Provide no-voltage pulse contacts for each terminal. Hold the ON state for at least 100 msec. Do not turn SW1 and SW2 ON simultaneously</p> <p><b>[3] Night time operation (sound reduction) control</b></p> <ul style="list-style-type: none"> <li>• Purpose: Reducing noise from an outdoor unit</li> <li>• Feature Sound level can be reduced by restricting the compressor and fan speed</li> <li>• Function As the cable (attached in this optional PCB) is connected to the "Interface PCB" on an outdoor unit, both compressor speed and fan speed are restricted while the signal of the night operation control is input. It makes the noise reduction during the night time operation.</li> <li>• Operation The outdoor unit connection is for the header unit (U1).</li> </ul> <p>Header outdoor unit</p>  <p>SW1: Night time signal switch</p> <table border="1"> <thead> <tr> <th>Terminal</th> <th>Input signal</th> <th>Operation</th> </tr> </thead> <tbody> <tr> <td rowspan="2">COOL (SW1)</td> <td>ON OFF</td> <td>All indoor units operate together</td> </tr> <tr> <td>ON OFF</td> <td>All indoor units stop together</td> </tr> </tbody> </table> <p>Each terminal should be connected to dry contact. The input signal is recognized during its rising/falling phase. (After reaching the top/bottom of the rising/falling edge, the signal must remain there for at least 100 ms.)</p>	Terminal	Input signal	Operation	COOL (SW1)	ON OFF	All indoor units operate together	HEAT (SW2)	ON OFF	All indoor units stop together	Terminal	Input signal	Operation	COOL (SW1)	ON OFF	All indoor units operate together	ON OFF	All indoor units stop together
Application																					
 <p>MMY-MAP080 to 120 MMY-MAP140 to 220    (max. number installed: 4 pcs)</p> <ul style="list-style-type: none"> <li>* Install the optional PCB in the outdoor header unit.</li> </ul>																					
Terminal	Input signal	Operation																			
COOL (SW1)	ON OFF	All indoor units operate together																			
HEAT (SW2)	ON OFF	All indoor units stop together																			
Terminal	Input signal	Operation																			
COOL (SW1)	ON OFF	All indoor units operate together																			
	ON OFF	All indoor units stop together																			

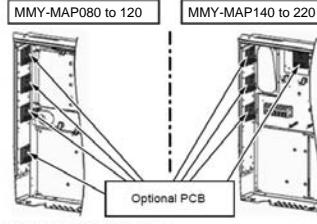
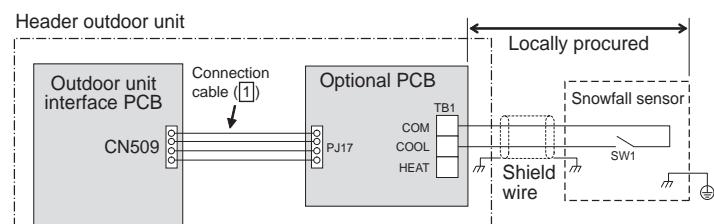


Model name	Appearance	Function										
TCB-PCM04E	 Size: 55.5 x 60 (mm)	<b>Sound reduction and approximation capacity (reference)</b>										
			Night operation sound reduction dB (A)	Capacity								
				COOL	HEAT							
		2206 type	50	Approx. 85%	Approx. 80%							
		2006 type	50	Approx. 70%	Approx. 65%							
		1806 type	50	Approx. 60%	Approx. 55%							
		1606 type	53	Approx. 80%	Approx. 80%							
		1406 type	53	Approx. 70%	Approx. 70%							
	  MMY-MAP080 to 120      MMY-MAP140 to 220 (max. number installed: 4 pcs) * Install the optional PCB in the outdoor header unit.	1206 type	54	Approx. 65%	Approx. 65%							
		1006 type	54	Approx. 60%	Approx. 60%							
		0806 type	54	Approx. 55%	Approx. 55%							
	<b>Condition</b> Cooling: (Indoor 27 deg DB, 19 deg WB) (Outdoor temperature 25 deg DB) Heating: (Indoor 20 deg DB) (Outdoor temperature 7 deg DB, 6 deg WB)											
	<b>[4] Snowfall fan control</b> <ul style="list-style-type: none"> <li>Purpose: Rotating the fan to prevent snow accumulation</li> <li>Feature</li> </ul> Outdoor fan is operated from the snowfall signal received from the outside.											
	<b>▼ Functions</b> The outdoor unit fan operates at snowfall by connecting to the outdoor unit interface PCB.											
	<b>▼ Operation</b>  SW1: Snowfall selection switch (snowfall sensor)											
	<table border="1"> <thead> <tr> <th>Terminal</th> <th>Input signal</th> <th>Operation</th> </tr> </thead> <tbody> <tr> <td rowspan="2">Cooling (SW1)</td> <td>ON</td> <td>Snowfall fan control (Fan in outdoor unit operates.)</td> </tr> <tr> <td>OFF</td> <td>Normal operation</td> </tr> </tbody> </table> Be sure to provide no-voltage continuous contacts for each terminal.					Terminal	Input signal	Operation	Cooling (SW1)	ON	Snowfall fan control (Fan in outdoor unit operates.)	OFF
Terminal	Input signal	Operation										
Cooling (SW1)	ON	Snowfall fan control (Fan in outdoor unit operates.)										
	OFF	Normal operation										

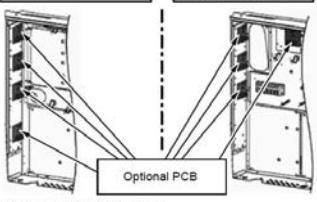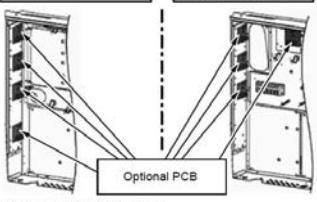
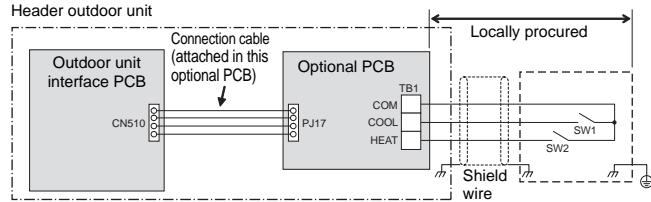

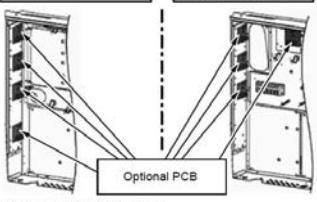


Model name	Appearance	Function																																																			
	 <p>Size: 55.5 x 60 (mm)</p> <table border="1"> <thead> <tr> <th>Application</th></tr> </thead> <tbody> <tr> <td>  <p>MMY-MAP080 to 120      MMY-MAP140 to 220    (max. number installed: 4 pcs)</p> <p>* Install the optional PCB in the outdoor header unit.</p> </td></tr> </tbody> </table>	Application	 <p>MMY-MAP080 to 120      MMY-MAP140 to 220    (max. number installed: 4 pcs)</p> <p>* Install the optional PCB in the outdoor header unit.</p>	<p><b>[5] Operation mode selection control</b></p> <ul style="list-style-type: none"> <li><b>Purpose:</b> Limiting operation modes to cooling and heating only</li> <li><b>Feature</b> This control can restrict the selectable operation mode.</li> </ul> <p><b>▼ Functions</b> The heating/cooling mode of the system can be selected by connecting to the interface PCB of outdoor units.</p> <p><b>▼ Operation</b> The outdoor unit connection is for the header unit (U1).</p>  <p>SW1: Cooling mode specified input switch SW2: Heating mode specified input switch</p> <table border="1"> <thead> <tr> <th colspan="2">Input Signal</th> <th>Operation: Selected operation mode</th> </tr> <tr> <th>Cooling (SW1)</th> <th>Heating (SW2)</th> <td></td> </tr> </thead> <tbody> <tr> <td>ON</td> <td>OFF</td> <td>Cooling operation only</td> </tr> <tr> <td>OFF</td> <td>ON</td> <td>Heating operation only</td> </tr> <tr> <td>OFF</td> <td>OFF</td> <td>Normal operation</td> </tr> </tbody> </table> <p>Each terminal should be connected to dry contact.</p> <h3>About Switching of Processing of Indoor Unit Operation State</h3> <p>Processing of the operation state can be switched for indoor units in a mode other than the selected operation mode by setting the jumper lead (J01) of the header outdoor unit interface PCB.</p> <table border="1"> <thead> <tr> <th>Jumper lead</th> <th>Details of Processing</th> </tr> </thead> <tbody> <tr> <td>J01 connected (factory default)</td> <td> <p>Unallowed indoor units in a mode other than the selected operation mode are not treated as priority (thermo OFF state). (Unallowed indoor units)</p> <table border="1"> <thead> <tr> <th>Operation Mode</th> <th>Operation State</th> <th>Remote control</th> </tr> </thead> <tbody> <tr> <td>Cooling unit</td> <td>Air blow operation at blow rate set on remote control</td> <td rowspan="3" style="text-align: center;">,  indicator is displayed.</td> </tr> <tr> <td>Heating unit</td> <td>Air blow operation at super-slow blow rate</td> </tr> <tr> <td>Air blow unit</td> <td>Regular air blow operation at blow rate set on remote control</td> </tr> </tbody> </table> </td> </tr> <tr> <td>J01 cut</td> <td> <p>Indoor units in a mode other than the selected operation mode are forcibly switched to the selected operation mode.</p> <table border="1"> <thead> <tr> <th>PC board selection mode</th> <th>Remote control operation/display</th> </tr> </thead> <tbody> <tr> <td>Normal</td> <td>, , , or  can be selected</td> <td rowspan="3" style="vertical-align: top;"> When using the remote control,  (mode select control) indicator is displayed. </td> </tr> <tr> <td>Cool</td> <td>Only , , or  can be selected</td> </tr> <tr> <td>Heat</td> <td>Only  or  can be selected</td> </tr> </tbody> </table> </td> </tr> </tbody> </table> <p>The jumper lead is not switched. Indoor units in a mode other than the selected operation mode are forcibly switched to the selected operation mode.</p> <table border="1"> <thead> <tr> <th>PC board selection mode</th> <th>Remote control operation/display</th> </tr> </thead> <tbody> <tr> <td>Normal</td> <td>, , , or  can be selected</td> <td rowspan="3" style="vertical-align: top;"> When using the remote control,  (mode select control) indicator is displayed. </td> </tr> <tr> <td>Cool</td> <td>Only , , or  can be selected</td> </tr> <tr> <td>Heat</td> <td>Only  or  can be selected</td> </tr> </tbody> </table>	Input Signal		Operation: Selected operation mode	Cooling (SW1)	Heating (SW2)		ON	OFF	Cooling operation only	OFF	ON	Heating operation only	OFF	OFF	Normal operation	Jumper lead	Details of Processing	J01 connected (factory default)	<p>Unallowed indoor units in a mode other than the selected operation mode are not treated as priority (thermo OFF state). (Unallowed indoor units)</p> <table border="1"> <thead> <tr> <th>Operation Mode</th> <th>Operation State</th> <th>Remote control</th> </tr> </thead> <tbody> <tr> <td>Cooling unit</td> <td>Air blow operation at blow rate set on remote control</td> <td rowspan="3" style="text-align: center;">,  indicator is displayed.</td> </tr> <tr> <td>Heating unit</td> <td>Air blow operation at super-slow blow rate</td> </tr> <tr> <td>Air blow unit</td> <td>Regular air blow operation at blow rate set on remote control</td> </tr> </tbody> </table>	Operation Mode	Operation State	Remote control	Cooling unit	Air blow operation at blow rate set on remote control	,  indicator is displayed.	Heating unit	Air blow operation at super-slow blow rate	Air blow unit	Regular air blow operation at blow rate set on remote control	J01 cut	<p>Indoor units in a mode other than the selected operation mode are forcibly switched to the selected operation mode.</p> <table border="1"> <thead> <tr> <th>PC board selection mode</th> <th>Remote control operation/display</th> </tr> </thead> <tbody> <tr> <td>Normal</td> <td>, , , or  can be selected</td> <td rowspan="3" style="vertical-align: top;"> When using the remote control,  (mode select control) indicator is displayed. </td> </tr> <tr> <td>Cool</td> <td>Only , , or  can be selected</td> </tr> <tr> <td>Heat</td> <td>Only  or  can be selected</td> </tr> </tbody> </table>	PC board selection mode	Remote control operation/display	Normal	, , , or  can be selected	When using the remote control,  (mode select control) indicator is displayed.	Cool	Only , , or  can be selected	Heat	Only  or  can be selected	PC board selection mode	Remote control operation/display	Normal	, , , or  can be selected	When using the remote control,  (mode select control) indicator is displayed.	Cool	Only , , or  can be selected	Heat	Only  or  can be selected
Application																																																					
 <p>MMY-MAP080 to 120      MMY-MAP140 to 220    (max. number installed: 4 pcs)</p> <p>* Install the optional PCB in the outdoor header unit.</p>																																																					
Input Signal		Operation: Selected operation mode																																																			
Cooling (SW1)	Heating (SW2)																																																				
ON	OFF	Cooling operation only																																																			
OFF	ON	Heating operation only																																																			
OFF	OFF	Normal operation																																																			
Jumper lead	Details of Processing																																																				
J01 connected (factory default)	<p>Unallowed indoor units in a mode other than the selected operation mode are not treated as priority (thermo OFF state). (Unallowed indoor units)</p> <table border="1"> <thead> <tr> <th>Operation Mode</th> <th>Operation State</th> <th>Remote control</th> </tr> </thead> <tbody> <tr> <td>Cooling unit</td> <td>Air blow operation at blow rate set on remote control</td> <td rowspan="3" style="text-align: center;">,  indicator is displayed.</td> </tr> <tr> <td>Heating unit</td> <td>Air blow operation at super-slow blow rate</td> </tr> <tr> <td>Air blow unit</td> <td>Regular air blow operation at blow rate set on remote control</td> </tr> </tbody> </table>	Operation Mode	Operation State	Remote control	Cooling unit	Air blow operation at blow rate set on remote control	,  indicator is displayed.	Heating unit	Air blow operation at super-slow blow rate	Air blow unit	Regular air blow operation at blow rate set on remote control																																										
Operation Mode	Operation State	Remote control																																																			
Cooling unit	Air blow operation at blow rate set on remote control	,  indicator is displayed.																																																			
Heating unit	Air blow operation at super-slow blow rate																																																				
Air blow unit	Regular air blow operation at blow rate set on remote control																																																				
J01 cut	<p>Indoor units in a mode other than the selected operation mode are forcibly switched to the selected operation mode.</p> <table border="1"> <thead> <tr> <th>PC board selection mode</th> <th>Remote control operation/display</th> </tr> </thead> <tbody> <tr> <td>Normal</td> <td>, , , or  can be selected</td> <td rowspan="3" style="vertical-align: top;"> When using the remote control,  (mode select control) indicator is displayed. </td> </tr> <tr> <td>Cool</td> <td>Only , , or  can be selected</td> </tr> <tr> <td>Heat</td> <td>Only  or  can be selected</td> </tr> </tbody> </table>	PC board selection mode	Remote control operation/display	Normal	, , , or  can be selected	When using the remote control,  (mode select control) indicator is displayed.	Cool	Only , , or  can be selected	Heat	Only  or  can be selected																																											
PC board selection mode	Remote control operation/display																																																				
Normal	, , , or  can be selected	When using the remote control,  (mode select control) indicator is displayed.																																																			
Cool	Only , , or  can be selected																																																				
Heat	Only  or  can be selected																																																				
PC board selection mode	Remote control operation/display																																																				
Normal	, , , or  can be selected	When using the remote control,  (mode select control) indicator is displayed.																																																			
Cool	Only , , or  can be selected																																																				
Heat	Only  or  can be selected																																																				



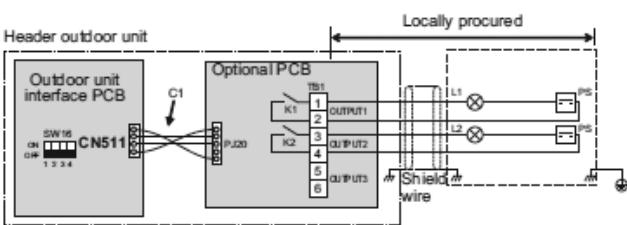


Model name	Appearance	Function																				
TCB-PCIN4E	 <p>Size: 73 x 79 (mm)</p>	<p><b>[6] Error / Operation Output</b></p> <ul style="list-style-type: none"> <li>• Feature Operation and error monitoring is possible.</li> </ul> <p>▼ Function The operation error output PCB can indicate operation and error states by connecting to the interface PCB of outdoor units.</p> <p>▼ Operation Operation output: The operation indicator is on while any indoor unit in the system is operating. Error output: The error indicator is on when an error is occurred on even one of the indoor or outdoor units in the system.</p> <p>Wiring example</p>  <table border="1"> <tr> <td>C1</td> <td>Attached connection cable 1 (4wires)</td> </tr> <tr> <td>CN511</td> <td>Connector on interface side (green)</td> </tr> <tr> <td>K1, K2</td> <td>Relays</td> </tr> <tr> <td>L1</td> <td>Error indication Lamp</td> </tr> <tr> <td>L2</td> <td>Operation indication Lamp</td> </tr> <tr> <td>OUTPUT1</td> <td>Error output</td> </tr> <tr> <td>OUTPUT2</td> <td>Operation output</td> </tr> <tr> <td>PJ20</td> <td>Connector on optional PCB side</td> </tr> <tr> <td>PS</td> <td>Power supply unit</td> </tr> <tr> <td>TB1</td> <td>Terminal block</td> </tr> </table> <p>* [OUTPUT3] is normally output when power is turned out.</p> <p>* Install the optional PCB in the outdoor header unit. (max. number installed: 2 pcs)</p>	C1	Attached connection cable 1 (4wires)	CN511	Connector on interface side (green)	K1, K2	Relays	L1	Error indication Lamp	L2	Operation indication Lamp	OUTPUT1	Error output	OUTPUT2	Operation output	PJ20	Connector on optional PCB side	PS	Power supply unit	TB1	Terminal block
C1	Attached connection cable 1 (4wires)																					
CN511	Connector on interface side (green)																					
K1, K2	Relays																					
L1	Error indication Lamp																					
L2	Operation indication Lamp																					
OUTPUT1	Error output																					
OUTPUT2	Operation output																					
PJ20	Connector on optional PCB side																					
PS	Power supply unit																					
TB1	Terminal block																					

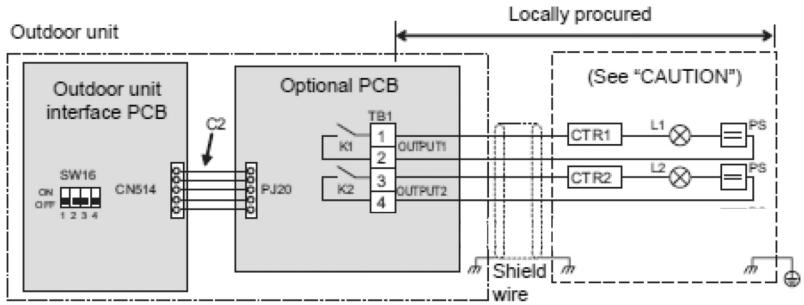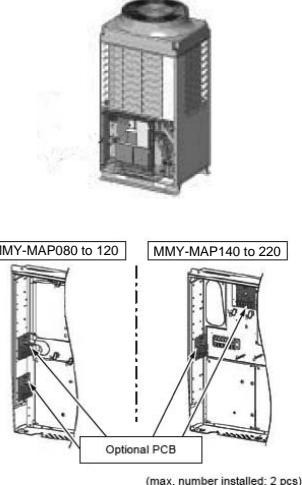


Model name	Appearance	Function																						
TCB-PCIN4E	 <p>Size: 73 x 79 (mm)</p>	<p><b>[7] Compressor Operation Output</b></p> <ul style="list-style-type: none"> <li><b>• Feature</b> Outputs the operation status of the compressors in each outdoor unit.</li> </ul> <p><b>▼ Functions</b> This function can be applied, for example, to the elapsed operation time count of each compressor mounted on an outdoor unit since the compressor in operation signal can be output externally</p> <p><b>▼ Operation</b> During compressor operation, the relay of the output terminal corresponding to that compressor turns ON (closes) and turns OFF (opens) when compressor operation stops. As shown in the figure, the output terminals are "OUTPUT1", "OUTPUT2" from the left compressor facing the front of the outdoor unit.</p>  <p><b>Wiring example</b></p>  <table border="1"> <tr> <td>C2</td> <td>Connector cable 2 (2)</td> </tr> <tr> <td>CN514</td> <td>Connector on interface side (green)</td> </tr> <tr> <td>CTR1</td> <td>Elapsed operation counter 1</td> </tr> <tr> <td>CTR2</td> <td>Elapsed operation counter 2</td> </tr> <tr> <td>K1, K2</td> <td>Relays</td> </tr> <tr> <td>L1, L2</td> <td>Operation indication LEDs</td> </tr> <tr> <td>OUTPUT1</td> <td>Compressor 1 operation output terminal</td> </tr> <tr> <td>OUTPUT2</td> <td>Compressor 2 operation output terminal</td> </tr> <tr> <td>PJ20</td> <td>Connector on optional PCB side</td> </tr> <tr> <td>PS</td> <td>Power supply unit</td> </tr> <tr> <td>TB1</td> <td>Terminal block</td> </tr> </table> <p><b>Application</b></p>  <p>* Install the optional PCB in individual outdoor unit</p>	C2	Connector cable 2 (2)	CN514	Connector on interface side (green)	CTR1	Elapsed operation counter 1	CTR2	Elapsed operation counter 2	K1, K2	Relays	L1, L2	Operation indication LEDs	OUTPUT1	Compressor 1 operation output terminal	OUTPUT2	Compressor 2 operation output terminal	PJ20	Connector on optional PCB side	PS	Power supply unit	TB1	Terminal block
C2	Connector cable 2 (2)																							
CN514	Connector on interface side (green)																							
CTR1	Elapsed operation counter 1																							
CTR2	Elapsed operation counter 2																							
K1, K2	Relays																							
L1, L2	Operation indication LEDs																							
OUTPUT1	Compressor 1 operation output terminal																							
OUTPUT2	Compressor 2 operation output terminal																							
PJ20	Connector on optional PCB side																							
PS	Power supply unit																							
TB1	Terminal block																							

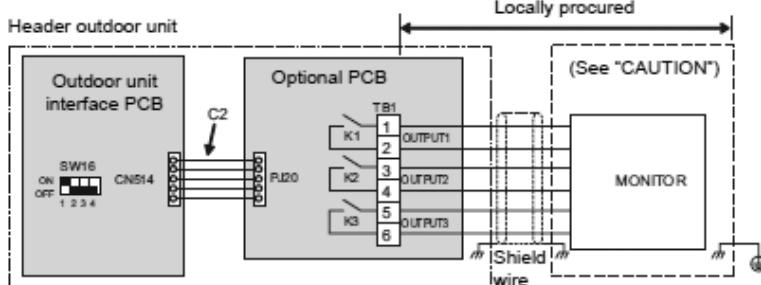


Model name	Appearance	Function																																															
TCB-PCIN4E	 <p>Size: 73 x 79 (mm)</p> <p><b>Application</b></p>  <p>MMY-MAP080 to 120 MMY-MAP140 to 220</p> <p>(max. number installed: 4 pcs)</p> <p>* Install the optional PCB in the outdoor header unit.</p>	<p><b>[8] Operating Rate Output</b></p> <ul style="list-style-type: none"> <li><b>Feature</b> Relay turn ON/OFF depending on the running rate of the system.</li> </ul> <p><b>▼ Functions</b> The operation state can be remotely checked since the system operating rate signal can be output externally.</p> <p><b>▼ Operation</b> As shown in the table, each of the output terminals turns ON (relay closes) and OFF (relay opens) according to the system operating rate.</p> <table border="1"> <thead> <tr> <th>Functions</th> <th>SW16</th> <th>OUTPUT1</th> <th>OUTPUT2</th> <th>OUTPUT3</th> <th>Operating rate FA</th> </tr> </thead> <tbody> <tr> <td rowspan="8">System operating rate output bit 1 : ON bit 2 : OFF</td> <td>ON</td> <td>OFF</td> <td>OFF</td> <td>OFF</td> <td>FA=0%</td> </tr> <tr> <td>OFF</td> <td>ON</td> <td>ON</td> <td>ON</td> <td>0%&lt;FA&lt;20%</td> </tr> <tr> <td>ON</td> <td>OFF</td> <td>OFF</td> <td>OFF</td> <td>20%≤FA&lt;35%</td> </tr> <tr> <td>OFF</td> <td>ON</td> <td>OFF</td> <td>OFF</td> <td>35%≤FA&lt;50%</td> </tr> <tr> <td>ON</td> <td>ON</td> <td>ON</td> <td>ON</td> <td>50%≤FA&lt;65%</td> </tr> <tr> <td>OFF</td> <td>OFF</td> <td>ON</td> <td>ON</td> <td>65%≤FA&lt;80%</td> </tr> <tr> <td>ON</td> <td>ON</td> <td>ON</td> <td>ON</td> <td>80%≤FA&lt;95%</td> </tr> <tr> <td>OFF</td> <td>ON</td> <td>ON</td> <td>ON</td> <td>95%≤FA</td> </tr> </tbody> </table> <p>OFF=relay open ON=relay closed</p> <p><b>Wiring example</b></p>  <p>Header outdoor unit</p> <p>Locally procured</p> <p>(See "CAUTION")</p> <p>C2</p> <p>Connector cable 2 (2)</p> <p>CN514</p> <p>Connector on interface side (green)</p> <p>K1, K2, K3</p> <p>Relays</p> <p>MONITOR</p> <p>Monitoring device</p> <p>OUTPUT1</p> <p>Output terminal for each function</p> <p>OUTPUT2</p> <p>Output terminal for each function</p> <p>OUTPUT3</p> <p>Output terminal for each function</p> <p>PJ20</p> <p>Connector on optional PCB side</p> <p>TB1</p> <p>Terminal block</p>	Functions	SW16	OUTPUT1	OUTPUT2	OUTPUT3	Operating rate FA	System operating rate output bit 1 : ON bit 2 : OFF	ON	OFF	OFF	OFF	FA=0%	OFF	ON	ON	ON	0%<FA<20%	ON	OFF	OFF	OFF	20%≤FA<35%	OFF	ON	OFF	OFF	35%≤FA<50%	ON	ON	ON	ON	50%≤FA<65%	OFF	OFF	ON	ON	65%≤FA<80%	ON	ON	ON	ON	80%≤FA<95%	OFF	ON	ON	ON	95%≤FA
Functions	SW16	OUTPUT1	OUTPUT2	OUTPUT3	Operating rate FA																																												
System operating rate output bit 1 : ON bit 2 : OFF	ON	OFF	OFF	OFF	FA=0%																																												
	OFF	ON	ON	ON	0%<FA<20%																																												
	ON	OFF	OFF	OFF	20%≤FA<35%																																												
	OFF	ON	OFF	OFF	35%≤FA<50%																																												
	ON	ON	ON	ON	50%≤FA<65%																																												
	OFF	OFF	ON	ON	65%≤FA<80%																																												
	ON	ON	ON	ON	80%≤FA<95%																																												
	OFF	ON	ON	ON	95%≤FA																																												




**TCB-PCDM4E**

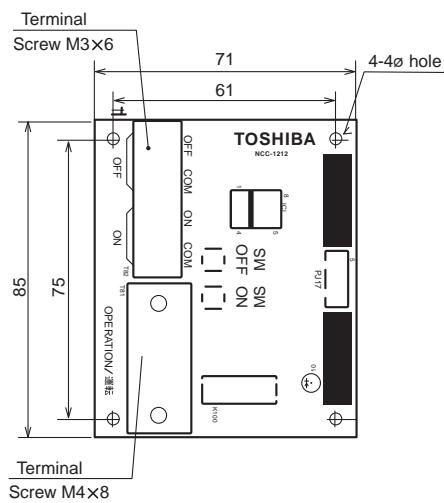

**TCB-PCMO4E**

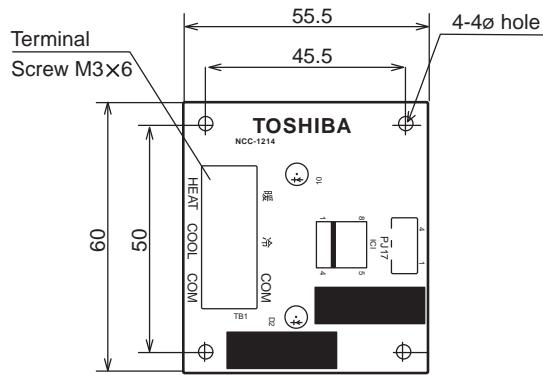

**TCB-PCIN4E**

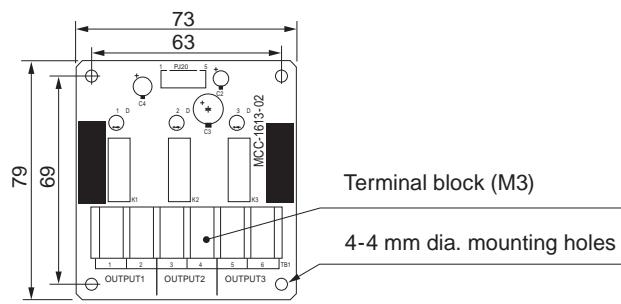

## 5-10. Part Load performance

MMY-MAP0806HT8P-E (8HP, 22.4kW system)

Cooling		Compressor + Outdoor Fan Power consumption (kW)																	
Outdoor Unit	Dry-Bulb (°C)	Outdoor Unit 100% Cooling Capacity		100% Capacity		90% Capacity		80% Capacity		70% Capacity		60% Capacity		50% Capacity		40% Capacity		30% Capacity	
		TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)		
40 °C	20.8	20.8	5.99	18.8	4.85	16.7	3.89	14.6	3.09	12.5	2.43	10.4	1.89	8.34	1.47	6.25	1.15		
39 °C	21.2	21.2	5.90	19.1	4.78	16.9	3.84	14.8	3.04	12.7	2.39	10.6	1.87	8.47	1.45	6.35	1.13		
37 °C	21.8	21.8	5.72	19.6	4.64	17.5	3.72	15.3	2.95	13.1	2.32	10.9	1.81	8.73	1.41	6.54	1.10		
35 °C	22.4	22.4	5.54	20.2	4.49	17.9	3.60	15.7	2.86	13.4	2.25	11.2	1.75	8.96	1.36	6.72	1.06		
32 °C	22.4	22.4	5.10	20.2	4.15	17.9	3.34	15.7	2.66	13.4	2.10	11.2	1.65	8.96	1.29	6.72	1.01		
31 °C	22.4	22.4	4.72	20.2	3.85	17.9	3.10	15.7	2.48	13.4	1.97	11.2	1.55	8.96	1.22	6.72	0.96		
30 °C	22.4	22.4	4.55	20.2	3.71	17.9	3.00	15.7	2.40	13.4	1.90	11.2	1.50	8.96	1.18	6.72	0.94		
29 °C	22.4	22.4	4.38	20.2	3.58	17.9	2.89	15.7	2.32	13.4	1.84	11.2	1.46	8.96	1.15	6.72	0.91		
27 °C	22.4	22.4	4.08	20.2	3.34	17.9	2.70	15.7	2.17	13.4	1.73	11.2	1.38	8.96	1.09	6.72	0.87		
25 °C	22.4	22.4	3.80	20.2	3.11	17.9	2.53	15.7	2.04	13.4	1.63	11.2	1.30	8.96	1.03	6.72	0.83		
23 °C	22.4	22.4	3.62	20.2	2.97	17.9	2.42	15.7	1.95	13.4	1.57	11.2	1.25	8.96	1.00	6.72	0.80		
21 °C	22.4	22.4	3.54	20.2	2.91	17.9	2.37	15.7	1.92	13.4	1.54	11.2	1.23	8.96	0.99	6.72	0.80		
20 °C	22.4	22.4	3.51	20.2	2.88	17.9	2.35	15.7	1.90	13.4	1.53	11.2	1.23	8.96	0.98	6.72	0.79		
19 °C	22.4	22.4	3.47	20.2	2.86	17.9	2.33	15.7	1.89	13.4	1.52	11.2	1.22	8.96	0.98	6.72	0.79		
17 °C	22.4	22.4	3.41	20.2	2.81	17.9	2.30	15.7	1.86	13.4	1.50	11.2	1.21	8.96	0.97	6.72	0.79		
15 °C	22.4	22.4	3.36	20.2	2.77	17.9	2.27	15.7	1.84	13.4	1.49	11.2	1.20	8.96	0.97	6.72	0.78		

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 27.0°C dry-bulb / 19.0°C wet bulb

Heating		Compressor + Outdoor Fan Power consumption (kW)																
Outdoor Unit		Outdoor Unit 100% Heating Capacity	100% Capacity		90% Capacity		80% Capacity		70% Capacity		60% Capacity		50% Capacity		40% Capacity		30% Capacity	
Dry-Bulb (°C)	Wet-Bulb (°C)		TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)
15.0	13.7	25.0	25.0	4.48	22.5	3.71	20.0	3.07	17.5	2.55	15.0	2.12	12.5	1.75	10.0	1.43	7.50	1.12
13.0	11.8	25.0	25.0	4.69	22.5	3.87	20.0	3.19	17.5	2.63	15.0	2.18	12.5	1.79	10.0	1.46	7.50	1.14
11.0	9.8	25.0	25.0	4.95	22.5	4.06	20.0	3.32	17.5	2.73	15.0	2.24	12.5	1.84	10.0	1.49	7.50	1.17
9.0	7.9	25.0	25.0	5.22	22.5	4.25	20.0	3.47	17.5	2.83	15.0	2.31	12.5	1.89	10.0	1.52	7.50	1.19
7.0	6.0	25.0	25.0	5.53	22.5	4.48	20.0	3.62	17.5	2.94	15.0	2.39	12.5	1.94	10.0	1.56	7.50	1.21
5.0	4.1	24.3	24.3	5.51	21.8	4.46	19.4	3.61	17.0	2.93	14.6	2.38	12.1	1.93	9.7	1.55	7.28	1.21
3.0	2.2	23.5	23.5	5.50	21.2	4.45	18.8	3.60	16.5	2.92	14.1	2.37	11.8	1.93	9.4	1.55	7.06	1.21
0.0	-0.7	22.4	22.4	5.47	20.2	4.43	17.9	3.59	15.7	2.91	13.5	2.36	11.2	1.92	9.0	1.54	6.73	1.20
-3.0	-3.7	21.3	21.3	5.44	19.1	4.41	17.0	3.57	14.9	2.89	12.8	2.35	10.6	1.91	8.5	1.54	6.38	1.20
-5.0	-5.6	20.5	20.5	5.43	18.5	4.39	16.4	3.56	14.4	2.89	12.3	2.34	10.3	1.90	8.2	1.53	6.16	1.19
-7.0	-7.6	19.8	19.8	5.41	17.8	4.38	15.8	3.55	13.8	2.88	11.9	2.34	9.9	1.90	7.9	1.53	5.93	1.19
-10	-10.5	18.7	18.7	5.38	16.8	4.36	14.9	3.53	13.1	2.86	11.2	2.33	9.3	1.89	7.5	1.52	5.60	1.18
-14.5	-15.0	16.9	16.9	5.34	15.2	4.33	13.5	3.50	11.8	2.84	10.2	2.31	8.5	1.87	6.8	1.51	5.08	1.17

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 20.0°C dry-bulb

## 5 Outdoor unit



### Part Load performance

MMY-MAP1006HT8P-E (10HP, 28kW system)

Cooling		Compressor + Outdoor Fan Power consumption (kW)																	
Outdoor Unit	Dry-Bulb (°C)	Outdoor Unit 100% Cooling Capacity		100% Capacity		90% Capacity		80% Capacity		70% Capacity		60% Capacity		50% Capacity		40% Capacity		30% Capacity	
		TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)
40 °C	26.1	26.1	8.31	23.5	6.77	20.8	5.41	18.2	4.24	15.6	3.24	13.0	2.43	10.42	1.82	7.82	1.39		
39 °C	26.5	26.5	8.19	23.8	6.67	21.2	5.33	18.5	4.17	15.9	3.19	13.2	2.40	10.59	1.79	7.94	1.37		
37 °C	27.3	27.3	7.94	24.5	6.47	21.8	5.17	19.1	4.05	16.4	3.10	13.6	2.33	10.91	1.73	8.18	1.33		
35 °C	28.0	28.0	7.69	25.2	6.26	22.4	5.01	19.6	3.92	16.8	3.00	14.0	2.25	11.20	1.68	8.40	1.28		
32 °C	28.0	28.0	7.10	25.2	5.79	22.4	4.63	19.6	3.63	16.8	2.79	14.0	2.10	11.20	1.58	8.40	1.22		
31 °C	28.0	28.0	6.57	25.2	5.37	22.4	4.30	19.6	3.38	16.8	2.60	14.0	1.97	11.20	1.49	8.40	1.16		
30 °C	28.0	28.0	6.33	25.2	5.17	22.4	4.15	19.6	3.26	16.8	2.51	14.0	1.91	11.20	1.45	8.40	1.13		
29 °C	28.0	28.0	6.11	25.2	4.99	22.4	4.00	19.6	3.15	16.8	2.43	14.0	1.85	11.20	1.41	8.40	1.11		
27 °C	28.0	28.0	5.68	25.2	4.65	22.4	3.73	19.6	2.94	16.8	2.28	14.0	1.74	11.20	1.33	8.40	1.05		
25 °C	28.0	28.0	5.30	25.2	4.33	22.4	3.48	19.6	2.75	16.8	2.13	14.0	1.64	11.20	1.26	8.40	1.00		
23 °C	28.0	28.0	5.06	25.2	4.14	22.4	3.33	19.6	2.63	16.8	2.05	14.0	1.57	11.20	1.22	8.40	0.97		
21 °C	28.0	28.0	4.94	25.2	4.05	22.4	3.26	19.6	2.58	16.8	2.01	14.0	1.55	11.20	1.20	8.40	0.97		
20 °C	28.0	28.0	4.89	25.2	4.01	22.4	3.23	19.6	2.55	16.8	1.99	14.0	1.54	11.20	1.19	8.40	0.96		
19 °C	28.0	28.0	4.84	25.2	3.97	22.4	3.20	19.6	2.53	16.8	1.98	14.0	1.53	11.20	1.19	8.40	0.96		
17 °C	28.0	28.0	4.76	25.2	3.90	22.4	3.15	19.6	2.49	16.8	1.95	14.0	1.51	11.20	1.18	8.40	0.96		
15 °C	28.0	28.0	4.69	25.2	3.84	22.4	3.10	19.6	2.46	16.8	1.93	14.0	1.49	11.20	1.17	8.40	0.95		

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 27.0°C dry-bulb / 19.0°C wet bulb

Heating		Compressor + Outdoor Fan Power consumption (kW)																	
Outdoor Unit		Outdoor Unit 100% Heating Capacity	100% Capacity		90% Capacity		80% Capacity		70% Capacity		60% Capacity		50% Capacity		40% Capacity		30% Capacity		
Dry-Bulb (°C)	Wet-Bulb (°C)		TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	
15.0	13.7	31.5	31.5	5.98	28.4	4.96	25.2	4.12	22.1	3.44	18.9	2.88	15.8	2.38	12.6	1.90	9.45	1.42	
13.0	11.8	31.5	31.5	6.27	28.4	5.17	25.2	4.28	22.1	3.55	18.9	2.95	15.8	2.43	12.6	1.95	9.45	1.45	
11.0	9.8	31.5	31.5	6.62	28.4	5.42	25.2	4.45	22.1	3.68	18.9	3.04	15.8	2.50	12.6	2.00	9.45	1.49	
9.0	7.9	31.5	31.5	6.99	28.4	5.68	25.2	4.64	22.1	3.81	18.9	3.13	15.8	2.56	12.6	2.05	9.45	1.53	
7.0	6.0	31.5	31.5	7.41	28.4	5.98	25.2	4.85	22.1	3.95	18.9	3.23	15.8	2.63	12.6	2.10	9.45	1.57	
5.0	4.1	30.5	30.5	7.37	27.4	5.95	24.4	4.82	21.3	3.93	18.3	3.21	15.2	2.62	12.2	2.09	9.15	1.57	
3.0	2.2	29.5	29.5	7.32	26.5	5.91	23.6	4.79	20.6	3.90	17.7	3.19	14.7	2.60	11.8	2.08	8.84	1.56	
0.0	-0.7	27.9	27.9	7.26	25.1	5.86	22.3	4.75	19.5	3.87	16.8	3.17	14.0	2.58	11.2	2.06	8.38	1.54	
-3.0	-3.7	26.3	26.3	7.19	23.7	5.81	21.1	4.71	18.4	3.83	15.8	3.14	13.2	2.56	10.5	2.04	7.90	1.53	
-5.0	-5.6	25.3	25.3	7.15	22.8	5.77	20.3	4.68	17.7	3.81	15.2	3.12	12.7	2.54	10.1	2.03	7.59	1.52	
-7.0	-7.6	24.2	24.2	7.11	21.8	5.74	19.4	4.65	17.0	3.79	14.5	3.10	12.1	2.53	9.7	2.01	7.27	1.51	
-10	-10.5	22.7	22.7	7.04	20.4	5.68	18.2	4.61	15.9	3.75	13.6	3.07	11.4	2.50	9.1	2.00	6.81	1.50	
-14.5	-15.0	20.3	20.3	6.94	18.3	5.60	16.2	4.54	14.2	3.70	12.2	3.03	10.2	2.47	8.1	1.97	6.09	1.48	

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 20.0°C dry-bulb

## 5 Outdoor unit

MMY-MAP1206HT8P-E (12HP, 33.5kW system)

Cooling		Compressor + Outdoor Fan Power consumption (kW)																	
Outdoor Unit	Dry-Bulb (°C)	Outdoor Unit 100% Cooling Capacity		100% Capacity		90% Capacity		80% Capacity		70% Capacity		60% Capacity		50% Capacity		40% Capacity		30% Capacity	
		TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)
40 °C	31.2	31.2	10.80	28.1	8.65	24.9	6.85	21.8	5.35	18.7	4.11	15.6	3.09	12.47	2.24	9.35	1.54		
39 °C	31.7	31.7	10.64	28.5	8.53	25.3	6.75	22.2	5.27	19.0	4.05	15.8	3.04	12.67	2.21	9.50	1.51		
37 °C	32.6	32.6	10.32	29.4	8.27	26.1	6.54	22.8	5.11	19.6	3.92	16.3	2.95	13.05	2.14	9.79	1.47		
35 °C	33.5	33.5	10.00	30.1	8.01	26.8	6.34	23.4	4.95	20.1	3.80	16.7	2.86	13.40	2.08	10.05	1.42		
32 °C	33.5	33.5	9.19	30.2	7.38	26.8	5.86	23.5	4.59	20.1	3.54	16.8	2.67	13.40	1.94	10.05	1.33		
31 °C	33.5	33.5	8.48	30.2	6.83	26.8	5.43	23.5	4.27	20.1	3.30	16.8	2.49	13.40	1.82	10.05	1.25		
30 °C	33.5	33.5	8.15	30.2	6.57	26.8	5.24	23.5	4.12	20.1	3.19	16.8	2.41	13.40	1.77	10.05	1.22		
29 °C	33.5	33.5	7.85	30.2	6.33	26.8	5.05	23.5	3.98	20.1	3.08	16.8	2.34	13.40	1.71	10.05	1.18		
27 °C	33.5	33.5	7.29	30.2	5.89	26.8	4.71	23.5	3.72	20.1	2.89	16.8	2.19	13.40	1.61	10.05	1.11		
25 °C	33.5	33.5	6.78	30.2	5.49	26.8	4.40	23.5	3.48	20.1	2.71	16.8	2.06	13.40	1.52	10.05	1.05		
23 °C	33.5	33.5	6.46	30.2	5.24	26.8	4.20	23.5	3.33	20.1	2.60	16.8	1.98	13.40	1.46	10.05	1.01		
21 °C	33.5	33.5	6.30	30.2	5.12	26.8	4.11	23.5	3.26	20.1	2.55	16.8	1.95	13.40	1.43	10.05	0.99		
20 °C	33.5	33.5	6.24	30.2	5.07	26.8	4.07	23.5	3.23	20.1	2.53	16.8	1.93	13.40	1.42	10.05	0.99		
19 °C	33.5	33.5	6.17	30.2	5.02	26.8	4.04	23.5	3.21	20.1	2.51	16.8	1.92	13.40	1.42	10.05	0.98		
17 °C	33.5	33.5	6.06	30.2	4.93	26.8	3.97	23.5	3.16	20.1	2.47	16.8	1.89	13.40	1.40	10.05	0.97		
15 °C	33.5	33.5	5.96	30.2	4.86	26.8	3.92	23.5	3.12	20.1	2.44	16.8	1.87	13.40	1.38	10.05	0.96		

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 27.0°C dry-bulb / 19.0°C wet bulb

Heating		Compressor + Outdoor Fan Power consumption (kW)																	
Outdoor Unit		Outdoor Unit 100% Heating Capacity	100% Capacity		90% Capacity		80% Capacity		70% Capacity		60% Capacity		50% Capacity		40% Capacity		30% Capacity		
Dry-Bulb (°C)	Wet-Bulb (°C)		TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	
15.0	13.7	37.5	37.5	7.91	33.8	6.62	30.0	5.53	26.3	4.61	22.5	3.80	18.8	3.08	15.0	2.39	11.3	1.70	
13.0	11.8	37.5	37.5	8.28	33.8	6.89	30.0	5.73	26.3	4.76	22.5	3.92	18.8	3.17	15.0	2.46	11.3	1.75	
11.0	9.8	37.5	37.5	8.70	33.8	7.21	30.0	5.97	26.3	4.93	22.5	4.04	18.8	3.26	15.0	2.53	11.3	1.81	
9.0	7.9	37.5	37.5	9.15	33.8	7.54	30.0	6.21	26.3	5.11	22.5	4.17	18.8	3.36	15.0	2.61	11.3	1.87	
7.0	6.0	37.5	37.5	9.65	33.8	7.91	30.0	6.48	26.3	5.30	22.5	4.31	18.8	3.46	15.0	2.68	11.3	1.93	
5.0	4.1	36.2	36.2	9.58	32.5	7.85	28.9	6.43	25.3	5.26	21.7	4.28	18.1	3.43	14.5	2.66	10.8	1.91	
3.0	2.2	34.8	34.8	9.50	31.3	7.79	27.9	6.38	24.4	5.22	20.9	4.25	17.4	3.41	13.9	2.64	10.4	1.90	
0.0	-0.7	32.8	32.8	9.39	29.5	7.70	26.2	6.31	22.9	5.16	19.7	4.20	16.4	3.37	13.1	2.61	9.8	1.88	
-3.0	-3.7	30.6	30.6	9.27	27.6	7.60	24.5	6.23	21.5	5.09	18.4	4.15	15.3	3.33	12.3	2.58	9.2	1.85	
-5.0	-5.6	29.3	29.3	9.20	26.4	7.54	23.4	6.18	20.5	5.05	17.6	4.11	14.7	3.30	11.7	2.56	8.8	1.84	
-7.0	-7.6	27.9	27.9	9.12	25.1	7.48	22.3	6.13	19.5	5.01	16.7	4.08	13.9	3.27	11.2	2.54	8.4	1.82	
-10	-10.5	25.8	25.8	9.01	23.3	7.39	20.7	6.05	18.1	4.95	15.5	4.03	12.9	3.23	10.3	2.51	7.8	1.80	
-14.5	-15.0	22.7	22.7	8.84	20.4	7.25	18.1	5.94	15.9	4.85	13.6	3.95	11.3	3.17	9.1	2.46	6.8	1.77	

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 20.0°C dry-bulb

## 5 Outdoor unit

MMY-MAP1406HT8P-E (14HP, 40kW system)

Cooling		Compressor + Outdoor Fan Power consumption (kW)																	
Outdoor Unit	Dry-Bulb (°C)	Outdoor Unit 100% Cooling Capacity		100% Capacity		90% Capacity		80% Capacity		70% Capacity		60% Capacity		50% Capacity		40% Capacity		30% Capacity	
		TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)
40 °C	37.2	37.2	13.3	33.5	10.5	29.8	8.21	26.1	6.40	22.3	4.95	18.6	3.79	14.9	2.82	11.2	1.95		
39 °C	37.8	37.8	13.1	34.0	10.3	30.3	8.08	26.5	6.30	22.7	4.88	18.9	3.74	15.1	2.78	11.3	1.92		
37 °C	39.0	39.0	12.7	35.1	10.0	31.2	7.84	27.3	6.11	23.4	4.73	19.5	3.62	15.6	2.69	11.7	1.86		
35 °C	40.0	40.0	12.3	36.0	9.69	32.0	7.59	28.0	5.92	24.0	4.58	20.0	3.51	16.0	2.61	12.0	1.81		
33 °C	40.0	40.0	11.3	36.0	8.91	32.0	7.01	28.0	5.49	24.0	4.27	20.0	3.28	16.0	2.45	12.0	1.69		
31 °C	40.0	40.0	10.3	36.0	8.22	32.0	6.50	28.0	5.11	24.0	3.99	20.0	3.08	16.0	2.30	12.0	1.59		
30 °C	40.0	40.0	9.94	36.0	7.91	32.0	6.26	28.0	4.94	24.0	3.86	20.0	2.98	16.0	2.23	12.0	1.54		
29 °C	40.0	40.0	9.55	36.0	7.62	32.0	6.04	28.0	4.77	24.0	3.74	20.0	2.89	16.0	2.16	12.0	1.49		
27 °C	40.0	40.0	8.85	36.0	7.08	32.0	5.63	28.0	4.46	24.0	3.51	20.0	2.72	16.0	2.04	12.0	1.40		
25 °C	40.0	40.0	8.22	36.0	6.59	32.0	5.26	28.0	4.18	24.0	3.30	20.0	2.56	16.0	1.92	12.0	1.32		
23 °C	40.0	40.0	7.81	36.0	6.28	32.0	5.02	28.0	4.00	24.0	3.16	20.0	2.46	16.0	1.85	12.0	1.27		
21 °C	40.0	40.0	7.62	36.0	6.13	32.0	4.92	28.0	3.93	24.0	3.11	20.0	2.42	16.0	1.82	12.0	1.25		
20 °C	40.0	40.0	7.53	36.0	6.07	32.0	4.87	28.0	3.89	24.0	3.09	20.0	2.41	16.0	1.81	12.0	1.24		
19 °C	40.0	40.0	7.45	36.0	6.01	32.0	4.83	28.0	3.86	24.0	3.06	20.0	2.39	16.0	1.79	12.0	1.23		
17 °C	40.0	40.0	7.31	36.0	5.90	32.0	4.75	28.0	3.81	24.0	3.02	20.0	2.36	16.0	1.77	12.0	1.22		
15 °C	40.0	40.0	7.18	36.0	5.81	32.0	4.69	28.0	3.76	24.0	2.99	20.0	2.34	16.0	1.76	12.0	1.20		

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 27.0°C dry-bulb / 19.0°C wet bulb

Heating		Compressor + Outdoor Fan Power consumption (kW)																	
Outdoor Unit		Outdoor Unit 100% Heating Capacity	100% Capacity		90% Capacity		80% Capacity		70% Capacity		60% Capacity		50% Capacity		40% Capacity		30% Capacity		
Dry-Bulb (°C)	Wet-Bulb (°C)		TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	
15.0	13.7	45.0	45.0	9.05	40.5	7.48	36.0	6.19	31.5	5.13	27.0	4.26	22.5	3.53	18.0	2.89	13.5	2.31	
13.0	11.8	45.0	45.0	9.50	40.5	7.81	36.0	6.43	31.5	5.30	27.0	4.37	22.5	3.61	18.0	2.95	13.5	2.35	
11.0	9.8	45.0	45.0	10.0	40.5	8.19	36.0	6.70	31.5	5.49	27.0	4.51	22.5	3.70	18.0	3.01	13.5	2.39	
9.0	7.9	45.0	45.0	10.6	40.5	8.60	36.0	6.99	31.5	5.69	27.0	4.65	22.5	3.79	18.0	3.07	13.5	2.43	
7.0	6.0	45.0	45.0	11.2	40.5	9.06	36.0	7.32	31.5	5.92	27.0	4.80	22.5	3.90	18.0	3.14	13.5	2.48	
5.0	4.1	43.6	43.6	11.1	39.2	9.00	34.8	7.27	30.5	5.88	26.1	4.77	21.8	3.87	17.4	3.13	13.1	2.47	
3.0	2.2	42.1	42.1	11.1	37.9	8.95	33.7	7.23	29.5	5.85	25.3	4.74	21.1	3.85	16.8	3.11	12.6	2.45	
0.0	-0.7	39.9	39.9	11.0	35.9	8.87	31.9	7.17	27.9	5.80	23.9	4.70	19.9	3.82	16.0	3.08	12.0	2.43	
-3.0	-3.7	37.6	37.6	10.9	33.8	8.79	30.1	7.10	26.3	5.75	22.6	4.66	18.8	3.78	15.0	3.05	11.3	2.41	
-5.0	-5.6	36.2	36.2	10.8	32.5	8.74	28.9	7.06	25.3	5.71	21.7	4.63	18.1	3.76	14.5	3.03	10.8	2.39	
-7.0	-7.6	34.6	34.6	10.7	31.2	8.68	27.7	7.02	24.2	5.68	20.8	4.60	17.3	3.74	13.9	3.02	10.4	2.38	
-10	-10.5	32.4	32.4	10.6	29.2	8.61	25.9	6.95	22.7	5.63	19.5	4.56	16.2	3.70	13.0	2.99	9.7	2.36	
-14.5	-15.0	29.0	29.0	10.5	26.1	8.48	23.2	6.85	20.3	5.55	17.4	4.50	14.5	3.65	11.6	2.95	8.7	2.32	

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 20.0°C dry-bulb

## 5 Outdoor unit

MMY-MAP1606HT8P-E (16HP, 45kW system)

Cooling		Compressor + Outdoor Fan Power consumption (kW)																	
Outdoor Unit	Dry-Bulb (°C)	Outdoor Unit 100% Cooling Capacity		100% Capacity		90% Capacity		80% Capacity		70% Capacity		60% Capacity		50% Capacity		40% Capacity		30% Capacity	
		TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)
40 °C	41.9	41.9	15.4	37.7	12.3	33.5	9.70	29.3	7.54	25.1	5.77	20.9	4.31	16.8	3.10	12.6	2.08		
39 °C	42.6	42.6	15.2	38.3	12.1	34.0	9.56	29.8	7.43	25.5	5.68	21.3	4.25	17.0	3.06	12.8	2.05		
37 °C	43.8	43.8	14.8	39.4	11.8	35.1	9.27	30.7	7.20	26.3	5.51	21.9	4.12	17.5	2.96	13.1	1.98		
35 °C	45.0	45.0	14.3	40.5	11.4	36.0	8.97	31.5	6.98	27.0	5.34	22.5	3.99	18.0	2.87	13.5	1.92		
33 °C	45.0	45.0	13.1	40.5	10.5	36.0	8.29	31.5	6.47	27.0	4.96	22.5	3.72	18.0	2.68	13.5	1.80		
31 °C	45.0	45.0	12.1	40.5	9.69	36.0	7.68	31.5	6.01	27.0	4.63	22.5	3.48	18.0	2.51	13.5	1.68		
30 °C	45.0	45.0	11.6	40.5	9.33	36.0	7.40	31.5	5.80	27.0	4.47	22.5	3.37	18.0	2.44	13.5	1.63		
29 °C	45.0	45.0	11.2	40.5	8.99	36.0	7.14	31.5	5.60	27.0	4.32	22.5	3.26	18.0	2.36	13.5	1.58		
27 °C	45.0	45.0	10.4	40.5	8.36	36.0	6.65	31.5	5.23	27.0	4.05	22.5	3.06	18.0	2.22	13.5	1.49		
25 °C	45.0	45.0	9.65	40.5	7.78	36.0	6.21	31.5	4.89	27.0	3.79	22.5	2.87	18.0	2.08	13.5	1.40		
23 °C	45.0	45.0	9.19	40.5	7.42	36.0	5.93	31.5	4.68	27.0	3.63	22.5	2.75	18.0	2.00	13.5	1.34		
21 °C	45.0	45.0	8.96	40.5	7.25	36.0	5.80	31.5	4.59	27.0	3.57	22.5	2.71	18.0	1.97	13.5	1.32		
20 °C	45.0	45.0	8.86	40.5	7.17	36.0	5.75	31.5	4.54	27.0	3.54	22.5	2.68	18.0	1.95	13.5	1.31		
19 °C	45.0	45.0	8.77	40.5	7.10	36.0	5.69	31.5	4.51	27.0	3.51	22.5	2.66	18.0	1.94	13.5	1.30		
17 °C	45.0	45.0	8.61	40.5	6.98	36.0	5.60	31.5	4.44	27.0	3.46	22.5	2.63	18.0	1.92	13.5	1.28		
15 °C	45.0	45.0	8.47	40.5	6.87	36.0	5.52	31.5	4.38	27.0	3.42	22.5	2.60	18.0	1.89	13.5	1.27		

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 27.0°C dry-bulb / 19.0°C wet bulb

Heating		Compressor + Outdoor Fan Power consumption (kW)																	
Outdoor Unit		Outdoor Unit 100% Heating Capacity	100% Capacity		90% Capacity		80% Capacity		70% Capacity		60% Capacity		50% Capacity		40% Capacity		30% Capacity		
Dry-Bulb (°C)	Wet-Bulb (°C)		TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	
15.0	13.7	50.0	50.0	10.6	45.0	8.83	40.0	7.32	35.0	6.03	30.0	4.95	25.0	4.03	20.0	3.26	15.0	2.61	
13.0	11.8	50.0	50.0	11.1	45.0	9.21	40.0	7.60	35.0	6.24	30.0	5.09	25.0	4.13	20.0	3.33	15.0	2.65	
11.0	9.8	50.0	50.0	11.7	45.0	9.64	40.0	7.93	35.0	6.48	30.0	5.26	25.0	4.25	20.0	3.41	15.0	2.70	
9.0	7.9	50.0	50.0	12.2	45.0	10.1	40.0	8.27	35.0	6.73	30.0	5.44	25.0	4.37	20.0	3.48	15.0	2.75	
7.0	6.0	50.0	50.0	12.9	45.0	10.6	40.0	8.64	35.0	7.00	30.0	5.63	25.0	4.50	20.0	3.57	15.0	2.80	
5.0	4.1	48.2	48.2	12.8	43.4	10.5	38.6	8.58	33.7	6.95	28.9	5.59	24.1	4.47	19.3	3.54	14.5	2.78	
3.0	2.2	46.4	46.4	12.7	41.8	10.4	37.1	8.51	32.5	6.89	27.9	5.55	23.2	4.43	18.6	3.51	13.9	2.76	
0.0	-0.7	43.7	43.7	12.6	39.3	10.3	34.9	8.41	30.6	6.81	26.2	5.48	21.8	4.38	17.5	3.47	13.1	2.72	
-3.0	-3.7	40.9	40.9	12.4	36.8	10.2	32.7	8.31	28.6	6.73	24.5	5.41	20.4	4.33	16.3	3.43	12.3	2.69	
-5.0	-5.6	39.1	39.1	12.3	35.2	10.1	31.3	8.24	27.3	6.67	23.4	5.37	19.5	4.29	15.6	3.40	11.7	2.67	
-7.0	-7.6	37.2	37.2	12.2	33.5	10.0	29.7	8.17	26.0	6.62	22.3	5.32	18.6	4.25	14.9	3.37	11.2	2.65	
-10	-10.5	34.5	34.5	12.0	31.0	9.90	27.6	8.07	24.1	6.54	20.7	5.26	17.2	4.20	13.8	3.33	10.3	2.61	
-14.5	-15.0	30.2	30.2	11.8	27.2	9.71	24.2	7.92	21.1	6.41	18.1	5.16	15.1	4.12	12.1	3.27	9.06	2.56	

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 20.0°C dry-bulb

## 5 Outdoor unit

MMY-MAP1806HT8P-E (18HP, 50.4kW system)

Cooling		Compressor + Outdoor Fan Power consumption (kW)																	
Outdoor Unit	Dry-Bulb (°C)	Outdoor Unit 100% Cooling Capacity		100% Capacity		90% Capacity		80% Capacity		70% Capacity		60% Capacity		50% Capacity		40% Capacity		30% Capacity	
		TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)
40 °C	46.9	46.9	15.8	42.2	12.8	37.5	10.26	32.8	8.17	28.1	6.42	23.5	4.95	18.8	3.69	14.1	2.54		
39 °C	47.7	47.7	15.5	42.9	12.6	38.1	10.11	33.4	8.05	28.6	6.33	23.8	4.88	19.1	3.63	14.3	2.51		
37 °C	49.1	49.1	15.1	44.2	12.2	39.3	9.80	34.4	7.80	29.4	6.14	24.5	4.73	19.6	3.52	14.7	2.43		
35 °C	50.4	50.4	14.6	45.4	11.8	40.3	9.49	35.3	7.56	30.2	5.94	25.2	4.58	20.2	3.41	15.1	2.35		
33 °C	50.4	50.4	13.4	45.4	10.9	40.3	8.80	35.3	7.03	30.2	5.55	25.2	4.29	20.2	3.20	15.1	2.21		
31 °C	50.4	50.4	12.4	45.4	10.1	40.3	8.19	35.3	6.56	30.2	5.19	25.2	4.03	20.2	3.00	15.1	2.07		
30 °C	50.4	50.4	12.0	45.4	9.76	40.3	7.91	35.3	6.35	30.2	5.03	25.2	3.90	20.2	2.91	15.1	2.01		
29 °C	50.4	50.4	11.5	45.4	9.42	40.3	7.64	35.3	6.14	30.2	4.87	25.2	3.78	20.2	2.83	15.1	1.95		
27 °C	50.4	50.4	10.7	45.4	8.78	40.3	7.14	35.3	5.75	30.2	4.57	25.2	3.56	20.2	2.66	15.1	1.83		
25 °C	50.4	50.4	10.0	45.4	8.20	40.3	6.68	35.3	5.39	30.2	4.30	25.2	3.35	20.2	2.50	15.1	1.72		
23 °C	50.4	50.4	9.53	45.4	7.84	40.3	6.39	35.3	5.17	30.2	4.13	25.2	3.22	20.2	2.41	15.1	1.66		
21 °C	50.4	50.4	9.32	45.4	7.67	40.3	6.27	35.3	5.08	30.2	4.06	25.2	3.17	20.2	2.37	15.1	1.63		
20 °C	50.4	50.4	9.22	45.4	7.60	40.3	6.22	35.3	5.04	30.2	4.03	25.2	3.15	20.2	2.36	15.1	1.62		
19 °C	50.4	50.4	9.13	45.4	7.53	40.3	6.16	35.3	5.00	30.2	4.00	25.2	3.12	20.2	2.34	15.1	1.61		
17 °C	50.4	50.4	8.98	45.4	7.41	40.3	6.07	35.3	4.93	30.2	3.95	25.2	3.09	20.2	2.31	15.1	1.59		
15 °C	50.4	50.4	8.84	45.4	7.31	40.3	6.00	35.3	4.87	30.2	3.90	25.2	3.06	20.2	2.29	15.1	1.57		

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 27.0°C dry-bulb / 19.0°C wet bulb

Heating		Compressor + Outdoor Fan Power consumption (kW)																	
Outdoor Unit		Outdoor Unit 100% Heating Capacity	100% Capacity		90% Capacity		80% Capacity		70% Capacity		60% Capacity		50% Capacity		40% Capacity		30% Capacity		
Dry-Bulb (°C)	Wet-Bulb (°C)		TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	
15.0	13.7	56.0	56.0	11.7	50.4	9.90	44.8	8.31	39.2	6.92	33.6	5.69	28.0	4.60	22.4	3.60	16.8	2.65	
13.0	11.8	56.0	56.0	12.2	50.4	10.3	44.8	8.61	39.2	7.14	33.6	5.86	28.0	4.73	22.4	3.69	16.8	2.72	
11.0	9.8	56.0	56.0	12.8	50.4	10.7	44.8	8.95	39.2	7.40	33.6	6.06	28.0	4.87	22.4	3.80	16.8	2.80	
9.0	7.9	56.0	56.0	13.4	50.4	11.2	44.8	9.30	39.2	7.67	33.6	6.25	28.0	5.02	22.4	3.90	16.8	2.87	
7.0	6.0	56.0	56.0	14.1	50.4	11.7	44.8	9.69	39.2	7.96	33.6	6.47	28.0	5.17	22.4	4.02	16.8	2.95	
5.0	4.1	54.2	54.2	14.0	48.8	11.7	43.4	9.64	37.9	7.91	32.5	6.43	27.1	5.14	21.7	3.99	16.3	2.93	
3.0	2.2	52.4	52.4	13.9	47.2	11.6	41.9	9.58	36.7	7.87	31.4	6.39	26.2	5.11	21.0	3.97	15.7	2.92	
0.0	-0.7	49.6	49.6	13.8	44.7	11.5	39.7	9.50	34.8	7.80	29.8	6.34	24.8	5.07	19.9	3.93	14.9	2.89	
-3.0	-3.7	46.8	46.8	13.7	42.1	11.4	37.4	9.41	32.8	7.73	28.1	6.28	23.4	5.02	18.7	3.90	14.0	2.86	
-5.0	-5.6	45.0	45.0	13.6	40.5	11.3	36.0	9.35	31.5	7.68	27.0	6.24	22.5	4.99	18.0	3.88	13.5	2.85	
-7.0	-7.6	43.1	43.1	13.5	38.8	11.2	34.5	9.30	30.2	7.63	25.9	6.20	21.6	4.96	17.2	3.85	12.9	2.83	
-10	-10.5	40.4	40.4	13.4	36.3	11.1	32.3	9.21	28.3	7.56	24.2	6.15	20.2	4.92	16.1	3.82	12.1	2.80	
-14.5	-15.0	36.1	36.1	13.2	32.5	11.0	28.9	9.08	25.3	7.46	21.7	6.06	18.0	4.85	14.4	3.76	10.8	2.76	

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 20.0°C dry-bulb

## 5 Outdoor unit



MMY-MAP2006HT8P-E (20HP, 56.0kW system)

Cooling		Compressor + Outdoor Fan Power consumption (kW)																	
Outdoor Unit	Dry-Bulb (°C)	Outdoor Unit 100% Cooling Capacity		100% Capacity		90% Capacity		80% Capacity		70% Capacity		60% Capacity		50% Capacity		40% Capacity		30% Capacity	
		TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)
40 °C	52.1	52.1	18.7	46.9	15.1	41.7	12.0	36.5	9.49	31.3	7.39	26.1	5.63	20.8	4.13	15.6	2.80		
39 °C	53.0	53.0	18.4	47.7	14.8	42.4	11.8	37.1	9.35	31.8	7.28	26.5	5.54	21.2	4.07	15.9	2.76		
37 °C	54.5	54.5	17.9	49.1	14.4	43.6	11.5	38.2	9.06	32.7	7.06	27.3	5.38	21.8	3.94	16.4	2.68		
35 °C	56.0	56.0	17.3	50.4	13.9	44.8	11.1	39.2	8.78	33.6	6.83	28.0	5.21	22.4	3.82	16.8	2.59		
33 °C	56.0	56.0	15.9	50.4	12.9	44.8	10.3	39.2	8.16	33.6	6.37	28.0	4.87	22.4	3.58	16.8	2.43		
31 °C	56.0	56.0	14.7	50.4	11.9	44.8	9.56	39.2	7.60	33.6	5.95	28.0	4.56	22.4	3.36	16.8	2.28		
30 °C	56.0	56.0	14.1	50.4	11.5	44.8	9.23	39.2	7.34	33.6	5.76	28.0	4.42	22.4	3.25	16.8	2.20		
29 °C	56.0	56.0	13.6	50.4	11.1	44.8	8.91	39.2	7.10	33.6	5.57	28.0	4.28	22.4	3.15	16.8	2.14		
27 °C	56.0	56.0	12.7	50.4	10.3	44.8	8.32	39.2	6.64	33.6	5.23	28.0	4.02	22.4	2.96	16.8	2.01		
25 °C	56.0	56.0	11.8	50.4	9.62	44.8	7.78	39.2	6.22	33.6	4.91	28.0	3.78	22.4	2.79	16.8	1.89		
23 °C	56.0	56.0	11.2	50.4	9.18	44.8	7.44	39.2	5.96	33.6	4.71	28.0	3.63	22.4	2.68	16.8	1.81		
21 °C	56.0	56.0	11.0	50.4	8.98	44.8	7.29	39.2	5.85	33.6	4.63	28.0	3.57	22.4	2.64	16.8	1.78		
20 °C	56.0	56.0	10.9	50.4	8.89	44.8	7.22	39.2	5.80	33.6	4.59	28.0	3.54	22.4	2.62	16.8	1.77		
19 °C	56.0	56.0	10.8	50.4	8.81	44.8	7.16	39.2	5.76	33.6	4.56	28.0	3.52	22.4	2.60	16.8	1.76		
17 °C	56.0	56.0	10.6	50.4	8.67	44.8	7.05	39.2	5.67	33.6	4.50	28.0	3.48	22.4	2.57	16.8	1.74		
15 °C	56.0	56.0	10.4	50.4	8.54	44.8	6.96	39.2	5.60	33.6	4.44	28.0	3.44	22.4	2.54	16.8	1.72		

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 27.0°C dry-bulb / 19.0°C wet bulb

Heating		Compressor + Outdoor Fan Power consumption (kW)																	
Outdoor Unit		Outdoor Unit 100% Heating Capacity	100% Capacity		90% Capacity		80% Capacity		70% Capacity		60% Capacity		50% Capacity		40% Capacity		30% Capacity		
Dry-Bulb (°C)	Wet-Bulb (°C)		TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	
15.0	13.7	63.0	63.0	14.2	56.7	12.0	50.4	10.1	44.1	8.39	37.8	6.89	31.5	5.52	25.2	4.25	18.9	3.02	
13.0	11.8	63.0	63.0	14.8	56.7	12.5	50.4	10.4	44.1	8.66	37.8	7.10	31.5	5.68	25.2	4.37	18.9	3.11	
11.0	9.8	63.0	63.0	15.5	56.7	13.0	50.4	10.8	44.1	8.97	37.8	7.33	31.5	5.86	25.2	4.51	18.9	3.21	
9.0	7.9	63.0	63.0	16.2	56.7	13.5	50.4	11.3	44.1	9.30	37.8	7.58	31.5	6.05	25.2	4.64	18.9	3.30	
7.0	6.0	63.0	63.0	17.0	56.7	14.2	50.4	11.7	44.1	9.65	37.8	7.84	31.5	6.24	25.2	4.79	18.9	3.41	
5.0	4.1	60.7	60.7	16.9	54.7	14.1	48.6	11.6	42.5	9.58	36.4	7.78	30.4	6.19	24.3	4.75	18.2	3.38	
3.0	2.2	58.5	58.5	16.7	52.6	13.9	46.8	11.6	40.9	9.50	35.1	7.72	29.2	6.15	23.4	4.71	17.5	3.36	
0.0	-0.7	55.0	55.0	16.5	49.5	13.8	44.0	11.4	38.5	9.39	33.0	7.63	27.5	6.07	22.0	4.66	16.5	3.32	
-3.0	-3.7	51.5	51.5	16.3	46.3	13.6	41.2	11.3	36.0	9.27	30.9	7.54	25.7	6.00	20.6	4.60	15.4	3.28	
-5.0	-5.6	49.2	49.2	16.2	44.3	13.5	39.4	11.2	34.5	9.20	29.5	7.48	24.6	5.95	19.7	4.56	14.8	3.25	
-7.0	-7.6	46.9	46.9	16.1	42.2	13.4	37.5	11.1	32.8	9.12	28.1	7.41	23.4	5.90	18.7	4.53	14.1	3.23	
-10	-10.5	43.4	43.4	15.9	39.1	13.2	34.7	11.0	30.4	9.01	26.0	7.32	21.7	5.83	17.4	4.47	13.0	3.19	
-14.5	-15.0	38.1	38.1	15.6	34.3	13.0	30.5	10.7	26.6	8.84	22.8	7.18	19.0	5.72	15.2	4.38	11.4	3.12	

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 20.0°C dry-bulb


**MMY-MAP2206HT8P-E (22HP, 61.5kW system)**

Cooling		Compressor + Outdoor Fan Power consumption (kW)															
Outdoor Unit (°C)	Outdoor Unit 100% Capacity (kW)	100%		90%		80%		70%		60%		50%		40%		30%	
		TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)
40 °C	57.2	57.2	25.1	51.5	19.7	45.8	15.2	40.1	11.6	34.3	8.59	28.6	6.22	22.9	4.36	17.2	2.91
39 °C	58.2	58.2	24.7	52.3	19.4	46.5	15.0	40.7	11.4	34.9	8.46	29.1	6.13	23.3	4.30	17.4	2.87
37 °C	59.9	59.9	23.9	53.9	18.8	47.9	14.6	41.9	11.0	35.9	8.20	29.9	5.94	24.0	4.17	18.0	2.78
35 °C	61.5	61.5	23.2	55.3	18.2	49.2	14.1	43.0	10.7	36.9	7.95	30.7	5.75	24.6	4.03	18.4	2.69
33 °C	61.5	61.5	21.2	55.4	16.7	49.2	13.0	43.1	9.87	36.9	7.36	30.8	5.35	24.6	3.76	18.5	2.52
31 °C	61.5	61.5	19.5	55.4	15.4	49.2	12.0	43.1	9.14	36.9	6.83	30.8	4.99	24.6	3.52	18.5	2.37
30 °C	61.5	61.5	18.7	55.4	14.8	49.2	11.5	43.1	8.80	36.9	6.59	30.8	4.82	24.6	3.41	18.5	2.30
29 °C	61.5	61.5	18.0	55.4	14.2	49.2	11.1	43.1	8.48	36.9	6.36	30.8	4.66	24.6	3.30	18.5	2.23
27 °C	61.5	61.5	16.7	55.4	13.2	49.2	10.3	43.1	7.90	36.9	5.94	30.8	4.36	24.6	3.10	18.5	2.10
25 °C	61.5	61.5	15.5	55.4	12.3	49.2	9.59	43.1	7.36	36.9	5.55	30.8	4.08	24.6	2.91	18.5	1.97
23 °C	61.5	61.5	14.7	55.4	11.7	49.2	9.13	43.1	7.03	36.9	5.31	30.8	3.91	24.6	2.79	18.5	1.90
21 °C	61.5	61.5	14.3	55.4	11.4	49.2	8.92	43.1	6.87	36.9	5.20	30.8	3.84	24.6	2.75	18.5	1.87
20 °C	61.5	61.5	14.1	55.4	11.2	49.2	8.82	43.1	6.80	36.9	5.15	30.8	3.81	24.6	2.73	18.5	1.86
19 °C	61.5	61.5	14.0	55.4	11.1	49.2	8.73	43.1	6.74	36.9	5.10	30.8	3.78	24.6	2.71	18.5	1.85
17 °C	61.5	61.5	13.7	55.4	10.9	49.2	8.57	43.1	6.62	36.9	5.02	30.8	3.72	24.6	2.67	18.5	1.83
15 °C	61.5	61.5	13.5	55.4	10.7	49.2	8.44	43.1	6.53	36.9	4.96	30.8	3.68	24.6	2.64	18.5	1.81

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 27.0°C dry-bulb / 19.0°C wet bulb

Heating		Compressor + Outdoor Fan Power consumption (kW)																
Outdoor Unit	Outdoor Unit 100% Capacity (kW)	100% Capacity		90% Capacity		80% Capacity		70% Capacity		60% Capacity		50% Capacity		40% Capacity		30% Capacity		
		Dry-Bulb (°C)	Wet-Bulb (°C)	TC (kW)	PI (kW)													
15.0	13.7	64.0	64.0	14.2	57.6	12.0	51.2	10.1	44.8	8.42	38.4	6.95	32.0	5.61	25.6	4.33	19.2	3.07
13.0	11.8	64.0	64.0	14.8	57.6	12.5	51.2	10.4	44.8	8.69	38.4	7.15	32.0	5.77	25.6	4.46	19.2	3.16
11.0	9.8	64.0	64.0	15.5	57.6	13.0	51.2	10.8	44.8	9.00	38.4	7.39	32.0	5.94	25.6	4.59	19.2	3.27
9.0	7.9	64.0	64.0	16.3	57.6	13.6	51.2	11.3	44.8	9.31	38.4	7.62	32.0	6.12	25.6	4.73	19.2	3.37
7.0	6.0	64.0	64.0	17.1	57.6	14.2	51.2	11.7	44.8	9.66	38.4	7.88	32.0	6.31	25.6	4.87	19.2	3.48
5.0	4.1	61.7	61.7	17.0	55.5	14.1	49.4	11.6	43.2	9.59	37.0	7.82	30.9	6.27	24.7	4.84	18.5	3.45
3.0	2.2	59.4	59.4	16.8	53.5	14.0	47.5	11.6	41.6	9.51	35.6	7.76	29.7	6.22	23.8	4.80	17.8	3.43
0.0	-0.7	55.9	55.9	16.6	50.3	13.8	44.7	11.4	39.1	9.40	33.6	7.67	28.0	6.14	22.4	4.74	16.8	3.38
-3.0	-3.7	52.3	52.3	16.4	47.1	13.6	41.8	11.3	36.6	9.28	31.4	7.57	26.1	6.07	20.9	4.68	15.7	3.34
-5.0	-5.6	50.0	50.0	16.3	45.0	13.5	40.0	11.2	35.0	9.21	30.0	7.51	25.0	6.02	20.0	4.65	15.0	3.32
-7.0	-7.6	47.6	47.6	16.2	42.8	13.4	38.1	11.1	33.3	9.13	28.6	7.45	23.8	5.97	19.0	4.61	14.3	3.29
-10	-10.5	44.1	44.1	16.0	39.7	13.2	35.3	11.0	30.9	9.02	26.5	7.36	22.0	5.90	17.6	4.55	13.2	3.25
-14.5	-15.0	38.7	38.7	15.7	34.8	13.0	30.9	10.7	27.1	8.85	23.2	7.22	19.3	5.78	15.5	4.46	11.6	3.19

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 20.0°C dry-bulb

## 5 Outdoor unit



MMY-AP2416HT8P-E (24HP, 67kW system)

Cooling		Compressor + Outdoor Fan Power consumption (kW)															
Outdoor Unit (°C)	Outdoor Unit 100% Capacity (kW)	100%		90%		80%		70%		60%		50%		40%		30%	
		TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)
40 °C	62.4	62.4	21.6	56.1	17.3	49.9	13.7	43.6	10.7	37.4	8.22	31.2	6.17	24.9	4.49	18.7	3.07
39 °C	63.4	63.4	21.3	57.0	17.1	50.7	13.5	44.3	10.5	38.0	8.09	31.7	6.08	25.3	4.42	19.0	3.03
37 °C	65.2	65.2	20.6	58.7	16.5	52.2	13.1	45.7	10.2	39.1	7.85	32.6	5.90	26.1	4.29	19.6	2.94
35 °C	67.0	67.0	20.0	60.3	16.0	53.6	12.7	46.9	9.90	40.2	7.60	33.5	5.71	26.8	4.15	20.1	2.84
33 °C	67.0	67.0	18.4	60.3	14.8	53.6	11.7	46.9	9.18	40.2	7.07	33.5	5.33	26.8	3.89	20.1	2.67
31 °C	67.0	67.0	17.0	60.3	13.7	53.6	10.9	46.9	8.54	40.2	6.60	33.5	4.99	26.8	3.65	20.1	2.51
30 °C	67.0	67.0	16.3	60.3	13.1	53.6	10.5	46.9	8.24	40.2	6.38	33.5	4.83	26.8	3.53	20.1	2.43
29 °C	67.0	67.0	15.7	60.3	12.7	53.6	10.1	46.9	7.96	40.2	6.17	33.5	4.68	26.8	3.43	20.1	2.36
27 °C	67.0	67.0	14.6	60.3	11.8	53.6	9.42	46.9	7.44	40.2	5.78	33.5	4.39	26.8	3.22	20.1	2.22
25 °C	67.0	67.0	13.6	60.3	11.0	53.6	8.80	46.9	6.96	40.2	5.42	33.5	4.12	26.8	3.03	20.1	2.09
23 °C	67.0	67.0	12.9	60.3	10.5	53.6	8.41	46.9	6.66	40.2	5.19	33.5	3.96	26.8	2.92	20.1	2.01
21 °C	67.0	67.0	12.6	60.3	10.2	53.6	8.23	46.9	6.53	40.2	5.10	33.5	3.89	26.8	2.87	20.1	1.98
20 °C	67.0	67.0	12.5	60.3	10.1	53.6	8.15	46.9	6.47	40.2	5.06	33.5	3.86	26.8	2.85	20.1	1.97
19 °C	67.0	67.0	12.3	60.3	10.0	53.6	8.07	46.9	6.42	40.2	5.02	33.5	3.84	26.8	2.83	20.1	1.96
17 °C	67.0	67.0	12.1	60.3	9.86	53.6	7.94	46.9	6.32	40.2	4.95	33.5	3.79	26.8	2.80	20.1	1.94
15 °C	67.0	67.0	11.9	60.3	9.72	53.6	7.83	46.9	6.24	40.2	4.89	33.5	3.74	26.8	2.77	20.1	1.92

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 27.0°C dry-bulb / 19.0°C wet bulb

Heating		Compressor + Outdoor Fan Power consumption (kW)																
Outdoor Unit	Outdoor Unit 100% Capacity (kW)	100% Capacity		90% Capacity		80% Capacity		70% Capacity		60% Capacity		50% Capacity		40% Capacity		30% Capacity		
		Dry-Bulb (°C)	Wet-Bulb (°C)	TC (kW)	PI (kW)													
15.0	13.7	75.0	75.0	15.8	67.5	13.2	60.0	11.1	52.5	9.22	45.0	7.61	37.5	6.16	30.0	4.79	22.5	3.41
13.0	11.8	75.0	75.0	16.6	67.5	13.8	60.0	11.5	52.5	9.51	45.0	7.83	37.5	6.33	30.0	4.92	22.5	3.51
11.0	9.8	75.0	75.0	17.4	67.5	14.4	60.0	11.9	52.5	9.86	45.0	8.08	37.5	6.52	30.0	5.07	22.5	3.62
9.0	7.9	75.0	75.0	18.3	67.5	15.1	60.0	12.4	52.5	10.2	45.0	8.34	37.5	6.71	30.0	5.21	22.5	3.74
7.0	6.0	75.0	75.0	19.3	67.5	15.8	60.0	13.0	52.5	10.6	45.0	8.62	37.5	6.92	30.0	5.37	22.5	3.86
5.0	4.1	72.3	72.3	19.2	65.1	15.7	57.9	12.9	50.6	10.5	43.4	8.56	36.2	6.87	28.9	5.33	21.7	3.83
3.0	2.2	69.6	69.6	19.0	62.7	15.6	55.7	12.8	48.7	10.4	41.8	8.49	34.8	6.81	27.9	5.29	20.9	3.80
0.0	-0.7	65.5	65.5	18.8	59.0	15.4	52.4	12.6	45.9	10.3	39.3	8.39	32.8	6.73	26.2	5.22	19.7	3.75
-3.0	-3.7	61.3	61.3	18.5	55.2	15.2	49.0	12.5	42.9	10.2	36.8	8.29	30.6	6.65	24.5	5.16	18.4	3.71
-5.0	-5.6	58.6	58.6	18.4	52.7	15.1	46.9	12.4	41.0	10.1	35.2	8.22	29.3	6.60	23.4	5.12	17.6	3.68
-7.0	-7.6	55.8	55.8	18.2	50.2	15.0	44.6	12.3	39.0	10.0	33.5	8.16	27.9	6.54	22.3	5.08	16.7	3.65
-10	-10.5	51.7	51.7	18.0	46.5	14.8	41.3	12.1	36.2	9.90	31.0	8.06	25.8	6.46	20.7	5.01	15.5	3.60
-14.5	-15.0	45.3	45.3	17.7	40.8	14.5	36.3	11.9	31.7	9.71	27.2	7.90	22.7	6.34	18.1	4.92	13.6	3.53

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 20.0°C dry-bulb

## 5 Outdoor unit



### MMY-AP2616HT8P-E (26HP, 73.5kW system)

Cooling		Compressor + Outdoor Fan Power consumption (kW)															
Outdoor Unit (°C)	Outdoor Unit 100% Capacity (kW)	100%		90%		80%		70%		60%		50%		40%		30%	
		TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)
40 °C	68.4	68.4	24.1	61.6	19.1	54.7	15.1	47.9	11.7	41.0	9.06	34.2	6.88	27.4	5.06	20.5	3.49
39 °C	69.5	69.5	23.7	62.6	18.8	55.6	14.8	48.7	11.6	41.7	8.93	34.8	6.78	27.8	4.99	20.9	3.44
37 °C	71.6	71.6	23.0	64.4	18.3	57.3	14.4	50.1	11.2	42.9	8.66	35.8	6.57	28.6	4.84	21.5	3.33
35 °C	73.5	73.5	22.3	66.1	17.7	58.8	13.9	51.4	10.9	44.1	8.38	36.7	6.36	29.4	4.69	22.0	3.23
33 °C	73.5	73.5	20.4	66.2	16.3	58.8	12.9	51.5	10.1	44.1	7.81	36.8	5.95	29.4	4.39	22.1	3.03
31 °C	73.5	73.5	18.8	66.2	15.0	58.8	11.9	51.5	9.38	44.1	7.29	36.8	5.57	29.4	4.12	22.1	2.84
30 °C	73.5	73.5	18.1	66.2	14.5	58.8	11.5	51.5	9.06	44.1	7.05	36.8	5.40	29.4	4.00	22.1	2.76
29 °C	73.5	73.5	17.4	66.2	13.9	58.8	11.1	51.5	8.75	44.1	6.83	36.8	5.23	29.4	3.88	22.1	2.67
27 °C	73.5	73.5	16.1	66.2	13.0	58.8	10.3	51.5	8.18	44.1	6.40	36.8	4.91	29.4	3.65	22.1	2.52
25 °C	73.5	73.5	15.0	66.2	12.1	58.8	9.66	51.5	7.66	44.1	6.00	36.8	4.62	29.4	3.43	22.1	2.37
23 °C	73.5	73.5	14.3	66.2	11.5	58.8	9.23	51.5	7.33	44.1	5.76	36.8	4.44	29.4	3.30	22.1	2.28
21 °C	73.5	73.5	13.9	66.2	11.3	58.8	9.03	51.5	7.19	44.1	5.66	36.8	4.37	29.4	3.25	22.1	2.24
20 °C	73.5	73.5	13.8	66.2	11.1	58.8	8.95	51.5	7.13	44.1	5.61	36.8	4.34	29.4	3.23	22.1	2.23
19 °C	73.5	73.5	13.6	66.2	11.0	58.8	8.87	51.5	7.07	44.1	5.57	36.8	4.31	29.4	3.21	22.1	2.21
17 °C	73.5	73.5	13.4	66.2	10.8	58.8	8.72	51.5	6.97	44.1	5.50	36.8	4.25	29.4	3.17	22.1	2.18
15 °C	73.5	73.5	13.1	66.2	10.7	58.8	8.60	51.5	6.88	44.1	5.43	36.8	4.21	29.4	3.14	22.1	2.16

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 27.0°C dry-bulb / 19.0°C wet bulb

Heating		Compressor + Outdoor Fan Power consumption (kW)																	
Outdoor Unit	Outdoor Unit 100% Capacity (kW)	100% Capacity		90% Capacity		80% Capacity		70% Capacity		60% Capacity		50% Capacity		40% Capacity		30% Capacity			
		Dry-Bulb (°C)	Wet-Bulb (°C)	TC (kW)	PI (kW)														
15.0	13.7	82.5	82.5	82.5	17.0	74.3	14.1	66.0	11.7	57.8	9.74	49.5	8.06	41.3	6.61	33.0	5.28	24.8	4.01
13.0	11.8	82.5	82.5	82.5	17.8	74.3	14.7	66.0	12.2	57.8	10.1	49.5	8.29	41.3	6.77	33.0	5.41	24.8	4.10
11.0	9.8	82.5	82.5	82.5	18.7	74.3	15.4	66.0	12.7	57.8	10.4	49.5	8.55	41.3	6.96	33.0	5.54	24.8	4.20
9.0	7.9	82.5	82.5	82.5	19.7	74.3	16.1	66.0	13.2	57.8	10.8	49.5	8.82	41.3	7.15	33.0	5.68	24.8	4.30
7.0	6.0	82.5	82.5	82.5	20.8	74.3	17.0	66.0	13.8	57.8	11.2	49.5	9.11	41.3	7.36	33.0	5.83	24.8	4.41
5.0	4.1	79.7	79.7	79.7	20.7	71.7	16.9	63.8	13.7	55.8	11.1	47.8	9.05	39.9	7.31	31.9	5.79	23.9	4.38
3.0	2.2	76.9	76.9	76.9	20.6	69.2	16.7	61.5	13.6	53.8	11.1	46.2	8.99	38.5	7.26	30.8	5.75	23.1	4.35
0.0	-0.7	72.7	72.7	72.7	20.4	65.4	16.6	58.1	13.5	50.9	11.0	43.6	8.90	36.3	7.18	29.1	5.69	21.8	4.31
-3.0	-3.7	68.3	68.3	68.3	20.1	61.4	16.4	54.6	13.3	47.8	10.8	41.0	8.80	34.1	7.11	27.3	5.63	20.5	4.26
-5.0	-5.6	65.5	65.5	65.5	20.0	58.9	16.3	52.4	13.2	45.8	10.8	39.3	8.74	32.7	7.06	26.2	5.59	19.6	4.23
-7.0	-7.6	62.5	62.5	62.5	19.9	56.3	16.2	50.0	13.1	43.8	10.7	37.5	8.68	31.3	7.01	25.0	5.55	18.8	4.20
-10	-10.5	58.3	58.3	58.3	19.7	52.4	16.0	46.6	13.0	40.8	10.6	35.0	8.59	29.1	6.93	23.3	5.49	17.5	4.16
-14.5	-15.0	51.7	51.7	51.7	19.3	46.5	15.7	41.3	12.8	36.2	10.4	31.0	8.45	25.8	6.82	20.7	5.40	15.5	4.09

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 20.0°C dry-bulb

## 5 Outdoor unit



### MMY-AP2816HT8P-E (28HP, 78.5kW system)

Cooling		Compressor + Outdoor Fan Power consumption (kW)															
Outdoor Unit (°C)	Outdoor Unit 100% Capacity (kW)	100%		90%		80%		70%		60%		50%		40%		30%	
		TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)
40 °C	73.1	73.1	26.3	65.7	21.0	58.4	16.5	51.1	12.9	43.8	9.87	36.5	7.40	29.2	5.35	21.9	3.61
39 °C	74.2	74.2	25.9	66.8	20.7	59.4	16.3	52.0	12.7	44.5	9.73	37.1	7.29	29.7	5.27	22.3	3.56
37 °C	76.4	76.4	25.1	68.8	20.0	61.2	15.8	53.5	12.3	45.9	9.43	38.2	7.07	30.6	5.11	22.9	3.45
35 °C	78.5	78.5	24.3	70.6	19.4	62.8	15.3	54.9	11.9	47.1	9.14	39.2	6.84	31.4	4.95	23.5	3.34
33 °C	78.5	78.5	22.3	70.7	17.9	62.8	14.1	55.0	11.1	47.1	8.50	39.3	6.39	31.4	4.63	23.6	3.13
31 °C	78.5	78.5	20.6	70.7	16.5	62.8	13.1	55.0	10.3	47.1	7.92	39.3	5.97	31.4	4.34	23.6	2.94
30 °C	78.5	78.5	19.8	70.7	15.9	62.8	12.6	55.0	9.9	47.1	7.66	39.3	5.78	31.4	4.20	23.6	2.85
29 °C	78.5	78.5	19.0	70.7	15.3	62.8	12.2	55.0	9.58	47.1	7.41	39.3	5.60	31.4	4.07	23.6	2.76
27 °C	78.5	78.5	17.7	70.7	14.2	62.8	11.4	55.0	8.95	47.1	6.93	39.3	5.25	31.4	3.83	23.6	2.60
25 °C	78.5	78.5	16.4	70.7	13.3	62.8	10.6	55.0	8.37	47.1	6.50	39.3	4.93	31.4	3.60	23.6	2.44
23 °C	78.5	78.5	15.6	70.7	12.7	62.8	10.1	55.0	8.01	47.1	6.23	39.3	4.73	31.4	3.46	23.6	2.35
21 °C	78.5	78.5	15.3	70.7	12.4	62.8	9.9	55.0	7.85	47.1	6.11	39.3	4.65	31.4	3.40	23.6	2.31
20 °C	78.5	78.5	15.1	70.7	12.2	62.8	9.8	55.0	7.78	47.1	6.06	39.3	4.62	31.4	3.38	23.6	2.30
19 °C	78.5	78.5	14.9	70.7	12.1	62.8	9.7	55.0	7.71	47.1	6.02	39.3	4.58	31.4	3.36	23.6	2.28
17 °C	78.5	78.5	14.7	70.7	11.9	62.8	9.57	55.0	7.60	47.1	5.93	39.3	4.52	31.4	3.31	23.6	2.25
15 °C	78.5	78.5	14.4	70.7	11.7	62.8	9.44	55.0	7.50	47.1	5.86	39.3	4.47	31.4	3.28	23.6	2.23

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 27.0°C dry-bulb / 19.0°C wet bulb

Heating		Compressor + Outdoor Fan Power consumption (kW)																
Outdoor Unit	Outdoor Unit 100% Capacity (kW)	100% Capacity		90% Capacity		80% Capacity		70% Capacity		60% Capacity		50% Capacity		40% Capacity		30% Capacity		
		Dry-Bulb (°C)	Wet-Bulb (°C)	TC (kW)	PI (kW)													
15.0	13.7	87.5	87.5	18.5	78.8	15.5	70.0	12.9	61.3	10.6	52.5	8.75	43.8	7.11	35.0	5.66	26.3	4.32
13.0	11.8	87.5	87.5	19.4	78.8	16.1	70.0	13.3	61.3	11.0	52.5	9.01	43.8	7.30	35.0	5.79	26.3	4.41
11.0	9.8	87.5	87.5	20.4	78.8	16.8	70.0	13.9	61.3	11.4	52.5	9.31	43.8	7.51	35.0	5.94	26.3	4.51
9.0	7.9	87.5	87.5	21.4	78.8	17.6	70.0	14.5	61.3	11.8	52.5	9.61	43.8	7.73	35.0	6.09	26.3	4.62
7.0	6.0	87.5	87.5	22.5	78.8	18.5	70.0	15.1	61.3	12.3	52.5	9.94	43.8	7.96	35.0	6.25	26.3	4.73
5.0	4.1	84.4	84.4	22.4	75.9	18.4	67.5	15.0	59.1	12.2	50.6	9.87	42.2	7.90	33.7	6.20	25.3	4.69
3.0	2.2	81.2	81.2	22.2	73.1	18.2	65.0	14.9	56.9	12.1	48.7	9.79	40.6	7.84	32.5	6.16	24.4	4.65
0.0	-0.7	76.4	76.4	21.9	68.8	18.0	61.2	14.7	53.5	12.0	45.9	9.68	38.2	7.75	30.6	6.08	22.9	4.60
-3.0	-3.7	71.5	71.5	21.7	64.4	17.8	57.2	14.5	50.1	11.8	42.9	9.56	35.8	7.65	28.6	6.01	21.5	4.54
-5.0	-5.6	68.4	68.4	21.5	61.5	17.6	54.7	14.4	47.9	11.7	41.0	9.48	34.2	7.59	27.3	5.96	20.5	4.51
-7.0	-7.6	65.1	65.1	21.3	58.6	17.5	52.1	14.3	45.5	11.6	39.0	9.40	32.5	7.53	26.0	5.91	19.5	4.47
-10	-10.5	60.3	60.3	21.1	54.3	17.3	48.2	14.1	42.2	11.5	36.2	9.29	30.1	7.43	24.1	5.84	18.1	4.41
-14.5	-15.0	52.9	52.9	20.7	47.6	17.0	42.3	13.9	37.0	11.3	31.7	9.11	26.4	7.29	21.1	5.73	15.9	4.33

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 20.0°C dry-bulb

## 5 Outdoor unit



MMY-AP3016HT8P-E (30HP, 85kW system)

Cooling		Compressor + Outdoor Fan Power consumption (kW)																	
Outdoor Unit (°C)	Outdoor Unit 100% Capacity (kW)	100%		90%		80%		70%		60%		50%		40%		30%			
		TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)		
40 °C	79.1	79.1	28.7	71.2	22.8	63.3	17.9	55.4	13.9	47.5	10.7	39.6	8.10	31.6	5.92	23.7	4.03		
39 °C	80.4	80.4	28.3	72.3	22.5	64.3	17.6	56.3	13.7	48.2	10.6	40.2	7.98	32.2	5.84	24.1	3.97		
37 °C	82.8	82.8	27.5	74.5	21.8	66.2	17.1	57.9	13.3	49.7	10.2	41.4	7.74	33.1	5.66	24.8	3.85		
35 °C	85.0	85.0	26.6	76.5	21.1	68.0	16.6	59.5	12.9	51.0	9.9	42.5	7.50	34.0	5.48	25.5	3.73		
33 °C	85.0	85.0	24.4	76.5	19.4	68.0	15.3	59.5	12.0	51.0	9.23	42.5	7.00	34.0	5.13	25.5	3.49		
31 °C	85.0	85.0	22.4	76.5	17.9	68.0	14.2	59.5	11.1	51.0	8.62	42.5	6.56	34.0	4.82	25.5	3.27		
30 °C	85.0	85.0	21.6	76.5	17.2	68.0	13.7	59.5	10.7	51.0	8.34	42.5	6.35	34.0	4.67	25.5	3.17		
29 °C	85.0	85.0	20.7	76.5	16.6	68.0	13.2	59.5	10.4	51.0	8.06	42.5	6.15	34.0	4.52	25.5	3.07		
27 °C	85.0	85.0	19.2	76.5	15.4	68.0	12.3	59.5	9.69	51.0	7.56	42.5	5.78	34.0	4.25	25.5	2.89		
25 °C	85.0	85.0	17.9	76.5	14.4	68.0	11.5	59.5	9.07	51.0	7.09	42.5	5.43	34.0	4.00	25.5	2.72		
23 °C	85.0	85.0	17.0	76.5	13.7	68.0	11.0	59.5	8.68	51.0	6.80	42.5	5.21	34.0	3.85	25.5	2.61		
21 °C	85.0	85.0	16.6	76.5	13.4	68.0	10.7	59.5	8.51	51.0	6.68	42.5	5.13	34.0	3.79	25.5	2.57		
20 °C	85.0	85.0	16.4	76.5	13.2	68.0	10.6	59.5	8.44	51.0	6.62	42.5	5.09	34.0	3.76	25.5	2.55		
19 °C	85.0	85.0	16.2	76.5	13.1	68.0	10.5	59.5	8.37	51.0	6.57	42.5	5.05	34.0	3.73	25.5	2.53		
17 °C	85.0	85.0	15.9	76.5	12.9	68.0	10.4	59.5	8.24	51.0	6.48	42.5	4.99	34.0	3.69	25.5	2.50		
15 °C	85.0	85.0	15.7	76.5	12.7	68.0	10.2	59.5	8.14	51.0	6.41	42.5	4.94	34.0	3.65	25.5	2.47		

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 27.0°C dry-bulb / 19.0°C wet bulb

Heating		Compressor + Outdoor Fan Power consumption (kW)																	
Outdoor Unit	Outdoor Unit 100% Capacity (kW)	100% Capacity		90%		80%		70%		60%		50%		40%		30%			
		Dry-Bulb (°C)	Wet-Bulb (°C)	TC (kW)	PI (kW)														
15.0	13.7	95.0	95.0	19.7	85.5	16.3	76.0	13.5	66.5	11.2	57.0	9.20	47.5	7.56	38.0	6.15	28.5	4.92	
13.0	11.8	95.0	95.0	20.6	85.5	17.0	76.0	14.0	66.5	11.5	57.0	9.47	47.5	7.74	38.0	6.28	28.5	5.00	
11.0	9.8	95.0	95.0	21.7	85.5	17.8	76.0	14.6	66.5	12.0	57.0	9.77	47.5	7.95	38.0	6.42	28.5	5.09	
9.0	7.9	95.0	95.0	22.8	85.5	18.7	76.0	15.3	66.5	12.4	57.0	10.1	47.5	8.16	38.0	6.56	28.5	5.18	
7.0	6.0	95.0	95.0	24.1	85.5	19.7	76.0	16.0	66.5	12.9	57.0	10.4	47.5	8.40	38.0	6.71	28.5	5.28	
5.0	4.1	91.8	91.8	23.9	82.6	19.5	73.4	15.9	64.2	12.8	55.1	10.4	45.9	8.34	36.7	6.67	27.5	5.24	
3.0	2.2	88.5	88.5	23.8	79.7	19.4	70.8	15.7	62.0	12.7	53.1	10.3	44.3	8.28	35.4	6.62	26.6	5.21	
0.0	-0.7	83.6	83.6	23.5	75.2	19.2	66.9	15.6	58.5	12.6	50.1	10.2	41.8	8.20	33.4	6.55	25.1	5.15	
-3.0	-3.7	78.5	78.5	23.3	70.6	19.0	62.8	15.4	54.9	12.5	47.1	10.1	39.2	8.11	31.4	6.48	23.5	5.10	
-5.0	-5.6	75.2	75.2	23.1	67.7	18.8	60.2	15.3	52.7	12.4	45.1	10.0	37.6	8.05	30.1	6.44	22.6	5.06	
-7.0	-7.6	71.8	71.8	22.9	64.6	18.7	57.5	15.2	50.3	12.3	43.1	9.93	35.9	7.99	28.7	6.39	21.5	5.03	
-10	-10.5	66.9	66.9	22.7	60.2	18.5	53.5	15.0	46.8	12.2	40.1	9.82	33.4	7.91	26.8	6.32	20.1	4.97	
-14.5	-15.0	59.2	59.2	22.3	53.3	18.2	47.4	14.8	41.5	12.0	35.5	9.65	29.6	7.77	23.7	6.21	17.8	4.89	

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 20.0°C dry-bulb



**MMY-AP3216HT8P-E (32HP, 90kW system)**

Cooling		Compressor + Outdoor Fan Power consumption (kW)															
Outdoor Unit (°C)	Outdoor Unit 100% Capacity (kW)	100%		90%		80%		70%		60%		50%		40%		30%	
		TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)
40 °C	83.8	83.8	30.9	75.4	24.6	67.0	19.4	58.6	15.1	50.3	11.5	41.9	8.62	33.5	6.21	25.1	4.15
39 °C	85.1	85.1	30.4	76.6	24.3	68.1	19.1	59.6	14.9	51.1	11.4	42.6	8.49	34.0	6.11	25.5	4.09
37 °C	87.6	87.6	29.5	78.9	23.5	70.1	18.5	61.4	14.4	52.6	11.0	43.8	8.24	35.1	5.93	26.3	3.97
35 °C	90.0	90.0	28.6	81.0	22.8	72.0	17.9	63.0	14.0	54.0	10.7	45.0	7.98	36.0	5.74	27.0	3.84
33 °C	90.0	90.0	26.2	81.0	21.0	72.0	16.6	63.0	12.9	54.0	9.92	45.0	7.44	36.0	5.37	27.0	3.60
31 °C	90.0	90.0	24.2	81.0	19.4	72.0	15.4	63.0	12.0	54.0	9.25	45.0	6.96	36.0	5.03	27.0	3.37
30 °C	90.0	90.0	23.3	81.0	18.7	72.0	14.8	63.0	11.6	54.0	8.94	45.0	6.73	36.0	4.87	27.0	3.26
29 °C	90.0	90.0	22.4	81.0	18.0	72.0	14.3	63.0	11.2	54.0	8.64	45.0	6.52	36.0	4.72	27.0	3.16
27 °C	90.0	90.0	20.8	81.0	16.7	72.0	13.3	63.0	10.5	54.0	8.09	45.0	6.11	36.0	4.43	27.0	2.97
25 °C	90.0	90.0	19.3	81.0	15.6	72.0	12.4	63.0	9.78	54.0	7.58	45.0	5.74	36.0	4.17	27.0	2.79
23 °C	90.0	90.0	18.4	81.0	14.8	72.0	11.9	63.0	9.36	54.0	7.27	45.0	5.51	36.0	4.00	27.0	2.68
21 °C	90.0	90.0	17.9	81.0	14.5	72.0	11.6	63.0	9.17	54.0	7.13	45.0	5.41	36.0	3.94	27.0	2.64
20 °C	90.0	90.0	17.7	81.0	14.3	72.0	11.5	63.0	9.09	54.0	7.07	45.0	5.37	36.0	3.91	27.0	2.62
19 °C	90.0	90.0	17.5	81.0	14.2	72.0	11.4	63.0	9.01	54.0	7.02	45.0	5.33	36.0	3.88	27.0	2.60
17 °C	90.0	90.0	17.2	81.0	14.0	72.0	11.2	63.0	8.87	54.0	6.92	45.0	5.26	36.0	3.83	27.0	2.57
15 °C	90.0	90.0	16.9	81.0	13.7	72.0	11.0	63.0	8.76	54.0	6.83	45.0	5.20	36.0	3.79	27.0	2.54

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 27.0°C dry-bulb / 19.0°C wet bulb

Heating		Compressor + Outdoor Fan Power consumption (kW)																
Outdoor Unit	Outdoor Unit 100% Capacity (kW)	100% Capacity		90% Capacity		80% Capacity		70% Capacity		60% Capacity		50% Capacity		40% Capacity		30% Capacity		
		Dry-Bulb (°C)	Wet-Bulb (°C)	TC (kW)	PI (kW)													
15.0	13.7	100.0	100.0	21.2	90.0	17.7	80.0	14.6	70.0	12.1	60.0	9.89	50.0	8.07	40.0	6.53	30.0	5.23
13.0	11.8	100.0	100.0	22.2	90.0	18.4	80.0	15.2	70.0	12.5	60.0	10.2	50.0	8.27	40.0	6.66	30.0	5.31
11.0	9.8	100.0	100.0	23.3	90.0	19.3	80.0	15.9	70.0	13.0	60.0	10.5	50.0	8.50	40.0	6.81	30.0	5.40
9.0	7.9	100.0	100.0	24.5	90.0	20.2	80.0	16.5	70.0	13.5	60.0	10.9	50.0	8.74	40.0	6.97	30.0	5.50
7.0	6.0	100.0	100.0	25.8	90.0	21.2	80.0	17.3	70.0	14.0	60.0	11.3	50.0	9.00	40.0	7.14	30.0	5.60
5.0	4.1	96.4	96.4	25.6	86.8	21.0	77.1	17.2	67.5	13.9	57.9	11.2	48.2	8.93	38.6	7.08	28.9	5.56
3.0	2.2	92.8	92.8	25.4	83.6	20.9	74.3	17.0	65.0	13.8	55.7	11.1	46.4	8.86	37.1	7.03	27.9	5.51
0.0	-0.7	87.4	87.4	25.1	78.6	20.6	69.9	16.8	61.2	13.6	52.4	11.0	43.7	8.76	34.9	6.94	26.2	5.45
-3.0	-3.7	81.7	81.7	24.8	73.5	20.4	65.4	16.6	57.2	13.5	49.0	10.8	40.9	8.65	32.7	6.86	24.5	5.38
-5.0	-5.6	78.1	78.1	24.6	70.3	20.2	62.5	16.5	54.7	13.3	46.9	10.7	39.1	8.58	31.3	6.80	23.4	5.34
-7.0	-7.6	74.4	74.4	24.4	66.9	20.0	59.5	16.3	52.1	13.2	44.6	10.6	37.2	8.51	29.7	6.75	22.3	5.29
-10	-10.5	68.9	68.9	24.1	62.0	19.8	55.1	16.1	48.2	13.1	41.3	10.5	34.5	8.41	27.6	6.67	20.7	5.23
-14.5	-15.0	60.4	60.4	23.6	54.4	19.4	48.3	15.8	42.3	12.8	36.3	10.3	30.2	8.24	24.2	6.54	18.1	5.13

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 20.0°C dry-bulb

## 5 Outdoor unit



### MMY-AP3416HT8P-E (34HP, 95.4kW system)

Cooling		Compressor + Outdoor Fan Power consumption (kW)															
Outdoor Unit (°C)	Outdoor Unit 100% Capacity (kW)	100%		90%		80%		70%		60%		50%		40%		30%	
		TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)
40 °C	88.8	88.8	31.2	79.9	25.1	71.0	20.0	62.1	15.7	53.3	12.2	44.4	9.27	35.5	6.79	26.6	4.62
39 °C	90.2	90.2	30.8	81.2	24.7	72.2	19.7	63.1	15.5	54.1	12.0	45.1	9.13	36.1	6.69	27.1	4.55
37 °C	92.9	92.9	29.8	83.6	24.0	74.3	19.1	65.0	15.0	55.7	11.6	46.5	8.85	37.2	6.49	27.9	4.41
35 °C	95.4	95.4	28.9	85.8	23.2	76.3	18.5	66.8	14.5	57.2	11.3	47.7	8.57	38.2	6.28	28.6	4.27
33 °C	95.4	95.4	26.6	85.9	21.4	76.3	17.1	66.8	13.5	57.2	10.5	47.7	8.01	38.2	5.88	28.6	4.00
31 °C	95.4	95.4	24.5	85.9	19.8	76.3	15.9	66.8	12.6	57.2	9.82	47.7	7.50	38.2	5.52	28.6	3.76
30 °C	95.4	95.4	23.6	85.9	19.1	76.3	15.3	66.8	12.1	57.2	9.50	47.7	7.27	38.2	5.35	28.6	3.64
29 °C	95.4	95.4	22.7	85.9	18.4	76.3	14.8	66.8	11.7	57.2	9.19	47.7	7.04	38.2	5.18	28.6	3.53
27 °C	95.4	95.4	21.1	85.9	17.1	76.3	13.8	66.8	11.0	57.2	8.62	47.7	6.61	38.2	4.88	28.6	3.32
25 °C	95.4	95.4	19.6	85.9	16.0	76.3	12.9	66.8	10.3	57.2	8.09	47.7	6.21	38.2	4.59	28.6	3.12
23 °C	95.4	95.4	18.7	85.9	15.3	76.3	12.3	66.8	9.85	57.2	7.76	47.7	5.97	38.2	4.41	28.6	3.00
21 °C	95.4	95.4	18.3	85.9	14.9	76.3	12.1	66.8	9.67	57.2	7.62	47.7	5.87	38.2	4.34	28.6	2.95
20 °C	95.4	95.4	18.1	85.9	14.8	76.3	12.0	66.8	9.58	57.2	7.56	47.7	5.83	38.2	4.31	28.6	2.93
19 °C	95.4	95.4	17.9	85.9	14.6	76.3	11.9	66.8	9.51	57.2	7.51	47.7	5.79	38.2	4.28	28.6	2.91
17 °C	95.4	95.4	17.6	85.9	14.4	76.3	11.7	66.8	9.37	57.2	7.41	47.7	5.72	38.2	4.23	28.6	2.87
15 °C	95.4	95.4	17.3	85.9	14.2	76.3	11.5	66.8	9.25	57.2	7.32	47.7	5.65	38.2	4.18	28.6	2.84

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 27.0°C dry-bulb / 19.0°C wet bulb

Heating		Compressor + Outdoor Fan Power consumption (kW)																
Outdoor Unit	Outdoor Unit 100% Capacity (kW)	100% Capacity		90% Capacity		80% Capacity		70% Capacity		60% Capacity		50% Capacity		40% Capacity		30% Capacity		
		Dry-Bulb (°C)	Wet-Bulb (°C)	TC (kW)	PI (kW)													
15.0	13.7	106.0	106.0	22.3	95.4	18.7	84.8	15.6	74.2	13.0	63.6	10.6	53.0	8.63	42.4	6.86	31.8	5.27
13.0	11.8	106.0	106.0	23.3	95.4	19.5	84.8	16.2	74.2	13.4	63.6	11.0	53.0	8.86	42.4	7.02	31.8	5.38
11.0	9.8	106.0	106.0	24.5	95.4	20.4	84.8	16.9	74.2	13.9	63.6	11.3	53.0	9.12	42.4	7.20	31.8	5.50
9.0	7.9	106.0	106.0	25.7	95.4	21.3	84.8	17.6	74.2	14.4	63.6	11.7	53.0	9.38	42.4	7.39	31.8	5.62
7.0	6.0	106.0	106.0	27.0	95.4	22.3	84.8	18.3	74.2	15.0	63.6	12.1	53.0	9.67	42.4	7.58	31.8	5.75
5.0	4.1	102.4	102.4	26.8	92.2	22.2	81.9	18.2	71.7	14.9	61.4	12.0	51.2	9.61	41.0	7.53	30.7	5.71
3.0	2.2	98.8	98.8	26.6	88.9	22.0	79.1	18.1	69.2	14.8	59.3	11.9	49.4	9.54	39.5	7.48	29.6	5.67
0.0	-0.7	93.3	93.3	26.4	84.0	21.8	74.7	17.9	65.3	14.6	56.0	11.8	46.7	9.45	37.3	7.41	28.0	5.61
-3.0	-3.7	87.7	87.7	26.1	78.9	21.6	70.1	17.7	61.4	14.5	52.6	11.7	43.8	9.35	35.1	7.33	26.3	5.55
-5.0	-5.6	84.1	84.1	25.9	75.7	21.4	67.3	17.6	58.9	14.4	50.4	11.6	42.0	9.28	33.6	7.28	25.2	5.52
-7.0	-7.6	80.3	80.3	25.7	72.3	21.3	64.2	17.5	56.2	14.3	48.2	11.5	40.1	9.22	32.1	7.23	24.1	5.48
-10	-10.5	74.8	74.8	25.4	67.3	21.0	59.8	17.3	52.4	14.1	44.9	11.4	37.4	9.12	29.9	7.15	22.4	5.42
-14.5	-15.0	66.3	66.3	25.0	59.7	20.7	53.0	17.0	46.4	13.9	39.8	11.2	33.2	8.97	26.5	7.03	19.9	5.33

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 20.0°C dry-bulb

## 5 Outdoor unit



MMY-AP3616HT8P-E (36HP, 101kW system)

Cooling		Compressor + Outdoor Fan Power consumption (kW)															
Outdoor Unit (°C)	Outdoor Unit 100% Capacity (kW)	100%		90%		80%		70%		60%		50%		40%		30%	
		TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)
40 °C	94.0	94.0	34.1	84.6	27.4	75.2	21.7	65.8	17.0	56.4	13.2	47.0	9.94	37.6	7.23	28.2	4.88
39 °C	95.5	95.5	33.6	86.0	27.0	76.4	21.4	66.9	16.8	57.3	13.0	47.8	9.79	38.2	7.12	28.7	4.81
37 °C	98.4	98.4	32.6	88.5	26.1	78.7	20.7	68.8	16.3	59.0	12.6	49.2	9.49	39.3	6.91	29.5	4.66
35 °C	101.0	101.0	31.6	90.9	25.3	80.8	20.1	70.7	15.8	60.6	12.2	50.5	9.19	40.4	6.69	30.3	4.51
33 °C	101.0	101.0	29.0	90.9	23.3	80.8	18.6	70.7	14.6	60.6	11.3	50.5	8.59	40.4	6.26	30.3	4.22
31 °C	101.0	101.0	26.8	90.9	21.6	80.8	17.2	70.7	13.6	60.6	10.58	50.5	8.04	40.4	5.87	30.3	3.96
30 °C	101.0	101.0	25.8	90.9	20.8	80.8	16.6	70.7	13.1	60.6	10.23	50.5	7.78	40.4	5.69	30.3	3.84
29 °C	101.0	101.0	24.8	90.9	20.1	80.8	16.1	70.7	12.7	60.6	9.90	50.5	7.54	40.4	5.51	30.3	3.72
27 °C	101.0	101.0	23.0	90.9	18.7	80.8	15.0	70.7	11.9	60.6	9.27	50.5	7.07	40.4	5.18	30.3	3.49
25 °C	101.0	101.0	21.4	90.9	17.4	80.8	14.0	70.7	11.1	60.6	8.70	50.5	6.65	40.4	4.87	30.3	3.28
23 °C	101.0	101.0	20.4	90.9	16.6	80.8	13.4	70.7	10.6	60.6	8.34	50.5	6.38	40.4	4.68	30.3	3.16
21 °C	101.0	101.0	19.9	90.9	16.2	80.8	13.1	70.7	10.4	60.6	8.19	50.5	6.28	40.4	4.61	30.3	3.10
20 °C	101.0	101.0	19.7	90.9	16.1	80.8	13.0	70.7	10.3	60.6	8.13	50.5	6.23	40.4	4.57	30.3	3.08
19 °C	101.0	101.0	19.5	90.9	15.9	80.8	12.9	70.7	10.3	60.6	8.06	50.5	6.18	40.4	4.54	30.3	3.06
17 °C	101.0	101.0	19.2	90.9	15.6	80.8	12.6	70.7	10.1	60.6	7.95	50.5	6.10	40.4	4.48	30.3	3.02
15 °C	101.0	101.0	18.9	90.9	15.4	80.8	12.5	70.7	9.98	60.6	7.86	50.5	6.04	40.4	4.44	30.3	2.99

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 27.0°C dry-bulb / 19.0°C wet bulb

Heating		Compressor + Outdoor Fan Power consumption (kW)																
Outdoor Unit	Outdoor Unit 100% Capacity (kW)	100% Capacity		90%		80%		70%		60%		50%		40%		30%		
		Dry-Bulb (°C)	Wet-Bulb (°C)	TC (kW)	PI (kW)													
15.0	13.7	113.0	113.0	24.8	101.7	20.8	90.4	17.4	79.1	14.4	67.8	11.8	56.5	9.56	45.2	7.51	33.9	5.63
13.0	11.8	113.0	113.0	25.9	101.7	21.7	90.4	18.0	79.1	14.9	67.8	12.2	56.5	9.82	45.2	7.70	33.9	5.76
11.0	9.8	113.0	113.0	27.1	101.7	22.6	90.4	18.8	79.1	15.5	67.8	12.6	56.5	10.1	45.2	7.91	33.9	5.91
9.0	7.9	113.0	113.0	28.4	101.7	23.6	90.4	19.5	79.1	16.0	67.8	13.0	56.5	10.4	45.2	8.13	33.9	6.05
7.0	6.0	113.0	113.0	29.9	101.7	24.8	90.4	20.4	79.1	16.6	67.8	13.5	56.5	10.7	45.2	8.35	33.9	6.21
5.0	4.1	109.0	109.0	29.7	98.1	24.6	87.2	20.2	76.3	16.5	65.4	13.4	54.5	10.7	43.6	8.29	32.7	6.16
3.0	2.2	104.9	104.9	29.4	94.4	24.4	83.9	20.1	73.4	16.4	62.9	13.3	52.5	10.6	42.0	8.23	31.5	6.12
0.0	-0.7	98.7	98.7	29.1	88.9	24.1	79.0	19.8	69.1	16.2	59.2	13.1	49.4	10.5	39.5	8.13	29.6	6.04
-3.0	-3.7	92.3	92.3	28.7	83.1	23.8	73.9	19.6	64.6	16.0	55.4	12.9	46.2	10.3	36.9	8.03	27.7	5.97
-5.0	-5.6	88.3	88.3	28.5	79.5	23.6	70.6	19.4	61.8	15.9	53.0	12.8	44.1	10.2	35.3	7.97	26.5	5.92
-7.0	-7.6	84.0	84.0	28.3	75.6	23.4	67.2	19.3	58.8	15.7	50.4	12.7	42.0	10.2	33.6	7.90	25.2	5.87
-10	-10.5	77.9	77.9	27.9	70.1	23.1	62.3	19.0	54.5	15.5	46.7	12.6	38.9	10.0	31.1	7.80	23.4	5.80
-14.5	-15.0	68.3	68.3	27.4	61.4	22.7	54.6	18.7	47.8	15.3	41.0	12.3	34.1	9.84	27.3	7.65	20.5	5.69

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 20.0°C dry-bulb



**MMY-AP3816HT8P-E (38HP, 106.5kW system)**

Cooling		Compressor + Outdoor Fan Power consumption (kW)															
Outdoor Unit (°C)	Outdoor Unit 100% Capacity (kW)	100%		90%		80%		70%		60%		50%		40%		30%	
		TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)
40 °C	99.1	99.1	40.5	89.2	32.0	79.3	24.9	69.4	19.1	59.5	14.4	49.6	10.53	39.6	7.46	29.7	4.98
39 °C	100.7	100.7	39.9	90.6	31.5	80.6	24.6	70.5	18.8	60.4	14.1	50.4	10.38	40.3	7.35	30.2	4.91
37 °C	103.7	103.7	38.7	93.3	30.6	83.0	23.8	72.6	18.2	62.2	13.7	51.9	10.06	41.5	7.13	31.1	4.76
35 °C	106.5	106.5	37.5	95.8	29.6	85.2	23.1	74.5	17.7	63.9	13.3	53.2	9.74	42.6	6.90	31.9	4.61
33 °C	106.5	106.5	34.3	95.9	27.2	85.2	21.2	74.6	16.3	63.9	12.3	53.3	9.07	42.6	6.45	32.0	4.32
31 °C	106.5	106.5	31.6	95.9	25.1	85.2	19.6	74.6	15.1	63.9	11.5	53.3	8.46	42.6	6.04	32.0	4.05
30 °C	106.5	106.5	30.4	95.9	24.1	85.2	18.9	74.6	14.6	63.9	11.1	53.3	8.18	42.6	5.84	32.0	3.93
29 °C	106.5	106.5	29.2	95.9	23.2	85.2	18.2	74.6	14.1	63.9	10.7	53.3	7.91	42.6	5.66	32.0	3.81
27 °C	106.5	106.5	27.1	95.9	21.6	85.2	17.0	74.6	13.1	63.9	9.98	53.3	7.41	42.6	5.31	32.0	3.58
25 °C	106.5	106.5	25.1	95.9	20.1	85.2	15.8	74.6	12.3	63.9	9.34	53.3	6.95	42.6	4.99	32.0	3.37
23 °C	106.5	106.5	23.9	95.9	19.1	85.2	15.1	74.6	11.7	63.9	8.94	53.3	6.67	42.6	4.80	32.0	3.24
21 °C	106.5	106.5	23.3	95.9	18.6	85.2	14.7	74.6	11.5	63.9	8.76	53.3	6.54	42.6	4.72	32.0	3.19
20 °C	106.5	106.5	23.0	95.9	18.4	85.2	14.6	74.6	11.3	63.9	8.68	53.3	6.49	42.6	4.68	32.0	3.17
19 °C	106.5	106.5	22.8	95.9	18.2	85.2	14.4	74.6	11.2	63.9	8.61	53.3	6.44	42.6	4.65	32.0	3.15
17 °C	106.5	106.5	22.3	95.9	17.9	85.2	14.2	74.6	11.1	63.9	8.48	53.3	6.35	42.6	4.59	32.0	3.11
15 °C	106.5	106.5	21.9	95.9	17.6	85.2	14.0	74.6	10.9	63.9	8.37	53.3	6.28	42.6	4.54	32.0	3.08

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 27.0°C dry-bulb / 19.0°C wet bulb

Heating		Compressor + Outdoor Fan Power consumption (kW)																
Outdoor Unit	Outdoor Unit 100% Capacity (kW)	100% Capacity		90% Capacity		80% Capacity		70% Capacity		60% Capacity		50% Capacity		40% Capacity		30% Capacity		
		Dry-Bulb (°C)	Wet-Bulb (°C)	TC (kW)	PI (kW)													
15.0	13.7	114.0	114.0	24.8	102.6	20.8	91.2	17.4	79.8	14.5	68.4	11.9	57.0	9.64	45.6	7.60	34.2	5.68
13.0	11.8	114.0	114.0	25.9	102.6	21.7	91.2	18.0	79.8	14.9	68.4	12.2	57.0	9.90	45.6	7.79	34.2	5.82
11.0	9.8	114.0	114.0	27.2	102.6	22.6	91.2	18.8	79.8	15.5	68.4	12.6	57.0	10.2	45.6	8.00	34.2	5.97
9.0	7.9	114.0	114.0	28.5	102.6	23.7	91.2	19.5	79.8	16.0	68.4	13.1	57.0	10.5	45.6	8.21	34.2	6.12
7.0	6.0	114.0	114.0	30.0	102.6	24.8	91.2	20.4	79.8	16.7	68.4	13.5	57.0	10.8	45.6	8.44	34.2	6.28
5.0	4.1	109.9	109.9	29.8	98.9	24.6	87.9	20.2	76.9	16.5	65.9	13.4	55.0	10.7	44.0	8.38	33.0	6.23
3.0	2.2	105.8	105.8	29.5	95.2	24.4	84.7	20.1	74.1	16.4	63.5	13.3	52.9	10.6	42.3	8.31	31.7	6.18
0.0	-0.7	99.6	99.6	29.2	89.6	24.1	79.7	19.8	69.7	16.2	59.8	13.1	49.8	10.5	39.8	8.22	29.9	6.11
-3.0	-3.7	93.2	93.2	28.8	83.8	23.8	74.5	19.6	65.2	16.0	55.9	13.0	46.6	10.4	37.3	8.11	27.9	6.03
-5.0	-5.6	89.1	89.1	28.6	80.2	23.6	71.3	19.4	62.4	15.9	53.4	12.9	44.5	10.3	35.6	8.05	26.7	5.99
-7.0	-7.6	84.8	84.8	28.4	76.3	23.4	67.8	19.3	59.3	15.8	50.9	12.8	42.4	10.2	33.9	7.98	25.4	5.94
-10	-10.5	78.5	78.5	28.0	70.7	23.1	62.8	19.0	55.0	15.6	47.1	12.6	39.3	10.1	31.4	7.88	23.6	5.86
-14.5	-15.0	68.9	68.9	27.5	62.0	22.7	55.1	18.7	48.2	15.3	41.3	12.4	34.4	9.90	27.6	7.73	20.7	5.75

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 20.0°C dry-bulb

## 5 Outdoor unit



MMY-AP4016HT8P-E (40HP, 112kW system)

Cooling		Compressor + Outdoor Fan Power consumption (kW)															
Outdoor Unit (°C)	Outdoor Unit 100% Capacity (kW)	100%		90%		80%		70%		60%		50%		40%		30%	
		TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)
40 °C	104.2	104.2	37.4	93.8	30.1	83.4	24.0	73.0	19.0	62.5	14.8	52.1	11.25	41.7	8.25	31.3	5.60
39 °C	105.9	105.9	36.8	95.3	29.7	84.7	23.7	74.1	18.7	63.5	14.6	53.0	11.09	42.4	8.13	31.8	5.52
37 °C	109.1	109.1	35.7	98.2	28.8	87.3	23.0	76.3	18.1	65.4	14.1	54.5	10.75	43.6	7.89	32.7	5.35
35 °C	112.0	112.0	34.6	100.8	27.9	89.6	22.2	78.4	17.6	67.2	13.7	56.0	10.41	44.8	7.64	33.6	5.18
33 °C	112.0	112.0	31.8	100.8	25.7	89.6	20.6	78.4	16.3	67.2	12.7	56.0	9.73	44.8	7.15	33.6	4.85
31 °C	112.0	112.0	29.4	100.8	23.8	89.6	19.1	78.4	15.2	67.2	11.9	56.0	9.12	44.8	6.71	33.6	4.55
30 °C	112.0	112.0	28.3	100.8	22.9	89.6	18.5	78.4	14.7	67.2	11.5	56.0	8.83	44.8	6.50	33.6	4.41
29 °C	112.0	112.0	27.2	100.8	22.1	89.6	17.8	78.4	14.2	67.2	11.1	56.0	8.56	44.8	6.30	33.6	4.27
27 °C	112.0	112.0	25.3	100.8	20.6	89.6	16.6	78.4	13.3	67.2	10.5	56.0	8.04	44.8	5.93	33.6	4.02
25 °C	112.0	112.0	23.6	100.8	19.2	89.6	15.6	78.4	12.4	67.2	9.81	56.0	7.55	44.8	5.57	33.6	3.78
23 °C	112.0	112.0	22.5	100.8	18.4	89.6	14.9	78.4	11.9	67.2	9.42	56.0	7.26	44.8	5.36	33.6	3.63
21 °C	112.0	112.0	22.0	100.8	18.0	89.6	14.6	78.4	11.7	67.2	9.25	56.0	7.14	44.8	5.28	33.6	3.57
20 °C	112.0	112.0	21.7	100.8	17.8	89.6	14.4	78.4	11.6	67.2	9.18	56.0	7.09	44.8	5.24	33.6	3.54
19 °C	112.0	112.0	21.5	100.8	17.6	89.6	14.3	78.4	11.5	67.2	9.11	56.0	7.04	44.8	5.20	33.6	3.52
17 °C	112.0	112.0	21.1	100.8	17.3	89.6	14.1	78.4	11.3	67.2	8.99	56.0	6.95	44.8	5.14	33.6	3.47
15 °C	112.0	112.0	20.8	100.8	17.1	89.6	13.9	78.4	11.2	67.2	8.89	56.0	6.87	44.8	5.08	33.6	3.43

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 27.0°C dry-bulb / 19.0°C wet bulb

Heating		Compressor + Outdoor Fan Power consumption (kW)																
Outdoor Unit	Outdoor Unit 100% Capacity (kW)	100% Capacity		90% Capacity		80% Capacity		70% Capacity		60% Capacity		50% Capacity		40% Capacity		30% Capacity		
		Dry-Bulb (°C)	Wet-Bulb (°C)	TC (kW)	PI (kW)													
15.0	13.7	126.0	126.0	28.4	113.4	24.0	100.8	20.1	88.2	16.8	75.6	13.8	63.0	11.0	50.4	8.50	37.8	6.03
13.0	11.8	126.0	126.0	29.6	113.4	24.9	100.8	20.9	88.2	17.3	75.6	14.2	63.0	11.4	50.4	8.74	37.8	6.21
11.0	9.8	126.0	126.0	30.9	113.4	26.0	100.8	21.7	88.2	17.9	75.6	14.7	63.0	11.7	50.4	9.01	37.8	6.41
9.0	7.9	126.0	126.0	32.4	113.4	27.1	100.8	22.5	88.2	18.6	75.6	15.2	63.0	12.1	50.4	9.28	37.8	6.61
7.0	6.0	126.0	126.0	34.0	113.4	28.3	100.8	23.5	88.2	19.3	75.6	15.7	63.0	12.5	50.4	9.57	37.8	6.82
5.0	4.1	121.5	121.5	33.7	109.3	28.1	97.2	23.3	85.0	19.2	72.9	15.6	60.7	12.4	48.6	9.50	36.4	6.77
3.0	2.2	117.0	117.0	33.5	105.3	27.9	93.6	23.1	81.9	19.0	70.2	15.4	58.5	12.3	46.8	9.43	35.1	6.72
0.0	-0.7	110.1	110.1	33.1	99.1	27.6	88.1	22.8	77.1	18.8	66.1	15.3	55.0	12.1	44.0	9.32	33.0	6.64
-3.0	-3.7	103.0	103.0	32.7	92.7	27.2	82.4	22.6	72.1	18.5	61.8	15.1	51.5	12.0	41.2	9.20	30.9	6.56
-5.0	-5.6	98.5	98.5	32.4	88.6	27.0	78.8	22.4	68.9	18.4	59.1	15.0	49.2	11.9	39.4	9.13	29.5	6.50
-7.0	-7.6	93.7	93.7	32.1	84.3	26.8	75.0	22.2	65.6	18.2	56.2	14.8	46.9	11.8	37.5	9.05	28.1	6.45
-10	-10.5	86.8	86.8	31.8	78.1	26.5	69.5	21.9	60.8	18.0	52.1	14.6	43.4	11.7	34.7	8.94	26.0	6.37
-14.5	-15.0	76.1	76.1	31.1	68.5	25.9	60.9	21.5	53.3	17.7	45.7	14.4	38.1	11.4	30.5	8.77	22.8	6.25

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 20.0°C dry-bulb

## 5 Outdoor unit



MMY-AP4216HT8P-E (42HP, 117kW system)

Cooling		Compressor + Outdoor Fan Power consumption (kW)															
Outdoor Unit (°C)	Outdoor Unit 100% Capacity (kW)	100%		90%		80%		70%		60%		50%		40%		30%	
		TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)
40 °C	109.4	109.4	43.8	98.4	34.8	87.5	27.2	76.5	21.0	65.6	16.0	54.7	11.8	43.7	8.49	32.8	5.71
39 °C	111.1	111.1	43.1	100.0	34.2	88.9	26.8	77.8	20.7	66.7	15.7	55.6	11.7	44.4	8.36	33.3	5.63
37 °C	114.4	114.4	41.8	103.0	33.2	91.5	26.0	80.1	20.1	68.7	15.3	57.2	11.3	45.8	8.11	34.3	5.45
35 °C	117.5	117.5	40.5	105.7	32.2	94.0	25.2	82.2	19.5	70.5	14.8	58.7	11.0	47.0	7.85	35.2	5.28
33 °C	117.5	117.5	37.1	105.8	29.6	94.0	23.3	82.3	18.0	70.5	13.7	58.8	10.2	47.0	7.34	35.3	4.95
31 °C	117.5	117.5	34.2	105.8	27.3	94.0	21.5	82.3	16.7	70.5	12.8	58.8	9.54	47.0	6.88	35.3	4.64
30 °C	117.5	117.5	32.9	105.8	26.3	94.0	20.7	82.3	16.1	70.5	12.4	58.8	9.23	47.0	6.66	35.3	4.50
29 °C	117.5	117.5	31.6	105.8	25.3	94.0	20.0	82.3	15.6	70.5	11.9	58.8	8.94	47.0	6.45	35.3	4.36
27 °C	117.5	117.5	29.3	105.8	23.5	94.0	18.6	82.3	14.5	70.5	11.2	58.8	8.38	47.0	6.06	35.3	4.11
25 °C	117.5	117.5	27.3	105.8	21.9	94.0	17.4	82.3	13.6	70.5	10.5	58.8	7.86	47.0	5.70	35.3	3.86
23 °C	117.5	117.5	25.9	105.8	20.9	94.0	16.6	82.3	13.0	70.5	10.0	58.8	7.54	47.0	5.47	35.3	3.71
21 °C	117.5	117.5	25.3	105.8	20.4	94.0	16.2	82.3	12.7	70.5	9.82	58.8	7.41	47.0	5.39	35.3	3.66
20 °C	117.5	117.5	25.0	105.8	20.1	94.0	16.0	82.3	12.6	70.5	9.74	58.8	7.35	47.0	5.35	35.3	3.63
19 °C	117.5	117.5	24.7	105.8	19.9	94.0	15.9	82.3	12.5	70.5	9.66	58.8	7.30	47.0	5.31	35.3	3.61
17 °C	117.5	117.5	24.3	105.8	19.6	94.0	15.6	82.3	12.3	70.5	9.52	58.8	7.20	47.0	5.24	35.3	3.56
15 °C	117.5	117.5	23.9	105.8	19.3	94.0	15.4	82.3	12.1	70.5	9.40	58.8	7.11	47.0	5.19	35.3	3.53

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 27.0°C dry-bulb / 19.0°C wet bulb

Heating		Compressor + Outdoor Fan Power consumption (kW)																
Outdoor Unit	Outdoor Unit 100% Capacity (kW)	100% Capacity		90% Capacity		80% Capacity		70% Capacity		60% Capacity		50% Capacity		40% Capacity		30% Capacity		
		Dry-Bulb (°C)	Wet-Bulb (°C)	TC (kW)	PI (kW)													
15.0	13.7	127.0	127.0	28.4	114.3	24.0	101.6	20.1	88.9	16.8	76.2	13.8	63.5	11.1	50.8	8.58	38.1	6.08
13.0	11.8	127.0	127.0	29.6	114.3	24.9	101.6	20.9	88.9	17.3	76.2	14.3	63.5	11.4	50.8	8.83	38.1	6.27
11.0	9.8	127.0	127.0	31.0	114.3	26.0	101.6	21.7	88.9	18.0	76.2	14.7	63.5	11.8	50.8	9.10	38.1	6.47
9.0	7.9	127.0	127.0	32.5	114.3	27.1	101.6	22.5	88.9	18.6	76.2	15.2	63.5	12.2	50.8	9.37	38.1	6.67
7.0	6.0	127.0	127.0	34.1	114.3	28.3	101.6	23.5	88.9	19.3	76.2	15.7	63.5	12.6	50.8	9.66	38.1	6.89
5.0	4.1	122.4	122.4	33.8	110.2	28.1	98.0	23.3	85.7	19.2	73.5	15.6	61.2	12.5	49.0	9.59	36.7	6.84
3.0	2.2	117.9	117.9	33.6	106.1	27.9	94.3	23.1	82.5	19.0	70.7	15.5	59.0	12.4	47.2	9.51	35.4	6.78
0.0	-0.7	111.0	111.0	33.2	99.9	27.6	88.8	22.8	77.7	18.8	66.6	15.3	55.5	12.2	44.4	9.40	33.3	6.70
-3.0	-3.7	103.8	103.8	32.8	93.4	27.2	83.0	22.6	72.6	18.6	62.3	15.1	51.9	12.1	41.5	9.29	31.1	6.62
-5.0	-5.6	99.2	99.2	32.5	89.3	27.0	79.4	22.4	69.5	18.4	59.5	15.0	49.6	12.0	39.7	9.21	29.8	6.57
-7.0	-7.6	94.4	94.4	32.2	85.0	26.8	75.6	22.2	66.1	18.3	56.7	14.9	47.2	11.9	37.8	9.13	28.3	6.51
-10	-10.5	87.5	87.5	31.8	78.8	26.5	70.0	21.9	61.3	18.0	52.5	14.7	43.8	11.7	35.0	9.02	26.3	6.43
-14.5	-15.0	76.7	76.7	31.2	69.1	26.0	61.4	21.5	53.7	17.7	46.0	14.4	38.4	11.5	30.7	8.85	23.0	6.31

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 20.0°C dry-bulb

## 5 Outdoor unit



MMY-AP4416HT8P-E (44HP, 123kW system)

Cooling		Compressor + Outdoor Fan Power consumption (kW)															
Outdoor Unit (°C)	Outdoor Unit 100% Capacity (kW)	100%		90%		80%		70%		60%		50%		40%		30%	
		TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)
40 °C	114.5	114.5	50.1	103.0	39.4	91.6	30.5	80.1	23.1	68.7	17.2	57.2	12.4	45.8	8.72	34.3	5.82
39 °C	116.3	116.3	49.4	104.7	38.8	93.0	30.0	81.4	22.8	69.8	16.9	58.2	12.3	46.5	8.59	34.9	5.73
37 °C	119.8	119.8	47.9	107.8	37.6	95.8	29.1	83.8	22.1	71.9	16.4	59.9	11.9	47.9	8.33	35.9	5.56
35 °C	123.0	123.0	46.4	110.7	36.5	98.4	28.2	86.1	21.4	73.8	15.9	61.5	11.5	49.2	8.07	36.9	5.38
33 °C	123.0	123.0	42.5	110.7	33.4	98.4	25.9	86.1	19.7	73.8	14.7	61.5	10.7	49.2	7.53	36.9	5.05
31 °C	123.0	123.0	39.0	110.7	30.8	98.4	23.9	86.1	18.3	73.8	13.7	61.5	9.97	49.2	7.04	36.9	4.74
30 °C	123.0	123.0	37.5	110.7	29.6	98.4	23.0	86.1	17.6	73.8	13.2	61.5	9.63	49.2	6.82	36.9	4.59
29 °C	123.0	123.0	36.0	110.7	28.5	98.4	22.2	86.1	17.0	73.8	12.7	61.5	9.31	49.2	6.60	36.9	4.46
27 °C	123.0	123.0	33.3	110.7	26.4	98.4	20.6	86.1	15.8	73.8	11.9	61.5	8.72	49.2	6.20	36.9	4.19
25 °C	123.0	123.0	30.9	110.7	24.5	98.4	19.2	86.1	14.7	73.8	11.1	61.5	8.17	49.2	5.82	36.9	3.95
23 °C	123.0	123.0	29.4	110.7	23.3	98.4	18.3	86.1	14.1	73.8	10.6	61.5	7.82	49.2	5.59	36.9	3.80
21 °C	123.0	123.0	28.6	110.7	22.8	98.4	17.8	86.1	13.7	73.8	10.39	61.5	7.68	49.2	5.50	36.9	3.75
20 °C	123.0	123.0	28.3	110.7	22.5	98.4	17.6	86.1	13.6	73.8	10.30	61.5	7.61	49.2	5.45	36.9	3.72
19 °C	123.0	123.0	28.0	110.7	22.3	98.4	17.5	86.1	13.5	73.8	10.21	61.5	7.55	49.2	5.42	36.9	3.70
17 °C	123.0	123.0	27.4	110.7	21.8	98.4	17.1	86.1	13.2	73.8	10.05	61.5	7.45	49.2	5.35	36.9	3.65
15 °C	123.0	123.0	26.9	110.7	21.5	98.4	16.9	86.1	13.1	73.8	9.91	61.5	7.35	49.2	5.29	36.9	3.62

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 27.0°C dry-bulb / 19.0°C wet bulb

Heating		Compressor + Outdoor Fan Power consumption (kW)																
Outdoor Unit	Outdoor Unit 100% Capacity (kW)	100% Capacity		90% Capacity		80% Capacity		70% Capacity		60% Capacity		50% Capacity		40% Capacity		30% Capacity		
		Dry-Bulb (°C)	Wet-Bulb (°C)	TC (kW)	PI (kW)													
15.0	13.7	128.0	128.0	28.4	115.2	24.0	102.4	20.2	89.6	16.8	76.8	13.9	64.0	11.2	51.2	8.67	38.4	6.14
13.0	11.8	128.0	128.0	29.6	115.2	24.9	102.4	20.9	89.6	17.4	76.8	14.3	64.0	11.5	51.2	8.91	38.4	6.32
11.0	9.8	128.0	128.0	31.0	115.2	26.0	102.4	21.7	89.6	18.0	76.8	14.8	64.0	11.9	51.2	9.18	38.4	6.53
9.0	7.9	128.0	128.0	32.5	115.2	27.1	102.4	22.5	89.6	18.6	76.8	15.2	64.0	12.2	51.2	9.46	38.4	6.74
7.0	6.0	128.0	128.0	34.2	115.2	28.4	102.4	23.5	89.6	19.3	76.8	15.8	64.0	12.6	51.2	9.75	38.4	6.96
5.0	4.1	123.4	123.4	33.9	111.1	28.2	98.7	23.3	86.4	19.2	74.0	15.6	61.7	12.5	49.4	9.67	37.0	6.90
3.0	2.2	118.8	118.8	33.7	106.9	27.9	95.1	23.1	83.2	19.0	71.3	15.5	59.4	12.4	47.5	9.60	35.6	6.85
0.0	-0.7	111.8	111.8	33.3	100.7	27.6	89.5	22.8	78.3	18.8	67.1	15.3	55.9	12.3	44.7	9.49	33.6	6.77
-3.0	-3.7	104.6	104.6	32.9	94.1	27.3	83.7	22.6	73.2	18.6	62.8	15.1	52.3	12.1	41.8	9.37	31.4	6.69
-5.0	-5.6	100.0	100.0	32.6	90.0	27.1	80.0	22.4	70.0	18.4	60.0	15.0	50.0	12.0	40.0	9.29	30.0	6.63
-7.0	-7.6	95.2	95.2	32.3	85.7	26.8	76.2	22.2	66.6	18.3	57.1	14.9	47.6	11.9	38.1	9.22	28.6	6.58
-10	-10.5	88.2	88.2	31.9	79.4	26.5	70.6	21.9	61.7	18.0	52.9	14.7	44.1	11.8	35.3	9.10	26.5	6.50
-14.5	-15.0	77.3	77.3	31.3	69.6	26.0	61.9	21.5	54.1	17.7	46.4	14.4	38.7	11.6	30.9	8.93	23.2	6.37

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 20.0°C dry-bulb

## 5 Outdoor unit



MMY-AP4616HT8P-E (46HP, 130kW system)

Cooling		Compressor + Outdoor Fan Power consumption (kW)																	
Outdoor Unit (°C)	Outdoor Unit 100% Capacity (kW)	100%		90%		80%		70%		60%		50%		40%		30%			
		TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)		
40 °C	121.0	121.0	44.2	108.9	35.1	96.8	27.6	84.7	21.5	72.6	16.5	60.5	12.4	48.4	9.03	36.3	6.10		
39 °C	122.9	122.9	43.5	110.6	34.6	98.3	27.2	86.0	21.2	73.8	16.2	61.5	12.2	49.2	8.89	36.9	6.01		
37 °C	126.6	126.6	42.2	113.9	33.5	101.3	26.4	88.6	20.5	76.0	15.8	63.3	11.9	50.6	8.62	38.0	5.83		
35 °C	130.0	130.0	40.9	117.0	32.5	104.0	25.5	91.0	19.9	78.0	15.3	65.0	11.5	52.0	8.35	39.0	5.65		
33 °C	130.0	130.0	37.5	117.0	29.9	104.0	23.6	91.0	18.4	78.0	14.2	65.0	10.7	52.0	7.82	39.0	5.29		
31 °C	130.0	130.0	34.5	117.0	27.6	104.0	21.9	91.0	17.1	78.0	13.2	65.0	10.0	52.0	7.33	39.0	4.96		
30 °C	130.0	130.0	33.2	117.0	26.6	104.0	21.1	91.0	16.5	78.0	12.8	65.0	9.71	52.0	7.10	39.0	4.80		
29 °C	130.0	130.0	31.9	117.0	25.6	104.0	20.3	91.0	16.0	78.0	12.4	65.0	9.41	52.0	6.88	39.0	4.66		
27 °C	130.0	130.0	29.6	117.0	23.8	104.0	18.9	91.0	14.9	78.0	11.6	65.0	8.83	52.0	6.47	39.0	4.38		
25 °C	130.0	130.0	27.5	117.0	22.2	104.0	17.7	91.0	14.0	78.0	10.9	65.0	8.30	52.0	6.08	39.0	4.11		
23 °C	130.0	130.0	26.2	117.0	21.1	104.0	16.9	91.0	13.4	78.0	10.4	65.0	7.97	52.0	5.85	39.0	3.95		
21 °C	130.0	130.0	25.5	117.0	20.6	104.0	16.5	91.0	13.1	78.0	10.2	65.0	7.83	52.0	5.75	39.0	3.89		
20 °C	130.0	130.0	25.3	117.0	20.4	104.0	16.4	91.0	13.0	78.0	10.2	65.0	7.77	52.0	5.71	39.0	3.86		
19 °C	130.0	130.0	25.0	117.0	20.2	104.0	16.2	91.0	12.9	78.0	10.1	65.0	7.72	52.0	5.67	39.0	3.83		
17 °C	130.0	130.0	24.5	117.0	19.9	104.0	16.0	91.0	12.7	78.0	9.94	65.0	7.62	52.0	5.60	39.0	3.78		
15 °C	130.0	130.0	24.1	117.0	19.6	104.0	15.7	91.0	12.5	78.0	9.82	65.0	7.53	52.0	5.54	39.0	3.74		

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 27.0°C dry-bulb / 19.0°C wet bulb

Heating		Compressor + Outdoor Fan Power consumption (kW)																	
Outdoor Unit	Outdoor Unit 100% Capacity (kW)	100% Capacity		90%		80%		70%		60%		50%		40%		30%			
		Dry-Bulb (°C)	Wet-Bulb (°C)	TC (kW)	PI (kW)														
15.0	13.7	145.0	145.0	30.3	130.5	25.1	116.0	20.8	101.5	17.2	87.0	14.2	72.5	11.6	58.0	9.42	43.5	7.53	
13.0	11.8	145.0	145.0	31.7	130.5	26.2	116.0	21.6	101.5	17.8	87.0	14.6	72.5	11.9	58.0	9.61	43.5	7.66	
11.0	9.8	145.0	145.0	33.3	130.5	27.5	116.0	22.6	101.5	18.4	87.0	15.0	72.5	12.2	58.0	9.82	43.5	7.79	
9.0	7.9	145.0	145.0	35.1	130.5	28.8	116.0	23.5	101.5	19.1	87.0	15.5	72.5	12.5	58.0	10.0	43.5	7.93	
7.0	6.0	145.0	145.0	37.0	130.5	30.2	116.0	24.6	101.5	19.9	87.0	16.1	72.5	12.9	58.0	10.3	43.5	8.08	
5.0	4.1	140.0	140.0	36.7	126.0	30.0	112.0	24.4	98.0	19.8	84.0	15.9	70.0	12.8	56.0	10.2	42.0	8.02	
3.0	2.2	134.9	134.9	36.5	121.4	29.8	108.0	24.3	94.5	19.6	81.0	15.8	67.5	12.7	54.0	10.1	40.5	7.96	
0.0	-0.7	127.3	127.3	36.1	114.5	29.5	101.8	24.0	89.1	19.4	76.4	15.7	63.6	12.6	50.9	10.0	38.2	7.88	
-3.0	-3.7	119.3	119.3	35.7	107.4	29.2	95.5	23.7	83.5	19.2	71.6	15.5	59.7	12.4	47.7	9.91	35.8	7.79	
-5.0	-5.6	114.3	114.3	35.4	102.9	28.9	91.4	23.5	80.0	19.1	68.6	15.4	57.1	12.3	45.7	9.84	34.3	7.73	
-7.0	-7.6	109.0	109.0	35.1	98.1	28.7	87.2	23.4	76.3	18.9	65.4	15.3	54.5	12.2	43.6	9.76	32.7	7.67	
-10	-10.5	101.3	101.3	34.7	91.2	28.4	81.1	23.1	70.9	18.7	60.8	15.1	50.7	12.1	40.5	9.65	30.4	7.59	
-14.5	-15.0	89.4	89.4	34.1	80.5	27.9	71.5	22.7	62.6	18.4	53.7	14.8	44.7	11.9	35.8	9.48	26.8	7.45	

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 20.0°C dry-bulb

## 5 Outdoor unit



### MMY-AP4816HT8P (48HP, 135kW system)

Cooling		Compressor + Outdoor Fan Power consumption (kW)															
Outdoor Unit (°C)	Outdoor Unit 100% Capacity (kW)	100%		90%		80%		70%		60%		50%		40%		30%	
		TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)
40 °C	125.6	125.6	46.3	113.1	36.9	100.5	29.1	87.9	22.6	75.4	17.3	62.8	12.9	50.3	9.31	37.7	6.23
39 °C	127.7	127.7	45.7	114.9	36.4	102.1	28.7	89.4	22.3	76.6	17.0	63.8	12.7	51.1	9.17	38.3	6.14
37 °C	131.5	131.5	44.3	118.3	35.3	105.2	27.8	92.0	21.6	78.9	16.5	65.7	12.4	52.6	8.89	39.4	5.95
35 °C	135.0	135.0	42.9	121.5	34.2	108.0	26.9	94.5	20.9	81.0	16.0	67.5	12.0	54.0	8.61	40.5	5.76
33 °C	135.0	135.0	39.4	121.5	31.5	108.0	24.9	94.5	19.4	81.0	14.9	67.5	11.2	54.0	8.05	40.5	5.39
31 °C	135.0	135.0	36.3	121.5	29.1	108.0	23.0	94.5	18.0	81.0	13.9	67.5	10.4	54.0	7.54	40.5	5.05
30 °C	135.0	135.0	34.9	121.5	28.0	108.0	22.2	94.5	17.4	81.0	13.4	67.5	10.1	54.0	7.31	40.5	4.90
29 °C	135.0	135.0	33.6	121.5	27.0	108.0	21.4	94.5	16.8	81.0	13.0	67.5	9.77	54.0	7.08	40.5	4.74
27 °C	135.0	135.0	31.1	121.5	25.1	108.0	20.0	94.5	15.7	81.0	12.1	67.5	9.17	54.0	6.65	40.5	4.46
25 °C	135.0	135.0	29.0	121.5	23.4	108.0	18.6	94.5	14.7	81.0	11.4	67.5	8.60	54.0	6.25	40.5	4.19
23 °C	135.0	135.0	27.6	121.5	22.3	108.0	17.8	94.5	14.0	81.0	10.9	67.5	8.26	54.0	6.00	40.5	4.03
21 °C	135.0	135.0	26.9	121.5	21.7	108.0	17.4	94.5	13.8	81.0	10.7	67.5	8.12	54.0	5.90	40.5	3.96
20 °C	135.0	135.0	26.6	121.5	21.5	108.0	17.2	94.5	13.6	81.0	10.6	67.5	8.05	54.0	5.86	40.5	3.93
19 °C	135.0	135.0	26.3	121.5	21.3	108.0	17.1	94.5	13.5	81.0	10.5	67.5	7.99	54.0	5.82	40.5	3.90
17 °C	135.0	135.0	25.8	121.5	20.9	108.0	16.8	94.5	13.3	81.0	10.4	67.5	7.89	54.0	5.75	40.5	3.85
15 °C	135.0	135.0	25.4	121.5	20.6	108.0	16.6	94.5	13.1	81.0	10.2	67.5	7.80	54.0	5.68	40.5	3.81

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 27.0°C dry-bulb / 19.0°C wet bulb

Heating		Compressor + Outdoor Fan Power consumption (kW)																
Outdoor Unit	Outdoor Unit 100% Capacity (kW)	100% Capacity		90% Capacity		80% Capacity		70% Capacity		60% Capacity		50% Capacity		40% Capacity		30% Capacity		
		Dry-Bulb (°C)	Wet-Bulb (°C)	TC (kW)	PI (kW)													
15.0	13.7	150.0	150.0	31.8	135.0	26.5	120.0	22.0	105.0	18.1	90.0	14.8	75.0	12.1	60.0	9.79	45.0	7.84
13.0	11.8	150.0	150.0	33.3	135.0	27.6	120.0	22.8	105.0	18.7	90.0	15.3	75.0	12.4	60.0	9.99	45.0	7.96
11.0	9.8	150.0	150.0	35.0	135.0	28.9	120.0	23.8	105.0	19.4	90.0	15.8	75.0	12.7	60.0	10.2	45.0	8.10
9.0	7.9	150.0	150.0	36.7	135.0	30.3	120.0	24.8	105.0	20.2	90.0	16.3	75.0	13.1	60.0	10.5	45.0	8.24
7.0	6.0	150.0	150.0	38.7	135.0	31.8	120.0	25.9	105.0	21.0	90.0	16.9	75.0	13.5	60.0	10.7	45.0	8.40
5.0	4.1	144.6	144.6	38.4	130.2	31.5	115.7	25.7	101.2	20.8	86.8	16.8	72.3	13.4	57.9	10.6	43.4	8.33
3.0	2.2	139.3	139.3	38.1	125.3	31.3	111.4	25.5	97.5	20.7	83.6	16.6	69.6	13.3	55.7	10.5	41.8	8.27
0.0	-0.7	131.1	131.1	37.7	118.0	30.9	104.8	25.2	91.7	20.4	78.6	16.4	65.5	13.1	52.4	10.4	39.3	8.17
-3.0	-3.7	122.6	122.6	37.2	110.3	30.6	98.1	24.9	85.8	20.2	73.5	16.2	61.3	13.0	49.0	10.3	36.8	8.07
-5.0	-5.6	117.2	117.2	36.9	105.5	30.3	93.8	24.7	82.0	20.0	70.3	16.1	58.6	12.9	46.9	10.2	35.2	8.01
-7.0	-7.6	111.6	111.6	36.6	100.4	30.1	89.2	24.5	78.1	19.9	66.9	16.0	55.8	12.8	44.6	10.1	33.5	7.94
-10	-10.5	103.4	103.4	36.1	93.0	29.7	82.7	24.2	72.3	19.6	62.0	15.8	51.7	12.6	41.3	10.0	31.0	7.84
-14.5	-15.0	90.6	90.6	35.4	81.6	29.1	72.5	23.7	63.4	19.2	54.4	15.5	45.3	12.4	36.3	9.80	27.2	7.69

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 20.0°C dry-bulb

## 5 Outdoor unit



### MMY-AP5016HT8P-E (50HP, 140.4kW system)

Cooling		Compressor + Outdoor Fan Power consumption (kW)															
Outdoor Unit (°C)	Outdoor Unit 100% Capacity (kW)	100%		90%		80%		70%		60%		50%		40%		30%	
		TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)
40 °C	130.7	130.7	46.7	117.6	37.4	104.5	29.7	91.5	23.2	78.4	18.0	65.3	13.6	52.3	9.89	39.2	6.70
39 °C	132.8	132.8	46.0	119.5	36.8	106.2	29.2	92.9	22.9	79.7	17.7	66.4	13.4	53.1	9.75	39.8	6.60
37 °C	136.7	136.7	44.6	123.1	35.7	109.4	28.3	95.7	22.2	82.0	17.2	68.4	13.0	54.7	9.45	41.0	6.40
35 °C	140.4	140.4	43.2	126.3	34.6	112.3	27.4	98.3	21.5	84.2	16.6	70.2	12.6	56.2	9.15	42.1	6.19
33 °C	140.4	140.4	39.7	126.4	31.9	112.3	25.4	98.3	20.0	84.2	15.5	70.2	11.7	56.2	8.57	42.1	5.80
31 °C	140.4	140.4	36.6	126.4	29.5	112.3	23.6	98.3	18.6	84.2	14.4	70.2	11.0	56.2	8.03	42.1	5.44
30 °C	140.4	140.4	35.2	126.4	28.4	112.3	22.7	98.3	17.9	84.2	14.0	70.2	10.6	56.2	7.78	42.1	5.27
29 °C	140.4	140.4	33.9	126.4	27.4	112.3	21.9	98.3	17.3	84.2	13.5	70.2	10.3	56.2	7.54	42.1	5.11
27 °C	140.4	140.4	31.5	126.4	25.5	112.3	20.4	98.3	16.2	84.2	12.7	70.2	9.67	56.2	7.09	42.1	4.80
25 °C	140.4	140.4	29.3	126.4	23.8	112.3	19.1	98.3	15.2	84.2	11.9	70.2	9.08	56.2	6.67	42.1	4.52
23 °C	140.4	140.4	27.9	126.4	22.7	112.3	18.3	98.3	14.5	84.2	11.4	70.2	8.72	56.2	6.41	42.1	4.34
21 °C	140.4	140.4	27.2	126.4	22.2	112.3	17.9	98.3	14.3	84.2	11.2	70.2	8.58	56.2	6.31	42.1	4.27
20 °C	140.4	140.4	27.0	126.4	21.9	112.3	17.7	98.3	14.1	84.2	11.1	70.2	8.51	56.2	6.26	42.1	4.24
19 °C	140.4	140.4	26.7	126.4	21.7	112.3	17.6	98.3	14.0	84.2	11.0	70.2	8.45	56.2	6.22	42.1	4.21
17 °C	140.4	140.4	26.2	126.4	21.4	112.3	17.3	98.3	13.8	84.2	10.9	70.2	8.35	56.2	6.14	42.1	4.16
15 °C	140.4	140.4	25.8	126.4	21.1	112.3	17.0	98.3	13.6	84.2	10.74	70.2	8.25	56.2	6.08	42.1	4.11

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 27.0°C dry-bulb / 19.0°C wet bulb

Heating		Compressor + Outdoor Fan Power consumption (kW)																
Outdoor Unit	Outdoor Unit 100% Capacity (kW)	100% Capacity		90%		80%		70%		60%		50%		40%		30%		
		Dry-Bulb (°C)	Wet-Bulb (°C)	Heating Capacity (kW)	TC (kW)	PI (kW)												
15.0	13.7	156.0	156.0	32.9	140.4	27.6	124.8	22.9	109.2	19.0	93.6	15.6	78.0	12.7	62.4	10.1	46.8	7.88
13.0	11.8	156.0	156.0	34.4	140.4	28.7	124.8	23.8	109.2	19.6	93.6	16.1	78.0	13.0	62.4	10.4	46.8	8.03
11.0	9.8	156.0	156.0	36.1	140.4	30.0	124.8	24.8	109.2	20.4	93.6	16.6	78.0	13.4	62.4	10.6	46.8	8.20
9.0	7.9	156.0	156.0	37.9	140.4	31.4	124.8	25.8	109.2	21.1	93.6	17.1	78.0	13.8	62.4	10.9	46.8	8.37
7.0	6.0	156.0	156.0	39.9	140.4	32.9	124.8	27.0	109.2	22.0	93.6	17.7	78.0	14.2	62.4	11.2	46.8	8.55
5.0	4.1	150.6	150.6	39.6	135.6	32.7	120.5	26.8	105.4	21.8	90.4	17.6	75.3	14.1	60.2	11.1	45.2	8.49
3.0	2.2	145.2	145.2	39.3	130.7	32.5	116.2	26.6	101.7	21.7	87.1	17.5	72.6	14.0	58.1	11.0	43.6	8.43
0.0	-0.7	137.0	137.0	38.9	123.3	32.1	109.6	26.3	95.9	21.4	82.2	17.3	68.5	13.8	54.8	10.9	41.1	8.34
-3.0	-3.7	128.5	128.5	38.5	115.7	31.7	102.8	26.0	90.0	21.2	77.1	17.1	64.3	13.7	51.4	10.8	38.6	8.24
-5.0	-5.6	123.1	123.1	38.2	110.8	31.5	98.5	25.8	86.2	21.0	73.9	17.0	61.6	13.6	49.3	10.7	36.9	8.18
-7.0	-7.6	117.5	117.5	37.9	105.7	31.3	94.0	25.6	82.2	20.9	70.5	16.9	58.7	13.5	47.0	10.6	35.2	8.12
-10	-10.5	109.3	109.3	37.5	98.3	30.9	87.4	25.4	76.5	20.6	65.6	16.7	54.6	13.3	43.7	10.5	32.8	8.03
-14.5	-15.0	96.5	96.5	36.8	86.9	30.4	77.2	24.9	67.6	20.3	57.9	16.4	48.3	13.1	38.6	10.3	29.0	7.89

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 20.0°C dry-bulb

## 5 Outdoor unit



**MMY-AP5216HT8P-E (52HP, 146kW system)**

Cooling		Compressor + Outdoor Fan Power consumption (kW)															
Outdoor Unit (°C)	Outdoor Unit 100% Capacity (kW)	100%		90%		80%		70%		60%		50%		40%		30%	
		TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)
40 °C	135.9	135.9	49.6	122.3	39.7	108.7	31.4	95.1	24.6	81.5	18.9	67.9	14.2	54.3	10.3	40.8	6.95
39 °C	138.1	138.1	48.9	124.3	39.1	110.4	30.9	96.6	24.2	82.8	18.6	69.0	14.0	55.2	10.2	41.4	6.85
37 °C	142.2	142.2	47.4	128.0	37.9	113.7	30.0	99.5	23.5	85.3	18.1	71.1	13.6	56.9	9.87	42.7	6.64
35 °C	146.0	146.0	45.9	131.4	36.7	116.8	29.1	102.2	22.7	87.6	17.5	73.0	13.2	58.4	9.56	43.8	6.43
33 °C	146.0	146.0	42.2	131.4	33.8	116.8	26.9	102.2	21.1	87.6	16.3	73.0	12.3	58.4	8.95	43.8	6.02
31 °C	146.0	146.0	38.9	131.4	31.3	116.8	24.9	102.2	19.6	87.6	15.2	73.0	11.5	58.4	8.38	43.8	5.65
30 °C	146.0	146.0	37.4	131.4	30.1	116.8	24.0	102.2	18.9	87.6	14.7	73.0	11.1	58.4	8.12	43.8	5.47
29 °C	146.0	146.0	36.0	131.4	29.0	116.8	23.2	102.2	18.3	87.6	14.2	73.0	10.8	58.4	7.87	43.8	5.30
27 °C	146.0	146.0	33.4	131.4	27.0	116.8	21.6	102.2	17.1	87.6	13.3	73.0	10.1	58.4	7.40	43.8	4.98
25 °C	146.0	146.0	31.1	131.4	25.2	116.8	20.2	102.2	16.0	87.6	12.5	73.0	9.51	58.4	6.95	43.8	4.68
23 °C	146.0	146.0	29.6	131.4	24.0	116.8	19.3	102.2	15.3	87.6	12.0	73.0	9.14	58.4	6.68	43.8	4.50
21 °C	146.0	146.0	28.9	131.4	23.5	116.8	18.9	102.2	15.0	87.6	11.8	73.0	8.98	58.4	6.57	43.8	4.42
20 °C	146.0	146.0	28.6	131.4	23.2	116.8	18.7	102.2	14.9	87.6	11.7	73.0	8.91	58.4	6.53	43.8	4.39
19 °C	146.0	146.0	28.3	131.4	23.0	116.8	18.5	102.2	14.8	87.6	11.6	73.0	8.85	58.4	6.48	43.8	4.36
17 °C	146.0	146.0	27.8	131.4	22.6	116.8	18.2	102.2	14.5	87.6	11.4	73.0	8.73	58.4	6.40	43.8	4.30
15 °C	146.0	146.0	27.3	131.4	22.3	116.8	18.0	102.2	14.4	87.6	11.3	73.0	8.63	58.4	6.33	43.8	4.26

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 27.0°C dry-bulb / 19.0°C wet bulb

Heating		Compressor + Outdoor Fan Power consumption (kW)																
Outdoor Unit	Outdoor Unit 100% Capacity (kW)	100% Capacity		90%		80%		70%		60%		50%		40%		30%		
		Dry-Bulb (°C)	Wet-Bulb (°C)	TC (kW)	PI (kW)													
15.0	13.7	163.0	163.0	35.4	46.7	29.7	30.4	24.7	114.1	20.5	97.8	16.8	81.5	13.6	65.2	10.8	48.9	8.24
13.0	11.8	163.0	163.0	37.0	46.7	30.9	30.4	25.6	114.1	21.1	97.8	17.3	81.5	14.0	65.2	11.0	48.9	8.42
11.0	9.8	163.0	163.0	38.8	46.7	32.3	30.4	26.7	114.1	21.9	97.8	17.9	81.5	14.4	65.2	11.3	48.9	8.61
9.0	7.9	163.0	163.0	40.7	46.7	33.7	30.4	27.8	114.1	22.8	97.8	18.5	81.5	14.8	65.2	11.6	48.9	8.80
7.0	6.0	163.0	163.0	42.8	46.7	35.4	30.4	29.0	114.1	23.6	97.8	19.1	81.5	15.2	65.2	11.9	48.9	9.01
5.0	4.1	157.2	157.2	42.5	141.4	35.1	125.7	28.8	110.0	23.5	94.3	19.0	78.6	15.1	62.9	11.8	47.1	8.94
3.0	2.2	151.3	151.3	42.1	136.2	34.8	121.1	28.6	105.9	23.3	90.8	18.8	75.7	15.0	60.5	11.7	45.4	8.87
0.0	-0.7	142.4	142.4	41.6	128.2	34.4	113.9	28.2	99.7	23.0	85.4	18.6	71.2	14.8	57.0	11.6	42.7	8.77
-3.0	-3.7	133.2	133.2	41.1	119.9	34.0	106.6	27.9	93.2	22.7	79.9	18.4	66.6	14.6	53.3	11.5	40.0	8.66
-5.0	-5.6	127.4	127.4	40.8	114.6	33.7	101.9	27.7	89.2	22.6	76.4	18.2	63.7	14.5	50.9	11.4	38.2	8.59
-7.0	-7.6	121.2	121.2	40.5	109.1	33.4	97.0	27.4	84.9	22.4	72.7	18.1	60.6	14.4	48.5	11.3	36.4	8.52
-10	-10.5	112.3	112.3	40.0	101.1	33.0	89.8	27.1	78.6	22.1	67.4	17.8	56.2	14.2	44.9	11.1	33.7	8.41
-14.5	-15.0	98.5	98.5	39.2	88.6	32.4	78.8	26.6	68.9	21.7	59.1	17.5	49.2	14.0	39.4	10.9	29.5	8.25

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 20.0°C dry-bulb



**MMY-AP5416HT8P-E (54HP, 151.5kW system)**

Cooling		Compressor + Outdoor Fan Power consumption (kW)															
Outdoor Unit (°C)	Outdoor Unit 100% Capacity (kW)	100%		90%		80%		70%		60%		50%		40%			
		TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)		
40 °C	141.0	141.0	56.0	126.9	44.3	112.8	34.6	98.7	26.6	84.6	20.1	70.5	14.8	56.4	10.6	42.3	7.06
39 °C	143.3	143.3	55.1	128.9	43.7	114.6	34.1	100.3	26.2	86.0	19.8	71.6	14.6	57.3	10.4	43.0	6.96
37 °C	147.5	147.5	53.5	132.8	42.3	118.0	33.1	103.3	25.5	88.5	19.2	73.8	14.2	59.0	10.1	44.3	6.75
35 °C	151.5	151.5	51.8	136.3	41.0	121.2	32.0	106.0	24.6	90.9	18.6	75.7	13.7	60.6	9.77	45.4	6.53
33 °C	151.5	151.5	47.5	136.4	37.7	121.2	29.5	106.1	22.8	90.9	17.3	75.8	12.8	60.6	9.13	45.5	6.12
31 °C	151.5	151.5	43.7	136.4	34.8	121.2	27.3	106.1	21.2	90.9	16.1	75.8	11.9	60.6	8.55	45.5	5.74
30 °C	151.5	151.5	42.0	136.4	33.5	121.2	26.3	106.1	20.4	90.9	15.5	75.8	11.5	60.6	8.28	45.5	5.56
29 °C	151.5	151.5	40.4	136.4	32.2	121.2	25.4	106.1	19.7	90.9	15.0	75.8	11.2	60.6	8.02	45.5	5.39
27 °C	151.5	151.5	37.4	136.4	29.9	121.2	23.6	106.1	18.4	90.9	14.0	75.8	10.5	60.6	7.53	45.5	5.07
25 °C	151.5	151.5	34.8	136.4	27.8	121.2	22.0	106.1	17.1	90.9	13.1	75.8	9.82	60.6	7.08	45.5	4.77
23 °C	151.5	151.5	33.1	136.4	26.5	121.2	21.0	106.1	16.4	90.9	12.6	75.8	9.42	60.6	6.80	45.5	4.58
21 °C	151.5	151.5	32.2	136.4	25.9	121.2	20.5	106.1	16.0	90.9	12.3	75.8	9.25	60.6	6.68	45.5	4.51
20 °C	151.5	151.5	31.9	136.4	25.6	121.2	20.3	106.1	15.9	90.9	12.2	75.8	9.17	60.6	6.63	45.5	4.48
19 °C	151.5	151.5	31.5	136.4	25.3	121.2	20.1	106.1	15.8	90.9	12.1	75.8	9.10	60.6	6.59	45.5	4.45
17 °C	151.5	151.5	30.9	136.4	24.9	121.2	19.8	106.1	15.5	90.9	11.9	75.8	8.98	60.6	6.50	45.5	4.39
15 °C	151.5	151.5	30.4	136.4	24.5	121.2	19.5	106.1	15.3	90.9	11.8	75.8	8.87	60.6	6.43	45.5	4.35

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 27.0°C dry-bulb / 19.0°C wet bulb

Heating		Compressor + Outdoor Fan Power consumption (kW)																
Outdoor Unit	Outdoor Unit 100% Capacity (kW)	100% Capacity		90% Capacity		80% Capacity		70% Capacity		60% Capacity		50% Capacity		40% Capacity		30% Capacity		
		Dry-Bulb (°C)	Wet-Bulb (°C)	TC (kW)	PI (kW)													
15.0	13.7	164.0	164.0	35.4	147.6	29.7	131.2	24.7	114.8	20.5	98.4	16.8	82.0	13.7	65.6	10.9	49.2	8.30
13.0	11.8	164.0	164.0	37.0	147.6	30.9	131.2	25.6	114.8	21.2	98.4	17.3	82.0	14.0	65.6	11.1	49.2	8.47
11.0	9.8	164.0	164.0	38.8	147.6	32.3	131.2	26.7	114.8	22.0	98.4	17.9	82.0	14.4	65.6	11.4	49.2	8.67
9.0	7.9	164.0	164.0	40.8	147.6	33.7	131.2	27.8	114.8	22.8	98.4	18.5	82.0	14.9	65.6	11.7	49.2	8.86
7.0	6.0	164.0	164.0	42.9	147.6	35.4	131.2	29.0	114.8	23.7	98.4	19.1	82.0	15.3	65.6	12.0	49.2	9.08
5.0	4.1	158.1	158.1	42.6	142.3	35.1	126.5	28.8	110.7	23.5	94.9	19.0	79.1	15.2	63.2	11.9	47.4	9.01
3.0	2.2	152.3	152.3	42.2	137.0	34.8	121.8	28.6	106.6	23.3	91.4	18.9	76.1	15.1	60.9	11.8	45.7	8.94
0.0	-0.7	143.3	143.3	41.7	129.0	34.4	114.6	28.2	100.3	23.0	86.0	18.6	71.6	14.9	57.3	11.7	43.0	8.83
-3.0	-3.7	134.0	134.0	41.2	120.6	34.0	107.2	27.9	93.8	22.7	80.4	18.4	67.0	14.7	53.6	11.5	40.2	8.72
-5.0	-5.6	128.1	128.1	40.9	115.3	33.7	102.5	27.7	89.7	22.6	76.9	18.3	64.1	14.6	51.3	11.5	38.4	8.65
-7.0	-7.6	122.0	122.0	40.6	109.8	33.5	97.6	27.4	85.4	22.4	73.2	18.1	61.0	14.5	48.8	11.4	36.6	8.58
-10	-10.5	113.0	113.0	40.1	101.7	33.0	90.4	27.1	79.1	22.1	67.8	17.9	56.5	14.3	45.2	11.2	33.9	8.48
-14.5	-15.0	99.1	99.1	39.3	89.2	32.4	79.3	26.6	69.4	21.7	59.5	17.5	49.5	14.0	39.6	11.0	29.7	8.31

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 20.0°C dry-bulb

## 5 Outdoor unit



MMY-AP5616HT8P-E (56HP, 157.0kW system)

Cooling		Compressor + Outdoor Fan Power consumption (kW)															
Outdoor Unit (°C)	Outdoor Unit 100% Capacity (kW)	100%		90%		80%		70%		60%		50%		40%		30%	
		TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)
40 °C	146.1	146.1	52.8	131.5	42.4	116.9	33.7	102.3	26.5	87.7	20.5	73.1	15.6	58.4	11.4	43.8	7.68
39 °C	148.5	148.5	52.0	133.6	41.8	118.8	33.2	103.9	26.1	89.1	20.2	74.2	15.3	59.4	11.2	44.5	7.56
37 °C	152.9	152.9	50.5	137.6	40.5	122.3	32.2	107.0	25.3	91.7	19.6	76.4	14.9	61.2	10.9	45.9	7.34
35 °C	157.0	157.0	48.9	141.3	39.2	125.6	31.2	109.9	24.5	94.2	19.0	78.5	14.4	62.8	10.51	47.1	7.10
33 °C	157.0	157.0	44.9	141.3	36.2	125.6	28.9	109.9	22.8	94.2	17.7	78.5	13.5	62.8	9.84	47.1	6.65
31 °C	157.0	157.0	41.5	141.3	33.5	125.6	26.8	109.9	21.2	94.2	16.5	78.5	12.60	62.8	9.22	47.1	6.24
30 °C	157.0	157.0	39.9	141.3	32.3	125.6	25.9	109.9	20.5	94.2	16.0	78.5	12.20	62.8	8.94	47.1	6.04
29 °C	157.0	157.0	38.4	141.3	31.1	125.6	25.0	109.9	19.8	94.2	15.5	78.5	11.81	62.8	8.66	47.1	5.86
27 °C	157.0	157.0	35.7	141.3	29.0	125.6	23.3	109.9	18.5	94.2	14.5	78.5	11.09	62.8	8.14	47.1	5.50
25 °C	157.0	157.0	33.2	141.3	27.0	125.6	21.8	109.9	17.3	94.2	13.6	78.5	10.42	62.8	7.66	47.1	5.17
23 °C	157.0	157.0	31.7	141.3	25.8	125.6	20.8	109.9	16.6	94.2	13.1	78.5	10.01	62.8	7.36	47.1	4.97
21 °C	157.0	157.0	30.9	141.3	25.2	125.6	20.4	109.9	16.3	94.2	12.8	78.5	9.85	62.8	7.24	47.1	4.89
20 °C	157.0	157.0	30.6	141.3	25.0	125.6	20.2	109.9	16.1	94.2	12.7	78.5	9.77	62.8	7.19	47.1	4.85
19 °C	157.0	157.0	30.3	141.3	24.7	125.6	20.0	109.9	16.0	94.2	12.6	78.5	9.70	62.8	7.14	47.1	4.82
17 °C	157.0	157.0	29.7	141.3	24.3	125.6	19.7	109.9	15.8	94.2	12.5	78.5	9.58	62.8	7.05	47.1	4.76
15 °C	157.0	157.0	29.3	141.3	24.0	125.6	19.4	109.9	15.6	94.2	12.3	78.5	9.47	62.8	6.98	47.1	4.70

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 27.0°C dry-bulb / 19.0°C wet bulb

Heating		Compressor + Outdoor Fan Power consumption (kW)																
Outdoor Unit	Outdoor Unit 100% Capacity (kW)	100% Capacity		90% Capacity		80% Capacity		70% Capacity		60% Capacity		50% Capacity		40% Capacity		30% Capacity		
		Dry-Bulb (°C)	Wet-Bulb (°C)	TC (kW)	PI (kW)													
15.0	13.7	176.0	176.0	39.0	158.4	32.8	140.8	27.5	123.2	22.8	105.6	18.7	88.0	15.1	70.4	11.8	52.8	8.65
13.0	11.8	176.0	176.0	40.6	158.4	34.1	140.8	28.5	123.2	23.6	105.6	19.3	88.0	15.5	70.4	12.1	52.8	8.87
11.0	9.8	176.0	176.0	42.6	158.4	35.6	140.8	29.6	123.2	24.4	105.6	19.9	88.0	16.0	70.4	12.4	52.8	9.11
9.0	7.9	176.0	176.0	44.6	158.4	37.2	140.8	30.8	123.2	25.3	105.6	20.6	88.0	16.5	70.4	12.8	52.8	9.36
7.0	6.0	176.0	176.0	46.9	158.4	38.9	140.8	32.1	123.2	26.3	105.6	21.3	88.0	17.0	70.4	13.1	52.8	9.62
5.0	4.1	169.7	169.7	46.5	152.7	38.6	135.8	31.9	118.8	26.1	101.8	21.1	84.8	16.9	67.9	13.0	50.9	9.55
3.0	2.2	163.4	163.4	46.2	147.1	38.3	130.7	31.6	114.4	25.9	98.0	21.0	81.7	16.7	65.4	12.9	49.0	9.47
0.0	-0.7	153.8	153.8	45.6	138.4	37.9	123.0	31.3	107.6	25.6	92.3	20.7	76.9	16.5	61.5	12.8	46.1	9.36
-3.0	-3.7	143.8	143.8	45.1	129.4	37.4	115.1	30.9	100.7	25.3	86.3	20.5	71.9	16.3	57.5	12.6	43.1	9.25
-5.0	-5.6	137.5	137.5	44.7	123.8	37.1	110.0	30.6	96.3	25.1	82.5	20.3	68.8	16.2	55.0	12.5	41.3	9.17
-7.0	-7.6	130.9	130.9	44.3	117.8	36.8	104.7	30.4	91.6	24.9	78.5	20.2	65.4	16.1	52.4	12.4	39.3	9.10
-10	-10.5	121.3	121.3	43.8	109.1	36.4	97.0	30.0	84.9	24.6	72.8	19.9	60.6	15.9	48.5	12.3	36.4	8.99
-14.5	-15.0	106.3	106.3	43.0	95.7	35.7	85.1	29.4	74.4	24.1	63.8	19.5	53.2	15.6	42.5	12.0	31.9	8.81

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 20.0°C dry-bulb

## 5 Outdoor unit



### MMY-AP5816HT8P-E (58HP, 162.5kW system)

Cooling		Compressor + Outdoor Fan Power consumption (kW)															
Outdoor Unit (°C)	Outdoor Unit 100% Capacity (kW)	100%		90%		80%		70%		60%		50%		40%		30%	
		TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)
40 °C	151.2	151.2	59.2	136.1	47.1	121.0	36.9	105.9	28.6	90.7	21.7	75.6	16.2	60.5	11.6	45.4	7.79
39 °C	153.7	153.7	58.3	138.3	46.4	122.9	36.4	107.6	28.2	92.2	21.4	76.8	15.9	61.5	11.4	46.1	7.67
37 °C	158.2	158.2	56.6	142.4	45.0	126.6	35.3	110.8	27.3	94.9	20.8	79.1	15.4	63.3	11.1	47.5	7.44
35 °C	162.5	162.5	54.8	146.2	43.5	130.0	34.2	113.7	26.4	97.5	20.1	81.2	14.9	65.0	10.7	48.7	7.20
33 °C	162.5	162.5	50.3	146.3	40.1	130.0	31.5	113.8	24.5	97.5	18.7	81.3	13.9	65.0	10.0	48.8	6.75
31 °C	162.5	162.5	46.3	146.3	37.0	130.0	29.2	113.8	22.7	97.5	17.4	81.3	13.0	65.0	9.39	48.8	6.33
30 °C	162.5	162.5	44.5	146.3	35.6	130.0	28.1	113.8	21.9	97.5	16.8	81.3	12.6	65.0	9.10	48.8	6.13
29 °C	162.5	162.5	42.8	146.3	34.3	130.0	27.1	113.8	21.2	97.5	16.3	81.3	12.2	65.0	8.81	48.8	5.95
27 °C	162.5	162.5	39.7	146.3	31.9	130.0	25.3	113.8	19.8	97.5	15.2	81.3	11.4	65.0	8.28	48.8	5.59
25 °C	162.5	162.5	36.9	146.3	29.7	130.0	23.6	113.8	18.5	97.5	14.2	81.3	10.7	65.0	7.78	48.8	5.26
23 °C	162.5	162.5	35.1	146.3	28.3	130.0	22.5	113.8	17.7	97.5	13.6	81.3	10.3	65.0	7.48	48.8	5.06
21 °C	162.5	162.5	34.2	146.3	27.6	130.0	22.0	113.8	17.3	97.5	13.4	81.3	10.1	65.0	7.35	48.8	4.98
20 °C	162.5	162.5	33.9	146.3	27.3	130.0	21.8	113.8	17.1	97.5	13.3	81.3	10.0	65.0	7.30	48.8	4.94
19 °C	162.5	162.5	33.5	146.3	27.0	130.0	21.6	113.8	17.0	97.5	13.2	81.3	9.96	65.0	7.25	48.8	4.91
17 °C	162.5	162.5	32.9	146.3	26.6	130.0	21.2	113.8	16.7	97.5	13.0	81.3	9.83	65.0	7.16	48.8	4.85
15 °C	162.5	162.5	32.3	146.3	26.1	130.0	20.9	113.8	16.5	97.5	12.8	81.3	9.71	65.0	7.08	48.8	4.80

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 27.0°C dry-bulb / 19.0°C wet bulb

Heating		Compressor + Outdoor Fan Power consumption (kW)																
Outdoor Unit	Outdoor Unit 100% Capacity (kW)	100% Capacity		90%		80%		70%		60%		50%		40%		30%		
		Dry-Bulb (°C)	Wet-Bulb (°C)	TC (kW)	PI (kW)													
15.0	13.7	177.0	177.0	39.0	159.3	32.8	141.6	27.5	123.9	22.8	106.2	18.8	88.5	15.2	70.8	11.8	53.1	8.70
13.0	11.8	177.0	177.0	40.7	159.3	34.1	141.6	28.5	123.9	23.6	106.2	19.3	88.5	15.6	70.8	12.2	53.1	8.92
11.0	9.8	177.0	177.0	42.6	159.3	35.6	141.6	29.6	123.9	24.4	106.2	20.0	88.5	16.1	70.8	12.5	53.1	9.17
9.0	7.9	177.0	177.0	44.7	159.3	37.2	141.6	30.8	123.9	25.3	106.2	20.6	88.5	16.5	70.8	12.9	53.1	9.42
7.0	6.0	177.0	177.0	47.0	159.3	38.9	141.6	32.1	123.9	26.3	106.2	21.4	88.5	17.1	70.8	13.2	53.1	9.69
5.0	4.1	170.7	170.7	46.6	153.6	38.6	136.5	31.9	119.5	26.1	102.4	21.2	85.3	16.9	68.3	13.1	51.2	9.61
3.0	2.2	164.3	164.3	46.3	147.9	38.4	131.5	31.6	115.0	25.9	98.6	21.0	82.2	16.8	65.7	13.0	49.3	9.54
0.0	-0.7	154.6	154.6	45.7	139.2	37.9	123.7	31.2	108.3	25.6	92.8	20.8	77.3	16.6	61.9	12.9	46.4	9.43
-3.0	-3.7	144.6	144.6	45.2	130.2	37.4	115.7	30.9	101.2	25.3	86.8	20.5	72.3	16.4	57.9	12.7	43.4	9.31
-5.0	-5.6	138.3	138.3	44.8	124.5	37.1	110.6	30.6	96.8	25.1	83.0	20.4	69.2	16.3	55.3	12.6	41.5	9.24
-7.0	-7.6	131.6	131.6	44.4	118.5	36.8	105.3	30.4	92.1	24.9	79.0	20.2	65.8	16.1	52.7	12.5	39.5	9.16
-10	-10.5	122.0	122.0	43.9	109.8	36.4	97.6	30.0	85.4	24.6	73.2	19.9	61.0	15.9	48.8	12.4	36.6	9.05
-14.5	-15.0	106.9	106.9	43.0	96.3	35.7	85.6	29.4	74.9	24.1	64.2	19.6	53.5	15.6	42.8	12.1	32.1	8.87

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 20.0°C dry-bulb

## 5 Outdoor unit

MMY-AP6016HT8P-E (60HP, 168kW system)

Cooling		Compressor + Outdoor Fan Power consumption (kW)																	
Outdoor Unit (°C)	Outdoor Unit 100% Capacity (kW)	100%		90%		80%		70%		60%		50%		40%		30%			
		TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)		
40 °C	156.3	156.3	65.6	140.7	51.7	125.1	40.2	109.4	30.7	93.8	22.9	78.2	16.8	62.5	11.8	46.9	7.89		
39 °C	158.9	158.9	64.6	143.0	50.9	127.1	39.6	111.2	30.2	95.3	22.6	79.4	16.5	63.5	11.6	47.7	7.78		
37 °C	163.6	163.6	62.7	147.2	49.4	130.9	38.4	114.5	29.3	98.2	21.9	81.8	16.0	65.4	11.3	49.1	7.54		
35 °C	168.0	168.0	60.7	151.2	47.8	134.4	37.2	117.6	28.4	100.8	21.2	84.0	15.5	67.2	10.9	50.4	7.30		
33 °C	168.0	168.0	55.6	151.2	43.9	134.4	34.2	117.6	26.2	100.8	19.7	84.0	14.4	67.2	10.2	50.4	6.84		
31 °C	168.0	168.0	51.1	151.2	40.5	134.4	31.6	117.6	24.3	100.8	18.3	84.0	13.4	67.2	9.56	50.4	6.42		
30 °C	168.0	168.0	49.1	151.2	38.9	134.4	30.4	117.6	23.4	100.8	17.7	84.0	13.0	67.2	9.25	50.4	6.23		
29 °C	168.0	168.0	47.2	151.2	37.5	134.4	29.3	117.6	22.6	100.8	17.0	84.0	12.6	67.2	8.96	50.4	6.04		
27 °C	168.0	168.0	43.7	151.2	34.8	134.4	27.3	117.6	21.0	100.8	15.9	84.0	11.8	67.2	8.41	50.4	5.68		
25 °C	168.0	168.0	40.6	151.2	32.3	134.4	25.4	117.6	19.6	100.8	14.9	84.0	11.0	67.2	7.90	50.4	5.35		
23 °C	168.0	168.0	38.6	151.2	30.8	134.4	24.2	117.6	18.7	100.8	14.2	84.0	10.6	67.2	7.59	50.4	5.14		
21 °C	168.0	168.0	37.6	151.2	30.0	134.4	23.6	117.6	18.3	100.8	14.0	84.0	10.4	67.2	7.46	50.4	5.06		
20 °C	168.0	168.0	37.1	151.2	29.7	134.4	23.4	117.6	18.2	100.8	13.8	84.0	10.3	67.2	7.41	50.4	5.03		
19 °C	168.0	168.0	36.7	151.2	29.4	134.4	23.2	117.6	18.0	100.8	13.7	84.0	10.2	67.2	7.36	50.4	5.00		
17 °C	168.0	168.0	36.0	151.2	28.8	134.4	22.7	117.6	17.7	100.8	13.5	84.0	10.1	67.2	7.26	50.4	4.94		
15 °C	168.0	168.0	35.4	151.2	28.3	134.4	22.4	117.6	17.4	100.8	13.3	84.0	9.95	67.2	7.18	50.4	4.89		

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 27.0°C dry-bulb / 19.0°C wet bulb

Heating		Compressor + Outdoor Fan Power consumption (kW)																	
Outdoor Unit	Outdoor Unit 100% Capacity (kW)	100% Capacity		90% Capacity		80% Capacity		70% Capacity		60% Capacity		50% Capacity		40% Capacity		30% Capacity			
		Dry-Bulb (°C)	Wet-Bulb (°C)	TC (kW)	PI (kW)	TC (kW)	PI (kW)												
15.0	13.7	178.0	178.0	39.0	160.2	32.8	142.4	27.5	124.6	22.9	106.8	18.8	89.0	15.2	71.2	11.9	53.4	8.75	
13.0	11.8	178.0	178.0	40.7	160.2	34.1	142.4	28.5	124.6	23.6	106.8	19.4	89.0	15.7	71.2	12.2	53.4	8.98	
11.0	9.8	178.0	178.0	42.7	160.2	35.6	142.4	29.6	124.6	24.5	106.8	20.0	89.0	16.1	71.2	12.6	53.4	9.23	
9.0	7.9	178.0	178.0	44.8	160.2	37.2	142.4	30.8	124.6	25.4	106.8	20.7	89.0	16.6	71.2	12.9	53.4	9.49	
7.0	6.0	178.0	178.0	47.1	160.2	39.0	142.4	32.1	124.6	26.3	106.8	21.4	89.0	17.1	71.2	13.3	53.4	9.76	
5.0	4.1	171.6	171.6	46.7	154.5	38.7	137.3	31.9	120.1	26.1	103.0	21.2	85.8	17.0	68.6	13.2	51.5	9.68	
3.0	2.2	165.2	165.2	46.4	148.7	38.4	132.2	31.6	115.7	25.9	99.1	21.1	82.6	16.9	66.1	13.1	49.6	9.61	
0.0	-0.7	155.5	155.5	45.8	140.0	37.9	124.4	31.2	108.9	25.6	93.3	20.8	77.8	16.7	62.2	13.0	46.7	9.49	
-3.0	-3.7	145.5	145.5	45.3	130.9	37.5	116.4	30.9	101.8	25.3	87.3	20.6	72.7	16.5	58.2	12.8	43.6	9.38	
-5.0	-5.6	139.1	139.1	44.9	125.2	37.2	111.3	30.6	97.4	25.1	83.4	20.4	69.5	16.3	55.6	12.7	41.7	9.30	
-7.0	-7.6	132.4	132.4	44.5	119.1	36.8	105.9	30.4	92.7	24.9	79.4	20.2	66.2	16.2	52.9	12.6	39.7	9.22	
-10	-10.5	122.6	122.6	44.0	110.4	36.4	98.1	30.0	85.9	24.6	73.6	20.0	61.3	16.0	49.1	12.4	36.8	9.11	
-14.5	-15.0	107.5	107.5	43.1	96.8	35.7	86.0	29.4	75.3	24.1	64.5	19.6	53.8	15.7	43.0	12.2	32.3	8.94	

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 20.0°C dry-bulb

**5 Outdoor unit**



**MMY-AP2026HT8P-E (20HP, 56kW system)**

Cooling		Compressor + Outdoor Fan Power consumption (kW)															
Outdoor Unit (°C)	Outdoor Unit 100% Capacity (kW)	100%		90%		80%		70%		60%		50%		40%		30%	
		TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)
40 °C	52.1	52.1	16.6	46.9	13.5	41.7	10.8	36.5	8.47	31.3	6.48	26.1	4.87	20.8	3.63	15.6	2.77
39 °C	53.0	53.0	16.4	47.7	13.3	42.4	10.7	37.1	8.34	31.8	6.39	26.5	4.80	21.2	3.58	15.9	2.73
37 °C	54.5	54.5	15.9	49.1	12.9	43.6	10.3	38.2	8.09	32.7	6.19	27.3	4.65	21.8	3.47	16.4	2.65
35 °C	56.0	56.0	15.4	50.4	12.5	44.8	10.0	39.2	7.84	33.6	6.00	28.0	4.50	22.4	3.36	16.8	2.57
33 °C	56.0	56.0	14.2	50.4	11.6	44.8	9.27	39.2	7.26	33.6	5.58	28.0	4.21	22.4	3.16	16.8	2.44
31 °C	56.0	56.0	13.1	50.4	10.7	44.8	8.60	39.2	6.75	33.6	5.20	28.0	3.94	22.4	2.98	16.8	2.32
30 °C	56.0	56.0	12.7	50.4	10.3	44.8	8.29	39.2	6.52	33.6	5.03	28.0	3.82	22.4	2.90	16.8	2.27
29 °C	56.0	56.0	12.2	50.4	10.0	44.8	8.00	39.2	6.30	33.6	4.86	28.0	3.70	22.4	2.82	16.8	2.21
27 °C	56.0	56.0	11.4	50.4	9.29	44.8	7.46	39.2	5.88	33.6	4.55	28.0	3.48	22.4	2.66	16.8	2.11
25 °C	56.0	56.0	10.6	50.4	8.67	44.8	6.97	39.2	5.50	33.6	4.27	28.0	3.27	22.4	2.52	16.8	2.00
23 °C	56.0	56.0	10.1	50.4	8.27	44.8	6.66	39.2	5.26	33.6	4.09	28.0	3.15	22.4	2.43	16.8	1.95
21 °C	56.0	56.0	9.88	50.4	8.09	44.8	6.52	39.2	5.16	33.6	4.02	28.0	3.10	22.4	2.40	16.8	1.93
20 °C	56.0	56.0	9.78	50.4	8.01	44.8	6.45	39.2	5.11	33.6	3.98	28.0	3.08	22.4	2.39	16.8	1.93
19 °C	56.0	56.0	9.69	50.4	7.94	44.8	6.39	39.2	5.07	33.6	3.95	28.0	3.06	22.4	2.38	16.8	1.92
17 °C	56.0	56.0	9.52	50.4	7.80	44.8	6.29	39.2	4.99	33.6	3.90	28.0	3.02	22.4	2.36	16.8	1.91
15 °C	56.0	56.0	9.38	50.4	7.69	44.8	6.20	39.2	4.92	33.6	3.85	28.0	2.99	22.4	2.34	16.8	1.90

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 27.0°C dry-bulb / 19.0°C wet bulb

Heating		Compressor + Outdoor Fan Power consumption (kW)																
Outdoor Unit	Outdoor Unit 100% Capacity (kW)	100% Capacity		90%		80%		70%		60%		50%		40%		30%		
		Dry-Bulb (°C)	Wet-Bulb (°C)	TC (kW)	PI (kW)													
15.0	13.7	63.0	63.0	12.0	56.7	9.91	50.4	8.25	44.1	6.89	37.8	5.75	31.5	4.75	25.2	3.81	18.9	2.84
13.0	11.8	63.0	63.0	12.5	56.7	10.3	50.4	8.55	44.1	7.10	37.8	5.90	31.5	4.87	25.2	3.90	18.9	2.91
11.0	9.8	63.0	63.0	13.2	56.7	10.8	50.4	8.90	44.1	7.35	37.8	6.08	31.5	4.99	25.2	4.00	18.9	2.99
9.0	7.9	63.0	63.0	14.0	56.7	11.4	50.4	9.28	44.1	7.61	37.8	6.26	31.5	5.12	25.2	4.09	18.9	3.07
7.0	6.0	63.0	63.0	14.8	56.7	12.0	50.4	9.70	44.1	7.90	37.8	6.46	31.5	5.27	25.2	4.20	18.9	3.15
5.0	4.1	61.0	61.0	14.7	54.9	11.9	48.8	9.64	42.7	7.85	36.6	6.42	30.5	5.24	24.4	4.18	18.3	3.13
3.0	2.2	58.9	58.9	14.6	53.1	11.8	47.2	9.58	41.3	7.81	35.4	6.39	29.5	5.21	23.6	4.15	17.7	3.11
0.0	-0.7	55.9	55.9	14.5	50.3	11.7	44.7	9.50	39.1	7.74	33.5	6.33	27.9	5.16	22.3	4.12	16.8	3.09
-3.0	-3.7	52.7	52.7	14.4	47.4	11.6	42.1	9.41	36.9	7.67	31.6	6.27	26.3	5.11	21.1	4.08	15.8	3.06
-5.0	-5.6	50.6	50.6	14.3	45.6	11.5	40.5	9.36	35.4	7.62	30.4	6.24	25.3	5.08	20.3	4.05	15.2	3.04
-7.0	-7.6	48.5	48.5	14.2	43.6	11.5	38.8	9.30	33.9	7.58	29.1	6.20	24.2	5.05	19.4	4.03	14.5	3.02
-10	-10.5	45.4	45.4	14.1	40.9	11.4	36.3	9.21	31.8	7.51	27.2	6.14	22.7	5.00	18.2	3.99	13.6	2.99
-14.5	-15.0	40.6	40.6	13.9	36.5	11.2	32.5	9.08	28.4	7.40	24.4	6.05	20.3	4.93	16.2	3.94	12.2	2.95

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 20.0°C dry-bulb

## 5 Outdoor unit



### MMY-AP2226HT8P-E (22HP, 61.5kW system)

Cooling		Compressor + Outdoor Fan Power consumption (kW)															
Outdoor Unit (°C)	Outdoor Unit 100% Capacity (kW)	100%		90%		80%		70%		60%		50%		40%		30%	
		TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)
40 °C	57.2	57.2	19.1	51.5	15.4	45.8	12.3	40.1	9.58	34.3	7.35	28.6	5.52	22.9	4.06	17.2	2.92
39 °C	58.2	58.2	18.8	52.3	15.2	46.5	12.1	40.7	9.44	34.9	7.24	29.1	5.44	23.3	4.00	17.4	2.88
37 °C	59.9	59.9	18.3	53.9	14.7	47.9	11.7	41.9	9.16	35.9	7.02	29.9	5.28	24.0	3.88	18.0	2.79
35 °C	61.5	61.5	17.7	55.3	14.3	49.2	11.3	43.0	8.87	36.9	6.80	30.7	5.11	24.6	3.76	18.4	2.71
33 °C	61.5	61.5	16.3	55.4	13.2	49.2	10.5	43.1	8.22	36.9	6.33	30.8	4.77	24.6	3.53	18.5	2.55
31 °C	61.5	61.5	15.1	55.4	12.2	49.2	9.73	43.1	7.64	36.9	5.90	30.8	4.47	24.6	3.31	18.5	2.42
30 °C	61.5	61.5	14.5	55.4	11.7	49.2	9.38	43.1	7.38	36.9	5.70	30.8	4.32	24.6	3.22	18.5	2.35
29 °C	61.5	61.5	14.0	55.4	11.3	49.2	9.05	43.1	7.13	36.9	5.52	30.8	4.19	24.6	3.12	18.5	2.29
27 °C	61.5	61.5	13.0	55.4	10.5	49.2	8.44	43.1	6.66	36.9	5.16	30.8	3.93	24.6	2.94	18.5	2.16
25 °C	61.5	61.5	12.1	55.4	9.83	49.2	7.88	43.1	6.23	36.9	4.84	30.8	3.70	24.6	2.77	18.5	2.05
23 °C	61.5	61.5	11.5	55.4	9.38	49.2	7.53	43.1	5.96	36.9	4.64	30.8	3.55	24.6	2.67	18.5	1.98
21 °C	61.5	61.5	11.2	55.4	9.17	49.2	7.37	43.1	5.84	36.9	4.56	30.8	3.50	24.6	2.64	18.5	1.96
20 °C	61.5	61.5	11.1	55.4	9.07	49.2	7.30	43.1	5.79	36.9	4.52	30.8	3.47	24.6	2.62	18.5	1.95
19 °C	61.5	61.5	11.0	55.4	8.99	49.2	7.23	43.1	5.74	36.9	4.48	30.8	3.45	24.6	2.60	18.5	1.94
17 °C	61.5	61.5	10.8	55.4	8.83	49.2	7.12	43.1	5.65	36.9	4.42	30.8	3.40	24.6	2.58	18.5	1.92
15 °C	61.5	61.5	10.7	55.4	8.70	49.2	7.02	43.1	5.58	36.9	4.37	30.8	3.37	24.6	2.55	18.5	1.91

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 27.0°C dry-bulb / 19.0°C wet bulb

Heating		Compressor + Outdoor Fan Power consumption (kW)																
Outdoor Unit	Outdoor Unit 100% Capacity (kW)	100% Capacity		90% Capacity		80% Capacity		70% Capacity		60% Capacity		50% Capacity		40% Capacity		30% Capacity		
		Dry-Bulb (°C)	Wet-Bulb (°C)	TC (kW)	PI (kW)													
15.0	13.7	69.0	69.0	13.9	62.1	11.6	55.2	9.66	48.3	8.05	41.4	6.68	34.5	5.46	27.6	4.30	20.7	3.12
13.0	11.8	69.0	69.0	14.6	62.1	12.1	55.2	10.0	48.3	8.31	41.4	6.87	34.5	5.60	27.6	4.41	20.7	3.21
11.0	9.8	69.0	69.0	15.3	62.1	12.6	55.2	10.4	48.3	8.60	41.4	7.08	34.5	5.76	27.6	4.53	20.7	3.31
9.0	7.9	69.0	69.0	16.1	62.1	13.2	55.2	10.8	48.3	8.91	41.4	7.30	34.5	5.92	27.6	4.65	20.7	3.40
7.0	6.0	69.0	69.0	17.1	62.1	13.9	55.2	11.3	48.3	9.25	41.4	7.54	34.5	6.09	27.6	4.78	20.7	3.50
5.0	4.1	66.6	66.6	16.9	60.0	13.8	53.3	11.2	46.6	9.19	40.0	7.49	33.3	6.05	26.7	4.75	20.0	3.48
3.0	2.2	64.3	64.3	16.8	57.9	13.7	51.4	11.2	45.0	9.12	38.6	7.44	32.1	6.01	25.7	4.72	19.3	3.46
0.0	-0.7	60.7	60.7	16.6	54.6	13.6	48.6	11.1	42.5	9.03	36.4	7.36	30.3	5.95	24.3	4.67	18.2	3.42
-3.0	-3.7	57.0	57.0	16.5	51.3	13.4	45.6	10.9	39.9	8.93	34.2	7.28	28.5	5.88	22.8	4.62	17.1	3.38
-5.0	-5.6	54.6	54.6	16.4	49.2	13.3	43.7	10.9	38.2	8.87	32.8	7.23	27.3	5.84	21.8	4.59	16.4	3.36
-7.0	-7.6	52.1	52.1	16.2	46.9	13.2	41.7	10.8	36.5	8.80	31.3	7.18	26.1	5.80	20.9	4.55	15.6	3.33
-10	-10.5	48.5	48.5	16.1	43.7	13.1	38.8	10.7	34.0	8.70	29.1	7.10	24.3	5.73	19.4	4.50	14.6	3.30
-14.5	-15.0	43.0	43.0	15.8	38.7	12.8	34.4	10.5	30.1	8.55	25.8	6.98	21.5	5.64	17.2	4.43	12.9	3.24

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 20.0°C dry-bulb

## 5 Outdoor unit



**MMY-AP3626HT8P-E (36HP, 100.5kW system)**

Cooling		Compressor + Outdoor Fan Power consumption (kW)															
Outdoor Unit (°C)	Outdoor Unit 100% Capacity (kW)	100%		90%		80%		70%		60%		50%		40%		30%	
		TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)
40 °C	93.5	93.5	32.4	84.2	26.0	74.8	20.5	65.5	16.0	56.1	12.3	46.8	9.26	37.4	6.73	28.1	4.61
39 °C	95.0	95.0	31.9	85.5	25.6	76.0	20.2	66.5	15.8	57.0	12.1	47.5	9.12	38.0	6.63	28.5	4.54
37 °C	97.9	97.9	31.0	88.1	24.8	78.3	19.6	68.5	15.3	58.7	11.8	48.9	8.85	39.1	6.43	29.4	4.41
35 °C	100.5	100.5	30.0	90.4	24.0	80.4	19.0	70.3	14.8	60.3	11.4	50.2	8.57	40.2	6.23	30.1	4.27
33 °C	100.5	100.5	27.6	90.5	22.1	80.4	17.6	70.4	13.8	60.3	10.6	50.3	8.00	40.2	5.83	30.2	4.00
31 °C	100.5	100.5	25.4	90.5	20.5	80.4	16.3	70.4	12.8	60.3	9.90	50.3	7.48	40.2	5.47	30.2	3.76
30 °C	100.5	100.5	24.5	90.5	19.7	80.4	15.7	70.4	12.4	60.3	9.57	50.3	7.24	40.2	5.30	30.2	3.65
29 °C	100.5	100.5	23.6	90.5	19.0	80.4	15.2	70.4	11.9	60.3	9.25	50.3	7.01	40.2	5.14	30.2	3.54
27 °C	100.5	100.5	21.9	90.5	17.7	80.4	14.1	70.4	11.2	60.3	8.66	50.3	6.58	40.2	4.83	30.2	3.33
25 °C	100.5	100.5	20.3	90.5	16.5	80.4	13.2	70.4	10.4	60.3	8.12	50.3	6.18	40.2	4.55	30.2	3.14
23 °C	100.5	100.5	19.4	90.5	15.7	80.4	12.6	70.4	10.0	60.3	7.79	50.3	5.94	40.2	4.37	30.2	3.02
21 °C	100.5	100.5	18.9	90.5	15.4	80.4	12.3	70.4	9.79	60.3	7.65	50.3	5.84	40.2	4.30	30.2	2.98
20 °C	100.5	100.5	18.7	90.5	15.2	80.4	12.2	70.4	9.70	60.3	7.58	50.3	5.79	40.2	4.27	30.2	2.96
19 °C	100.5	100.5	18.5	90.5	15.1	80.4	12.1	70.4	9.62	60.3	7.52	50.3	5.75	40.2	4.25	30.2	2.94
17 °C	100.5	100.5	18.2	90.5	14.8	80.4	11.9	70.4	9.48	60.3	7.42	50.3	5.68	40.2	4.19	30.2	2.90
15 °C	100.5	100.5	17.9	90.5	14.6	80.4	11.7	70.4	9.35	60.3	7.33	50.3	5.62	40.2	4.15	30.2	2.88

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 27.0°C dry-bulb / 19.0°C wet bulb

Heating		Compressor + Outdoor Fan Power consumption (kW)																
Outdoor Unit	Outdoor Unit 100% Capacity (kW)	100% Capacity		90% Capacity		80% Capacity		70% Capacity		60% Capacity		50% Capacity		40% Capacity		30% Capacity		
		Dry-Bulb (°C)	Wet-Bulb (°C)	TC (kW)	PI (kW)													
15.0	13.7	112.5	112.5	23.7	101.3	19.9	90.0	16.6	78.8	13.8	67.5	11.4	56.3	9.24	45.0	7.18	33.8	5.11
13.0	11.8	112.5	112.5	24.8	101.3	20.7	90.0	17.2	78.8	14.3	67.5	11.7	56.3	9.50	45.0	7.38	33.8	5.26
11.0	9.8	112.5	112.5	26.1	101.3	21.6	90.0	17.9	78.8	14.8	67.5	12.1	56.3	9.78	45.0	7.60	33.8	5.43
9.0	7.9	112.5	112.5	27.4	101.3	22.6	90.0	18.6	78.8	15.3	67.5	12.5	56.3	10.1	45.0	7.82	33.8	5.60
7.0	6.0	112.5	112.5	28.9	101.3	23.7	90.0	19.4	78.8	15.9	67.5	12.9	56.3	10.4	45.0	8.05	33.8	5.78
5.0	4.1	108.5	108.5	28.7	97.6	23.6	86.8	19.3	75.9	15.8	65.1	12.8	54.2	10.3	43.4	7.99	32.5	5.74
3.0	2.2	104.4	104.4	28.5	94.0	23.4	83.6	19.1	73.1	15.7	62.7	12.7	52.2	10.2	41.8	7.93	31.3	5.70
0.0	-0.7	98.3	98.3	28.2	88.5	23.1	78.6	18.9	68.8	15.5	59.0	12.6	49.1	10.1	39.3	7.84	29.5	5.63
-3.0	-3.7	91.9	91.9	27.8	82.7	22.8	73.5	18.7	64.4	15.3	55.2	12.4	46.0	10.0	36.8	7.74	27.6	5.56
-5.0	-5.6	87.9	87.9	27.6	79.1	22.6	70.3	18.5	61.5	15.2	52.7	12.3	44.0	9.90	35.2	7.68	26.4	5.52
-7.0	-7.6	83.7	83.7	27.4	75.3	22.4	66.9	18.4	58.6	15.0	50.2	12.2	41.8	9.81	33.5	7.61	25.1	5.47
-10	-10.5	77.5	77.5	27.0	69.8	22.2	62.0	18.2	54.3	14.8	46.5	12.1	38.8	9.69	31.0	7.52	23.3	5.40
-14.5	-15.0	68.0	68.0	26.5	61.2	21.7	54.4	17.8	47.6	14.6	40.8	11.9	34.0	9.51	27.2	7.38	20.4	5.30

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 20.0°C dry-bulb

## 5 Outdoor unit



MMY-AP3826HT8P-E (38HP, 107kW system)

Cooling		Compressor + Outdoor Fan Power consumption (kW)															
Outdoor Unit (°C)	Outdoor Unit 100% Capacity (kW)	100%		90%		80%		70%		60%		50%		40%		30%	
		TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)
40 °C	99.6	99.6	34.9	89.6	27.8	79.7	21.9	69.7	17.1	59.7	13.2	49.8	10.0	39.8	7.31	29.9	5.03
39 °C	101.2	101.2	34.4	91.1	27.4	80.9	21.6	70.8	16.8	60.7	13.0	50.6	9.82	40.5	7.20	30.4	4.95
37 °C	104.2	104.2	33.3	93.8	26.5	83.4	20.9	72.9	16.3	62.5	12.6	52.1	9.52	41.7	6.98	31.3	4.80
35 °C	107.0	107.0	32.3	96.3	25.7	85.6	20.3	74.9	15.8	64.2	12.2	53.5	9.22	42.8	6.76	32.1	4.65
33 °C	107.0	107.0	29.6	96.3	23.7	85.6	18.7	74.9	14.7	64.2	11.3	53.5	8.62	42.8	6.34	32.1	4.36
31 °C	107.0	107.0	27.3	96.3	21.9	85.6	17.4	74.9	13.6	64.2	10.6	53.5	8.07	42.8	5.95	32.1	4.10
30 °C	107.0	107.0	26.2	96.3	21.1	85.6	16.7	74.9	13.2	64.2	10.2	53.5	7.81	42.8	5.77	32.1	3.97
29 °C	107.0	107.0	25.3	96.3	20.3	85.6	16.1	74.9	12.7	64.2	9.91	53.5	7.57	42.8	5.59	32.1	3.85
27 °C	107.0	107.0	23.4	96.3	18.9	85.6	15.1	74.9	11.9	64.2	9.29	53.5	7.11	42.8	5.26	32.1	3.63
25 °C	107.0	107.0	21.8	96.3	17.6	85.6	14.1	74.9	11.1	64.2	8.71	53.5	6.68	42.8	4.95	32.1	3.41
23 °C	107.0	107.0	20.7	96.3	16.8	85.6	13.4	74.9	10.7	64.2	8.36	53.5	6.42	42.8	4.76	32.1	3.28
21 °C	107.0	107.0	20.2	96.3	16.4	85.6	13.1	74.9	10.5	64.2	8.21	53.5	6.32	42.8	4.69	32.1	3.23
20 °C	107.0	107.0	20.0	96.3	16.2	85.6	13.0	74.9	10.4	64.2	8.14	53.5	6.27	42.8	4.66	32.1	3.21
19 °C	107.0	107.0	19.8	96.3	16.0	85.6	12.9	74.9	10.3	64.2	8.08	53.5	6.23	42.8	4.62	32.1	3.19
17 °C	107.0	107.0	19.4	96.3	15.8	85.6	12.7	74.9	10.1	64.2	7.97	53.5	6.15	42.8	4.57	32.1	3.15
15 °C	107.0	107.0	19.1	96.3	15.5	85.6	12.5	74.9	10.0	64.2	7.88	53.5	6.08	42.8	4.52	32.1	3.12

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 27.0°C dry-bulb / 19.0°C wet bulb

Heating		Compressor + Outdoor Fan Power consumption (kW)																
Outdoor Unit	Outdoor Unit 100% Capacity (kW)	100% Capacity		90% Capacity		80% Capacity		70% Capacity		60% Capacity		50% Capacity		40% Capacity		30% Capacity		
		Dry-Bulb (°C)	Wet-Bulb (°C)	TC (kW)	PI (kW)													
15.0	13.7	120.0	120.0	24.9	108.0	20.7	96.0	17.3	84.0	14.3	72.0	11.9	60.0	9.69	48.0	7.68	36.0	5.71
13.0	11.8	120.0	120.0	26.1	108.0	21.6	96.0	17.9	84.0	14.8	72.0	12.2	60.0	9.94	48.0	7.87	36.0	5.85
11.0	9.8	120.0	120.0	27.4	108.0	22.6	96.0	18.6	84.0	15.3	72.0	12.6	60.0	10.2	48.0	8.08	36.0	6.01
9.0	7.9	120.0	120.0	28.9	108.0	23.7	96.0	19.4	84.0	15.9	72.0	13.0	60.0	10.5	48.0	8.29	36.0	6.17
7.0	6.0	120.0	120.0	30.5	108.0	24.9	96.0	20.3	84.0	16.5	72.0	13.4	60.0	10.8	48.0	8.51	36.0	6.34
5.0	4.1	115.9	115.9	30.3	104.3	24.7	92.7	20.1	81.1	16.4	69.5	13.3	57.9	10.7	46.3	8.45	34.8	6.29
3.0	2.2	111.7	111.7	30.1	100.6	24.5	89.4	20.0	78.2	16.3	67.0	13.2	55.9	10.7	44.7	8.39	33.5	6.25
0.0	-0.7	105.4	105.4	29.8	94.9	24.3	84.3	19.8	73.8	16.1	63.3	13.1	52.7	10.6	42.2	8.30	31.6	6.18
-3.0	-3.7	98.9	98.9	29.4	89.0	24.0	79.1	19.6	69.2	15.9	59.3	12.9	49.4	10.4	39.6	8.21	29.7	6.11
-5.0	-5.6	94.8	94.8	29.2	85.3	23.8	75.8	19.4	66.3	15.8	56.9	12.9	47.4	10.4	37.9	8.15	28.4	6.07
-7.0	-7.6	90.4	90.4	29.0	81.4	23.6	72.3	19.3	63.3	15.7	54.2	12.8	45.2	10.3	36.2	8.09	27.1	6.03
-10	-10.5	84.1	84.1	28.7	75.7	23.4	67.3	19.1	58.9	15.5	50.5	12.6	42.1	10.2	33.6	8.00	25.2	5.96
-14.5	-15.0	74.3	74.3	28.2	66.9	23.0	59.5	18.7	52.0	15.3	44.6	12.4	37.2	10.0	29.7	7.86	22.3	5.86

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 20.0°C dry-bulb

## 5 Outdoor unit



MMY-AP4026HT8P-E (40HP, 113.5kW system)

Cooling		Compressor + Outdoor Fan Power consumption (kW)															
Outdoor Unit (°C)	Outdoor Unit 100% Capacity (kW)	100%		90%		80%		70%		60%		50%		40%			
		TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)		
40 °C	105.6	105.6	37.4	95.1	29.6	84.5	23.3	73.9	18.1	63.4	14.0	52.8	10.7	42.3	7.89	31.7	5.44
39 °C	107.3	107.3	36.8	96.6	29.2	85.9	22.9	75.1	17.9	64.4	13.8	53.7	10.5	42.9	7.77	32.2	5.36
37 °C	110.5	110.5	35.7	99.5	28.3	88.4	22.2	77.4	17.3	66.3	13.4	55.3	10.2	44.2	7.53	33.2	5.20
35 °C	113.5	113.5	34.6	102.1	27.4	90.8	21.5	79.4	16.8	68.1	13.0	56.7	9.87	45.4	7.30	34.0	5.03
33 °C	113.5	113.5	31.7	102.2	25.2	90.8	19.9	79.5	15.6	68.1	12.1	56.8	9.23	45.4	6.84	34.1	4.72
31 °C	113.5	113.5	29.2	102.2	23.3	90.8	18.4	79.5	14.5	68.1	11.3	56.8	8.65	45.4	6.42	34.1	4.43
30 °C	113.5	113.5	28.0	102.2	22.4	90.8	17.8	79.5	14.0	68.1	10.9	56.8	8.38	45.4	6.23	34.1	4.30
29 °C	113.5	113.5	27.0	102.2	21.6	90.8	17.1	79.5	13.5	68.1	10.6	56.8	8.12	45.4	6.04	34.1	4.17
27 °C	113.5	113.5	25.0	102.2	20.0	90.8	16.0	79.5	12.6	68.1	9.91	56.8	7.63	45.4	5.68	34.1	3.92
25 °C	113.5	113.5	23.2	102.2	18.7	90.8	14.9	79.5	11.8	68.1	9.30	56.8	7.18	45.4	5.35	34.1	3.69
23 °C	113.5	113.5	22.1	102.2	17.8	90.8	14.3	79.5	11.3	68.1	8.92	56.8	6.90	45.4	5.15	34.1	3.55
21 °C	113.5	113.5	21.5	102.2	17.4	90.8	14.0	79.5	11.1	68.1	8.77	56.8	6.79	45.4	5.07	34.1	3.49
20 °C	113.5	113.5	21.3	102.2	17.2	90.8	13.8	79.5	11.0	68.1	8.70	56.8	6.74	45.4	5.04	34.1	3.47
19 °C	113.5	113.5	21.1	102.2	17.0	90.8	13.7	79.5	10.9	68.1	8.64	56.8	6.70	45.4	5.00	34.1	3.44
17 °C	113.5	113.5	20.7	102.2	16.7	90.8	13.5	79.5	10.8	68.1	8.52	56.8	6.62	45.4	4.95	34.1	3.40
15 °C	113.5	113.5	20.3	102.2	16.5	90.8	13.3	79.5	10.6	68.1	8.42	56.8	6.55	45.4	4.89	34.1	3.37

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 27.0°C dry-bulb / 19.0°C wet bulb

Heating		Compressor + Outdoor Fan Power consumption (kW)																
Outdoor Unit	Outdoor Unit 100% Capacity (kW)	100% Capacity		90%		80%		70%		60%		50%		40%				
		Dry-Bulb (°C)	Wet-Bulb (°C)	Heating Capacity (kW)	TC (kW)	PI (kW)												
15.0	13.7	127.5	127.5	26.0	114.8	21.6	102.0	17.9	89.3	14.9	76.5	12.3	63.8	10.1	51.0	8.18	38.3	6.32
13.0	11.8	127.5	127.5	27.3	114.8	22.5	102.0	18.6	89.3	15.3	76.5	12.7	63.8	10.4	51.0	8.35	38.3	6.45
11.0	9.8	127.5	127.5	28.7	114.8	23.6	102.0	19.4	89.3	15.9	76.5	13.1	63.8	10.7	51.0	8.55	38.3	6.59
9.0	7.9	127.5	127.5	30.3	114.8	24.7	102.0	20.2	89.3	16.5	76.5	13.5	63.8	10.9	51.0	8.75	38.3	6.74
7.0	6.0	127.5	127.5	32.0	114.8	26.0	102.0	21.1	89.3	17.1	76.5	13.9	63.8	11.3	51.0	8.97	38.3	6.89
5.0	4.1	123.3	123.3	31.8	110.9	25.9	98.6	21.0	86.3	17.0	74.0	13.8	61.6	11.2	49.3	8.91	37.0	6.85
3.0	2.2	119.0	119.0	31.6	107.1	25.7	95.2	20.8	83.3	16.9	71.4	13.7	59.5	11.1	47.6	8.86	35.7	6.80
0.0	-0.7	112.6	112.6	31.3	101.3	25.4	90.0	20.6	78.8	16.8	67.5	13.6	56.3	11.0	45.0	8.77	33.8	6.74
-3.0	-3.7	105.9	105.9	31.0	95.3	25.2	84.7	20.4	74.1	16.6	63.5	13.5	52.9	10.9	42.3	8.68	31.8	6.67
-5.0	-5.6	101.6	101.6	30.8	91.5	25.0	81.3	20.3	71.1	16.5	61.0	13.4	50.8	10.8	40.7	8.63	30.5	6.63
-7.0	-7.6	97.2	97.2	30.6	87.5	24.8	77.7	20.2	68.0	16.4	58.3	13.3	48.6	10.7	38.9	8.57	29.2	6.58
-10	-10.5	90.7	90.7	30.3	81.6	24.6	72.6	20.0	63.5	16.2	54.4	13.2	45.4	10.6	36.3	8.48	27.2	6.52
-14.5	-15.0	80.7	80.7	29.8	72.6	24.2	64.5	19.6	56.5	15.9	48.4	12.9	40.3	10.5	32.3	8.35	24.2	6.41

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 20.0°C dry-bulb

## 5 Outdoor unit



### MMY-AP4226HT8P-E (42HP, 120kW system)

Cooling		Compressor + Outdoor Fan Power consumption (kW)															
Outdoor Unit (°C)	Outdoor Unit 100% Capacity (kW)	100%		90%		80%		70%		60%		50%		40%		30%	
		TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)
40 °C	111.7	111.7	39.9	100.5	31.4	89.3	24.6	78.2	19.2	67.0	14.9	55.8	11.4	44.7	8.46	33.5	5.85
39 °C	113.5	113.5	39.3	102.1	31.0	90.8	24.3	79.4	18.9	68.1	14.6	56.7	11.2	45.4	8.34	34.0	5.77
37 °C	116.9	116.9	38.1	105.2	30.0	93.5	23.5	81.8	18.3	70.1	14.2	58.4	10.9	46.7	8.08	35.1	5.59
35 °C	120.0	120.0	36.9	108.0	29.1	96.0	22.8	84.0	17.8	72.0	13.8	60.0	10.5	48.0	7.83	36.0	5.42
33 °C	120.0	120.0	33.8	108.0	26.7	96.0	21.0	84.0	16.5	72.0	12.8	60.0	9.85	48.0	7.34	36.0	5.08
31 °C	120.0	120.0	31.0	108.0	24.7	96.0	19.5	84.0	15.3	72.0	12.0	60.0	9.24	48.0	6.90	36.0	4.77
30 °C	120.0	120.0	29.8	108.0	23.7	96.0	18.8	84.0	14.8	72.0	11.6	60.0	8.95	48.0	6.69	36.0	4.62
29 °C	120.0	120.0	28.7	108.0	22.8	96.0	18.1	84.0	14.3	72.0	11.2	60.0	8.68	48.0	6.49	36.0	4.48
27 °C	120.0	120.0	26.5	108.0	21.2	96.0	16.9	84.0	13.4	72.0	10.5	60.0	8.16	48.0	6.11	36.0	4.21
25 °C	120.0	120.0	24.7	108.0	19.8	96.0	15.8	84.0	12.5	72.0	9.89	60.0	7.68	48.0	5.75	36.0	3.96
23 °C	120.0	120.0	23.4	108.0	18.8	96.0	15.1	84.0	12.0	72.0	9.49	60.0	7.38	48.0	5.54	36.0	3.81
21 °C	120.0	120.0	22.8	108.0	18.4	96.0	14.8	84.0	11.8	72.0	9.33	60.0	7.27	48.0	5.45	36.0	3.75
20 °C	120.0	120.0	22.6	108.0	18.2	96.0	14.6	84.0	11.7	72.0	9.26	60.0	7.22	48.0	5.42	36.0	3.72
19 °C	120.0	120.0	22.3	108.0	18.0	96.0	14.5	84.0	11.6	72.0	9.19	60.0	7.17	48.0	5.38	36.0	3.70
17 °C	120.0	120.0	21.9	108.0	17.7	96.0	14.3	84.0	11.4	72.0	9.07	60.0	7.08	48.0	5.32	36.0	3.65
15 °C	120.0	120.0	21.6	108.0	17.4	96.0	14.1	84.0	11.3	72.0	8.97	60.0	7.01	48.0	5.27	36.0	3.61

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 27.0°C dry-bulb / 19.0°C wet bulb

Heating		Compressor + Outdoor Fan Power consumption (kW)																
Outdoor Unit	Outdoor Unit 100% Capacity (kW)	100% Capacity		90% Capacity		80% Capacity		70% Capacity		60% Capacity		50% Capacity		40% Capacity		30% Capacity		
		Dry-Bulb (°C)	Wet-Bulb (°C)	TC (kW)	PI (kW)													
15.0	13.7	135.0	135.0	27.2	21.5	22.4	108.0	18.6	94.5	15.4	81.0	12.8	67.5	10.6	54.0	8.67	40.5	6.92
13.0	11.8	135.0	135.0	28.5	21.5	23.4	108.0	19.3	94.5	15.9	81.0	13.1	67.5	10.8	54.0	8.84	40.5	7.04
11.0	9.8	135.0	135.0	30.1	21.5	24.6	108.0	20.1	94.5	16.5	81.0	13.5	67.5	11.1	54.0	9.03	40.5	7.17
9.0	7.9	135.0	135.0	31.7	21.5	25.8	108.0	21.0	94.5	17.1	81.0	13.9	67.5	11.4	54.0	9.22	40.5	7.30
7.0	6.0	135.0	135.0	33.6	21.5	27.2	108.0	21.9	94.5	17.8	81.0	14.4	67.5	11.7	54.0	9.43	40.5	7.44
5.0	4.1	130.7	130.7	33.4	117.6	27.0	104.5	21.8	91.5	17.7	78.4	14.3	65.3	11.6	52.3	9.38	39.2	7.40
3.0	2.2	126.3	126.3	33.2	113.7	26.9	101.0	21.7	88.4	17.6	75.8	14.2	63.2	11.6	50.5	9.32	37.9	7.36
0.0	-0.7	119.7	119.7	32.9	107.7	26.6	95.7	21.5	83.8	17.4	71.8	14.1	59.8	11.5	47.9	9.24	35.9	7.29
-3.0	-3.7	112.8	112.8	32.6	101.5	26.4	90.3	21.3	79.0	17.2	67.7	14.0	56.4	11.3	45.1	9.16	33.8	7.22
-5.0	-5.6	108.5	108.5	32.4	97.6	26.2	86.8	21.2	75.9	17.1	65.1	13.9	54.2	11.3	43.4	9.10	32.5	7.18
-7.0	-7.6	103.9	103.9	32.2	93.5	26.1	83.1	21.1	72.7	17.0	62.4	13.8	52.0	11.2	41.6	9.05	31.2	7.14
-10	-10.5	97.3	97.3	31.9	87.6	25.8	77.8	20.9	68.1	16.9	58.4	13.7	48.6	11.1	38.9	8.96	29.2	7.07
-14.5	-15.0	87.0	87.0	31.5	78.3	25.4	69.6	20.6	60.9	16.6	52.2	13.5	43.5	10.9	34.8	8.84	26.1	6.97

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 20.0°C dry-bulb

**MMY-AP4426HT8P-E (44HP, 125kW system)**

Cooling		Compressor + Outdoor Fan Power consumption (kW)															
Outdoor Unit (°C)	Outdoor Unit 100% Capacity (kW)	100%		90%		80%		70%		60%		50%		40%		30%	
		TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)
40 °C	116.3	116.3	42.0	104.7	33.3	93.1	26.1	81.4	20.3	69.8	15.7	58.2	11.9	46.5	8.74	34.9	5.98
39 °C	118.2	118.2	41.4	106.4	32.8	94.6	25.7	82.7	20.0	70.9	15.4	59.1	11.7	47.3	8.62	35.5	5.89
37 °C	121.7	121.7	40.2	109.6	31.8	97.4	24.9	85.2	19.4	73.0	15.0	60.9	11.4	48.7	8.35	36.5	5.71
35 °C	125.0	125.0	38.9	112.5	30.8	100.0	24.2	87.5	18.8	75.0	14.5	62.5	11.0	50.0	8.09	37.5	5.53
33 °C	125.0	125.0	35.6	112.5	28.3	100.0	22.3	87.5	17.4	75.0	13.5	62.5	10.3	50.0	7.58	37.5	5.18
31 °C	125.0	125.0	32.8	112.5	26.1	100.0	20.7	87.5	16.2	75.0	12.6	62.5	9.64	50.0	7.12	37.5	4.86
30 °C	125.0	125.0	31.5	112.5	25.1	100.0	19.9	87.5	15.7	75.0	12.2	62.5	9.33	50.0	6.90	37.5	4.71
29 °C	125.0	125.0	30.3	112.5	24.2	100.0	19.2	87.5	15.1	75.0	11.8	62.5	9.04	50.0	6.69	37.5	4.57
27 °C	125.0	125.0	28.1	112.5	22.5	100.0	17.9	87.5	14.2	75.0	11.1	62.5	8.50	50.0	6.29	37.5	4.29
25 °C	125.0	125.0	26.1	112.5	21.0	100.0	16.7	87.5	13.2	75.0	10.4	62.5	7.99	50.0	5.92	37.5	4.04
23 °C	125.0	125.0	24.8	112.5	20.0	100.0	16.0	87.5	12.7	75.0	10.0	62.5	7.68	50.0	5.69	37.5	3.88
21 °C	125.0	125.0	24.2	112.5	19.5	100.0	15.6	87.5	12.4	75.0	9.79	62.5	7.55	50.0	5.60	37.5	3.82
20 °C	125.0	125.0	23.9	112.5	19.3	100.0	15.5	87.5	12.3	75.0	9.71	62.5	7.50	50.0	5.57	37.5	3.79
19 °C	125.0	125.0	23.7	112.5	19.1	100.0	15.3	87.5	12.2	75.0	9.64	62.5	7.44	50.0	5.53	37.5	3.76
17 °C	125.0	125.0	23.2	112.5	18.8	100.0	15.1	87.5	12.1	75.0	9.51	62.5	7.35	50.0	5.46	37.5	3.72
15 °C	125.0	125.0	22.8	112.5	18.5	100.0	14.9	87.5	11.9	75.0	9.40	62.5	7.27	50.0	5.41	37.5	3.68

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 27.0°C dry-bulb / 19.0°C wet bulb

Heating		Compressor + Outdoor Fan Power consumption (kW)																
Outdoor Unit	Outdoor Unit 100% Capacity (kW)	100% Capacity		90% Capacity		80% Capacity		70% Capacity		60% Capacity		50% Capacity		40% Capacity		30% Capacity		
		Dry-Bulb (°C)	Wet-Bulb (°C)	TC (kW)	PI (kW)													
15.0	13.7	140.0	140.0	28.7	126.0	23.8	112.0	19.7	98.0	16.3	84.0	13.5	70.0	11.1	56.0	9.05	42.0	7.23
13.0	11.8	140.0	140.0	30.1	126.0	24.8	112.0	20.5	98.0	16.8	84.0	13.8	70.0	11.3	56.0	9.22	42.0	7.35
11.0	9.8	140.0	140.0	31.7	126.0	26.0	112.0	21.3	98.0	17.5	84.0	14.3	70.0	11.6	56.0	9.43	42.0	7.48
9.0	7.9	140.0	140.0	33.4	126.0	27.3	112.0	22.3	98.0	18.1	84.0	14.7	70.0	12.0	56.0	9.63	42.0	7.62
7.0	6.0	140.0	140.0	35.3	126.0	28.7	112.0	23.3	98.0	18.8	84.0	15.2	70.0	12.3	56.0	9.86	42.0	7.76
5.0	4.1	135.3	135.3	35.1	121.8	28.5	108.2	23.1	94.7	18.7	81.2	15.1	67.7	12.2	54.1	9.79	40.6	7.71
3.0	2.2	130.6	130.6	34.8	117.6	28.3	104.5	23.0	91.4	18.6	78.4	15.0	65.3	12.1	52.2	9.73	39.2	7.66
0.0	-0.7	123.5	123.5	34.5	111.1	28.1	98.8	22.7	86.4	18.4	74.1	14.9	61.7	12.0	49.4	9.63	37.0	7.59
-3.0	-3.7	116.1	116.1	34.1	104.5	27.8	92.9	22.5	81.3	18.2	69.6	14.7	58.0	11.9	46.4	9.53	34.8	7.51
-5.0	-5.6	111.4	111.4	33.9	100.3	27.6	89.1	22.4	78.0	18.1	66.8	14.6	55.7	11.8	44.6	9.47	33.4	7.46
-7.0	-7.6	106.5	106.5	33.7	95.8	27.4	85.2	22.2	74.5	18.0	63.9	14.5	53.2	11.7	42.6	9.40	31.9	7.41
-10	-10.5	99.3	99.3	33.3	89.4	27.1	79.5	22.0	69.5	17.8	59.6	14.4	49.7	11.6	39.7	9.31	29.8	7.33
-14.5	-15.0	88.2	88.2	32.8	79.4	26.7	70.6	21.6	61.8	17.5	52.9	14.2	44.1	11.4	35.3	9.16	26.5	7.21

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 20.0°C dry-bulb

## 5 Outdoor unit



MMY-AP5426HT8P-E (54HP, 152kW system)

Cooling		Compressor + Outdoor Fan Power consumption (kW)															
Outdoor Unit (°C)	Outdoor Unit 100% Capacity (kW)	100%		90%		80%		70%		60%		50%		40%		30%	
		TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)
40 °C	141.5	141.5	50.7	127.3	40.6	113.2	32.2	99.0	25.4	84.9	19.7	70.7	15.0	56.6	11.1	42.4	7.55
39 °C	143.7	143.7	49.9	129.4	40.0	115.0	31.8	100.6	25.0	86.2	19.4	71.9	14.8	57.5	10.9	43.1	7.44
37 °C	148.0	148.0	48.4	133.2	38.8	118.4	30.8	103.6	24.2	88.8	18.8	74.0	14.4	59.2	10.6	44.4	7.22
35 °C	152.0	152.0	46.9	136.8	37.5	121.6	29.8	106.4	23.5	91.2	18.2	76.0	13.9	60.8	10.2	45.6	6.99
33 °C	152.0	152.0	43.1	136.8	34.6	121.6	27.6	106.4	21.8	91.2	17.0	76.0	13.0	60.8	9.60	45.6	6.55
31 °C	152.0	152.0	39.7	136.8	32.0	121.6	25.6	106.4	20.3	91.2	15.9	76.0	12.2	60.8	9.01	45.6	6.14
30 °C	152.0	152.0	38.2	136.8	30.9	121.6	24.7	106.4	19.6	91.2	15.4	76.0	11.8	60.8	8.73	45.6	5.95
29 °C	152.0	152.0	36.8	136.8	29.7	121.6	23.9	106.4	19.0	91.2	14.9	76.0	11.4	60.8	8.47	45.6	5.77
27 °C	152.0	152.0	34.2	136.8	27.7	121.6	22.3	106.4	17.7	91.2	14.0	76.0	10.8	60.8	7.96	45.6	5.42
25 °C	152.0	152.0	31.8	136.8	25.8	121.6	20.8	106.4	16.6	91.2	13.1	76.0	10.1	60.8	7.49	45.6	5.10
23 °C	152.0	152.0	30.3	136.8	24.6	121.6	19.9	106.4	15.9	91.2	12.6	76.0	9.72	60.8	7.21	45.6	4.90
21 °C	152.0	152.0	29.6	136.8	24.1	121.6	19.5	106.4	15.6	91.2	12.4	76.0	9.56	60.8	7.09	45.6	4.82
20 °C	152.0	152.0	29.3	136.8	23.9	121.6	19.3	106.4	15.5	91.2	12.3	76.0	9.49	60.8	7.04	45.6	4.78
19 °C	152.0	152.0	29.0	136.8	23.6	121.6	19.1	106.4	15.4	91.2	12.2	76.0	9.43	60.8	7.00	45.6	4.75
17 °C	152.0	152.0	28.4	136.8	23.2	121.6	18.9	106.4	15.2	91.2	12.0	76.0	9.31	60.8	6.91	45.6	4.69
15 °C	152.0	152.0	28.0	136.8	22.9	121.6	18.6	106.4	15.0	91.2	11.9	76.0	9.21	60.8	6.84	45.6	4.64

TC : Total Capacity

PI : Power Input

Indoor air temperature conditions : 27.0°C dry-bulb / 19.0°C wet bulb

Heating		Compressor + Outdoor Fan Power consumption (kW)																
Outdoor Unit	Outdoor Unit 100% Capacity (kW)	100% Capacity		90%		80%		70%		60%		50%		40%		30%		
		Dry-Bulb (°C)	Wet-Bulb (°C)	TC (kW)	PI (kW)													
15.0	13.7	171.0	171.0	37.4	153.9	31.5	136.8	26.3	119.7	21.9	102.6	18.0	85.5	14.6	68.4	11.4	51.3	8.34
13.0	11.8	171.0	171.0	39.1	153.9	32.7	136.8	27.3	119.7	22.6	102.6	18.6	85.5	15.0	68.4	11.7	51.3	8.56
11.0	9.8	171.0	171.0	41.0	153.9	34.2	136.8	28.4	119.7	23.4	102.6	19.2	85.5	15.4	68.4	12.0	51.3	8.80
9.0	7.9	171.0	171.0	43.0	153.9	35.7	136.8	29.5	119.7	24.3	102.6	19.8	85.5	15.9	68.4	12.4	51.3	9.04
7.0	6.0	171.0	171.0	45.2	153.9	37.4	136.8	30.8	119.7	25.2	102.6	20.5	85.5	16.4	68.4	12.7	51.3	9.30
5.0	4.1	165.0	165.0	44.9	148.5	37.1	132.0	30.6	115.5	25.0	99.0	20.3	82.5	16.3	66.0	12.6	49.5	9.24
3.0	2.2	159.1	159.1	44.5	143.2	36.8	127.3	30.3	111.4	24.9	95.4	20.2	79.5	16.1	63.6	12.5	47.7	9.17
0.0	-0.7	150.0	150.0	44.1	135.0	36.4	120.0	30.0	105.0	24.6	90.0	20.0	75.0	16.0	60.0	12.4	45.0	9.07
-3.0	-3.7	140.6	140.6	43.5	126.5	36.0	112.5	29.7	98.4	24.3	84.3	19.7	70.3	15.8	56.2	12.3	42.2	8.97
-5.0	-5.6	134.6	134.6	43.2	121.2	35.8	107.7	29.4	94.2	24.1	80.8	19.6	67.3	15.7	53.8	12.2	40.4	8.90
-7.0	-7.6	128.3	128.3	42.9	115.5	35.5	102.7	29.2	89.8	23.9	77.0	19.4	64.2	15.5	51.3	12.1	38.5	8.83
-10	-10.5	119.2	119.2	42.4	107.3	35.1	95.4	28.9	83.5	23.6	71.5	19.2	59.6	15.4	47.7	11.9	35.8	8.73
-14.5	-15.0	105.1	105.1	41.6	94.6	34.4	84.1	28.4	73.6	23.2	63.1	18.9	52.6	15.1	42.1	11.7	31.5	8.57

TC : Total Capacity


PI : Power Input

Indoor air temperature conditions : 20.0°C dry-bulb




## 5-10. Sound pressure level data

### Outdoor Unit

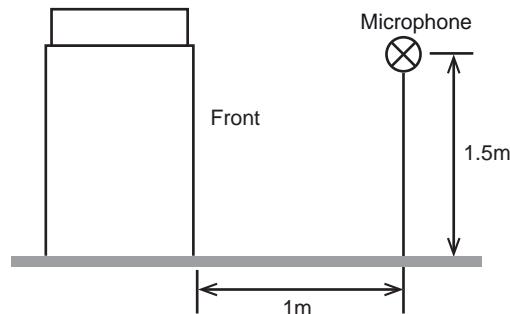


### Standard model

MMY-MAP0806HT8P-E

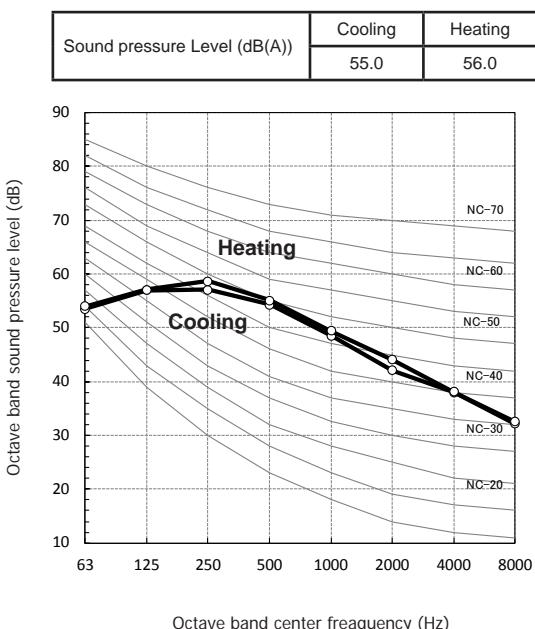

MMY-MAP1006HT8P-E

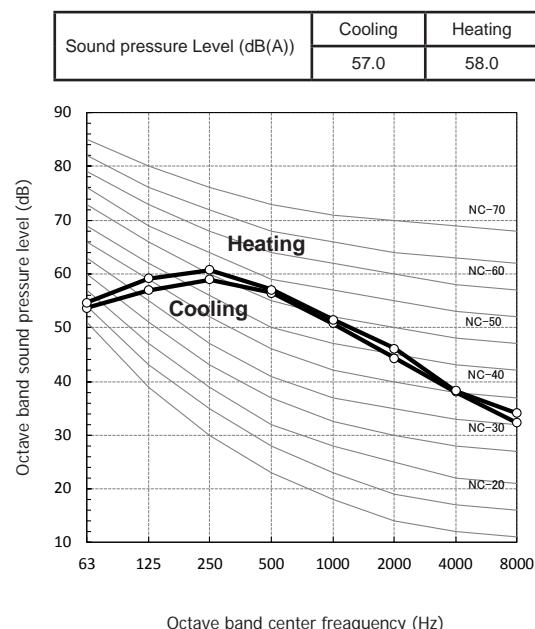


## 5 Outdoor Unit




MMY-MAP1206HT8P-E

Sound pressure Level (dB(A))	Cooling	Heating
	59.0	61.0

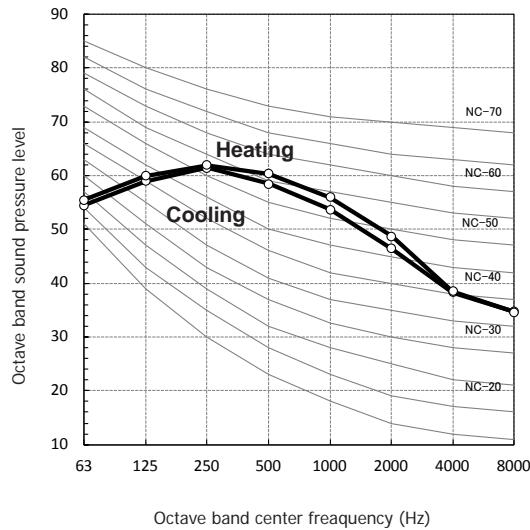


MMY-MAP1406HT8P-E

Sound pressure Level (dB(A))	Cooling	Heating
	60.0	62.0

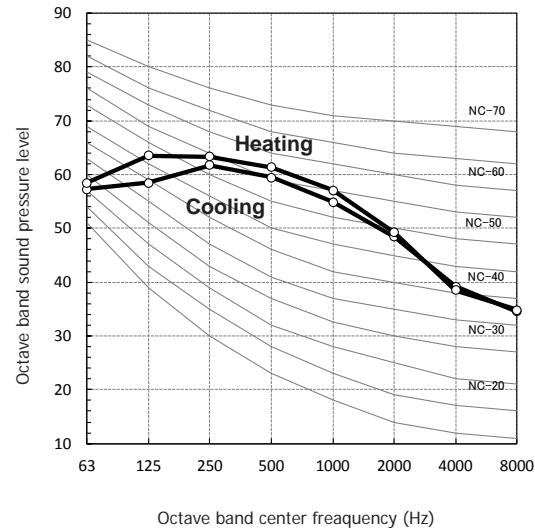


MMY-MAP1604HT8P-E

Sound pressure Level (dB(A))	Cooling	Heating
	62.0	64.0

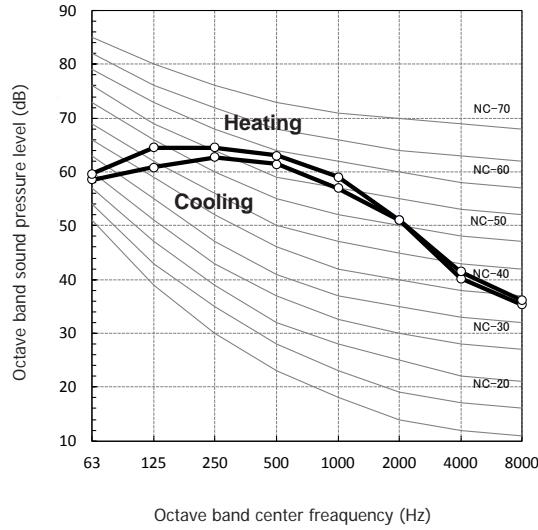

MMY-MAP1806HT8P-E

Sound pressure Level (dB(A))	Cooling	Heating
	60.0	61.0

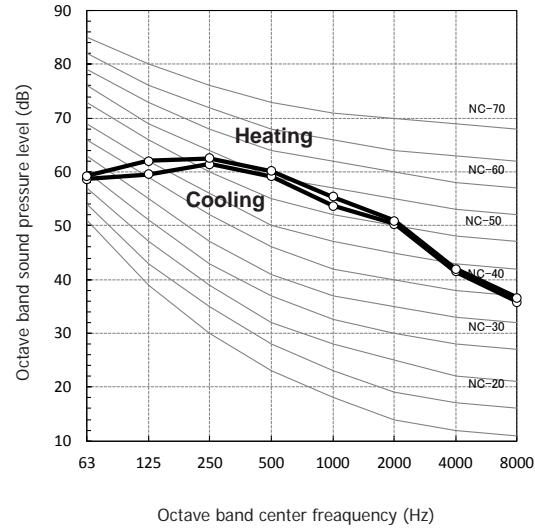


## 5 Outdoor Unit




MMY-MAP2006HT8P-E

Sound pressure Level (dB(A))	Cooling	Heating
	61.0	62.0

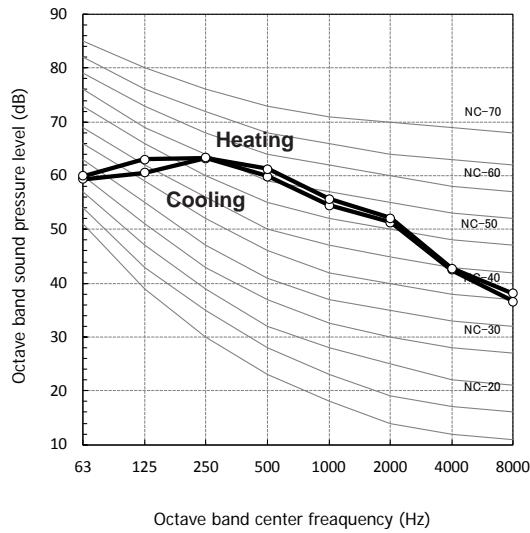


MMY-MAP2206HT8P-E

Sound pressure Level (dB(A))	Cooling	Heating
	61.0	62.0

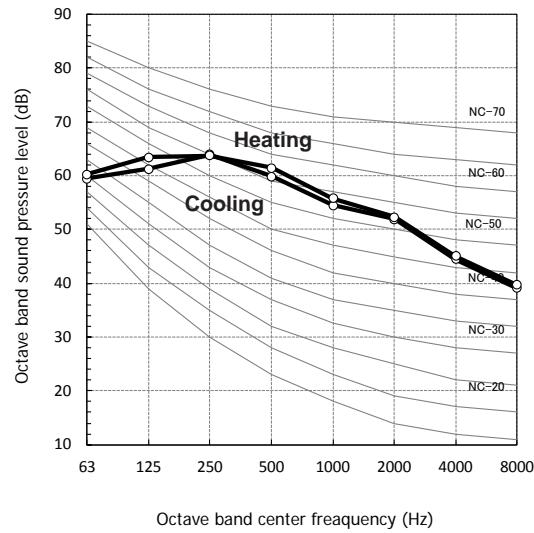


MMY-AP2416HT8P-E

Sound pressure Level (dB(A))	Cooling	Heating
	62.0	64.0

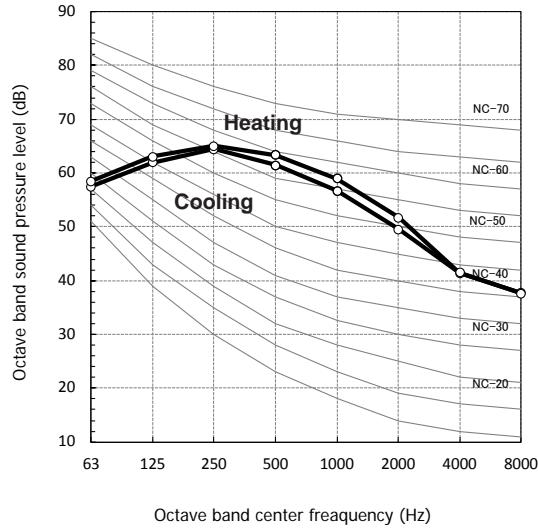

MMY-AP2616HT8P-E

Sound pressure Level (dB(A))	Cooling	Heating
	62.5	64.5

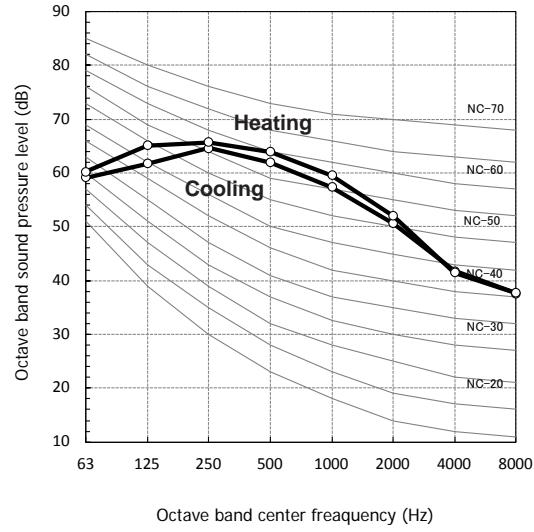


## 5 Outdoor Unit




MMY-AP2816HT8P-E

Sound pressure Level (dB(A))	Cooling	Heating
	64.0	66.0

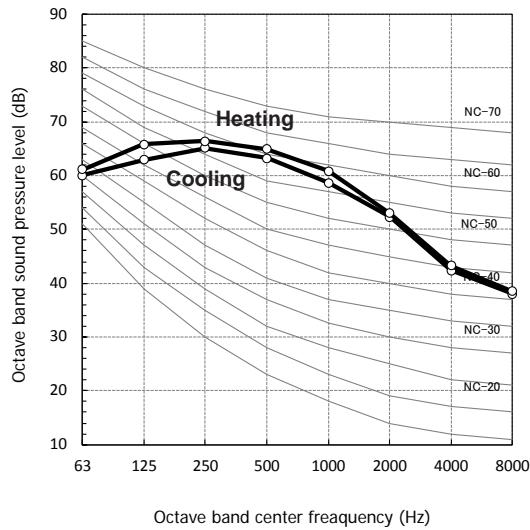


MMY-AP3016HT8P-E

Sound pressure Level (dB(A))	Cooling	Heating
	64.5	66.5

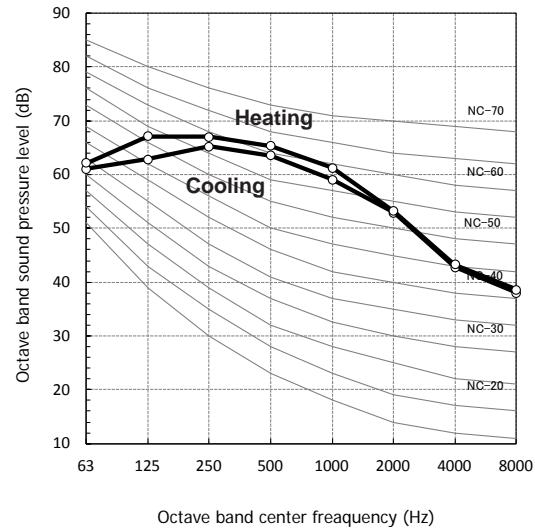


MMY-AP3216HT8P-E

Sound pressure Level (dB(A))	Cooling	Heating
	65.0	67.0

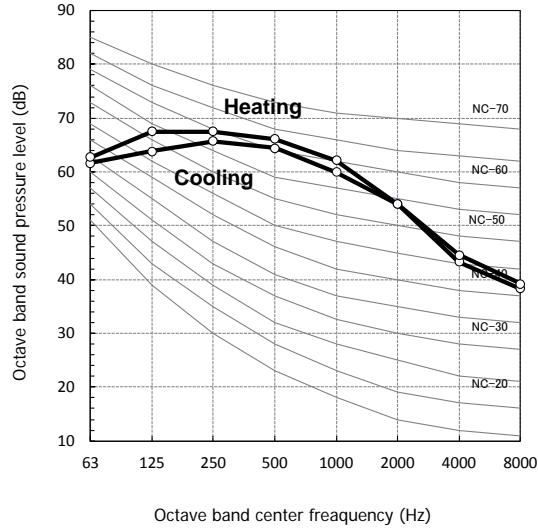

MMY-AP3416HT8P-E

Sound pressure Level (dB(A))	Cooling	Heating
	64.5	66.0

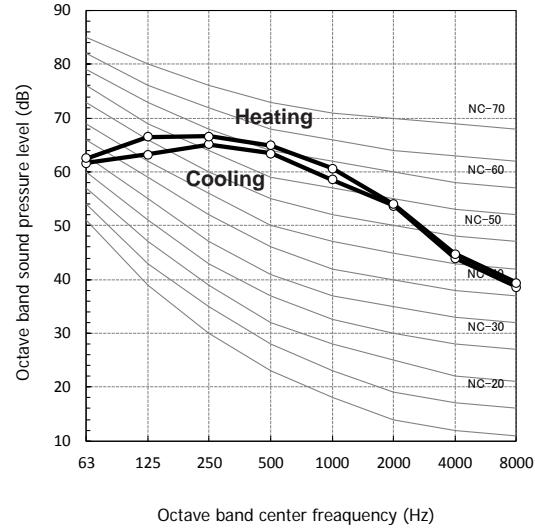


## 5 Outdoor Unit




MMY-AP3616HT8P-E

Sound pressure Level (dB(A))	Cooling	Heating
	64.5	66.5

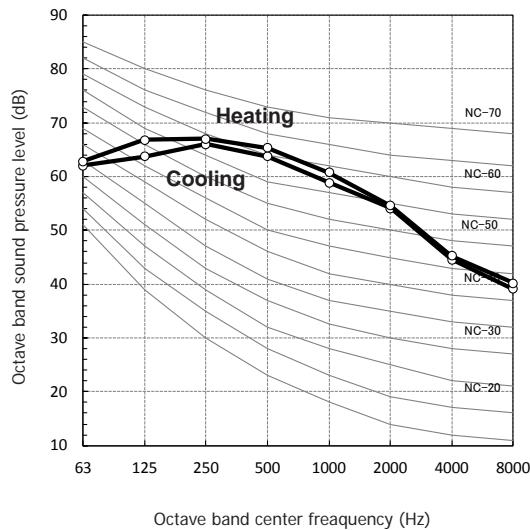


MMY-AP3816HT8P-E

Sound pressure Level (dB(A))	Cooling	Heating
	64.5	66.5

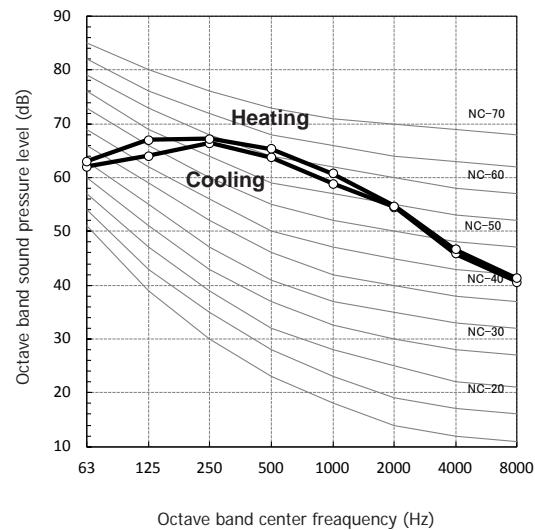


MMY-AP4016HT8P-E

Sound pressure Level (dB(A))	Cooling	Heating
	64.0	65.0

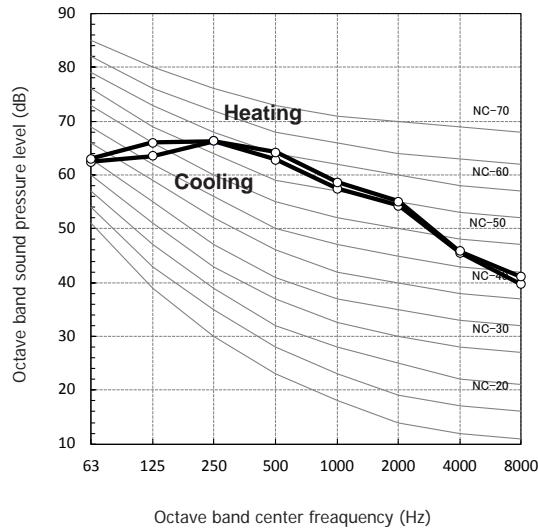

MMY-AP4216HT8P-E

Sound pressure Level (dB(A))	Cooling	Heating
	64.0	65.0

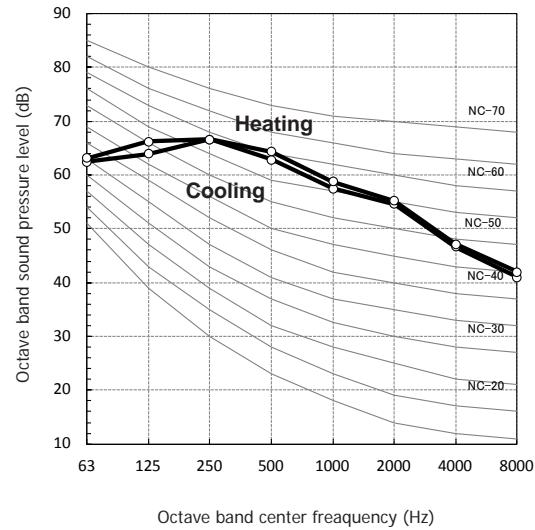


## 5 Outdoor Unit




MMY-AP4416HT8P-E

Sound pressure Level (dB(A))	Cooling	Heating
	64.0	65.0

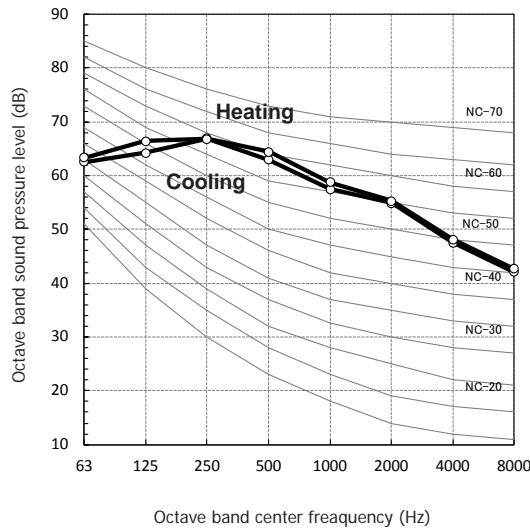


MMY-AP4616HT8P-E

Sound pressure Level (dB(A))	Cooling	Heating
	66.5	68.5

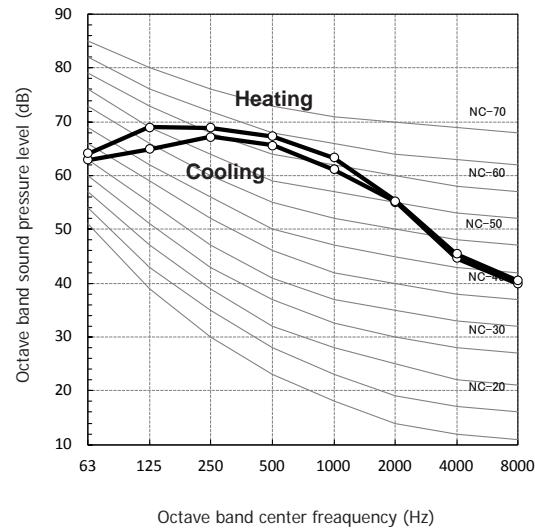


MMY-AP4816HT8P-E

Sound pressure Level (dB(A))	Cooling	Heating
	67.0	69.0

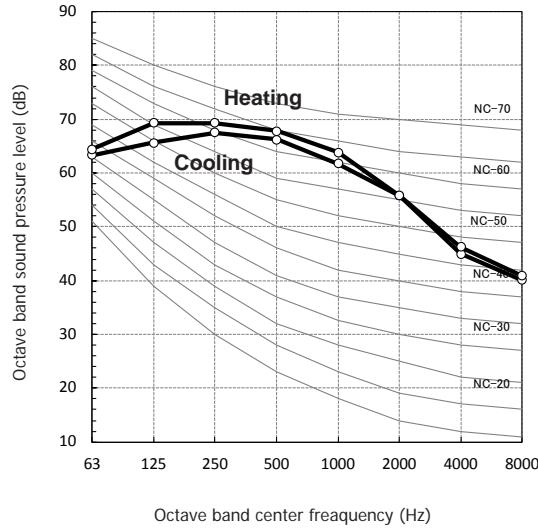

MMY-AP5016HT8P-E

Sound pressure Level (dB(A))	Cooling	Heating
	66.5	68.0

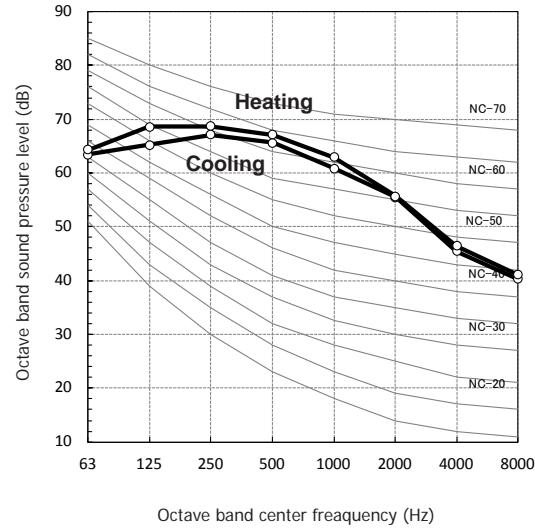


## 5 Outdoor Unit




MMY-AP5216HT8P-E

Sound pressure Level (dB(A))	Cooling	Heating
	66.5	68.5

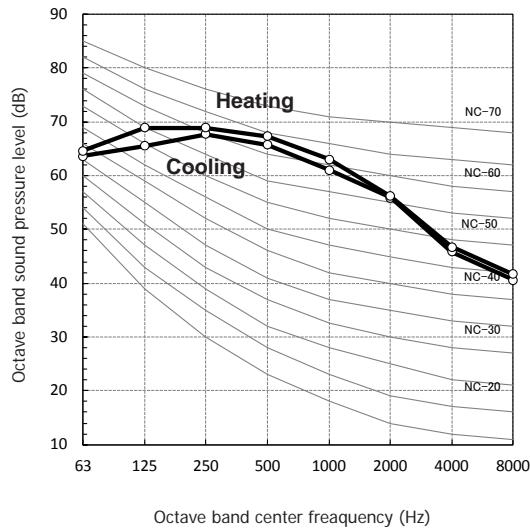


MMY-AP5416HT8P-E

Sound pressure Level (dB(A))	Cooling	Heating
	66.5	68.5

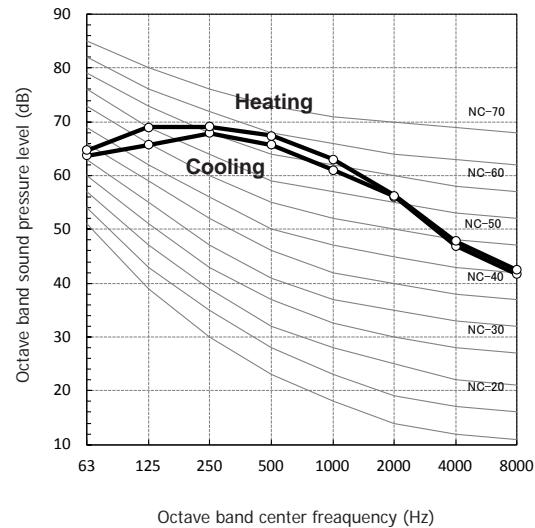


MMY-AP5616HT8P-E

Sound pressure Level (dB(A))	Cooling	Heating
	66.5	67.5

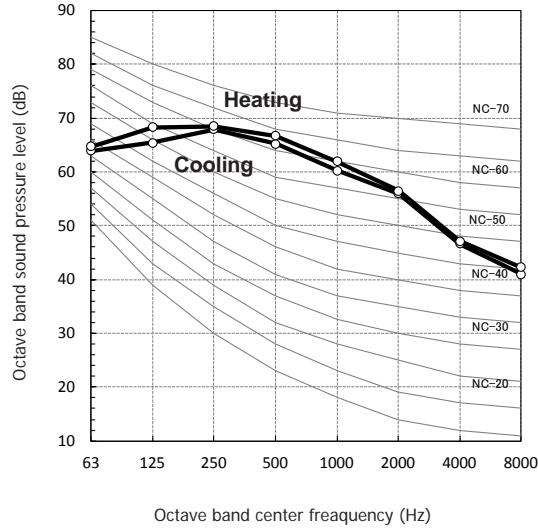

MMY-AP5816HT8P-E

Sound pressure Level (dB(A))	Cooling	Heating
	66.5	67.5

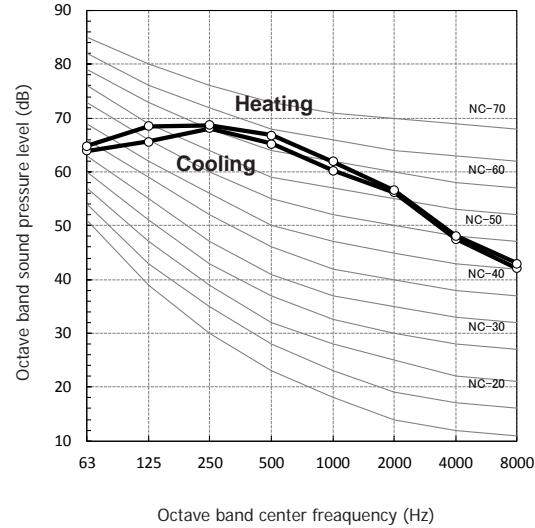


## 5 Outdoor Unit



MMY-AP6016HT8P-E

Sound pressure Level (dB(A))	Cooling	Heating
	66.5	67.5

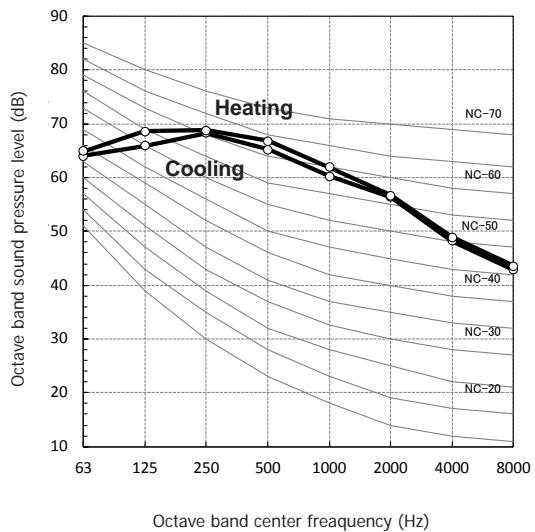


## 5 Outdoor Unit



### High efficiency model


MMY-AP2026HT8P-E

Sound pressure Level (dB(A))	Cooling	Heating
	60.0	61.0

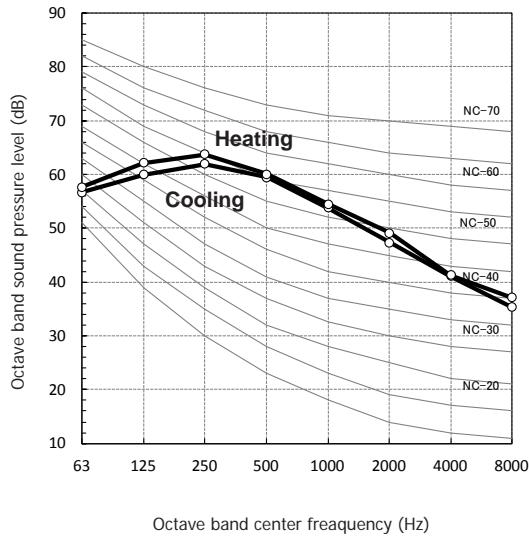


MMY-AP2226HT8P-E

Sound pressure Level (dB(A))	Cooling	Heating
	61.5	63.0

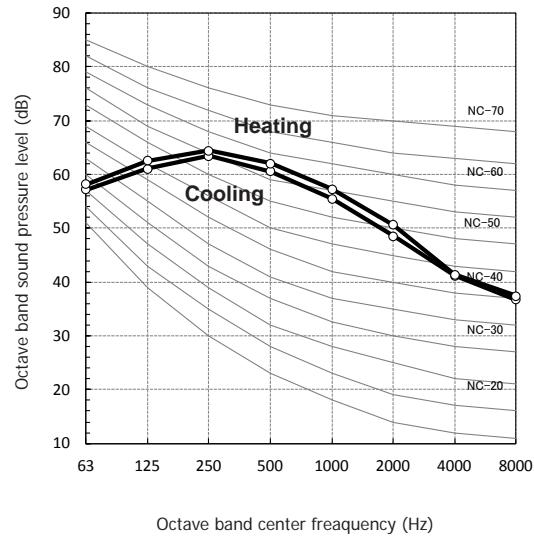


MMY-AP3626HT8P-E

Sound pressure Level (dB(A))	Cooling	Heating
	64.0	66.0

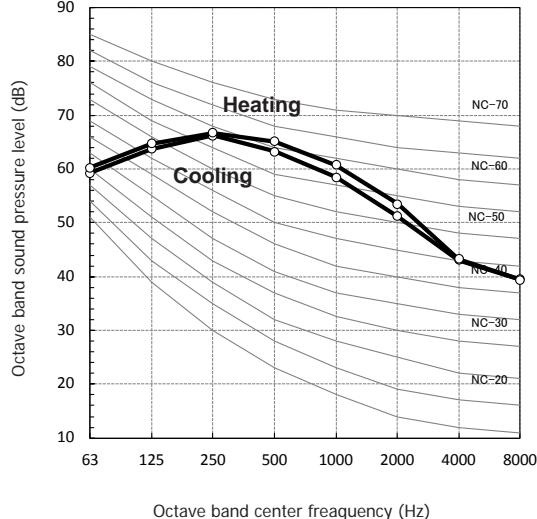

MMY-AP3826HT8P-E

Sound pressure Level (dB(A))	Cooling	Heating
	64.5	66.5

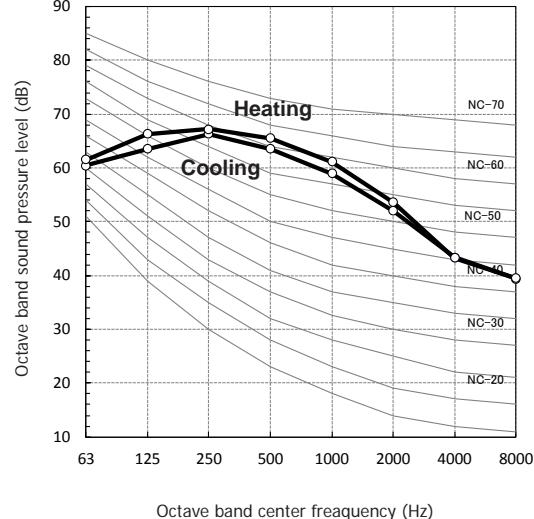


## 5 Outdoor Unit




MMY-AP4026HT8P-E

Sound pressure Level (dB(A))	Cooling	Heating
	64.5	66.5

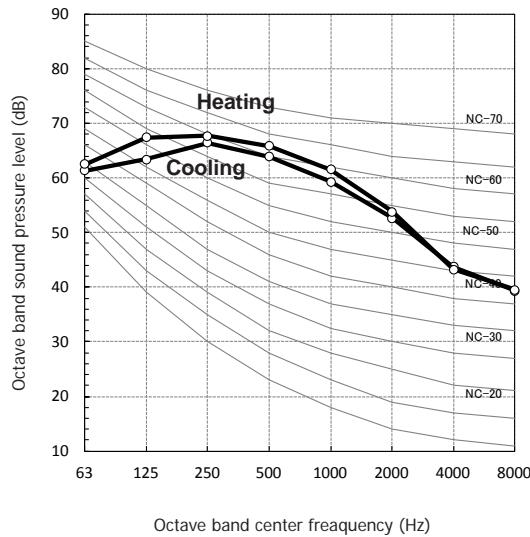


MMY-AP4226HT8P-E

Sound pressure Level (dB(A))	Cooling	Heating
	65.0	67.0

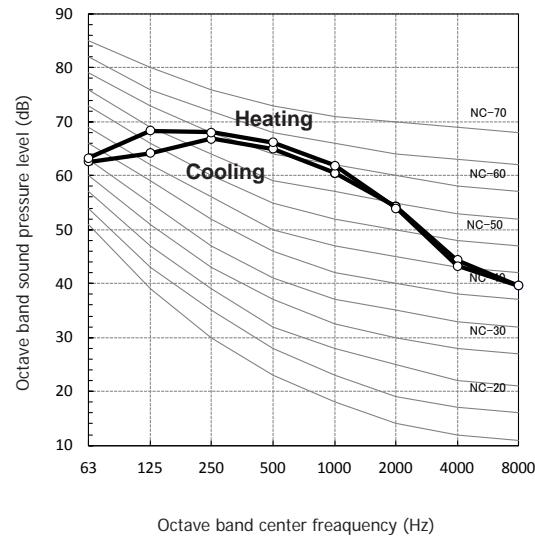


MMY-AP4426HT8P-E

Sound pressure Level (dB(A))	Cooling	Heating
	65.5	67.5

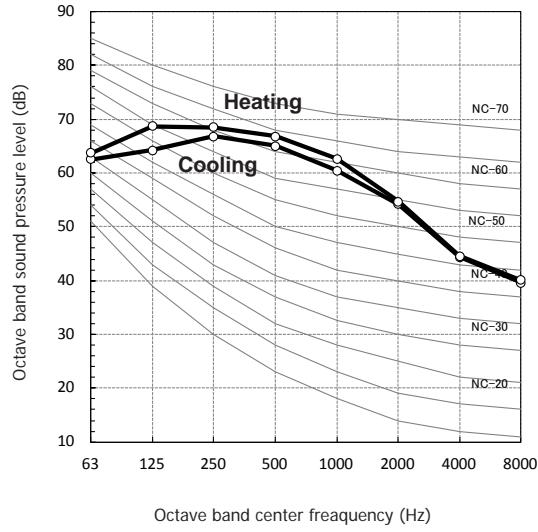

MMY-AP5426HT8P-E

Sound pressure Level (dB(A))	Cooling	Heating
	65.5	67.0

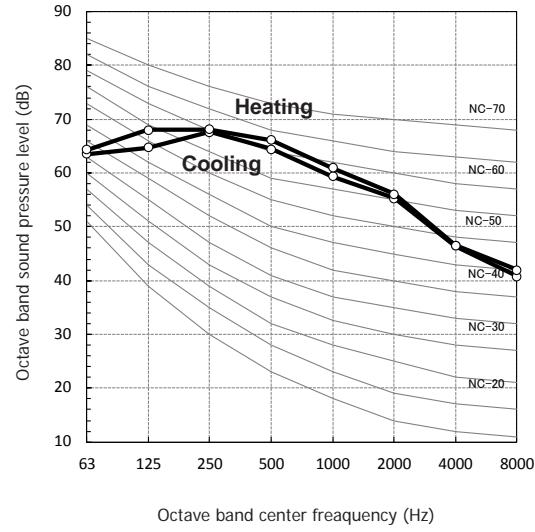

## Appendix



**4-way Air Discharge Cassette Type (MMU-AP 4HP-E)**

TC : Total capacity [kW] SHC : Sensible capacity [kW]

unit size	outdoor air temp. °CDB	indoor air temp.													
		14°CWB		16°CWB		18°CWB		19°CWB		20°CWB		22°CWB			
		20°CDB		23°CDB		26°CDB		27°CDB		28°CDB		30°CDB			
		TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC		
009	10	2.3	2.0	2.5	2.2	2.7	2.3	2.8	2.3	2.9	2.3	3.1	2.3	3.2	2.2
	12	2.3	2.0	2.5	2.2	2.7	2.3	2.8	2.3	2.9	2.3	3.1	2.3	3.2	2.2
	14	2.3	2.0	2.5	2.2	2.7	2.3	2.8	2.3	2.9	2.3	3.1	2.3	3.2	2.2
	16	2.3	2.0	2.5	2.2	2.7	2.3	2.8	2.3	2.9	2.3	3.1	2.3	3.2	2.2
	18	2.3	2.0	2.5	2.2	2.7	2.3	2.8	2.3	2.9	2.3	3.1	2.3	3.2	2.2
	20	2.3	2.0	2.5	2.2	2.7	2.3	2.8	2.3	2.9	2.3	3.1	2.3	3.2	2.2
	21	2.3	2.0	2.5	2.2	2.7	2.3	2.8	2.3	2.9	2.3	3.1	2.3	3.2	2.2
	23	2.3	2.0	2.5	2.2	2.7	2.3	2.8	2.3	2.9	2.3	3.1	2.3	3.2	2.2
	25	2.3	2.0	2.5	2.2	2.7	2.3	2.8	2.3	2.9	2.3	3.1	2.3	3.2	2.2
	27	2.3	2.0	2.5	2.2	2.7	2.3	2.8	2.3	2.9	2.3	3.1	2.3	3.2	2.2
	29	2.3	2.0	2.5	2.2	2.7	2.3	2.8	2.3	2.9	2.3	3.1	2.3	3.2	2.2
	31	2.3	2.0	2.5	2.2	2.7	2.3	2.8	2.3	2.9	2.3	3.1	2.3	3.2	2.2
	33	2.3	2.0	2.5	2.2	2.7	2.3	2.8	2.3	2.9	2.3	3.1	2.3	3.2	2.2
	35	2.3	2.0	2.5	2.2	2.7	2.3	2.8	2.3	2.9	2.3	3.1	2.3	3.2	2.2
	37	2.2	2.0	2.5	2.1	2.6	2.2	2.7	2.2	2.8	2.2	3.0	2.2	3.1	2.2
	39	2.1	1.9	2.4	2.0	2.5	2.1	2.6	2.1	2.7	2.1	2.8	2.1	3.0	2.1
	40	2.1	1.8	2.3	2.0	2.4	2.1	2.5	2.1	2.6	2.1	2.7	2.1	2.9	2.0
	42	1.9	1.7	2.1	1.8	2.3	1.9	2.3	1.9	2.4	1.9	2.6	1.9	2.7	1.9
	44	1.8	1.6	1.9	1.7	2.1	1.8	2.1	1.8	2.2	1.8	2.3	1.7	2.4	1.7
	46	1.5	1.4	1.7	1.5	1.8	1.6	1.9	1.5	1.9	1.5	2.1	1.5	2.1	1.5
012	10	3.0	2.6	3.3	2.7	3.5	2.9	3.6	2.9	3.7	2.9	3.9	2.9	4.1	2.8
	12	3.0	2.6	3.3	2.7	3.5	2.9	3.6	2.9	3.7	2.9	3.9	2.9	4.1	2.8
	14	3.0	2.6	3.3	2.7	3.5	2.9	3.6	2.9	3.7	2.9	3.9	2.9	4.1	2.8
	16	3.0	2.6	3.3	2.7	3.5	2.9	3.6	2.9	3.7	2.9	3.9	2.9	4.1	2.8
	18	3.0	2.6	3.3	2.7	3.5	2.9	3.6	2.9	3.7	2.9	3.9	2.9	4.1	2.8
	20	3.0	2.6	3.3	2.7	3.5	2.9	3.6	2.9	3.7	2.9	3.9	2.9	4.1	2.8
	21	3.0	2.6	3.3	2.7	3.5	2.9	3.6	2.9	3.7	2.9	3.9	2.9	4.1	2.8
	23	3.0	2.6	3.3	2.7	3.5	2.9	3.6	2.9	3.7	2.9	3.9	2.9	4.1	2.8
	25	3.0	2.6	3.3	2.7	3.5	2.9	3.6	2.9	3.7	2.9	3.9	2.9	4.1	2.8
	27	3.0	2.6	3.3	2.7	3.5	2.9	3.6	2.9	3.7	2.9	3.9	2.9	4.1	2.8
	29	3.0	2.6	3.3	2.7	3.5	2.9	3.6	2.9	3.7	2.9	3.9	2.9	4.1	2.8
	31	3.0	2.6	3.3	2.7	3.5	2.9	3.6	2.9	3.7	2.9	3.9	2.9	4.1	2.8
	33	3.0	2.6	3.3	2.7	3.5	2.9	3.6	2.9	3.7	2.9	3.9	2.9	4.1	2.8
	35	3.0	2.6	3.3	2.7	3.5	2.9	3.6	2.9	3.7	2.9	3.9	2.9	4.1	2.8
	37	2.9	2.5	3.2	2.7	3.4	2.8	3.5	2.8	3.6	2.8	3.8	2.8	4.0	2.7
	39	2.7	2.4	3.0	2.5	3.2	2.7	3.3	2.7	3.4	2.7	3.6	2.7	3.8	2.6
	40	2.7	2.3	2.9	2.5	3.1	2.6	3.2	2.6	3.3	2.6	3.5	2.6	3.7	2.5
	42	2.5	2.2	2.7	2.3	2.9	2.4	3.0	2.4	3.1	2.4	3.3	2.4	3.4	2.3
	44	2.3	2.0	2.5	2.1	2.7	2.2	2.7	2.2	2.8	2.2	3.0	2.2	3.1	2.1
	46	2.0	1.7	2.2	1.8	2.3	2.0	2.4	2.0	2.5	1.9	2.6	1.9	2.8	1.9
015	10	3.7	3.2	4.1	3.4	4.4	3.6	4.5	3.6	4.6	3.6	4.9	3.6	5.1	3.5
	12	3.7	3.2	4.1	3.4	4.4	3.6	4.5	3.6	4.6	3.6	4.9	3.6	5.1	3.5
	14	3.7	3.2	4.1	3.4	4.4	3.6	4.5	3.6	4.6	3.6	4.9	3.6	5.1	3.5
	16	3.7	3.2	4.1	3.4	4.4	3.6	4.5	3.6	4.6	3.6	4.9	3.6	5.1	3.5
	18	3.7	3.2	4.1	3.4	4.4	3.6	4.5	3.6	4.6	3.6	4.9	3.6	5.1	3.5
	20	3.7	3.2	4.1	3.4	4.4	3.6	4.5	3.6	4.6	3.6	4.9	3.6	5.1	3.5
	21	3.7	3.2	4.1	3.4	4.4	3.6	4.5	3.6	4.6	3.6	4.9	3.6	5.1	3.5
	23	3.7	3.2	4.1	3.4	4.4	3.6	4.5	3.6	4.6	3.6	4.9	3.6	5.1	3.5
	25	3.7	3.2	4.1	3.4	4.4	3.6	4.5	3.6	4.6	3.6	4.9	3.6	5.1	3.5
	27	3.7	3.2	4.1	3.4	4.4	3.6	4.5	3.6	4.6	3.6	4.9	3.6	5.1	3.5
	29	3.7	3.2	4.1	3.4	4.4	3.6	4.5	3.6	4.6	3.6	4.9	3.6	5.1	3.5
	31	3.7	3.2	4.1	3.4	4.4	3.6	4.5	3.6	4.6	3.6	4.9	3.6	5.1	3.5
	33	3.7	3.2	4.1	3.4	4.4	3.6	4.5	3.6	4.6	3.6	4.9	3.6	5.1	3.5
	35	3.7	3.2	4.1	3.4	4.4	3.6	4.5	3.6	4.6	3.6	4.9	3.6	5.1	3.5
	37	3.6	3.1	4.0	3.3	4.2	3.5	4.4	3.5	4.5	3.5	4.8	3.5	5.0	3.4
	39	3.4	3.0	3.8	3.2	4.0	3.3	4.2	3.3	4.3	3.3	4.5	3.3	4.8	3.2
	40	3.3	2.9	3.7	3.1	3.9	3.2	4.1	3.2	4.2	3.2	4.4	3.2	4.6	3.1
	42	3.1	2.7	3.4	2.8	3.7	3.0	3.8	3.0	3.9	3.0	4.1	3.0	4.3	2.9
	44	2.8	2.4	3.1	2.6	3.3	2.7	3.4	2.7	3.5	2.7	3.7	2.7	3.9	2.7
	46	2.5	2.1	2.7	2.3	2.9	2.4	3.0	2.4	3.1	2.4	3.3	2.4	3.4	2.3

# Sensible capacity table



## 4-way Air Discharge Cassette Type (MMU-AP 4HP-E)

TC : Total capacity [kW] SHC : Sensible capacity [kW]

unit size	outdoor air temp. °CDB	indoor air temp.													
		14°CWB		16°CWB		18°CWB		19°CWB		20°CWB		22°CWB			
		20°CDB		23°CDB		26°CDB		27°CDB		28°CDB		30°CDB			
		TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC		
018	10	4.6	3.9	5.1	4.2	5.4	4.4	5.6	4.4	5.8	4.4	6.1	4.4	6.4	4.3
	12	4.6	3.9	5.1	4.2	5.4	4.4	5.6	4.4	5.8	4.4	6.1	4.4	6.4	4.3
	14	4.6	3.9	5.1	4.2	5.4	4.4	5.6	4.4	5.8	4.4	6.1	4.4	6.4	4.3
	16	4.6	3.9	5.1	4.2	5.4	4.4	5.6	4.4	5.8	4.4	6.1	4.4	6.4	4.3
	18	4.6	3.9	5.1	4.2	5.4	4.4	5.6	4.4	5.8	4.4	6.1	4.4	6.4	4.3
	20	4.6	3.9	5.1	4.2	5.4	4.4	5.6	4.4	5.8	4.4	6.1	4.4	6.4	4.3
	21	4.6	3.9	5.1	4.2	5.4	4.4	5.6	4.4	5.8	4.4	6.1	4.4	6.4	4.3
	23	4.6	3.9	5.1	4.2	5.4	4.4	5.6	4.4	5.8	4.4	6.1	4.4	6.4	4.3
	25	4.6	3.9	5.1	4.2	5.4	4.4	5.6	4.4	5.8	4.4	6.1	4.4	6.4	4.3
	27	4.6	3.9	5.1	4.2	5.4	4.4	5.6	4.4	5.8	4.4	6.1	4.4	6.4	4.3
	29	4.6	3.9	5.1	4.2	5.4	4.4	5.6	4.4	5.8	4.4	6.1	4.4	6.4	4.3
	31	4.6	3.9	5.1	4.2	5.4	4.4	5.6	4.4	5.8	4.4	6.1	4.4	6.4	4.3
	33	4.6	3.9	5.1	4.2	5.4	4.4	5.6	4.4	5.8	4.4	6.1	4.4	6.4	4.3
	35	4.6	3.9	5.1	4.2	5.4	4.4	5.6	4.4	5.8	4.4	6.1	4.4	6.4	4.3
	37	4.5	3.8	4.9	4.0	5.3	4.3	5.4	4.3	5.6	4.3	5.9	4.2	6.2	4.1
	39	4.3	3.6	4.7	3.9	5.0	4.1	5.2	4.1	5.3	4.1	5.7	4.0	5.9	3.9
	40	4.1	3.5	4.6	3.7	4.9	4.0	5.0	4.0	5.2	4.0	5.5	3.9	5.7	3.8
	42	3.8	3.3	4.3	3.5	4.5	3.7	4.7	3.7	4.8	3.7	5.1	3.6	5.3	3.6
	44	3.5	3.0	3.9	3.2	4.1	3.4	4.3	3.3	4.4	3.3	4.6	3.3	4.9	3.2
	46	3.1	2.6	3.4	2.8	3.7	3.0	3.8	3.0	3.9	3.0	4.1	2.9	4.3	2.9
024	10	5.8	4.9	6.4	5.2	6.9	5.5	7.1	5.5	7.3	5.5	7.7	5.4	8.1	5.3
	12	5.8	4.9	6.4	5.2	6.9	5.5	7.1	5.5	7.3	5.5	7.7	5.4	8.1	5.3
	14	5.8	4.9	6.4	5.2	6.9	5.5	7.1	5.5	7.3	5.5	7.7	5.4	8.1	5.3
	16	5.8	4.9	6.4	5.2	6.9	5.5	7.1	5.5	7.3	5.5	7.7	5.4	8.1	5.3
	18	5.8	4.9	6.4	5.2	6.9	5.5	7.1	5.5	7.3	5.5	7.7	5.4	8.1	5.3
	20	5.8	4.9	6.4	5.2	6.9	5.5	7.1	5.5	7.3	5.5	7.7	5.4	8.1	5.3
	21	5.8	4.9	6.4	5.2	6.9	5.5	7.1	5.5	7.3	5.5	7.7	5.4	8.1	5.3
	23	5.8	4.9	6.4	5.2	6.9	5.5	7.1	5.5	7.3	5.5	7.7	5.4	8.1	5.3
	25	5.8	4.9	6.4	5.2	6.9	5.5	7.1	5.5	7.3	5.5	7.7	5.4	8.1	5.3
	27	5.8	4.9	6.4	5.2	6.9	5.5	7.1	5.5	7.3	5.5	7.7	5.4	8.1	5.3
	29	5.8	4.9	6.4	5.2	6.9	5.5	7.1	5.5	7.3	5.5	7.7	5.4	8.1	5.3
	31	5.8	4.9	6.4	5.2	6.9	5.5	7.1	5.5	7.3	5.5	7.7	5.4	8.1	5.3
	33	5.8	4.9	6.4	5.2	6.9	5.5	7.1	5.5	7.3	5.5	7.7	5.4	8.1	5.3
	35	5.8	4.9	6.4	5.2	6.9	5.5	7.1	5.5	7.3	5.5	7.7	5.4	8.1	5.3
	37	5.7	4.7	6.3	5.0	6.7	5.4	6.9	5.3	7.1	5.3	7.5	5.3	7.9	5.2
	39	5.4	4.5	6.0	4.8	6.4	5.1	6.6	5.1	6.8	5.1	7.2	5.0	7.5	4.9
	40	5.2	4.4	5.8	4.7	6.2	5.0	6.4	5.0	6.6	5.0	7.0	4.9	7.3	4.8
	42	4.9	4.1	5.4	4.3	5.8	4.6	5.9	4.6	6.1	4.6	6.5	4.6	6.8	4.5
	44	4.4	3.7	4.9	4.0	5.2	4.2	5.4	4.2	5.6	4.2	5.9	4.1	6.2	4.1
	46	3.9	3.3	4.3	3.5	4.6	3.7	4.8	3.7	4.9	3.7	5.2	3.7	5.4	3.6
027	10	6.6	5.3	7.3	5.7	7.8	6.0	8.0	6.0	8.2	6.0	8.7	5.9	9.1	5.8
	12	6.6	5.3	7.3	5.7	7.8	6.0	8.0	6.0	8.2	6.0	8.7	5.9	9.1	5.8
	14	6.6	5.3	7.3	5.7	7.8	6.0	8.0	6.0	8.2	6.0	8.7	5.9	9.1	5.8
	16	6.6	5.3	7.3	5.7	7.8	6.0	8.0	6.0	8.2	6.0	8.7	5.9	9.1	5.8
	18	6.6	5.3	7.3	5.7	7.8	6.0	8.0	6.0	8.2	6.0	8.7	5.9	9.1	5.8
	20	6.6	5.3	7.3	5.7	7.8	6.0	8.0	6.0	8.2	6.0	8.7	5.9	9.1	5.8
	21	6.6	5.3	7.3	5.7	7.8	6.0	8.0	6.0	8.2	6.0	8.7	5.9	9.1	5.8
	23	6.6	5.3	7.3	5.7	7.8	6.0	8.0	6.0	8.2	6.0	8.7	5.9	9.1	5.8
	25	6.6	5.3	7.3	5.7	7.8	6.0	8.0	6.0	8.2	6.0	8.7	5.9	9.1	5.8
	27	6.6	5.3	7.3	5.7	7.8	6.0	8.0	6.0	8.2	6.0	8.7	5.9	9.1	5.8
	29	6.6	5.3	7.3	5.7	7.8	6.0	8.0	6.0	8.2	6.0	8.7	5.9	9.1	5.8
	31	6.6	5.3	7.3	5.7	7.8	6.0	8.0	6.0	8.2	6.0	8.7	5.9	9.1	5.8
	33	6.6	5.3	7.3	5.7	7.8	6.0	8.0	6.0	8.2	6.0	8.7	5.9	9.1	5.8
	35	6.6	5.3	7.3	5.7	7.8	6.0	8.0	6.0	8.2	6.0	8.7	5.9	9.1	5.8
	37	6.4	5.2	7.0	5.5	7.5	5.8	7.8	5.8	8.0	5.8	8.5	5.8	8.8	5.6
	39	6.1	4.9	6.7	5.3	7.2	5.6	7.4	5.6	7.6	5.6	8.1	5.5	8.5	5.4
	40	5.9	4.8	6.5	5.1	7.0	5.4	7.2	5.4	7.4	5.4	7.8	5.4	8.2	5.2
	42	5.5	4.5	6.1	4.7	6.5	5.0	6.7	5.0	6.9	5.0	7.3	5.0	7.6	4.9
	44	5.0	4.1	5.5	4.3	5.9	4.6	6.1	4.6	6.3	4.6	6.6	4.5	6.9	4.4
	46	4.4	3.6	4.9	3.8	5.2	4.0	5.4	4.0	5.5	4.0	5.9	4.0	6.1	3.9

**4-way Air Discharge Cassette Type (MMU-AP 4HP-E)**

TC : Total capacity [kW] SHC : Sensible capacity [kW]

unit size	outdoor air temp. °CDB	indoor air temp.													
		14°CWB		16°CWB		18°CWB		19°CWB		20°CWB		22°CWB			
		20°CDB	23°CDB	26°CDB	27°CDB	28°CDB	30°CDB	32°CDB	TC	SHC	TC	SHC	TC	SHC	
030	10	7.4	5.9	8.2	6.2	8.7	6.6	9.0	6.6	9.3	6.6	9.8	6.5	10.3	6.4
	12	7.4	5.9	8.2	6.2	8.7	6.6	9.0	6.6	9.3	6.6	9.8	6.5	10.3	6.4
	14	7.4	5.9	8.2	6.2	8.7	6.6	9.0	6.6	9.3	6.6	9.8	6.5	10.3	6.4
	16	7.4	5.9	8.2	6.2	8.7	6.6	9.0	6.6	9.3	6.6	9.8	6.5	10.3	6.4
	18	7.4	5.9	8.2	6.2	8.7	6.6	9.0	6.6	9.3	6.6	9.8	6.5	10.3	6.4
	20	7.4	5.9	8.2	6.2	8.7	6.6	9.0	6.6	9.3	6.6	9.8	6.5	10.3	6.4
	21	7.4	5.9	8.2	6.2	8.7	6.6	9.0	6.6	9.3	6.6	9.8	6.5	10.3	6.4
	23	7.4	5.9	8.2	6.2	8.7	6.6	9.0	6.6	9.3	6.6	9.8	6.5	10.3	6.4
	25	7.4	5.9	8.2	6.2	8.7	6.6	9.0	6.6	9.3	6.6	9.8	6.5	10.3	6.4
	27	7.4	5.9	8.2	6.2	8.7	6.6	9.0	6.6	9.3	6.6	9.8	6.5	10.3	6.4
	29	7.4	5.9	8.2	6.2	8.7	6.6	9.0	6.6	9.3	6.6	9.8	6.5	10.3	6.4
	31	7.4	5.9	8.2	6.2	8.7	6.6	9.0	6.6	9.3	6.6	9.8	6.5	10.3	6.4
	33	7.4	5.9	8.2	6.2	8.7	6.6	9.0	6.6	9.3	6.6	9.8	6.5	10.3	6.4
	35	7.4	5.9	8.2	6.2	8.7	6.6	9.0	6.6	9.3	6.6	9.8	6.5	10.3	6.4
	37	7.2	5.7	7.9	6.0	8.5	6.4	8.7	6.4	9.0	6.4	9.5	6.3	10.0	6.2
	39	6.8	5.4	7.6	5.8	8.1	6.1	8.3	6.1	8.6	6.1	9.1	6.1	9.5	5.9
	40	6.7	5.3	7.4	5.6	7.9	6.0	8.1	5.9	8.3	5.9	8.8	5.9	9.2	5.7
	42	6.2	4.9	6.8	5.2	7.3	5.5	7.5	5.5	7.8	5.5	8.2	5.5	8.6	5.3
	44	5.6	4.5	6.2	4.7	6.6	5.0	6.9	5.0	7.1	5.0	7.5	5.0	7.8	4.9
	46	5.0	3.9	5.5	4.2	5.9	4.5	6.1	4.4	6.2	4.4	6.6	4.4	6.9	4.3
036	10	9.2	7.6	10.2	8.1	10.9	8.6	11.2	8.6	11.5	8.6	12.2	8.5	12.8	8.3
	12	9.2	7.6	10.2	8.1	10.9	8.6	11.2	8.6	11.5	8.6	12.2	8.5	12.8	8.3
	14	9.2	7.6	10.2	8.1	10.9	8.6	11.2	8.6	11.5	8.6	12.2	8.5	12.8	8.3
	16	9.2	7.6	10.2	8.1	10.9	8.6	11.2	8.6	11.5	8.6	12.2	8.5	12.8	8.3
	18	9.2	7.6	10.2	8.1	10.9	8.6	11.2	8.6	11.5	8.6	12.2	8.5	12.8	8.3
	20	9.2	7.6	10.2	8.1	10.9	8.6	11.2	8.6	11.5	8.6	12.2	8.5	12.8	8.3
	21	9.2	7.6	10.2	8.1	10.9	8.6	11.2	8.6	11.5	8.6	12.2	8.5	12.8	8.3
	23	9.2	7.6	10.2	8.1	10.9	8.6	11.2	8.6	11.5	8.6	12.2	8.5	12.8	8.3
	25	9.2	7.6	10.2	8.1	10.9	8.6	11.2	8.6	11.5	8.6	12.2	8.5	12.8	8.3
	27	9.2	7.6	10.2	8.1	10.9	8.6	11.2	8.6	11.5	8.6	12.2	8.5	12.8	8.3
	29	9.2	7.6	10.2	8.1	10.9	8.6	11.2	8.6	11.5	8.6	12.2	8.5	12.8	8.3
	31	9.2	7.6	10.2	8.1	10.9	8.6	11.2	8.6	11.5	8.6	12.2	8.5	12.8	8.3
	33	9.2	7.6	10.2	8.1	10.9	8.6	11.2	8.6	11.5	8.6	12.2	8.5	12.8	8.3
	35	9.2	7.6	10.2	8.1	10.9	8.6	11.2	8.6	11.5	8.6	12.2	8.5	12.8	8.3
	37	9.0	7.4	9.9	7.9	10.6	8.4	10.9	8.4	11.3	8.4	11.9	8.3	12.5	8.1
	39	8.6	7.1	9.5	7.6	10.2	8.1	10.5	8.1	10.8	8.1	11.4	8.0	12.0	7.8
	40	8.4	7.0	9.3	7.4	9.9	7.9	10.2	7.8	10.5	7.8	11.1	7.8	11.6	7.6
	42	7.8	6.5	8.7	6.9	9.3	7.4	9.5	7.3	9.8	7.3	10.4	7.3	10.9	7.1
	44	7.2	5.9	7.9	6.3	8.5	6.7	8.7	6.7	9.0	6.7	9.5	6.6	9.9	6.5
	46	6.4	5.3	7.0	5.6	7.5	6.0	7.7	5.9	8.0	5.9	8.4	5.9	8.8	5.8
048	10	11.5	9.5	12.7	10.1	13.6	10.7	14.0	10.7	14.4	10.7	15.3	10.6	16.0	10.4
	12	11.5	9.5	12.7	10.1	13.6	10.7	14.0	10.7	14.4	10.7	15.3	10.6	16.0	10.4
	14	11.5	9.5	12.7	10.1	13.6	10.7	14.0	10.7	14.4	10.7	15.3	10.6	16.0	10.4
	16	11.5	9.5	12.7	10.1	13.6	10.7	14.0	10.7	14.4	10.7	15.3	10.6	16.0	10.4
	18	11.5	9.5	12.7	10.1	13.6	10.7	14.0	10.7	14.4	10.7	15.3	10.6	16.0	10.4
	20	11.5	9.5	12.7	10.1	13.6	10.7	14.0	10.7	14.4	10.7	15.3	10.6	16.0	10.4
	21	11.5	9.5	12.7	10.1	13.6	10.7	14.0	10.7	14.4	10.7	15.3	10.6	16.0	10.4
	23	11.5	9.5	12.7	10.1	13.6	10.7	14.0	10.7	14.4	10.7	15.3	10.6	16.0	10.4
	25	11.5	9.5	12.7	10.1	13.6	10.7	14.0	10.7	14.4	10.7	15.3	10.6	16.0	10.4
	27	11.5	9.5	12.7	10.1	13.6	10.7	14.0	10.7	14.4	10.7	15.3	10.6	16.0	10.4
	29	11.5	9.5	12.7	10.1	13.6	10.7	14.0	10.7	14.4	10.7	15.3	10.6	16.0	10.4
	31	11.5	9.5	12.7	10.1	13.6	10.7	14.0	10.7	14.4	10.7	15.3	10.6	16.0	10.4
	33	11.5	9.5	12.7	10.1	13.6	10.7	14.0	10.7	14.4	10.7	15.3	10.6	16.0	10.4
	35	11.5	9.5	12.7	10.1	13.6	10.7	14.0	10.7	14.4	10.7	15.3	10.6	16.0	10.4
	37	11.1	9.2	12.3	9.8	13.2	10.4	13.6	10.4	14.0	10.4	14.8	10.3	15.5	10.0
	39	10.7	8.8	11.8	9.4	12.6	9.9	13.0	9.9	13.4	9.9	14.1	9.8	14.8	9.6
	40	10.3	8.5	11.4	9.1	12.2	9.7	12.6	9.6	13.0	9.6	13.7	9.5	14.4	9.3
	42	9.6	7.9	10.6	8.5	11.4	9.0	11.7	9.0	12.1	9.0	12.8	8.9	13.4	8.7
	44	8.8	7.2	9.7	7.7	10.3	8.2	10.7	8.1	11.0	8.1	11.6	8.1	12.2	7.9
	46	7.7	6.4	8.5	6.8	9.1	7.2	9.4	7.2	9.7	7.2	10.3	7.1	10.7	7.0



## 4-way Air Discharge Cassette Type (MMU-AP 4HP-E)

TC : Total capacity [kW] SHC : Sensible capacity [kW]

unit size	outdoor air temp. °CDB	indoor air temp.													
		14°CWB		16°CWB		18°CWB		19°CWB		20°CWB		22°CWB			
		20°CDB	23°CDB	26°CDB	27°CDB	28°CDB	30°CDB	32°CDB	TC	SHC	TC	SHC	TC	SHC	
056	10	13.1	10.6	14.5	11.3	15.5	12.0	16.0	12.0	16.5	12.0	17.4	11.9	18.2	11.6
	12	13.1	10.6	14.5	11.3	15.5	12.0	16.0	12.0	16.5	12.0	17.4	11.9	18.2	11.6
	14	13.1	10.6	14.5	11.3	15.5	12.0	16.0	12.0	16.5	12.0	17.4	11.9	18.2	11.6
	16	13.1	10.6	14.5	11.3	15.5	12.0	16.0	12.0	16.5	12.0	17.4	11.9	18.2	11.6
	18	13.1	10.6	14.5	11.3	15.5	12.0	16.0	12.0	16.5	12.0	17.4	11.9	18.2	11.6
	20	13.1	10.6	14.5	11.3	15.5	12.0	16.0	12.0	16.5	12.0	17.4	11.9	18.2	11.6
	21	13.1	10.6	14.5	11.3	15.5	12.0	16.0	12.0	16.5	12.0	17.4	11.9	18.2	11.6
	23	13.1	10.6	14.5	11.3	15.5	12.0	16.0	12.0	16.5	12.0	17.4	11.9	18.2	11.6
	25	13.1	10.6	14.5	11.3	15.5	12.0	16.0	12.0	16.5	12.0	17.4	11.9	18.2	11.6
	27	13.1	10.6	14.5	11.3	15.5	12.0	16.0	12.0	16.5	12.0	17.4	11.9	18.2	11.6
	29	13.1	10.6	14.5	11.3	15.5	12.0	16.0	12.0	16.5	12.0	17.4	11.9	18.2	11.6
	31	13.1	10.6	14.5	11.3	15.5	12.0	16.0	12.0	16.5	12.0	17.4	11.9	18.2	11.6
	33	13.1	10.6	14.5	11.3	15.5	12.0	16.0	12.0	16.5	12.0	17.4	11.9	18.2	11.6
	35	13.1	10.6	14.5	11.3	15.5	12.0	16.0	12.0	16.5	12.0	17.4	11.9	18.2	11.6
	37	12.7	10.3	14.1	11.0	15.1	11.7	15.5	11.6	16.0	11.6	16.9	11.5	17.7	11.3
	39	12.2	9.9	13.5	10.5	14.4	11.2	14.8	11.1	15.3	11.1	16.2	11.0	16.9	10.8
	40	11.8	9.6	13.1	10.2	14.0	10.8	14.4	10.8	14.8	10.8	15.7	10.7	16.4	10.5
	42	11.0	8.9	12.2	9.5	13.0	10.1	13.4	10.0	13.8	10.0	14.6	10.0	15.3	9.7
	44	10.0	8.1	11.1	8.6	11.8	9.2	12.2	9.1	12.5	9.1	13.3	9.1	13.9	8.8
	46	8.8	7.2	9.8	7.6	10.4	8.1	10.8	8.1	11.1	8.1	11.7	8.0	12.3	7.8



## Compact 4-way Cassette (600 x 600) Type ( MMU-AP 6MH-E)

TC : Total capacity [kW] SHC : Sensible capacity [kW]

unit size	outdoor air temp. °CDB	indoor air temp.													
		14°CWB		16°CWB		18°CWB		19°CWB		20°CWB		22°CWB			
		20°CDB	23°CDB	26°CDB	27°CDB	28°CDB	30°CDB	32°CDB	TC	SHC	TC	SHC	TC	SHC	
005	10	1.4	1.3	1.5	1.4	1.6	1.5	1.7	1.5	1.8	1.5	1.9	1.5	1.9	1.5
	12	1.4	1.3	1.5	1.4	1.6	1.5	1.7	1.5	1.8	1.5	1.9	1.5	1.9	1.5
	14	1.4	1.3	1.5	1.4	1.6	1.5	1.7	1.5	1.8	1.5	1.9	1.5	1.9	1.5
	16	1.4	1.3	1.5	1.4	1.6	1.5	1.7	1.5	1.8	1.5	1.9	1.5	1.9	1.5
	18	1.4	1.3	1.5	1.4	1.6	1.5	1.7	1.5	1.8	1.5	1.9	1.5	1.9	1.5
	20	1.4	1.3	1.5	1.4	1.6	1.5	1.7	1.5	1.8	1.5	1.9	1.5	1.9	1.5
	21	1.4	1.3	1.5	1.4	1.6	1.5	1.7	1.5	1.8	1.5	1.9	1.5	1.9	1.5
	23	1.4	1.3	1.5	1.4	1.6	1.5	1.7	1.5	1.8	1.5	1.9	1.5	1.9	1.5
	25	1.4	1.3	1.5	1.4	1.6	1.5	1.7	1.5	1.8	1.5	1.9	1.5	1.9	1.5
	27	1.4	1.3	1.5	1.4	1.6	1.5	1.7	1.5	1.8	1.5	1.9	1.5	1.9	1.5
	29	1.4	1.3	1.5	1.4	1.6	1.5	1.7	1.5	1.8	1.5	1.9	1.5	1.9	1.5
	31	1.4	1.3	1.5	1.4	1.6	1.5	1.7	1.5	1.8	1.5	1.9	1.5	1.9	1.5
	33	1.4	1.3	1.5	1.4	1.6	1.5	1.7	1.5	1.8	1.5	1.9	1.5	1.9	1.5
	35	1.4	1.3	1.5	1.4	1.6	1.5	1.7	1.5	1.8	1.5	1.9	1.5	1.9	1.5
	37	1.4	1.3	1.5	1.4	1.6	1.5	1.6	1.5	1.7	1.5	1.8	1.4	1.9	1.4
	39	1.3	1.2	1.4	1.3	1.5	1.4	1.6	1.4	1.6	1.4	1.7	1.4	1.8	1.3
	40	1.3	1.2	1.4	1.3	1.5	1.4	1.5	1.4	1.6	1.4	1.7	1.3	1.7	1.3
	42	1.2	1.1	1.3	1.2	1.4	1.3	1.4	1.3	1.5	1.3	1.6	1.2	1.6	1.2
	44	1.1	1.0	1.2	1.1	1.3	1.1	1.3	1.1	1.3	1.1	1.4	1.1	1.5	1.1
	46	0.9	0.9	1.0	1.0	1.1	1.0	1.1	1.0	1.2	1.0	1.2	1.0	1.3	1.0



## Compact 4-way Cassette (600 x 600) Type ( MMU-AP \_\_\_\_ 4MH-E)

TC : Total capacity [kW] SHC : Sensible capacity [kW]

unit size	outdoor air temp. °CDB	indoor air temp.											
		14°CWB		16°CWB		18°CWB		19°CWB		20°CWB		22°CWB	
		20°CDB		23°CDB		26°CDB		27°CDB		28°CDB		30°CDB	
		TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
007	10	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8
	12	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8
	14	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8
	16	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8
	18	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8
	20	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8
	21	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8
	23	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8
	25	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8
	27	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8
	29	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8
	31	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8
	33	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8
	35	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8
	37	1.8	1.5	1.9	1.6	2.1	1.8	2.1	1.7	2.2	1.7	2.3	1.7
	39	1.7	1.5	1.9	1.6	2.0	1.7	2.0	1.7	2.1	1.7	2.2	1.7
	40	1.6	1.4	1.8	1.5	1.9	1.6	2.0	1.6	2.0	1.6	2.2	1.6
	42	1.5	1.3	1.7	1.4	1.8	1.5	1.8	1.5	1.9	1.5	2.0	1.5
	44	1.4	1.2	1.5	1.3	1.6	1.4	1.7	1.4	1.7	1.4	1.8	1.4
	46	1.2	1.1	1.3	1.1	1.4	1.2	1.5	1.2	1.5	1.2	1.6	1.2
009	10	2.3	2.0	2.5	2.1	2.7	2.2	2.8	2.2	2.9	2.2	3.1	2.2
	12	2.3	2.0	2.5	2.1	2.7	2.2	2.8	2.2	2.9	2.2	3.1	2.2
	14	2.3	2.0	2.5	2.1	2.7	2.2	2.8	2.2	2.9	2.2	3.1	2.2
	16	2.3	2.0	2.5	2.1	2.7	2.2	2.8	2.2	2.9	2.2	3.1	2.2
	18	2.3	2.0	2.5	2.1	2.7	2.2	2.8	2.2	2.9	2.2	3.1	2.2
	20	2.3	2.0	2.5	2.1	2.7	2.2	2.8	2.2	2.9	2.2	3.1	2.2
	21	2.3	2.0	2.5	2.1	2.7	2.2	2.8	2.2	2.9	2.2	3.1	2.2
	23	2.3	2.0	2.5	2.1	2.7	2.2	2.8	2.2	2.9	2.2	3.1	2.2
	25	2.3	2.0	2.5	2.1	2.7	2.2	2.8	2.2	2.9	2.2	3.1	2.2
	27	2.3	2.0	2.5	2.1	2.7	2.2	2.8	2.2	2.9	2.2	3.1	2.2
	29	2.3	2.0	2.5	2.1	2.7	2.2	2.8	2.2	2.9	2.2	3.1	2.2
	31	2.3	2.0	2.5	2.1	2.7	2.2	2.8	2.2	2.9	2.2	3.1	2.2
	33	2.3	2.0	2.5	2.1	2.7	2.2	2.8	2.2	2.9	2.2	3.1	2.2
	35	2.3	2.0	2.5	2.1	2.7	2.2	2.8	2.2	2.9	2.2	3.1	2.2
	37	2.2	1.9	2.5	2.0	2.6	2.1	2.7	2.1	2.8	2.1	3.0	2.1
	39	2.1	1.8	2.4	1.9	2.5	2.0	2.6	2.0	2.7	2.0	2.8	2.0
	40	2.1	1.8	2.3	1.9	2.4	2.0	2.5	2.0	2.6	2.0	2.7	2.0
	42	1.9	1.6	2.1	1.7	2.3	1.8	2.3	1.8	2.4	1.8	2.6	1.8
	44	1.8	1.5	1.9	1.6	2.1	1.7	2.1	1.7	2.2	1.7	2.3	1.7
	46	1.5	1.3	1.7	1.4	1.8	1.5	1.9	1.5	1.9	1.5	2.1	1.4

# Sensible capacity table



## Compact 4-way Cassette (600 x 600) Type ( MMU-AP 4MH-E)

TC : Total capacity [kW] SHC : Sensible capacity [kW]

unit size	outdoor air temp. °CDB	indoor air temp.													
		14°CWB		16°CWB		18°CWB		19°CWB		20°CWB		22°CWB			
		20°CDB		23°CDB		26°CDB		27°CDB		28°CDB		30°CDB			
TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC		
012	10	3.0	2.4	3.3	2.5	3.5	2.7	3.6	2.7	3.7	2.7	3.9	2.7	4.1	2.6
	12	3.0	2.4	3.3	2.5	3.5	2.7	3.6	2.7	3.7	2.7	3.9	2.7	4.1	2.6
	14	3.0	2.4	3.3	2.5	3.5	2.7	3.6	2.7	3.7	2.7	3.9	2.7	4.1	2.6
	16	3.0	2.4	3.3	2.5	3.5	2.7	3.6	2.7	3.7	2.7	3.9	2.7	4.1	2.6
	18	3.0	2.4	3.3	2.5	3.5	2.7	3.6	2.7	3.7	2.7	3.9	2.7	4.1	2.6
	20	3.0	2.4	3.3	2.5	3.5	2.7	3.6	2.7	3.7	2.7	3.9	2.7	4.1	2.6
	21	3.0	2.4	3.3	2.5	3.5	2.7	3.6	2.7	3.7	2.7	3.9	2.7	4.1	2.6
	23	3.0	2.4	3.3	2.5	3.5	2.7	3.6	2.7	3.7	2.7	3.9	2.7	4.1	2.6
	25	3.0	2.4	3.3	2.5	3.5	2.7	3.6	2.7	3.7	2.7	3.9	2.7	4.1	2.6
	27	3.0	2.4	3.3	2.5	3.5	2.7	3.6	2.7	3.7	2.7	3.9	2.7	4.1	2.6
	29	3.0	2.4	3.3	2.5	3.5	2.7	3.6	2.7	3.7	2.7	3.9	2.7	4.1	2.6
	31	3.0	2.4	3.3	2.5	3.5	2.7	3.6	2.7	3.7	2.7	3.9	2.7	4.1	2.6
	33	3.0	2.4	3.3	2.5	3.5	2.7	3.6	2.7	3.7	2.7	3.9	2.7	4.1	2.6
	35	3.0	2.4	3.3	2.5	3.5	2.7	3.6	2.7	3.7	2.7	3.9	2.7	4.1	2.6
	37	2.9	2.3	3.2	2.5	3.4	2.6	3.5	2.6	3.6	2.6	3.8	2.6	4.0	2.5
	39	2.7	2.2	3.0	2.4	3.2	2.5	3.3	2.5	3.4	2.5	3.6	2.5	3.8	2.4
	40	2.7	2.2	2.9	2.3	3.1	2.4	3.2	2.4	3.3	2.4	3.5	2.4	3.7	2.4
	42	2.5	2.0	2.7	2.1	2.9	2.3	3.0	2.3	3.1	2.3	3.3	2.2	3.4	2.2
	44	2.3	1.8	2.5	1.9	2.7	2.1	2.7	2.1	2.8	2.1	3.0	2.0	3.1	2.0
	46	2.0	1.6	2.2	1.7	2.3	1.8	2.4	1.8	2.5	1.8	2.6	1.8	2.8	1.8
015	10	3.7	2.9	4.1	3.1	4.4	3.3	4.5	3.3	4.6	3.3	4.9	3.3	5.1	3.2
	12	3.7	2.9	4.1	3.1	4.4	3.3	4.5	3.3	4.6	3.3	4.9	3.3	5.1	3.2
	14	3.7	2.9	4.1	3.1	4.4	3.3	4.5	3.3	4.6	3.3	4.9	3.3	5.1	3.2
	16	3.7	2.9	4.1	3.1	4.4	3.3	4.5	3.3	4.6	3.3	4.9	3.3	5.1	3.2
	18	3.7	2.9	4.1	3.1	4.4	3.3	4.5	3.3	4.6	3.3	4.9	3.3	5.1	3.2
	20	3.7	2.9	4.1	3.1	4.4	3.3	4.5	3.3	4.6	3.3	4.9	3.3	5.1	3.2
	21	3.7	2.9	4.1	3.1	4.4	3.3	4.5	3.3	4.6	3.3	4.9	3.3	5.1	3.2
	23	3.7	2.9	4.1	3.1	4.4	3.3	4.5	3.3	4.6	3.3	4.9	3.3	5.1	3.2
	25	3.7	2.9	4.1	3.1	4.4	3.3	4.5	3.3	4.6	3.3	4.9	3.3	5.1	3.2
	27	3.7	2.9	4.1	3.1	4.4	3.3	4.5	3.3	4.6	3.3	4.9	3.3	5.1	3.2
	29	3.7	2.9	4.1	3.1	4.4	3.3	4.5	3.3	4.6	3.3	4.9	3.3	5.1	3.2
	31	3.7	2.9	4.1	3.1	4.4	3.3	4.5	3.3	4.6	3.3	4.9	3.3	5.1	3.2
	33	3.7	2.9	4.1	3.1	4.4	3.3	4.5	3.3	4.6	3.3	4.9	3.3	5.1	3.2
	35	3.7	2.9	4.1	3.1	4.4	3.3	4.5	3.3	4.6	3.3	4.9	3.3	5.1	3.2
	37	3.6	2.8	4.0	3.0	4.2	3.2	4.4	3.2	4.5	3.2	4.8	3.2	5.0	3.1
	39	3.4	2.7	3.8	2.9	4.0	3.1	4.2	3.1	4.3	3.1	4.5	3.0	4.8	3.0
	40	3.3	2.6	3.7	2.8	3.9	3.0	4.1	3.0	4.2	3.0	4.4	2.9	4.6	2.9
	42	3.1	2.4	3.4	2.6	3.7	2.8	3.8	2.8	3.9	2.8	4.1	2.7	4.3	2.7
	44	2.8	2.2	3.1	2.4	3.3	2.5	3.4	2.5	3.5	2.5	3.7	2.5	3.9	2.4
	46	2.5	2.0	2.7	2.1	2.9	2.2	3.0	2.2	3.1	2.2	3.3	2.2	3.4	2.1
018	10	4.6	3.5	5.1	3.8	5.4	4.0	5.6	4.0	5.8	4.0	6.1	4.0	6.4	3.9
	12	4.6	3.5	5.1	3.8	5.4	4.0	5.6	4.0	5.8	4.0	6.1	4.0	6.4	3.9
	14	4.6	3.5	5.1	3.8	5.4	4.0	5.6	4.0	5.8	4.0	6.1	4.0	6.4	3.9
	16	4.6	3.5	5.1	3.8	5.4	4.0	5.6	4.0	5.8	4.0	6.1	4.0	6.4	3.9
	18	4.6	3.5	5.1	3.8	5.4	4.0	5.6	4.0	5.8	4.0	6.1	4.0	6.4	3.9
	20	4.6	3.5	5.1	3.8	5.4	4.0	5.6	4.0	5.8	4.0	6.1	4.0	6.4	3.9
	21	4.6	3.5	5.1	3.8	5.4	4.0	5.6	4.0	5.8	4.0	6.1	4.0	6.4	3.9
	23	4.6	3.5	5.1	3.8	5.4	4.0	5.6	4.0	5.8	4.0	6.1	4.0	6.4	3.9
	25	4.6	3.5	5.1	3.8	5.4	4.0	5.6	4.0	5.8	4.0	6.1	4.0	6.4	3.9
	27	4.6	3.5	5.1	3.8	5.4	4.0	5.6	4.0	5.8	4.0	6.1	4.0	6.4	3.9
	29	4.6	3.5	5.1	3.8	5.4	4.0	5.6	4.0	5.8	4.0	6.1	4.0	6.4	3.9
	31	4.6	3.5	5.1	3.8	5.4	4.0	5.6	4.0	5.8	4.0	6.1	4.0	6.4	3.9
	33	4.6	3.5	5.1	3.8	5.4	4.0	5.6	4.0	5.8	4.0	6.1	4.0	6.4	3.9
	35	4.6	3.5	5.1	3.8	5.4	4.0	5.6	4.0	5.8	4.0	6.1	4.0	6.4	3.9
	37	4.5	3.4	4.9	3.7	5.3	3.9	5.4	3.9	5.6	3.9	5.9	3.8	6.2	3.8
	39	4.3	3.3	4.7	3.5	5.0	3.7	5.2	3.7	5.3	3.7	5.7	3.7	5.9	3.6
	40	4.1	3.2	4.6	3.4	4.9	3.6	5.0	3.6	5.2	3.6	5.5	3.6	5.7	3.5
	42	3.8	3.0	4.3	3.2	4.5	3.4	4.7	3.3	4.8	3.3	5.1	3.3	5.3	3.2
	44	3.5	2.7	3.9	2.9	4.1	3.1	4.3	3.0	4.4	3.0	4.6	3.0	4.9	2.9
	46	3.1	2.4	3.4	2.5	3.7	2.7	3.8	2.7	3.9	2.7	4.1	2.7	4.3	2.6

# Sensible capacity table



## 2-way Air Discharge Cassette Type ( MMU-AP 2WH )

TC : Total capacity [kW] SHC : Sensible capacity [kW]

unit size	outdoor air temp. °CDB	indoor air temp.													
		14°CWB		16°CWB		18°CWB		19°CWB		20°CWB		22°CWB		24°CWB	
		20°CDB	23°CDB	26°CDB	27°CDB	28°CDB	30°CDB	32°CDB	TC	SHC	TC	SHC	TC	SHC	TC
007	10	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	12	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	14	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	16	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	18	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	20	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	21	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	23	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	25	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	27	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	29	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	31	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	33	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	35	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	37	1.8	1.5	1.9	1.6	2.1	1.8	2.1	1.7	2.2	1.7	2.3	1.7	2.4	1.7
	39	1.7	1.5	1.9	1.6	2.0	1.7	2.0	1.7	2.1	1.7	2.2	1.7	2.3	1.6
	40	1.6	1.4	1.8	1.5	1.9	1.6	2.0	1.6	2.0	1.6	2.2	1.6	2.3	1.6
	42	1.5	1.3	1.7	1.4	1.8	1.5	1.8	1.5	1.9	1.5	2.0	1.5	2.1	1.5
	44	1.4	1.2	1.5	1.3	1.6	1.4	1.7	1.4	1.7	1.4	1.8	1.4	1.9	1.3
	46	1.2	1.1	1.3	1.1	1.4	1.2	1.5	1.2	1.5	1.2	1.6	1.2	1.7	1.2
009	10	2.3	2.0	2.5	2.1	2.7	2.2	2.8	2.2	2.9	2.2	3.1	2.2	3.2	2.1
	12	2.3	2.0	2.5	2.1	2.7	2.2	2.8	2.2	2.9	2.2	3.1	2.2	3.2	2.1
	14	2.3	2.0	2.5	2.1	2.7	2.2	2.8	2.2	2.9	2.2	3.1	2.2	3.2	2.1
	16	2.3	2.0	2.5	2.1	2.7	2.2	2.8	2.2	2.9	2.2	3.1	2.2	3.2	2.1
	18	2.3	2.0	2.5	2.1	2.7	2.2	2.8	2.2	2.9	2.2	3.1	2.2	3.2	2.1
	20	2.3	2.0	2.5	2.1	2.7	2.2	2.8	2.2	2.9	2.2	3.1	2.2	3.2	2.1
	21	2.3	2.0	2.5	2.1	2.7	2.2	2.8	2.2	2.9	2.2	3.1	2.2	3.2	2.1
	23	2.3	2.0	2.5	2.1	2.7	2.2	2.8	2.2	2.9	2.2	3.1	2.2	3.2	2.1
	25	2.3	2.0	2.5	2.1	2.7	2.2	2.8	2.2	2.9	2.2	3.1	2.2	3.2	2.1
	27	2.3	2.0	2.5	2.1	2.7	2.2	2.8	2.2	2.9	2.2	3.1	2.2	3.2	2.1
	29	2.3	2.0	2.5	2.1	2.7	2.2	2.8	2.2	2.9	2.2	3.1	2.2	3.2	2.1
	31	2.3	2.0	2.5	2.1	2.7	2.2	2.8	2.2	2.9	2.2	3.1	2.2	3.2	2.1
	33	2.3	2.0	2.5	2.1	2.7	2.2	2.8	2.2	2.9	2.2	3.1	2.2	3.2	2.1
	35	2.3	2.0	2.5	2.1	2.7	2.2	2.8	2.2	2.9	2.2	3.1	2.2	3.2	2.1
	37	2.2	1.9	2.5	2.0	2.6	2.1	2.7	2.1	2.8	2.1	3.0	2.1	3.1	2.1
	39	2.1	1.8	2.4	1.9	2.5	2.0	2.6	2.0	2.7	2.0	2.8	2.0	3.0	2.0
	40	2.1	1.8	2.3	1.9	2.4	2.0	2.5	2.0	2.6	2.0	2.7	2.0	2.9	1.9
	42	1.9	1.6	2.1	1.7	2.3	1.8	2.3	1.8	2.4	1.8	2.6	1.8	2.7	1.8
	44	1.8	1.5	1.9	1.6	2.1	1.7	2.1	1.7	2.2	1.7	2.3	1.7	2.4	1.6
	46	1.5	1.3	1.7	1.4	1.8	1.5	1.9	1.5	1.9	1.5	2.1	1.5	2.1	1.4
012	10	3.0	2.4	3.3	2.5	3.5	2.7	3.6	2.7	3.7	2.7	3.9	2.7	4.1	2.6
	12	3.0	2.4	3.3	2.5	3.5	2.7	3.6	2.7	3.7	2.7	3.9	2.7	4.1	2.6
	14	3.0	2.4	3.3	2.5	3.5	2.7	3.6	2.7	3.7	2.7	3.9	2.7	4.1	2.6
	16	3.0	2.4	3.3	2.5	3.5	2.7	3.6	2.7	3.7	2.7	3.9	2.7	4.1	2.6
	18	3.0	2.4	3.3	2.5	3.5	2.7	3.6	2.7	3.7	2.7	3.9	2.7	4.1	2.6
	20	3.0	2.4	3.3	2.5	3.5	2.7	3.6	2.7	3.7	2.7	3.9	2.7	4.1	2.6
	21	3.0	2.4	3.3	2.5	3.5	2.7	3.6	2.7	3.7	2.7	3.9	2.7	4.1	2.6
	23	3.0	2.4	3.3	2.5	3.5	2.7	3.6	2.7	3.7	2.7	3.9	2.7	4.1	2.6
	25	3.0	2.4	3.3	2.5	3.5	2.7	3.6	2.7	3.7	2.7	3.9	2.7	4.1	2.6
	27	3.0	2.4	3.3	2.5	3.5	2.7	3.6	2.7	3.7	2.7	3.9	2.7	4.1	2.6
	29	3.0	2.4	3.3	2.5	3.5	2.7	3.6	2.7	3.7	2.7	3.9	2.7	4.1	2.6
	31	3.0	2.4	3.3	2.5	3.5	2.7	3.6	2.7	3.7	2.7	3.9	2.7	4.1	2.6
	33	3.0	2.4	3.3	2.5	3.5	2.7	3.6	2.7	3.7	2.7	3.9	2.7	4.1	2.6
	35	3.0	2.4	3.3	2.5	3.5	2.7	3.6	2.7	3.7	2.7	3.9	2.7	4.1	2.6
	37	2.9	2.3	3.2	2.5	3.4	2.6	3.5	2.6	3.6	2.6	3.8	2.6	4.0	2.5
	39	2.7	2.2	3.0	2.4	3.2	2.5	3.3	2.5	3.4	2.5	3.6	2.5	3.8	2.4
	40	2.7	2.2	2.9	2.3	3.1	2.4	3.2	2.4	3.3	2.4	3.5	2.4	3.7	2.4
	42	2.5	2.0	2.7	2.1	2.9	2.3	3.0	2.3	3.1	2.3	3.3	2.2	3.4	2.2
	44	2.3	1.8	2.5	1.9	2.7	2.1	2.7	2.1	2.8	2.1	3.0	2.0	3.1	2.0
	46	2.0	1.6	2.2	1.7	2.3	1.8	2.4	1.8	2.5	1.8	2.6	1.8	2.8	1.8

# Sensible capacity table



## 2-way Air Discharge Cassette Type ( MMU-AP 2WH )

TC : Total capacity [kW] SHC : Sensible capacity [kW]

unit size	outdoor air temp. °CDB	indoor air temp.													
		14°CWB		16°CWB		18°CWB		19°CWB		20°CWB		22°CWB		24°CWB	
		20°CDB		23°CDB		26°CDB		27°CDB		28°CDB		30°CDB		32°CDB	
		TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
015	10	3.7	2.8	4.1	3.0	4.4	3.2	4.5	3.2	4.6	3.2	4.9	3.2	5.1	3.1
	12	3.7	2.8	4.1	3.0	4.4	3.2	4.5	3.2	4.6	3.2	4.9	3.2	5.1	3.1
	14	3.7	2.8	4.1	3.0	4.4	3.2	4.5	3.2	4.6	3.2	4.9	3.2	5.1	3.1
	16	3.7	2.8	4.1	3.0	4.4	3.2	4.5	3.2	4.6	3.2	4.9	3.2	5.1	3.1
	18	3.7	2.8	4.1	3.0	4.4	3.2	4.5	3.2	4.6	3.2	4.9	3.2	5.1	3.1
	20	3.7	2.8	4.1	3.0	4.4	3.2	4.5	3.2	4.6	3.2	4.9	3.2	5.1	3.1
	21	3.7	2.8	4.1	3.0	4.4	3.2	4.5	3.2	4.6	3.2	4.9	3.2	5.1	3.1
	23	3.7	2.8	4.1	3.0	4.4	3.2	4.5	3.2	4.6	3.2	4.9	3.2	5.1	3.1
	25	3.7	2.8	4.1	3.0	4.4	3.2	4.5	3.2	4.6	3.2	4.9	3.2	5.1	3.1
	27	3.7	2.8	4.1	3.0	4.4	3.2	4.5	3.2	4.6	3.2	4.9	3.2	5.1	3.1
	29	3.7	2.8	4.1	3.0	4.4	3.2	4.5	3.2	4.6	3.2	4.9	3.2	5.1	3.1
	31	3.7	2.8	4.1	3.0	4.4	3.2	4.5	3.2	4.6	3.2	4.9	3.2	5.1	3.1
	33	3.7	2.8	4.1	3.0	4.4	3.2	4.5	3.2	4.6	3.2	4.9	3.2	5.1	3.1
	35	3.7	2.8	4.1	3.0	4.4	3.2	4.5	3.2	4.6	3.2	4.9	3.2	5.1	3.1
	37	3.6	2.8	4.0	2.9	4.2	3.1	4.4	3.1	4.5	3.1	4.8	3.1	5.0	3.0
	39	3.4	2.6	3.8	2.8	4.0	3.0	4.2	3.0	4.3	3.0	4.5	2.9	4.8	2.9
	40	3.3	2.6	3.7	2.7	3.9	2.9	4.1	2.9	4.2	2.9	4.4	2.9	4.6	2.8
	42	3.1	2.4	3.4	2.5	3.7	2.7	3.8	2.7	3.9	2.7	4.1	2.7	4.3	2.6
	44	2.8	2.2	3.1	2.3	3.3	2.4	3.4	2.4	3.5	2.4	3.7	2.4	3.9	2.4
	46	2.5	1.9	2.7	2.0	2.9	2.2	3.0	2.2	3.1	2.2	3.3	2.1	3.4	2.1
018	10	4.6	3.6	5.1	3.9	5.4	4.1	5.6	4.1	5.8	4.1	6.1	4.1	6.4	4.0
	12	4.6	3.6	5.1	3.9	5.4	4.1	5.6	4.1	5.8	4.1	6.1	4.1	6.4	4.0
	14	4.6	3.6	5.1	3.9	5.4	4.1	5.6	4.1	5.8	4.1	6.1	4.1	6.4	4.0
	16	4.6	3.6	5.1	3.9	5.4	4.1	5.6	4.1	5.8	4.1	6.1	4.1	6.4	4.0
	18	4.6	3.6	5.1	3.9	5.4	4.1	5.6	4.1	5.8	4.1	6.1	4.1	6.4	4.0
	20	4.6	3.6	5.1	3.9	5.4	4.1	5.6	4.1	5.8	4.1	6.1	4.1	6.4	4.0
	21	4.6	3.6	5.1	3.9	5.4	4.1	5.6	4.1	5.8	4.1	6.1	4.1	6.4	4.0
	23	4.6	3.6	5.1	3.9	5.4	4.1	5.6	4.1	5.8	4.1	6.1	4.1	6.4	4.0
	25	4.6	3.6	5.1	3.9	5.4	4.1	5.6	4.1	5.8	4.1	6.1	4.1	6.4	4.0
	27	4.6	3.6	5.1	3.9	5.4	4.1	5.6	4.1	5.8	4.1	6.1	4.1	6.4	4.0
	29	4.6	3.6	5.1	3.9	5.4	4.1	5.6	4.1	5.8	4.1	6.1	4.1	6.4	4.0
	31	4.6	3.6	5.1	3.9	5.4	4.1	5.6	4.1	5.8	4.1	6.1	4.1	6.4	4.0
	33	4.6	3.6	5.1	3.9	5.4	4.1	5.6	4.1	5.8	4.1	6.1	4.1	6.4	4.0
	35	4.6	3.6	5.1	3.9	5.4	4.1	5.6	4.1	5.8	4.1	6.1	4.1	6.4	4.0
	37	4.5	3.5	4.9	3.8	5.3	4.0	5.4	4.0	5.6	4.0	5.9	3.9	6.2	3.8
	39	4.3	3.4	4.7	3.6	5.0	3.8	5.2	3.8	5.3	3.8	5.7	3.8	5.9	3.7
	40	4.1	3.3	4.6	3.5	4.9	3.7	5.0	3.7	5.2	3.7	5.5	3.7	5.7	3.6
	42	3.8	3.0	4.3	3.2	4.5	3.4	4.7	3.4	4.8	3.4	5.1	3.4	5.3	3.3
	44	3.5	2.8	3.9	2.9	4.1	3.1	4.3	3.1	4.4	3.1	4.6	3.1	4.9	3.0
	46	3.1	2.4	3.4	2.6	3.7	2.8	3.8	2.8	3.9	2.8	4.1	2.7	4.3	2.7
024	10	5.8	4.5	6.4	4.8	6.9	5.1	7.1	5.1	7.3	5.1	7.7	5.1	8.1	4.9
	12	5.8	4.5	6.4	4.8	6.9	5.1	7.1	5.1	7.3	5.1	7.7	5.1	8.1	4.9
	14	5.8	4.5	6.4	4.8	6.9	5.1	7.1	5.1	7.3	5.1	7.7	5.1	8.1	4.9
	16	5.8	4.5	6.4	4.8	6.9	5.1	7.1	5.1	7.3	5.1	7.7	5.1	8.1	4.9
	18	5.8	4.5	6.4	4.8	6.9	5.1	7.1	5.1	7.3	5.1	7.7	5.1	8.1	4.9
	20	5.8	4.5	6.4	4.8	6.9	5.1	7.1	5.1	7.3	5.1	7.7	5.1	8.1	4.9
	21	5.8	4.5	6.4	4.8	6.9	5.1	7.1	5.1	7.3	5.1	7.7	5.1	8.1	4.9
	23	5.8	4.5	6.4	4.8	6.9	5.1	7.1	5.1	7.3	5.1	7.7	5.1	8.1	4.9
	25	5.8	4.5	6.4	4.8	6.9	5.1	7.1	5.1	7.3	5.1	7.7	5.1	8.1	4.9
	27	5.8	4.5	6.4	4.8	6.9	5.1	7.1	5.1	7.3	5.1	7.7	5.1	8.1	4.9
	29	5.8	4.5	6.4	4.8	6.9	5.1	7.1	5.1	7.3	5.1	7.7	5.1	8.1	4.9
	31	5.8	4.5	6.4	4.8	6.9	5.1	7.1	5.1	7.3	5.1	7.7	5.1	8.1	4.9
	33	5.8	4.5	6.4	4.8	6.9	5.1	7.1	5.1	7.3	5.1	7.7	5.1	8.1	4.9
	35	5.8	4.5	6.4	4.8	6.9	5.1	7.1	5.1	7.3	5.1	7.7	5.1	8.1	4.9
	37	5.7	4.4	6.3	4.7	6.7	5.0	6.9	4.9	7.1	4.9	7.5	4.9	7.9	4.8
	39	5.4	4.2	6.0	4.5	6.4	4.7	6.6	4.7	6.8	4.7	7.2	4.7	7.5	4.6
	40	5.2	4.1	5.8	4.3	6.2	4.6	6.4	4.6	6.6	4.6	7.0	4.5	7.3	4.4
	42	4.9	3.8	5.4	4.0	5.8	4.3	5.9	4.3	6.1	4.3	6.5	4.2	6.8	4.1
	44	4.4	3.4	4.9	3.7	5.2	3.9	5.4	3.9	5.6	3.9	5.9	3.8	6.2	3.8
	46	3.9	3.0	4.3	3.2	4.6	3.4	4.8	3.4	4.9	3.4	5.2	3.4	5.4	3.3

# Sensible capacity table



## 2-way Air Discharge Cassette Type ( MMU-AP 2WH )

TC : Total capacity [kW] SHC : Sensible capacity [kW]

unit size	outdoor air temp. °CDB	indoor air temp.													
		14°CWB		16°CWB		18°CWB		19°CWB		20°CWB		22°CWB		24°CWB	
		20°CDB	23°CDB	26°CDB	27°CDB	28°CDB	30°CDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC
027	10	6.6	5.0	7.3	5.3	7.8	5.6	8.0	5.6	8.2	5.6	8.7	5.5	9.1	5.4
	12	6.6	5.0	7.3	5.3	7.8	5.6	8.0	5.6	8.2	5.6	8.7	5.5	9.1	5.4
	14	6.6	5.0	7.3	5.3	7.8	5.6	8.0	5.6	8.2	5.6	8.7	5.5	9.1	5.4
	16	6.6	5.0	7.3	5.3	7.8	5.6	8.0	5.6	8.2	5.6	8.7	5.5	9.1	5.4
	18	6.6	5.0	7.3	5.3	7.8	5.6	8.0	5.6	8.2	5.6	8.7	5.5	9.1	5.4
	20	6.6	5.0	7.3	5.3	7.8	5.6	8.0	5.6	8.2	5.6	8.7	5.5	9.1	5.4
	21	6.6	5.0	7.3	5.3	7.8	5.6	8.0	5.6	8.2	5.6	8.7	5.5	9.1	5.4
	23	6.6	5.0	7.3	5.3	7.8	5.6	8.0	5.6	8.2	5.6	8.7	5.5	9.1	5.4
	25	6.6	5.0	7.3	5.3	7.8	5.6	8.0	5.6	8.2	5.6	8.7	5.5	9.1	5.4
	27	6.6	5.0	7.3	5.3	7.8	5.6	8.0	5.6	8.2	5.6	8.7	5.5	9.1	5.4
	29	6.6	5.0	7.3	5.3	7.8	5.6	8.0	5.6	8.2	5.6	8.7	5.5	9.1	5.4
	31	6.6	5.0	7.3	5.3	7.8	5.6	8.0	5.6	8.2	5.6	8.7	5.5	9.1	5.4
	33	6.6	5.0	7.3	5.3	7.8	5.6	8.0	5.6	8.2	5.6	8.7	5.5	9.1	5.4
	35	6.6	5.0	7.3	5.3	7.8	5.6	8.0	5.6	8.2	5.6	8.7	5.5	9.1	5.4
	37	6.4	4.8	7.0	5.1	7.5	5.4	7.8	5.4	8.0	5.4	8.5	5.4	8.8	5.3
	39	6.1	4.6	6.7	4.9	7.2	5.2	7.4	5.2	7.6	5.2	8.1	5.1	8.5	5.0
	40	5.9	4.5	6.5	4.8	7.0	5.1	7.2	5.0	7.4	5.0	7.8	5.0	8.2	4.9
	42	5.5	4.2	6.1	4.4	6.5	4.7	6.7	4.7	6.9	4.7	7.3	4.6	7.6	4.5
	44	5.0	3.8	5.5	4.0	5.9	4.3	6.1	4.3	6.3	4.3	6.6	4.2	6.9	4.1
	46	4.4	3.3	4.9	3.6	5.2	3.8	5.4	3.8	5.5	3.8	5.9	3.7	6.1	3.6
030	10	7.4	5.5	8.2	5.9	8.7	6.2	9.0	6.2	9.3	6.2	9.8	6.1	10.3	6.0
	12	7.4	5.5	8.2	5.9	8.7	6.2	9.0	6.2	9.3	6.2	9.8	6.1	10.3	6.0
	14	7.4	5.5	8.2	5.9	8.7	6.2	9.0	6.2	9.3	6.2	9.8	6.1	10.3	6.0
	16	7.4	5.5	8.2	5.9	8.7	6.2	9.0	6.2	9.3	6.2	9.8	6.1	10.3	6.0
	18	7.4	5.5	8.2	5.9	8.7	6.2	9.0	6.2	9.3	6.2	9.8	6.1	10.3	6.0
	20	7.4	5.5	8.2	5.9	8.7	6.2	9.0	6.2	9.3	6.2	9.8	6.1	10.3	6.0
	21	7.4	5.5	8.2	5.9	8.7	6.2	9.0	6.2	9.3	6.2	9.8	6.1	10.3	6.0
	23	7.4	5.5	8.2	5.9	8.7	6.2	9.0	6.2	9.3	6.2	9.8	6.1	10.3	6.0
	25	7.4	5.5	8.2	5.9	8.7	6.2	9.0	6.2	9.3	6.2	9.8	6.1	10.3	6.0
	27	7.4	5.5	8.2	5.9	8.7	6.2	9.0	6.2	9.3	6.2	9.8	6.1	10.3	6.0
	29	7.4	5.5	8.2	5.9	8.7	6.2	9.0	6.2	9.3	6.2	9.8	6.1	10.3	6.0
	31	7.4	5.5	8.2	5.9	8.7	6.2	9.0	6.2	9.3	6.2	9.8	6.1	10.3	6.0
	33	7.4	5.5	8.2	5.9	8.7	6.2	9.0	6.2	9.3	6.2	9.8	6.1	10.3	6.0
	35	7.4	5.5	8.2	5.9	8.7	6.2	9.0	6.2	9.3	6.2	9.8	6.1	10.3	6.0
	37	7.2	5.4	8.0	5.7	8.5	6.1	8.8	6.0	9.0	6.0	9.6	6.0	10.0	5.9
	39	6.9	5.1	7.7	5.5	8.2	5.8	8.4	5.8	8.7	5.8	9.2	5.8	9.6	5.6
	40	6.7	5.0	7.5	5.3	8.0	5.7	8.2	5.7	8.5	5.7	8.9	5.6	9.4	5.5
	42	6.3	4.7	7.0	5.0	7.4	5.3	7.7	5.3	7.9	5.3	8.4	5.2	8.7	5.1
	44	5.8	4.3	6.4	4.6	6.8	4.8	7.0	4.8	7.2	4.8	7.6	4.8	8.0	4.7
	46	5.1	3.8	5.7	4.0	6.0	4.3	6.2	4.3	6.4	4.3	6.8	4.2	7.1	4.1
036	10	9.2	7.4	10.2	7.9	10.9	8.4	11.2	8.4	11.5	8.4	12.2	8.3	12.8	8.1
	12	9.2	7.4	10.2	7.9	10.9	8.4	11.2	8.4	11.5	8.4	12.2	8.3	12.8	8.1
	14	9.2	7.4	10.2	7.9	10.9	8.4	11.2	8.4	11.5	8.4	12.2	8.3	12.8	8.1
	16	9.2	7.4	10.2	7.9	10.9	8.4	11.2	8.4	11.5	8.4	12.2	8.3	12.8	8.1
	18	9.2	7.4	10.2	7.9	10.9	8.4	11.2	8.4	11.5	8.4	12.2	8.3	12.8	8.1
	20	9.2	7.4	10.2	7.9	10.9	8.4	11.2	8.4	11.5	8.4	12.2	8.3	12.8	8.1
	21	9.2	7.4	10.2	7.9	10.9	8.4	11.2	8.4	11.5	8.4	12.2	8.3	12.8	8.1
	23	9.2	7.4	10.2	7.9	10.9	8.4	11.2	8.4	11.5	8.4	12.2	8.3	12.8	8.1
	25	9.2	7.4	10.2	7.9	10.9	8.4	11.2	8.4	11.5	8.4	12.2	8.3	12.8	8.1
	27	9.2	7.4	10.2	7.9	10.9	8.4	11.2	8.4	11.5	8.4	12.2	8.3	12.8	8.1
	29	9.2	7.4	10.2	7.9	10.9	8.4	11.2	8.4	11.5	8.4	12.2	8.3	12.8	8.1
	31	9.2	7.4	10.2	7.9	10.9	8.4	11.2	8.4	11.5	8.4	12.2	8.3	12.8	8.1
	33	9.2	7.4	10.2	7.9	10.9	8.4	11.2	8.4	11.5	8.4	12.2	8.3	12.8	8.1
	35	9.2	7.4	10.2	7.9	10.9	8.4	11.2	8.4	11.5	8.4	12.2	8.3	12.8	8.1
	37	8.9	7.2	9.9	7.7	10.5	8.2	10.9	8.1	11.2	8.1	11.8	8.1	12.4	7.9
	39	8.5	6.9	9.4	7.4	10.1	7.8	10.4	7.8	10.7	7.8	11.3	7.7	11.8	7.5
	40	8.3	6.7	9.2	7.1	9.8	7.6	10.1	7.6	10.4	7.6	11.0	7.5	11.5	7.3
	42	7.7	6.2	8.5	6.6	9.1	7.1	9.4	7.0	9.7	7.0	10.2	7.0	10.7	6.8
	44	7.0	5.7	7.7	6.0	8.3	6.4	8.5	6.4	8.8	6.4	9.3	6.3	9.7	6.2
	46	6.2	5.0	6.8	5.3	7.3	5.7	7.5	5.6	7.8	5.6	8.2	5.6	8.6	5.5



## 2-way Air Discharge Cassette Type ( MMU-AP 2WH )

TC : Total capacity [kW] SHC : Sensible capacity [kW]

unit size	outdoor air temp. °CDB	indoor air temp.													
		14°CWB		16°CWB		18°CWB		19°CWB		20°CWB		22°CWB		24°CWB	
		20°CDB	23°CDB	26°CDB	27°CDB	28°CDB	30°CDB	32°CDB	TC	SHC	TC	SHC	TC	SHC	
048	10	11.5	8.6	12.7	9.2	13.6	9.7	14.0	9.7	14.4	9.7	15.3	9.6	16.0	9.4
	12	11.5	8.6	12.7	9.2	13.6	9.7	14.0	9.7	14.4	9.7	15.3	9.6	16.0	9.4
	14	11.5	8.6	12.7	9.2	13.6	9.7	14.0	9.7	14.4	9.7	15.3	9.6	16.0	9.4
	16	11.5	8.6	12.7	9.2	13.6	9.7	14.0	9.7	14.4	9.7	15.3	9.6	16.0	9.4
	18	11.5	8.6	12.7	9.2	13.6	9.7	14.0	9.7	14.4	9.7	15.3	9.6	16.0	9.4
	20	11.5	8.6	12.7	9.2	13.6	9.7	14.0	9.7	14.4	9.7	15.3	9.6	16.0	9.4
	21	11.5	8.6	12.7	9.2	13.6	9.7	14.0	9.7	14.4	9.7	15.3	9.6	16.0	9.4
	23	11.5	8.6	12.7	9.2	13.6	9.7	14.0	9.7	14.4	9.7	15.3	9.6	16.0	9.4
	25	11.5	8.6	12.7	9.2	13.6	9.7	14.0	9.7	14.4	9.7	15.3	9.6	16.0	9.4
	27	11.5	8.6	12.7	9.2	13.6	9.7	14.0	9.7	14.4	9.7	15.3	9.6	16.0	9.4
	29	11.5	8.6	12.7	9.2	13.6	9.7	14.0	9.7	14.4	9.7	15.3	9.6	16.0	9.4
	31	11.5	8.6	12.7	9.2	13.6	9.7	14.0	9.7	14.4	9.7	15.3	9.6	16.0	9.4
	33	11.5	8.6	12.7	9.2	13.6	9.7	14.0	9.7	14.4	9.7	15.3	9.6	16.0	9.4
	35	11.5	8.6	12.7	9.2	13.6	9.7	14.0	9.7	14.4	9.7	15.3	9.6	16.0	9.4
	37	11.1	8.3	12.3	8.9	13.2	9.4	13.6	9.4	14.0	9.4	14.8	9.3	15.5	9.1
	39	10.7	8.0	11.8	8.5	12.6	9.0	13.0	9.0	13.4	9.0	14.1	8.9	14.8	8.7
	40	10.3	7.7	11.4	8.2	12.2	8.8	12.6	8.7	13.0	8.7	13.7	8.6	14.4	8.4
	42	9.6	7.2	10.6	7.7	11.4	8.1	11.7	8.1	12.1	8.1	12.8	8.0	13.4	7.9
	44	8.8	6.5	9.7	7.0	10.3	7.4	10.7	7.4	11.0	7.4	11.6	7.3	12.2	7.1
	46	7.7	5.8	8.5	6.2	9.1	6.5	9.4	6.5	9.7	6.5	10.3	6.5	10.7	6.3
056	10	13.1	9.7	14.5	10.3	15.5	10.9	16.0	10.9	16.5	10.9	17.4	10.8	18.2	10.5
	12	13.1	9.7	14.5	10.3	15.5	10.9	16.0	10.9	16.5	10.9	17.4	10.8	18.2	10.5
	14	13.1	9.7	14.5	10.3	15.5	10.9	16.0	10.9	16.5	10.9	17.4	10.8	18.2	10.5
	16	13.1	9.7	14.5	10.3	15.5	10.9	16.0	10.9	16.5	10.9	17.4	10.8	18.2	10.5
	18	13.1	9.7	14.5	10.3	15.5	10.9	16.0	10.9	16.5	10.9	17.4	10.8	18.2	10.5
	20	13.1	9.7	14.5	10.3	15.5	10.9	16.0	10.9	16.5	10.9	17.4	10.8	18.2	10.5
	21	13.1	9.7	14.5	10.3	15.5	10.9	16.0	10.9	16.5	10.9	17.4	10.8	18.2	10.5
	23	13.1	9.7	14.5	10.3	15.5	10.9	16.0	10.9	16.5	10.9	17.4	10.8	18.2	10.5
	25	13.1	9.7	14.5	10.3	15.5	10.9	16.0	10.9	16.5	10.9	17.4	10.8	18.2	10.5
	27	13.1	9.7	14.5	10.3	15.5	10.9	16.0	10.9	16.5	10.9	17.4	10.8	18.2	10.5
	29	13.1	9.7	14.5	10.3	15.5	10.9	16.0	10.9	16.5	10.9	17.4	10.8	18.2	10.5
	31	13.1	9.7	14.5	10.3	15.5	10.9	16.0	10.9	16.5	10.9	17.4	10.8	18.2	10.5
	33	13.1	9.7	14.5	10.3	15.5	10.9	16.0	10.9	16.5	10.9	17.4	10.8	18.2	10.5
	35	13.1	9.7	14.5	10.3	15.5	10.9	16.0	10.9	16.5	10.9	17.4	10.8	18.2	10.5
	37	12.7	9.4	14.1	10.0	15.1	10.6	15.5	10.6	16.0	10.6	16.9	10.5	17.7	10.2
	39	12.2	9.0	13.5	9.5	14.4	10.1	14.8	10.1	15.3	10.1	16.2	10.0	16.9	9.8
	40	11.8	8.7	13.1	9.3	14.0	9.8	14.4	9.8	14.8	9.8	15.7	9.7	16.4	9.5
	42	11.0	8.1	12.2	8.6	13.0	9.2	13.4	9.1	13.8	9.1	14.6	9.0	15.3	8.8
	44	10.0	7.4	11.1	7.8	11.8	8.3	12.2	8.3	12.5	8.3	13.3	8.2	13.9	8.0
	46	8.8	6.5	9.8	6.9	10.4	7.4	10.8	7.3	11.1	7.3	11.7	7.3	12.3	7.1

**1-way Air Discharge Cassette Type ( MMU-AP 4YH-E )**

TC : Total capacity [kW] SHC : Sensible capacity [kW]

unit size	outdoor air temp. °CDB	indoor air temp.													
		14°CWB		16°CWB		18°CWB		19°CWB		20°CWB		22°CWB		24°CWB	
		20°CDB	23°CDB	26°CDB	27°CDB	28°CDB	30°CDB	32°CDB	TC	SHC	TC	SHC	TC	SHC	TC
007	10	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	12	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	14	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	16	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	18	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	20	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	21	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	23	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	25	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	27	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	29	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	31	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	33	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	35	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	37	1.8	1.5	1.9	1.6	2.1	1.8	2.1	1.7	2.2	1.7	2.3	1.7	2.4	1.7
	39	1.7	1.5	1.9	1.6	2.0	1.7	2.0	1.7	2.1	1.7	2.2	1.7	2.3	1.6
	40	1.6	1.4	1.8	1.5	1.9	1.6	2.0	1.6	2.0	1.6	2.2	1.6	2.3	1.6
	42	1.5	1.3	1.7	1.4	1.8	1.5	1.8	1.5	1.9	1.5	2.0	1.5	2.1	1.5
	44	1.4	1.2	1.5	1.3	1.6	1.4	1.7	1.4	1.7	1.4	1.8	1.4	1.9	1.3
	46	1.2	1.1	1.3	1.1	1.4	1.2	1.5	1.2	1.5	1.2	1.6	1.2	1.7	1.2
009	10	2.3	2.0	2.5	2.1	2.7	2.3	2.8	2.3	2.9	2.2	3.1	2.2	3.2	2.2
	12	2.3	2.0	2.5	2.1	2.7	2.3	2.8	2.3	2.9	2.2	3.1	2.2	3.2	2.2
	14	2.3	2.0	2.5	2.1	2.7	2.3	2.8	2.3	2.9	2.2	3.1	2.2	3.2	2.2
	16	2.3	2.0	2.5	2.1	2.7	2.3	2.8	2.3	2.9	2.2	3.1	2.2	3.2	2.2
	18	2.3	2.0	2.5	2.1	2.7	2.3	2.8	2.3	2.9	2.2	3.1	2.2	3.2	2.2
	20	2.3	2.0	2.5	2.1	2.7	2.3	2.8	2.3	2.9	2.2	3.1	2.2	3.2	2.2
	21	2.3	2.0	2.5	2.1	2.7	2.3	2.8	2.3	2.9	2.2	3.1	2.2	3.2	2.2
	23	2.3	2.0	2.5	2.1	2.7	2.3	2.8	2.3	2.9	2.2	3.1	2.2	3.2	2.2
	25	2.3	2.0	2.5	2.1	2.7	2.3	2.8	2.3	2.9	2.2	3.1	2.2	3.2	2.2
	27	2.3	2.0	2.5	2.1	2.7	2.3	2.8	2.3	2.9	2.2	3.1	2.2	3.2	2.2
	29	2.3	2.0	2.5	2.1	2.7	2.3	2.8	2.3	2.9	2.2	3.1	2.2	3.2	2.2
	31	2.3	2.0	2.5	2.1	2.7	2.3	2.8	2.3	2.9	2.2	3.1	2.2	3.2	2.2
	33	2.3	2.0	2.5	2.1	2.7	2.3	2.8	2.3	2.9	2.2	3.1	2.2	3.2	2.2
	35	2.3	2.0	2.5	2.1	2.7	2.3	2.8	2.3	2.9	2.2	3.1	2.2	3.2	2.2
	37	2.2	1.9	2.5	2.1	2.6	2.2	2.7	2.2	2.8	2.2	3.0	2.2	3.1	2.1
	39	2.1	1.8	2.4	2.0	2.5	2.1	2.6	2.1	2.7	2.1	2.8	2.1	3.0	2.0
	40	2.1	1.8	2.3	1.9	2.4	2.0	2.5	2.0	2.6	2.0	2.7	2.0	2.9	2.0
	42	1.9	1.7	2.1	1.8	2.3	1.9	2.3	1.9	2.4	1.9	2.6	1.9	2.7	1.8
	44	1.8	1.5	1.9	1.6	2.1	1.7	2.1	1.7	2.2	1.7	2.3	1.7	2.4	1.7
	46	1.5	1.3	1.7	1.4	1.8	1.5	1.9	1.5	1.9	1.5	2.1	1.5	2.1	1.5
012	10	3.0	2.5	3.3	2.6	3.5	2.8	3.6	2.8	3.7	2.8	3.9	2.8	4.1	2.7
	12	3.0	2.5	3.3	2.6	3.5	2.8	3.6	2.8	3.7	2.8	3.9	2.8	4.1	2.7
	14	3.0	2.5	3.3	2.6	3.5	2.8	3.6	2.8	3.7	2.8	3.9	2.8	4.1	2.7
	16	3.0	2.5	3.3	2.6	3.5	2.8	3.6	2.8	3.7	2.8	3.9	2.8	4.1	2.7
	18	3.0	2.5	3.3	2.6	3.5	2.8	3.6	2.8	3.7	2.8	3.9	2.8	4.1	2.7
	20	3.0	2.5	3.3	2.6	3.5	2.8	3.6	2.8	3.7	2.8	3.9	2.8	4.1	2.7
	21	3.0	2.5	3.3	2.6	3.5	2.8	3.6	2.8	3.7	2.8	3.9	2.8	4.1	2.7
	23	3.0	2.5	3.3	2.6	3.5	2.8	3.6	2.8	3.7	2.8	3.9	2.8	4.1	2.7
	25	3.0	2.5	3.3	2.6	3.5	2.8	3.6	2.8	3.7	2.8	3.9	2.8	4.1	2.7
	27	3.0	2.5	3.3	2.6	3.5	2.8	3.6	2.8	3.7	2.8	3.9	2.8	4.1	2.7
	29	3.0	2.5	3.3	2.6	3.5	2.8	3.6	2.8	3.7	2.8	3.9	2.8	4.1	2.7
	31	3.0	2.5	3.3	2.6	3.5	2.8	3.6	2.8	3.7	2.8	3.9	2.8	4.1	2.7
	33	3.0	2.5	3.3	2.6	3.5	2.8	3.6	2.8	3.7	2.8	3.9	2.8	4.1	2.7
	35	3.0	2.5	3.3	2.6	3.5	2.8	3.6	2.8	3.7	2.8	3.9	2.8	4.1	2.7
	37	2.9	2.4	3.2	2.6	3.4	2.7	3.5	2.7	3.6	2.7	3.8	2.7	4.0	2.6
	39	2.7	2.3	3.0	2.5	3.2	2.6	3.3	2.6	3.4	2.6	3.6	2.6	3.8	2.5
	40	2.7	2.2	2.9	2.4	3.1	2.5	3.2	2.5	3.3	2.5	3.5	2.5	3.7	2.4
	42	2.5	2.1	2.7	2.2	2.9	2.4	3.0	2.3	3.1	2.3	3.3	2.3	3.4	2.3
	44	2.3	1.9	2.5	2.0	2.7	2.1	2.7	2.1	2.8	2.1	3.0	2.1	3.1	2.1
	46	2.0	1.7	2.2	1.8	2.3	1.9	2.4	1.9	2.5	1.9	2.6	1.9	2.8	1.8



**1-way Air Discharge Cassette Type ( MMU-AP 4SH-E )**

TC : Total capacity [kW] SHC : Sensible capacity [kW]

unit size	outdoor air temp. °CDB	indoor air temp.													
		14°CWB		16°CWB		18°CWB		19°CWB		20°CWB		22°CWB		24°CWB	
		20°CDB	23°CDB	26°CDB	27°CDB	28°CDB	30°CDB	32°CDB	TC	SHC	TC	SHC	TC	SHC	
015	10	3.7	3.0	4.1	3.2	4.4	3.4	4.5	3.4	4.6	3.4	4.9	3.4	5.1	3.3
	12	3.7	3.0	4.1	3.2	4.4	3.4	4.5	3.4	4.6	3.4	4.9	3.4	5.1	3.3
	14	3.7	3.0	4.1	3.2	4.4	3.4	4.5	3.4	4.6	3.4	4.9	3.4	5.1	3.3
	16	3.7	3.0	4.1	3.2	4.4	3.4	4.5	3.4	4.6	3.4	4.9	3.4	5.1	3.3
	18	3.7	3.0	4.1	3.2	4.4	3.4	4.5	3.4	4.6	3.4	4.9	3.4	5.1	3.3
	20	3.7	3.0	4.1	3.2	4.4	3.4	4.5	3.4	4.6	3.4	4.9	3.4	5.1	3.3
	21	3.7	3.0	4.1	3.2	4.4	3.4	4.5	3.4	4.6	3.4	4.9	3.4	5.1	3.3
	23	3.7	3.0	4.1	3.2	4.4	3.4	4.5	3.4	4.6	3.4	4.9	3.4	5.1	3.3
	25	3.7	3.0	4.1	3.2	4.4	3.4	4.5	3.4	4.6	3.4	4.9	3.4	5.1	3.3
	27	3.7	3.0	4.1	3.2	4.4	3.4	4.5	3.4	4.6	3.4	4.9	3.4	5.1	3.3
	29	3.7	3.0	4.1	3.2	4.4	3.4	4.5	3.4	4.6	3.4	4.9	3.4	5.1	3.3
	31	3.7	3.0	4.1	3.2	4.4	3.4	4.5	3.4	4.6	3.4	4.9	3.4	5.1	3.3
	33	3.7	3.0	4.1	3.2	4.4	3.4	4.5	3.4	4.6	3.4	4.9	3.4	5.1	3.3
	35	3.7	3.0	4.1	3.2	4.4	3.4	4.5	3.4	4.6	3.4	4.9	3.4	5.1	3.3
	37	3.6	2.9	4.0	3.1	4.2	3.3	4.4	3.3	4.5	3.3	4.8	3.3	5.0	3.2
	39	3.4	2.8	3.8	3.0	4.0	3.2	4.2	3.2	4.3	3.2	4.5	3.1	4.8	3.0
	40	3.3	2.7	3.7	2.9	3.9	3.1	4.1	3.1	4.2	3.1	4.4	3.0	4.6	3.0
	42	3.1	2.5	3.4	2.7	3.7	2.9	3.8	2.8	3.9	2.8	4.1	2.8	4.3	2.8
	44	2.8	2.3	3.1	2.4	3.3	2.6	3.4	2.6	3.5	2.6	3.7	2.6	3.9	2.5
	46	2.5	2.0	2.7	2.2	2.9	2.3	3.0	2.3	3.1	2.3	3.3	2.3	3.4	2.2
018	10	4.6	3.5	5.1	3.8	5.4	4.0	5.6	4.0	5.8	4.0	6.1	4.0	6.4	3.9
	12	4.6	3.5	5.1	3.8	5.4	4.0	5.6	4.0	5.8	4.0	6.1	4.0	6.4	3.9
	14	4.6	3.5	5.1	3.8	5.4	4.0	5.6	4.0	5.8	4.0	6.1	4.0	6.4	3.9
	16	4.6	3.5	5.1	3.8	5.4	4.0	5.6	4.0	5.8	4.0	6.1	4.0	6.4	3.9
	18	4.6	3.5	5.1	3.8	5.4	4.0	5.6	4.0	5.8	4.0	6.1	4.0	6.4	3.9
	20	4.6	3.5	5.1	3.8	5.4	4.0	5.6	4.0	5.8	4.0	6.1	4.0	6.4	3.9
	21	4.6	3.5	5.1	3.8	5.4	4.0	5.6	4.0	5.8	4.0	6.1	4.0	6.4	3.9
	23	4.6	3.5	5.1	3.8	5.4	4.0	5.6	4.0	5.8	4.0	6.1	4.0	6.4	3.9
	25	4.6	3.5	5.1	3.8	5.4	4.0	5.6	4.0	5.8	4.0	6.1	4.0	6.4	3.9
	27	4.6	3.5	5.1	3.8	5.4	4.0	5.6	4.0	5.8	4.0	6.1	4.0	6.4	3.9
	29	4.6	3.5	5.1	3.8	5.4	4.0	5.6	4.0	5.8	4.0	6.1	4.0	6.4	3.9
	31	4.6	3.5	5.1	3.8	5.4	4.0	5.6	4.0	5.8	4.0	6.1	4.0	6.4	3.9
	33	4.6	3.5	5.1	3.8	5.4	4.0	5.6	4.0	5.8	4.0	6.1	4.0	6.4	3.9
	35	4.6	3.5	5.1	3.8	5.4	4.0	5.6	4.0	5.8	4.0	6.1	4.0	6.4	3.9
	37	4.5	3.4	4.9	3.7	5.3	3.9	5.4	3.9	5.6	3.9	5.9	3.8	6.2	3.8
	39	4.3	3.3	4.7	3.5	5.0	3.7	5.2	3.7	5.3	3.7	5.7	3.7	5.9	3.6
	40	4.1	3.2	4.6	3.4	4.9	3.6	5.0	3.6	5.2	3.6	5.5	3.6	5.7	3.5
	42	3.8	3.0	4.3	3.2	4.5	3.4	4.7	3.3	4.8	3.3	5.1	3.3	5.3	3.2
	44	3.5	2.7	3.9	2.9	4.1	3.1	4.3	3.0	4.4	3.0	4.6	3.0	4.9	2.9
	46	3.1	2.4	3.4	2.5	3.7	2.7	3.8	2.7	3.9	2.7	4.1	2.7	4.3	2.6
024	10	5.8	4.4	6.4	4.7	6.9	5.0	7.1	5.0	7.3	5.0	7.7	5.0	8.1	4.8
	12	5.8	4.4	6.4	4.7	6.9	5.0	7.1	5.0	7.3	5.0	7.7	5.0	8.1	4.8
	14	5.8	4.4	6.4	4.7	6.9	5.0	7.1	5.0	7.3	5.0	7.7	5.0	8.1	4.8
	16	5.8	4.4	6.4	4.7	6.9	5.0	7.1	5.0	7.3	5.0	7.7	5.0	8.1	4.8
	18	5.8	4.4	6.4	4.7	6.9	5.0	7.1	5.0	7.3	5.0	7.7	5.0	8.1	4.8
	20	5.8	4.4	6.4	4.7	6.9	5.0	7.1	5.0	7.3	5.0	7.7	5.0	8.1	4.8
	21	5.8	4.4	6.4	4.7	6.9	5.0	7.1	5.0	7.3	5.0	7.7	5.0	8.1	4.8
	23	5.8	4.4	6.4	4.7	6.9	5.0	7.1	5.0	7.3	5.0	7.7	5.0	8.1	4.8
	25	5.8	4.4	6.4	4.7	6.9	5.0	7.1	5.0	7.3	5.0	7.7	5.0	8.1	4.8
	27	5.8	4.4	6.4	4.7	6.9	5.0	7.1	5.0	7.3	5.0	7.7	5.0	8.1	4.8
	29	5.8	4.4	6.4	4.7	6.9	5.0	7.1	5.0	7.3	5.0	7.7	5.0	8.1	4.8
	31	5.8	4.4	6.4	4.7	6.9	5.0	7.1	5.0	7.3	5.0	7.7	5.0	8.1	4.8
	33	5.8	4.4	6.4	4.7	6.9	5.0	7.1	5.0	7.3	5.0	7.7	5.0	8.1	4.8
	35	5.8	4.4	6.4	4.7	6.9	5.0	7.1	5.0	7.3	5.0	7.7	5.0	8.1	4.8
	37	5.7	4.3	6.3	4.6	6.7	4.9	6.9	4.9	7.1	4.8	7.5	4.8	7.9	4.7
	39	5.4	4.1	6.0	4.4	6.4	4.6	6.6	4.6	6.8	4.6	7.2	4.6	7.5	4.5
	40	5.2	4.0	5.8	4.2	6.2	4.5	6.4	4.5	6.6	4.5	7.0	4.5	7.3	4.4
	42	4.9	3.7	5.4	4.0	5.8	4.2	5.9	4.2	6.1	4.2	6.5	4.1	6.8	4.1
	44	4.4	3.4	4.9	3.6	5.2	3.8	5.4	3.8	5.6	3.8	5.9	3.8	6.2	3.7
	46	3.9	3.0	4.3	3.2	4.6	3.4	4.8	3.4	4.9	3.4	5.2	3.3	5.4	3.3

# Sensible capacity table



## Concealed Duct Standard Type ( MMD-AP 6BHP-E )

TC : Total capacity [kW] SHC : Sensible capacity [kW]

unit size	outdoor air temp. °CDB	indoor air temp.													
		14°CWB		16°CWB		18°CWB		19°CWB		20°CWB		22°CWB		24°CWB	
		20°CDB	23°CDB	26°CDB	27°CDB	28°CDB	30°CDB	32°CDB	TC	SHC	TC	SHC	TC	SHC	TC
007	10	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	12	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	14	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	16	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	18	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	20	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	21	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	23	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	25	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	27	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	29	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	31	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	33	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	35	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	37	1.8	1.5	1.9	1.6	2.1	1.8	2.1	1.7	2.2	1.7	2.3	1.7	2.4	1.7
	39	1.7	1.5	1.9	1.6	2.0	1.7	2.0	1.7	2.1	1.7	2.2	1.7	2.3	1.6
	40	1.6	1.4	1.8	1.5	1.9	1.6	2.0	1.6	2.0	1.6	2.2	1.6	2.3	1.6
	42	1.5	1.3	1.7	1.4	1.8	1.5	1.8	1.5	1.9	1.5	2.0	1.5	2.1	1.5
	44	1.4	1.2	1.5	1.3	1.6	1.4	1.7	1.4	1.7	1.4	1.8	1.4	1.9	1.3
	46	1.2	1.1	1.3	1.1	1.4	1.2	1.5	1.2	1.5	1.2	1.6	1.2	1.7	1.2
009	10	2.3	2.0	2.5	2.2	2.7	2.3	2.8	2.3	2.9	2.3	3.1	2.3	3.2	2.2
	12	2.3	2.0	2.5	2.2	2.7	2.3	2.8	2.3	2.9	2.3	3.1	2.3	3.2	2.2
	14	2.3	2.0	2.5	2.2	2.7	2.3	2.8	2.3	2.9	2.3	3.1	2.3	3.2	2.2
	16	2.3	2.0	2.5	2.2	2.7	2.3	2.8	2.3	2.9	2.3	3.1	2.3	3.2	2.2
	18	2.3	2.0	2.5	2.2	2.7	2.3	2.8	2.3	2.9	2.3	3.1	2.3	3.2	2.2
	20	2.3	2.0	2.5	2.2	2.7	2.3	2.8	2.3	2.9	2.3	3.1	2.3	3.2	2.2
	21	2.3	2.0	2.5	2.2	2.7	2.3	2.8	2.3	2.9	2.3	3.1	2.3	3.2	2.2
	23	2.3	2.0	2.5	2.2	2.7	2.3	2.8	2.3	2.9	2.3	3.1	2.3	3.2	2.2
	25	2.3	2.0	2.5	2.2	2.7	2.3	2.8	2.3	2.9	2.3	3.1	2.3	3.2	2.2
	27	2.3	2.0	2.5	2.2	2.7	2.3	2.8	2.3	2.9	2.3	3.1	2.3	3.2	2.2
	29	2.3	2.0	2.5	2.2	2.7	2.3	2.8	2.3	2.9	2.3	3.1	2.3	3.2	2.2
	31	2.3	2.0	2.5	2.2	2.7	2.3	2.8	2.3	2.9	2.3	3.1	2.3	3.2	2.2
	33	2.3	2.0	2.5	2.2	2.7	2.3	2.8	2.3	2.9	2.3	3.1	2.3	3.2	2.2
	35	2.3	2.0	2.5	2.2	2.7	2.3	2.8	2.3	2.9	2.3	3.1	2.3	3.2	2.2
	37	2.2	2.0	2.5	2.1	2.6	2.2	2.7	2.2	2.8	2.2	3.0	2.2	3.1	2.2
	39	2.1	1.9	2.4	2.0	2.5	2.1	2.6	2.1	2.7	2.1	2.8	2.1	3.0	2.1
	40	2.1	1.8	2.3	2.0	2.4	2.1	2.5	2.1	2.6	2.1	2.7	2.1	2.9	2.0
	42	1.9	1.7	2.1	1.8	2.3	1.9	2.3	1.9	2.4	1.9	2.6	1.9	2.7	1.9
	44	1.8	1.6	1.9	1.7	2.1	1.8	2.1	1.8	2.2	1.8	2.3	1.7	2.4	1.7
	46	1.5	1.4	1.7	1.5	1.8	1.6	1.9	1.5	1.9	1.5	2.1	1.5	2.1	1.5
012	10	3.0	2.4	3.3	2.5	3.5	2.7	3.6	2.7	3.7	2.7	3.9	2.7	4.1	2.6
	12	3.0	2.4	3.3	2.5	3.5	2.7	3.6	2.7	3.7	2.7	3.9	2.7	4.1	2.6
	14	3.0	2.4	3.3	2.5	3.5	2.7	3.6	2.7	3.7	2.7	3.9	2.7	4.1	2.6
	16	3.0	2.4	3.3	2.5	3.5	2.7	3.6	2.7	3.7	2.7	3.9	2.7	4.1	2.6
	18	3.0	2.4	3.3	2.5	3.5	2.7	3.6	2.7	3.7	2.7	3.9	2.7	4.1	2.6
	20	3.0	2.4	3.3	2.5	3.5	2.7	3.6	2.7	3.7	2.7	3.9	2.7	4.1	2.6
	21	3.0	2.4	3.3	2.5	3.5	2.7	3.6	2.7	3.7	2.7	3.9	2.7	4.1	2.6
	23	3.0	2.4	3.3	2.5	3.5	2.7	3.6	2.7	3.7	2.7	3.9	2.7	4.1	2.6
	25	3.0	2.4	3.3	2.5	3.5	2.7	3.6	2.7	3.7	2.7	3.9	2.7	4.1	2.6
	27	3.0	2.4	3.3	2.5	3.5	2.7	3.6	2.7	3.7	2.7	3.9	2.7	4.1	2.6
	29	3.0	2.4	3.3	2.5	3.5	2.7	3.6	2.7	3.7	2.7	3.9	2.7	4.1	2.6
	31	3.0	2.4	3.3	2.5	3.5	2.7	3.6	2.7	3.7	2.7	3.9	2.7	4.1	2.6
	33	3.0	2.4	3.3	2.5	3.5	2.7	3.6	2.7	3.7	2.7	3.9	2.7	4.1	2.6
	35	3.0	2.4	3.3	2.5	3.5	2.7	3.6	2.7	3.7	2.7	3.9	2.7	4.1	2.6
	37	2.9	2.3	3.2	2.5	3.4	2.6	3.5	2.6	3.6	2.6	3.8	2.6	4.0	2.5
	39	2.7	2.2	3.0	2.4	3.2	2.5	3.3	2.5	3.4	2.5	3.6	2.5	3.8	2.4
	40	2.7	2.2	2.9	2.3	3.1	2.4	3.2	2.4	3.3	2.4	3.5	2.4	3.7	2.4
	42	2.5	2.0	2.7	2.1	2.9	2.3	3.0	2.3	3.1	2.3	3.3	2.2	3.4	2.2
	44	2.3	1.8	2.5	1.9	2.7	2.1	2.7	2.1	2.8	2.1	3.0	2.0	3.1	2.0
	46	2.0	1.6	2.2	1.7	2.3	1.8	2.4	1.8	2.5	1.8	2.6	1.8	2.8	1.8

## Sensible capacity table



### Concealed Duct Standard Type ( MMD-AP\_\_6BHP-E )

TC : Total capacity [kW] SHC : Sensible capacity [kW]

unit size	outdoor air temp. °CDB	indoor air temp.													
		14°CWB		16°CWB		18°CWB		19°CWB		20°CWB		22°CWB		24°CWB	
		20°CDB	23°CDB	26°CDB	27°CDB	28°CDB	30°CDB	32°CDB	TC	SHC	TC	SHC	TC	SHC	
015	10	3.7	3.2	4.1	3.4	4.4	3.6	4.5	3.6	4.6	3.6	4.9	3.6	5.1	3.5
	12	3.7	3.2	4.1	3.4	4.4	3.6	4.5	3.6	4.6	3.6	4.9	3.6	5.1	3.5
	14	3.7	3.2	4.1	3.4	4.4	3.6	4.5	3.6	4.6	3.6	4.9	3.6	5.1	3.5
	16	3.7	3.2	4.1	3.4	4.4	3.6	4.5	3.6	4.6	3.6	4.9	3.6	5.1	3.5
	18	3.7	3.2	4.1	3.4	4.4	3.6	4.5	3.6	4.6	3.6	4.9	3.6	5.1	3.5
	20	3.7	3.2	4.1	3.4	4.4	3.6	4.5	3.6	4.6	3.6	4.9	3.6	5.1	3.5
	21	3.7	3.2	4.1	3.4	4.4	3.6	4.5	3.6	4.6	3.6	4.9	3.6	5.1	3.5
	23	3.7	3.2	4.1	3.4	4.4	3.6	4.5	3.6	4.6	3.6	4.9	3.6	5.1	3.5
	25	3.7	3.2	4.1	3.4	4.4	3.6	4.5	3.6	4.6	3.6	4.9	3.6	5.1	3.5
	27	3.7	3.2	4.1	3.4	4.4	3.6	4.5	3.6	4.6	3.6	4.9	3.6	5.1	3.5
	29	3.7	3.2	4.1	3.4	4.4	3.6	4.5	3.6	4.6	3.6	4.9	3.6	5.1	3.5
	31	3.7	3.2	4.1	3.4	4.4	3.6	4.5	3.6	4.6	3.6	4.9	3.6	5.1	3.5
	33	3.7	3.2	4.1	3.4	4.4	3.6	4.5	3.6	4.6	3.6	4.9	3.6	5.1	3.5
	35	3.7	3.2	4.1	3.4	4.4	3.6	4.5	3.6	4.6	3.6	4.9	3.6	5.1	3.5
	37	3.6	3.1	4.0	3.3	4.2	3.5	4.4	3.5	4.5	3.5	4.8	3.5	5.0	3.4
	39	3.4	3.0	3.8	3.2	4.0	3.3	4.2	3.3	4.3	3.3	4.5	3.3	4.8	3.2
	40	3.3	2.9	3.7	3.1	3.9	3.2	4.1	3.2	4.2	3.2	4.4	3.2	4.6	3.1
	42	3.1	2.7	3.4	2.8	3.7	3.0	3.8	3.0	3.9	3.0	4.1	3.0	4.3	2.9
	44	2.8	2.4	3.1	2.6	3.3	2.7	3.4	2.7	3.5	2.7	3.7	2.7	3.9	2.7
	46	2.5	2.1	2.7	2.3	2.9	2.4	3.0	2.4	3.1	2.4	3.3	2.4	3.4	2.3
018	10	4.6	3.7	5.1	4.0	5.4	4.2	5.6	4.2	5.8	4.2	6.1	4.2	6.4	4.1
	12	4.6	3.7	5.1	4.0	5.4	4.2	5.6	4.2	5.8	4.2	6.1	4.2	6.4	4.1
	14	4.6	3.7	5.1	4.0	5.4	4.2	5.6	4.2	5.8	4.2	6.1	4.2	6.4	4.1
	16	4.6	3.7	5.1	4.0	5.4	4.2	5.6	4.2	5.8	4.2	6.1	4.2	6.4	4.1
	18	4.6	3.7	5.1	4.0	5.4	4.2	5.6	4.2	5.8	4.2	6.1	4.2	6.4	4.1
	20	4.6	3.7	5.1	4.0	5.4	4.2	5.6	4.2	5.8	4.2	6.1	4.2	6.4	4.1
	21	4.6	3.7	5.1	4.0	5.4	4.2	5.6	4.2	5.8	4.2	6.1	4.2	6.4	4.1
	23	4.6	3.7	5.1	4.0	5.4	4.2	5.6	4.2	5.8	4.2	6.1	4.2	6.4	4.1
	25	4.6	3.7	5.1	4.0	5.4	4.2	5.6	4.2	5.8	4.2	6.1	4.2	6.4	4.1
	27	4.6	3.7	5.1	4.0	5.4	4.2	5.6	4.2	5.8	4.2	6.1	4.2	6.4	4.1
	29	4.6	3.7	5.1	4.0	5.4	4.2	5.6	4.2	5.8	4.2	6.1	4.2	6.4	4.1
	31	4.6	3.7	5.1	4.0	5.4	4.2	5.6	4.2	5.8	4.2	6.1	4.2	6.4	4.1
	33	4.6	3.7	5.1	4.0	5.4	4.2	5.6	4.2	5.8	4.2	6.1	4.2	6.4	4.1
	35	4.6	3.7	5.1	4.0	5.4	4.2	5.6	4.2	5.8	4.2	6.1	4.2	6.4	4.1
	37	4.5	3.6	4.9	3.8	5.3	4.1	5.4	4.1	5.6	4.1	5.9	4.0	6.2	3.9
	39	4.3	3.5	4.7	3.7	5.0	3.9	5.2	3.9	5.3	3.9	5.7	3.9	5.9	3.8
	40	4.1	3.4	4.6	3.6	4.9	3.8	5.0	3.8	5.2	3.8	5.5	3.7	5.7	3.7
	42	3.8	3.1	4.3	3.3	4.5	3.5	4.7	3.5	4.8	3.5	5.1	3.5	5.3	3.4
	44	3.5	2.8	3.9	3.0	4.1	3.2	4.3	3.2	4.4	3.2	4.6	3.2	4.9	3.1
	46	3.1	2.5	3.4	2.7	3.7	2.8	3.8	2.8	3.9	2.8	4.1	2.8	4.3	2.7
024	10	5.8	4.9	6.4	5.2	6.9	5.5	7.1	5.5	7.3	5.5	7.7	5.4	8.1	5.3
	12	5.8	4.9	6.4	5.2	6.9	5.5	7.1	5.5	7.3	5.5	7.7	5.4	8.1	5.3
	14	5.8	4.9	6.4	5.2	6.9	5.5	7.1	5.5	7.3	5.5	7.7	5.4	8.1	5.3
	16	5.8	4.9	6.4	5.2	6.9	5.5	7.1	5.5	7.3	5.5	7.7	5.4	8.1	5.3
	18	5.8	4.9	6.4	5.2	6.9	5.5	7.1	5.5	7.3	5.5	7.7	5.4	8.1	5.3
	20	5.8	4.9	6.4	5.2	6.9	5.5	7.1	5.5	7.3	5.5	7.7	5.4	8.1	5.3
	21	5.8	4.9	6.4	5.2	6.9	5.5	7.1	5.5	7.3	5.5	7.7	5.4	8.1	5.3
	23	5.8	4.9	6.4	5.2	6.9	5.5	7.1	5.5	7.3	5.5	7.7	5.4	8.1	5.3
	25	5.8	4.9	6.4	5.2	6.9	5.5	7.1	5.5	7.3	5.5	7.7	5.4	8.1	5.3
	27	5.8	4.9	6.4	5.2	6.9	5.5	7.1	5.5	7.3	5.5	7.7	5.4	8.1	5.3
	29	5.8	4.9	6.4	5.2	6.9	5.5	7.1	5.5	7.3	5.5	7.7	5.4	8.1	5.3
	31	5.8	4.9	6.4	5.2	6.9	5.5	7.1	5.5	7.3	5.5	7.7	5.4	8.1	5.3
	33	5.8	4.9	6.4	5.2	6.9	5.5	7.1	5.5	7.3	5.5	7.7	5.4	8.1	5.3
	35	5.8	4.9	6.4	5.2	6.9	5.5	7.1	5.5	7.3	5.5	7.7	5.4	8.1	5.3
	37	5.7	4.7	6.3	5.0	6.7	5.4	6.9	5.3	7.1	5.3	7.5	5.3	7.9	5.2
	39	5.4	4.5	6.0	4.8	6.4	5.1	6.6	5.1	6.8	5.1	7.2	5.0	7.5	4.9
	40	5.2	4.4	5.8	4.7	6.2	5.0	6.4	5.0	6.6	5.0	7.0	4.9	7.3	4.8
	42	4.9	4.1	5.4	4.3	5.8	4.6	5.9	4.6	6.1	4.6	6.5	4.6	6.8	4.5
	44	4.4	3.7	4.9	4.0	5.2	4.2	5.4	4.2	5.6	4.2	5.9	4.1	6.2	4.1
	46	3.9	3.3	4.3	3.5	4.6	3.7	4.8	3.7	4.9	3.7	5.2	3.7	5.4	3.6

# Sensible capacity table



## Concealed Duct Standard Type ( MMD-AP\_6BHP-E )

TC : Total capacity [kW] SHC : Sensible capacity [kW]

unit size	outdoor air temp. °CDB	indoor air temp.													
		14°CWB		16°CWB		18°CWB		19°CWB		20°CWB		22°CWB		24°CWB	
		20°CDB	23°CDB	26°CDB	27°CDB	28°CDB	30°CDB	32°CDB	TC	SHC	TC	SHC	TC	SHC	TC
027	10	6.6	5.4	7.3	5.8	7.8	6.1	8.0	6.1	8.2	6.1	8.7	6.0	9.1	5.9
	12	6.6	5.4	7.3	5.8	7.8	6.1	8.0	6.1	8.2	6.1	8.7	6.0	9.1	5.9
	14	6.6	5.4	7.3	5.8	7.8	6.1	8.0	6.1	8.2	6.1	8.7	6.0	9.1	5.9
	16	6.6	5.4	7.3	5.8	7.8	6.1	8.0	6.1	8.2	6.1	8.7	6.0	9.1	5.9
	18	6.6	5.4	7.3	5.8	7.8	6.1	8.0	6.1	8.2	6.1	8.7	6.0	9.1	5.9
	20	6.6	5.4	7.3	5.8	7.8	6.1	8.0	6.1	8.2	6.1	8.7	6.0	9.1	5.9
	21	6.6	5.4	7.3	5.8	7.8	6.1	8.0	6.1	8.2	6.1	8.7	6.0	9.1	5.9
	23	6.6	5.4	7.3	5.8	7.8	6.1	8.0	6.1	8.2	6.1	8.7	6.0	9.1	5.9
	25	6.6	5.4	7.3	5.8	7.8	6.1	8.0	6.1	8.2	6.1	8.7	6.0	9.1	5.9
	27	6.6	5.4	7.3	5.8	7.8	6.1	8.0	6.1	8.2	6.1	8.7	6.0	9.1	5.9
	29	6.6	5.4	7.3	5.8	7.8	6.1	8.0	6.1	8.2	6.1	8.7	6.0	9.1	5.9
	31	6.6	5.4	7.3	5.8	7.8	6.1	8.0	6.1	8.2	6.1	8.7	6.0	9.1	5.9
	33	6.6	5.4	7.3	5.8	7.8	6.1	8.0	6.1	8.2	6.1	8.7	6.0	9.1	5.9
	35	6.6	5.4	7.3	5.8	7.8	6.1	8.0	6.1	8.2	6.1	8.7	6.0	9.1	5.9
	37	6.4	5.2	7.0	5.6	7.5	5.9	7.8	5.9	8.0	5.9	8.5	5.9	8.8	5.7
	39	6.1	5.0	6.7	5.3	7.2	5.7	7.4	5.7	7.6	5.7	8.1	5.6	8.5	5.5
	40	5.9	4.9	6.5	5.2	7.0	5.5	7.2	5.5	7.4	5.5	7.8	5.4	8.2	5.3
	42	5.5	4.5	6.1	4.8	6.5	5.1	6.7	5.1	6.9	5.1	7.3	5.1	7.6	4.9
	44	5.0	4.1	5.5	4.4	5.9	4.7	6.1	4.6	6.3	4.6	6.6	4.6	6.9	4.5
	46	4.4	3.6	4.9	3.9	5.2	4.1	5.4	4.1	5.5	4.1	5.9	4.1	6.1	4.0
030	10	7.4	5.9	8.2	6.3	8.7	6.7	9.0	6.7	9.3	6.7	9.8	6.6	10.3	6.5
	12	7.4	5.9	8.2	6.3	8.7	6.7	9.0	6.7	9.3	6.7	9.8	6.6	10.3	6.5
	14	7.4	5.9	8.2	6.3	8.7	6.7	9.0	6.7	9.3	6.7	9.8	6.6	10.3	6.5
	16	7.4	5.9	8.2	6.3	8.7	6.7	9.0	6.7	9.3	6.7	9.8	6.6	10.3	6.5
	18	7.4	5.9	8.2	6.3	8.7	6.7	9.0	6.7	9.3	6.7	9.8	6.6	10.3	6.5
	20	7.4	5.9	8.2	6.3	8.7	6.7	9.0	6.7	9.3	6.7	9.8	6.6	10.3	6.5
	21	7.4	5.9	8.2	6.3	8.7	6.7	9.0	6.7	9.3	6.7	9.8	6.6	10.3	6.5
	23	7.4	5.9	8.2	6.3	8.7	6.7	9.0	6.7	9.3	6.7	9.8	6.6	10.3	6.5
	25	7.4	5.9	8.2	6.3	8.7	6.7	9.0	6.7	9.3	6.7	9.8	6.6	10.3	6.5
	27	7.4	5.9	8.2	6.3	8.7	6.7	9.0	6.7	9.3	6.7	9.8	6.6	10.3	6.5
	29	7.4	5.9	8.2	6.3	8.7	6.7	9.0	6.7	9.3	6.7	9.8	6.6	10.3	6.5
	31	7.4	5.9	8.2	6.3	8.7	6.7	9.0	6.7	9.3	6.7	9.8	6.6	10.3	6.5
	33	7.4	5.9	8.2	6.3	8.7	6.7	9.0	6.7	9.3	6.7	9.8	6.6	10.3	6.5
	35	7.4	5.9	8.2	6.3	8.7	6.7	9.0	6.7	9.3	6.7	9.8	6.6	10.3	6.5
	37	7.2	5.8	8.0	6.2	8.5	6.6	8.8	6.5	9.0	6.5	9.6	6.5	10.0	6.3
	39	6.9	5.6	7.7	5.9	8.2	6.3	8.4	6.3	8.7	6.3	9.2	6.2	9.6	6.1
	40	6.7	5.4	7.5	5.8	8.0	6.1	8.2	6.1	8.5	6.1	8.9	6.1	9.4	5.9
	42	6.3	5.1	7.0	5.4	7.4	5.7	7.7	5.7	7.9	5.7	8.4	5.7	8.7	5.5
	44	5.8	4.6	6.4	4.9	6.8	5.2	7.0	5.2	7.2	5.2	7.6	5.2	8.0	5.0
	46	5.1	4.1	5.7	4.4	6.0	4.6	6.2	4.6	6.4	4.6	6.8	4.6	7.1	4.5
036	10	9.2	7.8	10.2	8.3	10.9	8.8	11.2	8.8	11.5	8.8	12.2	8.7	12.8	8.5
	12	9.2	7.8	10.2	8.3	10.9	8.8	11.2	8.8	11.5	8.8	12.2	8.7	12.8	8.5
	14	9.2	7.8	10.2	8.3	10.9	8.8	11.2	8.8	11.5	8.8	12.2	8.7	12.8	8.5
	16	9.2	7.8	10.2	8.3	10.9	8.8	11.2	8.8	11.5	8.8	12.2	8.7	12.8	8.5
	18	9.2	7.8	10.2	8.3	10.9	8.8	11.2	8.8	11.5	8.8	12.2	8.7	12.8	8.5
	20	9.2	7.8	10.2	8.3	10.9	8.8	11.2	8.8	11.5	8.8	12.2	8.7	12.8	8.5
	21	9.2	7.8	10.2	8.3	10.9	8.8	11.2	8.8	11.5	8.8	12.2	8.7	12.8	8.5
	23	9.2	7.8	10.2	8.3	10.9	8.8	11.2	8.8	11.5	8.8	12.2	8.7	12.8	8.5
	25	9.2	7.8	10.2	8.3	10.9	8.8	11.2	8.8	11.5	8.8	12.2	8.7	12.8	8.5
	27	9.2	7.8	10.2	8.3	10.9	8.8	11.2	8.8	11.5	8.8	12.2	8.7	12.8	8.5
	29	9.2	7.8	10.2	8.3	10.9	8.8	11.2	8.8	11.5	8.8	12.2	8.7	12.8	8.5
	31	9.2	7.8	10.2	8.3	10.9	8.8	11.2	8.8	11.5	8.8	12.2	8.7	12.8	8.5
	33	9.2	7.8	10.2	8.3	10.9	8.8	11.2	8.8	11.5	8.8	12.2	8.7	12.8	8.5
	35	9.2	7.8	10.2	8.3	10.9	8.8	11.2	8.8	11.5	8.8	12.2	8.7	12.8	8.5
	37	8.9	7.6	9.9	8.1	10.5	8.6	10.9	8.5	11.2	8.5	11.8	8.5	12.4	8.3
	39	8.5	7.2	9.4	7.7	10.1	8.2	10.4	8.2	10.7	8.2	11.3	8.1	11.8	7.9
	40	8.3	7.0	9.2	7.5	9.8	7.9	10.1	7.9	10.4	7.9	11.0	7.8	11.5	7.7
	42	7.7	6.5	8.5	7.0	9.1	7.4	9.4	7.4	9.7	7.4	10.2	7.3	10.7	7.1
	44	7.0	5.9	7.7	6.3	8.3	6.7	8.5	6.7	8.8	6.7	9.3	6.6	9.7	6.5
	46	6.2	5.2	6.8	5.6	7.3	5.9	7.5	5.9	7.8	5.9	8.2	5.9	8.6	5.7

## Sensible capacity table

### Concealed Duct Standard Type ( MMD-AP\_\_6BHP-E )

TC : Total capacity [kW] SHC : Sensible capacity [kW]

unit size	outdoor air temp. °CDB	indoor air temp.													
		14°CWB		16°CWB		18°CWB		19°CWB		20°CWB		22°CWB		24°CWB	
		20°CDB	23°CDB	26°CDB	27°CDB	28°CDB	30°CDB	32°CDB	TC	SHC	TC	SHC	TC	SHC	TC
048	10	11.5	9.5	12.7	10.1	13.6	10.7	14.0	10.7	14.4	10.7	15.3	10.6	16.0	10.4
	12	11.5	9.5	12.7	10.1	13.6	10.7	14.0	10.7	14.4	10.7	15.3	10.6	16.0	10.4
	14	11.5	9.5	12.7	10.1	13.6	10.7	14.0	10.7	14.4	10.7	15.3	10.6	16.0	10.4
	16	11.5	9.5	12.7	10.1	13.6	10.7	14.0	10.7	14.4	10.7	15.3	10.6	16.0	10.4
	18	11.5	9.5	12.7	10.1	13.6	10.7	14.0	10.7	14.4	10.7	15.3	10.6	16.0	10.4
	20	11.5	9.5	12.7	10.1	13.6	10.7	14.0	10.7	14.4	10.7	15.3	10.6	16.0	10.4
	21	11.5	9.5	12.7	10.1	13.6	10.7	14.0	10.7	14.4	10.7	15.3	10.6	16.0	10.4
	23	11.5	9.5	12.7	10.1	13.6	10.7	14.0	10.7	14.4	10.7	15.3	10.6	16.0	10.4
	25	11.5	9.5	12.7	10.1	13.6	10.7	14.0	10.7	14.4	10.7	15.3	10.6	16.0	10.4
	27	11.5	9.5	12.7	10.1	13.6	10.7	14.0	10.7	14.4	10.7	15.3	10.6	16.0	10.4
	29	11.5	9.5	12.7	10.1	13.6	10.7	14.0	10.7	14.4	10.7	15.3	10.6	16.0	10.4
	31	11.5	9.5	12.7	10.1	13.6	10.7	14.0	10.7	14.4	10.7	15.3	10.6	16.0	10.4
	33	11.5	9.5	12.7	10.1	13.6	10.7	14.0	10.7	14.4	10.7	15.3	10.6	16.0	10.4
	35	11.5	9.5	12.7	10.1	13.6	10.7	14.0	10.7	14.4	10.7	15.3	10.6	16.0	10.4
	37	11.1	9.2	12.3	9.8	13.2	10.4	13.6	10.4	14.0	10.4	14.8	10.3	15.5	10.0
	39	10.7	8.8	11.8	9.4	12.6	9.9	13.0	9.9	13.4	9.9	14.1	9.8	14.8	9.6
	40	10.3	8.5	11.4	9.1	12.2	9.7	12.6	9.6	13.0	9.6	13.7	9.5	14.4	9.3
	42	9.6	7.9	10.6	8.5	11.4	9.0	11.7	9.0	12.1	9.0	12.8	8.9	13.4	8.7
	44	8.8	7.2	9.7	7.7	10.3	8.2	10.7	8.1	11.0	8.1	11.6	8.1	12.2	7.9
	46	7.7	6.4	8.5	6.8	9.1	7.2	9.4	7.2	9.7	7.2	10.3	7.1	10.7	7.0
056	10	13.1	10.2	14.5	10.9	15.5	11.5	16.0	11.5	16.5	11.5	17.4	11.4	18.2	11.1
	12	13.1	10.2	14.5	10.9	15.5	11.5	16.0	11.5	16.5	11.5	17.4	11.4	18.2	11.1
	14	13.1	10.2	14.5	10.9	15.5	11.5	16.0	11.5	16.5	11.5	17.4	11.4	18.2	11.1
	16	13.1	10.2	14.5	10.9	15.5	11.5	16.0	11.5	16.5	11.5	17.4	11.4	18.2	11.1
	18	13.1	10.2	14.5	10.9	15.5	11.5	16.0	11.5	16.5	11.5	17.4	11.4	18.2	11.1
	20	13.1	10.2	14.5	10.9	15.5	11.5	16.0	11.5	16.5	11.5	17.4	11.4	18.2	11.1
	21	13.1	10.2	14.5	10.9	15.5	11.5	16.0	11.5	16.5	11.5	17.4	11.4	18.2	11.1
	23	13.1	10.2	14.5	10.9	15.5	11.5	16.0	11.5	16.5	11.5	17.4	11.4	18.2	11.1
	25	13.1	10.2	14.5	10.9	15.5	11.5	16.0	11.5	16.5	11.5	17.4	11.4	18.2	11.1
	27	13.1	10.2	14.5	10.9	15.5	11.5	16.0	11.5	16.5	11.5	17.4	11.4	18.2	11.1
	29	13.1	10.2	14.5	10.9	15.5	11.5	16.0	11.5	16.5	11.5	17.4	11.4	18.2	11.1
	31	13.1	10.2	14.5	10.9	15.5	11.5	16.0	11.5	16.5	11.5	17.4	11.4	18.2	11.1
	33	13.1	10.2	14.5	10.9	15.5	11.5	16.0	11.5	16.5	11.5	17.4	11.4	18.2	11.1
	35	13.1	10.2	14.5	10.9	15.5	11.5	16.0	11.5	16.5	11.5	17.4	11.4	18.2	11.1
	37	12.7	9.9	14.1	10.5	15.1	11.2	15.5	11.2	16.0	11.2	16.9	11.1	17.7	10.8
	39	12.2	9.4	13.5	10.1	14.4	10.7	14.8	10.7	15.3	10.7	16.2	10.6	16.9	10.3
	40	11.8	9.2	13.1	9.8	14.0	10.4	14.4	10.4	14.8	10.4	15.7	10.3	16.4	10.0
	42	11.0	8.5	12.2	9.1	13.0	9.7	13.4	9.6	13.8	9.6	14.6	9.5	15.3	9.3
	44	10.0	7.8	11.1	8.3	11.8	8.8	12.2	8.8	12.5	8.8	13.3	8.7	13.9	8.5
	46	8.8	6.9	9.8	7.3	10.4	7.8	10.8	7.7	11.1	7.7	11.7	7.7	12.3	7.5

# Sensible capacity table



## Concealed Duct High Static Pressure Type ( MMD-AP 6HP-E )

TC : Total capacity [kW] SHC : Sensible capacity [kW]

unit size	outdoor air temp. °CDB	indoor air temp.													
		14°CWB		16°CWB		18°CWB		19°CWB		20°CWB		22°CWB		24°CWB	
		20°CDB	23°CDB	26°CDB	27°CDB	28°CDB	30°CDB	32°CDB	TC	SHC	TC	SHC	TC	SHC	
018	10	4.6	4.0	5.1	4.2	5.4	4.5	5.6	4.5	5.8	4.5	6.1	4.5	6.4	4.4
	12	4.6	4.0	5.1	4.2	5.4	4.5	5.6	4.5	5.8	4.5	6.1	4.5	6.4	4.4
	14	4.6	4.0	5.1	4.2	5.4	4.5	5.6	4.5	5.8	4.5	6.1	4.5	6.4	4.4
	16	4.6	4.0	5.1	4.2	5.4	4.5	5.6	4.5	5.8	4.5	6.1	4.5	6.4	4.4
	18	4.6	4.0	5.1	4.2	5.4	4.5	5.6	4.5	5.8	4.5	6.1	4.5	6.4	4.4
	20	4.6	4.0	5.1	4.2	5.4	4.5	5.6	4.5	5.8	4.5	6.1	4.5	6.4	4.4
	21	4.6	4.0	5.1	4.2	5.4	4.5	5.6	4.5	5.8	4.5	6.1	4.5	6.4	4.4
	23	4.6	4.0	5.1	4.2	5.4	4.5	5.6	4.5	5.8	4.5	6.1	4.5	6.4	4.4
	25	4.6	4.0	5.1	4.2	5.4	4.5	5.6	4.5	5.8	4.5	6.1	4.5	6.4	4.4
	27	4.6	4.0	5.1	4.2	5.4	4.5	5.6	4.5	5.8	4.5	6.1	4.5	6.4	4.4
	29	4.6	4.0	5.1	4.2	5.4	4.5	5.6	4.5	5.8	4.5	6.1	4.5	6.4	4.4
	31	4.6	4.0	5.1	4.2	5.4	4.5	5.6	4.5	5.8	4.5	6.1	4.5	6.4	4.4
	33	4.6	4.0	5.1	4.2	5.4	4.5	5.6	4.5	5.8	4.5	6.1	4.5	6.4	4.4
	35	4.6	4.0	5.1	4.2	5.4	4.5	5.6	4.5	5.8	4.5	6.1	4.5	6.4	4.4
	37	4.5	3.9	4.9	4.1	5.3	4.4	5.4	4.4	5.6	4.4	5.9	4.3	6.2	4.2
	39	4.3	3.7	4.7	3.9	5.0	4.2	5.2	4.2	5.3	4.2	5.7	4.1	5.9	4.0
	40	4.1	3.6	4.6	3.8	4.9	4.1	5.0	4.1	5.2	4.1	5.5	4.0	5.7	3.9
	42	3.8	3.3	4.3	3.6	4.5	3.8	4.7	3.8	4.8	3.8	5.1	3.7	5.3	3.6
	44	3.5	3.0	3.9	3.2	4.1	3.4	4.3	3.4	4.4	3.4	4.6	3.4	4.9	3.3
	46	3.1	2.7	3.4	2.9	3.7	3.0	3.8	3.0	3.9	3.0	4.1	3.0	4.3	2.9
024	10	5.8	5.0	6.4	5.3	6.9	5.6	7.1	5.6	7.3	5.6	7.7	5.5	8.1	5.4
	12	5.8	5.0	6.4	5.3	6.9	5.6	7.1	5.6	7.3	5.6	7.7	5.5	8.1	5.4
	14	5.8	5.0	6.4	5.3	6.9	5.6	7.1	5.6	7.3	5.6	7.7	5.5	8.1	5.4
	16	5.8	5.0	6.4	5.3	6.9	5.6	7.1	5.6	7.3	5.6	7.7	5.5	8.1	5.4
	18	5.8	5.0	6.4	5.3	6.9	5.6	7.1	5.6	7.3	5.6	7.7	5.5	8.1	5.4
	20	5.8	5.0	6.4	5.3	6.9	5.6	7.1	5.6	7.3	5.6	7.7	5.5	8.1	5.4
	21	5.8	5.0	6.4	5.3	6.9	5.6	7.1	5.6	7.3	5.6	7.7	5.5	8.1	5.4
	23	5.8	5.0	6.4	5.3	6.9	5.6	7.1	5.6	7.3	5.6	7.7	5.5	8.1	5.4
	25	5.8	5.0	6.4	5.3	6.9	5.6	7.1	5.6	7.3	5.6	7.7	5.5	8.1	5.4
	27	5.8	5.0	6.4	5.3	6.9	5.6	7.1	5.6	7.3	5.6	7.7	5.5	8.1	5.4
	29	5.8	5.0	6.4	5.3	6.9	5.6	7.1	5.6	7.3	5.6	7.7	5.5	8.1	5.4
	31	5.8	5.0	6.4	5.3	6.9	5.6	7.1	5.6	7.3	5.6	7.7	5.5	8.1	5.4
	33	5.8	5.0	6.4	5.3	6.9	5.6	7.1	5.6	7.3	5.6	7.7	5.5	8.1	5.4
	35	5.8	5.0	6.4	5.3	6.9	5.6	7.1	5.6	7.3	5.6	7.7	5.5	8.1	5.4
	37	5.7	4.8	6.3	5.1	6.7	5.4	6.9	5.4	7.1	5.4	7.5	5.4	7.9	5.3
	39	5.4	4.6	6.0	4.9	6.4	5.2	6.6	5.2	6.8	5.2	7.2	5.1	7.5	5.0
	40	5.2	4.5	5.8	4.8	6.2	5.1	6.4	5.0	6.6	5.0	7.0	5.0	7.3	4.9
	42	4.9	4.2	5.4	4.4	5.8	4.7	5.9	4.7	6.1	4.7	6.5	4.6	6.8	4.5
	44	4.4	3.8	4.9	4.0	5.2	4.3	5.4	4.3	5.6	4.3	5.9	4.2	6.2	4.1
	46	3.9	3.3	4.3	3.6	4.6	3.8	4.8	3.8	4.9	3.8	5.2	3.7	5.4	3.6
027	10	6.6	5.4	7.3	5.8	7.8	6.1	8.0	6.1	8.2	6.1	8.7	6.0	9.1	5.9
	12	6.6	5.4	7.3	5.8	7.8	6.1	8.0	6.1	8.2	6.1	8.7	6.0	9.1	5.9
	14	6.6	5.4	7.3	5.8	7.8	6.1	8.0	6.1	8.2	6.1	8.7	6.0	9.1	5.9
	16	6.6	5.4	7.3	5.8	7.8	6.1	8.0	6.1	8.2	6.1	8.7	6.0	9.1	5.9
	18	6.6	5.4	7.3	5.8	7.8	6.1	8.0	6.1	8.2	6.1	8.7	6.0	9.1	5.9
	20	6.6	5.4	7.3	5.8	7.8	6.1	8.0	6.1	8.2	6.1	8.7	6.0	9.1	5.9
	21	6.6	5.4	7.3	5.8	7.8	6.1	8.0	6.1	8.2	6.1	8.7	6.0	9.1	5.9
	23	6.6	5.4	7.3	5.8	7.8	6.1	8.0	6.1	8.2	6.1	8.7	6.0	9.1	5.9
	25	6.6	5.4	7.3	5.8	7.8	6.1	8.0	6.1	8.2	6.1	8.7	6.0	9.1	5.9
	27	6.6	5.4	7.3	5.8	7.8	6.1	8.0	6.1	8.2	6.1	8.7	6.0	9.1	5.9
	29	6.6	5.4	7.3	5.8	7.8	6.1	8.0	6.1	8.2	6.1	8.7	6.0	9.1	5.9
	31	6.6	5.4	7.3	5.8	7.8	6.1	8.0	6.1	8.2	6.1	8.7	6.0	9.1	5.9
	33	6.6	5.4	7.3	5.8	7.8	6.1	8.0	6.1	8.2	6.1	8.7	6.0	9.1	5.9
	35	6.6	5.4	7.3	5.8	7.8	6.1	8.0	6.1	8.2	6.1	8.7	6.0	9.1	5.9
	37	6.4	5.2	7.0	5.6	7.5	5.9	7.8	5.9	8.0	5.9	8.5	5.9	8.8	5.7
	39	6.1	5.0	6.7	5.3	7.2	5.7	7.4	5.7	7.6	5.7	8.1	5.6	8.5	5.5
	40	5.9	4.9	6.5	5.2	7.0	5.5	7.2	5.5	7.4	5.5	7.8	5.4	8.2	5.3
	42	5.5	4.5	6.1	4.8	6.5	5.1	6.7	5.1	6.9	5.1	7.3	5.1	7.6	4.9
	44	5.0	4.1	5.5	4.4	5.9	4.7	6.1	4.6	6.3	4.6	6.6	4.6	6.9	4.5
	46	4.4	3.6	4.9	3.9	5.2	4.1	5.4	4.1	5.5	4.1	5.9	4.1	6.1	4.0

# Sensible capacity table



## Concealed Duct High Static Pressure Type ( MMD-AP 6HP-E )

TC : Total capacity [kW] SHC : Sensible capacity [kW]

unit size	outdoor air temp. °CDB	indoor air temp.													
		14°CWB		16°CWB		18°CWB		19°CWB		20°CWB		22°CWB		24°CWB	
		20°CDB	23°CDB	26°CDB	27°CDB	28°CDB	30°CDB	32°CDB	TC	SHC	TC	SHC	TC	SHC	
036	10	9.2	7.5	10.2	8.0	10.9	8.5	11.2	8.5	11.5	8.5	12.2	8.4	12.8	8.2
	12	9.2	7.5	10.2	8.0	10.9	8.5	11.2	8.5	11.5	8.5	12.2	8.4	12.8	8.2
	14	9.2	7.5	10.2	8.0	10.9	8.5	11.2	8.5	11.5	8.5	12.2	8.4	12.8	8.2
	16	9.2	7.5	10.2	8.0	10.9	8.5	11.2	8.5	11.5	8.5	12.2	8.4	12.8	8.2
	18	9.2	7.5	10.2	8.0	10.9	8.5	11.2	8.5	11.5	8.5	12.2	8.4	12.8	8.2
	20	9.2	7.5	10.2	8.0	10.9	8.5	11.2	8.5	11.5	8.5	12.2	8.4	12.8	8.2
	21	9.2	7.5	10.2	8.0	10.9	8.5	11.2	8.5	11.5	8.5	12.2	8.4	12.8	8.2
	23	9.2	7.5	10.2	8.0	10.9	8.5	11.2	8.5	11.5	8.5	12.2	8.4	12.8	8.2
	25	9.2	7.5	10.2	8.0	10.9	8.5	11.2	8.5	11.5	8.5	12.2	8.4	12.8	8.2
	27	9.2	7.5	10.2	8.0	10.9	8.5	11.2	8.5	11.5	8.5	12.2	8.4	12.8	8.2
	29	9.2	7.5	10.2	8.0	10.9	8.5	11.2	8.5	11.5	8.5	12.2	8.4	12.8	8.2
	31	9.2	7.5	10.2	8.0	10.9	8.5	11.2	8.5	11.5	8.5	12.2	8.4	12.8	8.2
	33	9.2	7.5	10.2	8.0	10.9	8.5	11.2	8.5	11.5	8.5	12.2	8.4	12.8	8.2
	35	9.2	7.5	10.2	8.0	10.9	8.5	11.2	8.5	11.5	8.5	12.2	8.4	12.8	8.2
	37	8.9	7.3	9.9	7.8	10.5	8.3	10.9	8.2	11.2	8.2	11.8	8.2	12.4	8.0
	39	8.5	7.0	9.4	7.4	10.1	7.9	10.4	7.9	10.7	7.9	11.3	7.8	11.8	7.6
	40	8.3	6.8	9.2	7.2	9.8	7.7	10.1	7.7	10.4	7.7	11.0	7.6	11.5	7.4
	42	7.7	6.3	8.5	6.7	9.1	7.1	9.4	7.1	9.7	7.1	10.2	7.1	10.7	6.9
	44	7.0	5.7	7.7	6.1	8.3	6.5	8.5	6.5	8.8	6.5	9.3	6.4	9.7	6.3
	46	6.2	5.1	6.8	5.4	7.3	5.7	7.5	5.7	7.8	5.7	8.2	5.7	8.6	5.5
048	10	11.5	9.5	12.7	10.1	13.6	10.7	14.0	10.7	14.4	10.7	15.3	10.6	16.0	10.4
	12	11.5	9.5	12.7	10.1	13.6	10.7	14.0	10.7	14.4	10.7	15.3	10.6	16.0	10.4
	14	11.5	9.5	12.7	10.1	13.6	10.7	14.0	10.7	14.4	10.7	15.3	10.6	16.0	10.4
	16	11.5	9.5	12.7	10.1	13.6	10.7	14.0	10.7	14.4	10.7	15.3	10.6	16.0	10.4
	18	11.5	9.5	12.7	10.1	13.6	10.7	14.0	10.7	14.4	10.7	15.3	10.6	16.0	10.4
	20	11.5	9.5	12.7	10.1	13.6	10.7	14.0	10.7	14.4	10.7	15.3	10.6	16.0	10.4
	21	11.5	9.5	12.7	10.1	13.6	10.7	14.0	10.7	14.4	10.7	15.3	10.6	16.0	10.4
	23	11.5	9.5	12.7	10.1	13.6	10.7	14.0	10.7	14.4	10.7	15.3	10.6	16.0	10.4
	25	11.5	9.5	12.7	10.1	13.6	10.7	14.0	10.7	14.4	10.7	15.3	10.6	16.0	10.4
	27	11.5	9.5	12.7	10.1	13.6	10.7	14.0	10.7	14.4	10.7	15.3	10.6	16.0	10.4
	29	11.5	9.5	12.7	10.1	13.6	10.7	14.0	10.7	14.4	10.7	15.3	10.6	16.0	10.4
	31	11.5	9.5	12.7	10.1	13.6	10.7	14.0	10.7	14.4	10.7	15.3	10.6	16.0	10.4
	33	11.5	9.5	12.7	10.1	13.6	10.7	14.0	10.7	14.4	10.7	15.3	10.6	16.0	10.4
	35	11.5	9.5	12.7	10.1	13.6	10.7	14.0	10.7	14.4	10.7	15.3	10.6	16.0	10.4
	37	11.1	9.2	12.3	9.8	13.2	10.4	13.6	10.4	14.0	10.4	14.8	10.3	15.5	10.0
	39	10.7	8.8	11.8	9.4	12.6	9.9	13.0	9.9	13.4	9.9	14.1	9.8	14.8	9.6
	40	10.3	8.5	11.4	9.1	12.2	9.7	12.6	9.6	13.0	9.6	13.7	9.5	14.4	9.3
	42	9.6	7.9	10.6	8.5	11.4	9.0	11.7	9.0	12.1	9.0	12.8	8.9	13.4	8.7
	44	8.8	7.2	9.7	7.7	10.3	8.2	10.7	8.1	11.0	8.1	11.6	8.1	12.2	7.9
	46	7.7	6.4	8.5	6.8	9.1	7.2	9.4	7.2	9.7	7.2	10.3	7.1	10.7	7.0
056	10	13.1	10.2	14.5	10.9	15.5	11.5	16.0	11.5	16.5	11.5	17.4	11.4	18.2	11.1
	12	13.1	10.2	14.5	10.9	15.5	11.5	16.0	11.5	16.5	11.5	17.4	11.4	18.2	11.1
	14	13.1	10.2	14.5	10.9	15.5	11.5	16.0	11.5	16.5	11.5	17.4	11.4	18.2	11.1
	16	13.1	10.2	14.5	10.9	15.5	11.5	16.0	11.5	16.5	11.5	17.4	11.4	18.2	11.1
	18	13.1	10.2	14.5	10.9	15.5	11.5	16.0	11.5	16.5	11.5	17.4	11.4	18.2	11.1
	20	13.1	10.2	14.5	10.9	15.5	11.5	16.0	11.5	16.5	11.5	17.4	11.4	18.2	11.1
	21	13.1	10.2	14.5	10.9	15.5	11.5	16.0	11.5	16.5	11.5	17.4	11.4	18.2	11.1
	23	13.1	10.2	14.5	10.9	15.5	11.5	16.0	11.5	16.5	11.5	17.4	11.4	18.2	11.1
	25	13.1	10.2	14.5	10.9	15.5	11.5	16.0	11.5	16.5	11.5	17.4	11.4	18.2	11.1
	27	13.1	10.2	14.5	10.9	15.5	11.5	16.0	11.5	16.5	11.5	17.4	11.4	18.2	11.1
	29	13.1	10.2	14.5	10.9	15.5	11.5	16.0	11.5	16.5	11.5	17.4	11.4	18.2	11.1
	31	13.1	10.2	14.5	10.9	15.5	11.5	16.0	11.5	16.5	11.5	17.4	11.4	18.2	11.1
	33	13.1	10.2	14.5	10.9	15.5	11.5	16.0	11.5	16.5	11.5	17.4	11.4	18.2	11.1
	35	13.1	10.2	14.5	10.9	15.5	11.5	16.0	11.5	16.5	11.5	17.4	11.4	18.2	11.1
	37	12.7	9.9	14.1	10.5	15.1	11.2	15.5	11.2	16.0	11.2	16.9	11.1	17.7	10.8
	39	12.2	9.4	13.5	10.1	14.4	10.7	14.8	10.7	15.3	10.7	16.2	10.6	16.9	10.3
	40	11.8	9.2	13.1	9.8	14.0	10.4	14.4	10.4	14.8	10.4	15.7	10.3	16.4	10.0
	42	11.0	8.5	12.2	9.1	13.0	9.7	13.4	9.6	13.8	9.6	14.6	9.5	15.3	9.3
	44	10.0	7.8	11.1	8.3	11.8	8.8	12.2	8.8	12.5	8.8	13.3	8.7	13.9	8.5
	46	8.8	6.9	9.8	7.3	10.4	7.8	10.8	7.7	11.1	7.7	11.7	7.7	12.3	7.5

# Sensible capacity table



## Concealed Duct High Static Pressure Type ( MMD-AP 4H-E )

TC : Total capacity [kW] SHC : Sensible capacity [kW]

unit size	outdoor air temp. °CDB	indoor air temp.													
		14°CWB		16°CWB		18°CWB		19°CWB		20°CWB		22°CWB			
		20°CDB	23°CDB	26°CDB	27°CDB	28°CDB	30°CDB	32°CDB	TC	SHC	TC	SHC	TC	SHC	
072	10	13.1	10.2	14.5	10.9	15.5	11.5	16.0	11.5	16.5	11.5	17.4	11.4	18.2	11.1
	12	13.1	10.2	14.5	10.9	15.5	11.5	16.0	11.5	16.5	11.5	17.4	11.4	18.2	11.1
	14	13.1	10.2	14.5	10.9	15.5	11.5	16.0	11.5	16.5	11.5	17.4	11.4	18.2	11.1
	16	13.1	10.2	14.5	10.9	15.5	11.5	16.0	11.5	16.5	11.5	17.4	11.4	18.2	11.1
	18	13.1	10.2	14.5	10.9	15.5	11.5	16.0	11.5	16.5	11.5	17.4	11.4	18.2	11.1
	20	13.1	10.2	14.5	10.9	15.5	11.5	16.0	11.5	16.5	11.5	17.4	11.4	18.2	11.1
	21	13.1	10.2	14.5	10.9	15.5	11.5	16.0	11.5	16.5	11.5	17.4	11.4	18.2	11.1
	23	13.1	10.2	14.5	10.9	15.5	11.5	16.0	11.5	16.5	11.5	17.4	11.4	18.2	11.1
	25	13.1	10.2	14.5	10.9	15.5	11.5	16.0	11.5	16.5	11.5	17.4	11.4	18.2	11.1
	27	13.1	10.2	14.5	10.9	15.5	11.5	16.0	11.5	16.5	11.5	17.4	11.4	18.2	11.1
	29	13.1	10.2	14.5	10.9	15.5	11.5	16.0	11.5	16.5	11.5	17.4	11.4	18.2	11.1
	31	13.1	10.2	14.5	10.9	15.5	11.5	16.0	11.5	16.5	11.5	17.4	11.4	18.2	11.1
	33	13.1	10.2	14.5	10.9	15.5	11.5	16.0	11.5	16.5	11.5	17.4	11.4	18.2	11.1
	35	18.4	14.6	20.3	15.6	21.7	16.5	22.4	16.5	23.1	16.5	24.4	16.3	25.5	16.0
	37	12.7	9.9	14.1	10.5	15.1	11.2	15.5	11.2	16.0	11.2	16.9	11.1	17.7	10.8
	39	12.2	9.4	13.5	10.1	14.4	10.7	14.8	10.7	15.3	10.7	16.2	10.6	16.9	10.3
	40	11.8	9.2	13.1	9.8	14.0	10.4	14.4	10.4	14.8	10.4	15.7	10.3	16.4	10.0
	42	11.0	8.5	12.2	9.1	13.0	9.7	13.4	9.6	13.8	9.6	14.6	9.5	15.3	9.3
	44	10.0	7.8	11.1	8.3	11.8	8.8	12.2	8.8	12.5	8.8	13.3	8.7	13.9	8.5
	46	8.8	6.9	9.8	7.3	10.4	7.8	10.8	7.7	11.1	7.7	11.7	7.7	12.3	7.5
096	10	18.4	14.6	20.3	15.6	21.7	16.5	22.4	16.5	23.1	16.5	24.4	16.3	25.5	16.0
	12	18.4	14.6	20.3	15.6	21.7	16.5	22.4	16.5	23.1	16.5	24.4	16.3	25.5	16.0
	14	18.4	14.6	20.3	15.6	21.7	16.5	22.4	16.5	23.1	16.5	24.4	16.3	25.5	16.0
	16	18.4	14.6	20.3	15.6	21.7	16.5	22.4	16.5	23.1	16.5	24.4	16.3	25.5	16.0
	18	18.4	14.6	20.3	15.6	21.7	16.5	22.4	16.5	23.1	16.5	24.4	16.3	25.5	16.0
	20	18.4	14.6	20.3	15.6	21.7	16.5	22.4	16.5	23.1	16.5	24.4	16.3	25.5	16.0
	21	18.4	14.6	20.3	15.6	21.7	16.5	22.4	16.5	23.1	16.5	24.4	16.3	25.5	16.0
	23	18.4	14.6	20.3	15.6	21.7	16.5	22.4	16.5	23.1	16.5	24.4	16.3	25.5	16.0
	25	18.4	14.6	20.3	15.6	21.7	16.5	22.4	16.5	23.1	16.5	24.4	16.3	25.5	16.0
	27	18.4	14.6	20.3	15.6	21.7	16.5	22.4	16.5	23.1	16.5	24.4	16.3	25.5	16.0
	29	18.4	14.6	20.3	15.6	21.7	16.5	22.4	16.5	23.1	16.5	24.4	16.3	25.5	16.0
	31	18.4	14.6	20.3	15.6	21.7	16.5	22.4	16.5	23.1	16.5	24.4	16.3	25.5	16.0
	33	18.4	14.6	20.3	15.6	21.7	16.5	22.4	16.5	23.1	16.5	24.4	16.3	25.5	16.0
	35	23.0	17.9	25.4	19.1	27.2	20.3	28.0	20.2	28.8	20.2	30.5	20.0	31.9	19.5
	37	17.8	14.2	19.7	15.1	21.1	16.1	21.7	16.0	22.4	16.0	23.7	15.9	24.8	15.5
	39	17.0	13.6	18.8	14.4	20.1	15.3	20.8	15.3	21.4	15.3	22.6	15.1	23.7	14.8
	40	16.6	13.2	18.3	14.0	19.6	14.9	20.2	14.9	20.8	14.9	22.0	14.7	23.0	14.4
	42	15.4	12.2	17.0	13.0	18.2	13.9	18.8	13.8	19.3	13.8	20.4	13.7	21.4	13.4
	44	14.0	11.1	15.5	11.9	16.5	12.6	17.1	12.6	17.6	12.6	18.6	12.4	19.4	12.2
	46	12.4	9.8	13.7	10.5	14.6	11.1	15.1	11.1	15.5	11.1	16.4	11.0	17.2	10.7

**Sensible capacity table**



**Slim Duct Type ( MMD-AP 6SPH-E )**

TC : Total capacity [kW] SHC : Sensible capacity [kW]

unit size	outdoor air temp. °CDB	indoor air temp.												
		14°CWB		16°CWB		18°CWB		19°CWB		20°CWB		22°CWB		
		20°CDB		23°CDB		26°CDB		27°CDB		28°CDB		30°CDB		
005	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
	10	1.4	1.3	1.5	1.4	1.6	1.5	1.7	1.5	1.8	1.5	1.9	1.5	1.9
	12	1.4	1.3	1.5	1.4	1.6	1.5	1.7	1.5	1.8	1.5	1.9	1.5	1.9
	14	1.4	1.3	1.5	1.4	1.6	1.5	1.7	1.5	1.8	1.5	1.9	1.5	1.9
	16	1.4	1.3	1.5	1.4	1.6	1.5	1.7	1.5	1.8	1.5	1.9	1.5	1.9
	18	1.4	1.3	1.5	1.4	1.6	1.5	1.7	1.5	1.8	1.5	1.9	1.5	1.9
	20	1.4	1.3	1.5	1.4	1.6	1.5	1.7	1.5	1.8	1.5	1.9	1.5	1.9
	21	1.4	1.3	1.5	1.4	1.6	1.5	1.7	1.5	1.8	1.5	1.9	1.5	1.9
	23	1.4	1.3	1.5	1.4	1.6	1.5	1.7	1.5	1.8	1.5	1.9	1.5	1.9
	25	1.4	1.3	1.5	1.4	1.6	1.5	1.7	1.5	1.8	1.5	1.9	1.5	1.9
	27	1.4	1.3	1.5	1.4	1.6	1.5	1.7	1.5	1.8	1.5	1.9	1.5	1.9
	29	1.4	1.3	1.5	1.4	1.6	1.5	1.7	1.5	1.8	1.5	1.9	1.5	1.9
	31	1.4	1.3	1.5	1.4	1.6	1.5	1.7	1.5	1.8	1.5	1.9	1.5	1.9
	33	1.4	1.3	1.5	1.4	1.6	1.5	1.7	1.5	1.8	1.5	1.9	1.5	1.9
	35	1.4	1.3	1.5	1.4	1.6	1.5	1.7	1.5	1.8	1.5	1.9	1.5	1.9
	37	1.4	1.3	1.5	1.4	1.6	1.5	1.6	1.5	1.7	1.5	1.8	1.4	1.9
	39	1.3	1.2	1.4	1.3	1.5	1.4	1.6	1.4	1.6	1.4	1.7	1.4	1.8
	40	1.3	1.2	1.4	1.3	1.5	1.4	1.5	1.4	1.6	1.4	1.7	1.3	1.7
	42	1.2	1.1	1.3	1.2	1.4	1.3	1.4	1.3	1.5	1.3	1.6	1.2	1.6
	44	1.1	1.0	1.2	1.1	1.3	1.1	1.3	1.1	1.3	1.1	1.4	1.1	1.5
	46	0.9	0.9	1.0	1.0	1.1	1.0	1.1	1.0	1.2	1.0	1.2	1.0	1.3
														1.0

# Sensible capacity table



## Slim Duct Type ( MMD-AP 4SPH-E )

TC : Total capacity [kW] SHC : Sensible capacity [kW]

unit size	outdoor air temp. °CDB	indoor air temp.													
		14°CWB		16°CWB		18°CWB		19°CWB		20°CWB		22°CWB		24°CWB	
		20°CDB		23°CDB		26°CDB		27°CDB		28°CDB		30°CDB		32°CDB	
		TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
007	10	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	12	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	14	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	16	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	18	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	20	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	21	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	23	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	25	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	27	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	29	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	31	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	33	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	35	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	37	1.8	1.5	1.9	1.6	2.1	1.8	2.1	1.7	2.2	1.7	2.3	1.7	2.4	1.7
	39	1.7	1.5	1.9	1.6	2.0	1.7	2.0	1.7	2.1	1.7	2.2	1.7	2.3	1.6
	40	1.6	1.4	1.8	1.5	1.9	1.6	2.0	1.6	2.0	1.6	2.2	1.6	2.3	1.6
	42	1.5	1.3	1.7	1.4	1.8	1.5	1.8	1.5	1.9	1.5	2.0	1.5	2.1	1.5
	44	1.4	1.2	1.5	1.3	1.6	1.4	1.7	1.4	1.7	1.4	1.8	1.4	1.9	1.3
	46	1.2	1.1	1.3	1.1	1.4	1.2	1.5	1.2	1.5	1.2	1.6	1.2	1.7	1.2
009	10	2.3	2.0	2.5	2.1	2.7	2.2	2.8	2.2	2.9	2.2	3.1	2.2	3.2	2.1
	12	2.3	2.0	2.5	2.1	2.7	2.2	2.8	2.2	2.9	2.2	3.1	2.2	3.2	2.1
	14	2.3	2.0	2.5	2.1	2.7	2.2	2.8	2.2	2.9	2.2	3.1	2.2	3.2	2.1
	16	2.3	2.0	2.5	2.1	2.7	2.2	2.8	2.2	2.9	2.2	3.1	2.2	3.2	2.1
	18	2.3	2.0	2.5	2.1	2.7	2.2	2.8	2.2	2.9	2.2	3.1	2.2	3.2	2.1
	20	2.3	2.0	2.5	2.1	2.7	2.2	2.8	2.2	2.9	2.2	3.1	2.2	3.2	2.1
	21	2.3	2.0	2.5	2.1	2.7	2.2	2.8	2.2	2.9	2.2	3.1	2.2	3.2	2.1
	23	2.3	2.0	2.5	2.1	2.7	2.2	2.8	2.2	2.9	2.2	3.1	2.2	3.2	2.1
	25	2.3	2.0	2.5	2.1	2.7	2.2	2.8	2.2	2.9	2.2	3.1	2.2	3.2	2.1
	27	2.3	2.0	2.5	2.1	2.7	2.2	2.8	2.2	2.9	2.2	3.1	2.2	3.2	2.1
	29	2.3	2.0	2.5	2.1	2.7	2.2	2.8	2.2	2.9	2.2	3.1	2.2	3.2	2.1
	31	2.3	2.0	2.5	2.1	2.7	2.2	2.8	2.2	2.9	2.2	3.1	2.2	3.2	2.1
	33	2.3	2.0	2.5	2.1	2.7	2.2	2.8	2.2	2.9	2.2	3.1	2.2	3.2	2.1
	35	2.3	2.0	2.5	2.1	2.7	2.2	2.8	2.2	2.9	2.2	3.1	2.2	3.2	2.1
	37	2.2	1.9	2.5	2.0	2.6	2.1	2.7	2.1	2.8	2.1	3.0	2.1	3.1	2.1
	39	2.1	1.8	2.4	1.9	2.5	2.0	2.6	2.0	2.7	2.0	2.8	2.0	3.0	2.0
	40	2.1	1.8	2.3	1.9	2.4	2.0	2.5	2.0	2.6	2.0	2.7	2.0	2.9	1.9
	42	1.9	1.6	2.1	1.7	2.3	1.8	2.3	1.8	2.4	1.8	2.6	1.8	2.7	1.8
	44	1.8	1.5	1.9	1.6	2.1	1.7	2.1	1.7	2.2	1.7	2.3	1.7	2.4	1.6
	46	1.5	1.3	1.7	1.4	1.8	1.5	1.9	1.5	1.9	1.5	2.1	1.5	2.1	1.4

# Sensible capacity table



## Slim Duct Type ( MMD-AP 4SPH-E )

TC : Total capacity [kW] SHC : Sensible capacity [kW]

unit size	outdoor air temp. °CDB	indoor air temp.											
		14°CWB		16°CWB		18°CWB		19°CWB		20°CWB		22°CWB	
		20°CDB	23°CDB	26°CDB	27°CDB	28°CDB	30°CDB	32°CDB					
012	10	3.0	2.4	3.3	2.5	3.5	2.7	3.6	2.7	3.7	2.7	3.9	2.7
	12	3.0	2.4	3.3	2.5	3.5	2.7	3.6	2.7	3.7	2.7	3.9	2.7
	14	3.0	2.4	3.3	2.5	3.5	2.7	3.6	2.7	3.7	2.7	3.9	2.7
	16	3.0	2.4	3.3	2.5	3.5	2.7	3.6	2.7	3.7	2.7	3.9	2.7
	18	3.0	2.4	3.3	2.5	3.5	2.7	3.6	2.7	3.7	2.7	3.9	2.7
	20	3.0	2.4	3.3	2.5	3.5	2.7	3.6	2.7	3.7	2.7	3.9	2.7
	21	3.0	2.4	3.3	2.5	3.5	2.7	3.6	2.7	3.7	2.7	3.9	2.7
	23	3.0	2.4	3.3	2.5	3.5	2.7	3.6	2.7	3.7	2.7	3.9	2.7
	25	3.0	2.4	3.3	2.5	3.5	2.7	3.6	2.7	3.7	2.7	3.9	2.7
	27	3.0	2.4	3.3	2.5	3.5	2.7	3.6	2.7	3.7	2.7	3.9	2.7
	29	3.0	2.4	3.3	2.5	3.5	2.7	3.6	2.7	3.7	2.7	3.9	2.7
	31	3.0	2.4	3.3	2.5	3.5	2.7	3.6	2.7	3.7	2.7	3.9	2.7
	33	3.0	2.4	3.3	2.5	3.5	2.7	3.6	2.7	3.7	2.7	3.9	2.7
	35	3.0	2.4	3.3	2.5	3.5	2.7	3.6	2.7	3.7	2.7	3.9	2.7
	37	2.9	2.3	3.2	2.5	3.4	2.6	3.5	2.6	3.6	2.6	3.8	2.6
	39	2.7	2.2	3.0	2.4	3.2	2.5	3.3	2.5	3.4	2.5	3.6	2.5
	40	2.7	2.2	2.9	2.3	3.1	2.4	3.2	2.4	3.3	2.4	3.5	2.4
	42	2.5	2.0	2.7	2.1	2.9	2.3	3.0	2.3	3.1	2.3	3.3	2.2
	44	2.3	1.8	2.5	1.9	2.7	2.1	2.7	2.1	2.8	2.1	3.0	2.0
	46	2.0	1.6	2.2	1.7	2.3	1.8	2.4	1.8	2.5	1.8	2.6	1.8
015	10	3.7	3.0	4.1	3.2	4.4	3.4	4.5	3.4	4.6	3.3	4.9	3.3
	12	3.7	3.0	4.1	3.2	4.4	3.4	4.5	3.4	4.6	3.3	4.9	3.3
	14	3.7	3.0	4.1	3.2	4.4	3.4	4.5	3.4	4.6	3.3	4.9	3.3
	16	3.7	3.0	4.1	3.2	4.4	3.4	4.5	3.4	4.6	3.3	4.9	3.3
	18	3.7	3.0	4.1	3.2	4.4	3.4	4.5	3.4	4.6	3.3	4.9	3.3
	20	3.7	3.0	4.1	3.2	4.4	3.4	4.5	3.4	4.6	3.3	4.9	3.3
	21	3.7	3.0	4.1	3.2	4.4	3.4	4.5	3.4	4.6	3.3	4.9	3.3
	23	3.7	3.0	4.1	3.2	4.4	3.4	4.5	3.4	4.6	3.3	4.9	3.3
	25	3.7	3.0	4.1	3.2	4.4	3.4	4.5	3.4	4.6	3.3	4.9	3.3
	27	3.7	3.0	4.1	3.2	4.4	3.4	4.5	3.4	4.6	3.3	4.9	3.3
	29	3.7	3.0	4.1	3.2	4.4	3.4	4.5	3.4	4.6	3.3	4.9	3.3
	31	3.7	3.0	4.1	3.2	4.4	3.4	4.5	3.4	4.6	3.3	4.9	3.3
	33	3.7	3.0	4.1	3.2	4.4	3.4	4.5	3.4	4.6	3.3	4.9	3.3
	35	3.7	3.0	4.1	3.2	4.4	3.4	4.5	3.4	4.6	3.3	4.9	3.3
	37	3.6	2.9	4.0	3.1	4.2	3.3	4.4	3.2	4.5	3.2	4.8	3.2
	39	3.4	2.8	3.8	2.9	4.0	3.1	4.2	3.1	4.3	3.1	4.5	3.1
	40	3.3	2.7	3.7	2.8	3.9	3.0	4.1	3.0	4.2	3.0	4.4	3.0
	42	3.1	2.5	3.4	2.6	3.7	2.8	3.8	2.8	3.9	2.8	4.1	2.8
	44	2.8	2.3	3.1	2.4	3.3	2.6	3.4	2.6	3.5	2.6	3.7	2.5
	46	2.5	2.0	2.7	2.1	2.9	2.3	3.0	2.3	3.1	2.3	3.3	2.2
018	10	4.6	3.6	5.1	3.9	5.4	4.1	5.6	4.1	5.8	4.1	6.1	4.1
	12	4.6	3.6	5.1	3.9	5.4	4.1	5.6	4.1	5.8	4.1	6.1	4.1
	14	4.6	3.6	5.1	3.9	5.4	4.1	5.6	4.1	5.8	4.1	6.1	4.1
	16	4.6	3.6	5.1	3.9	5.4	4.1	5.6	4.1	5.8	4.1	6.1	4.1
	18	4.6	3.6	5.1	3.9	5.4	4.1	5.6	4.1	5.8	4.1	6.1	4.1
	20	4.6	3.6	5.1	3.9	5.4	4.1	5.6	4.1	5.8	4.1	6.1	4.1
	21	4.6	3.6	5.1	3.9	5.4	4.1	5.6	4.1	5.8	4.1	6.1	4.1
	23	4.6	3.6	5.1	3.9	5.4	4.1	5.6	4.1	5.8	4.1	6.1	4.1
	25	4.6	3.6	5.1	3.9	5.4	4.1	5.6	4.1	5.8	4.1	6.1	4.1
	27	4.6	3.6	5.1	3.9	5.4	4.1	5.6	4.1	5.8	4.1	6.1	4.1
	29	4.6	3.6	5.1	3.9	5.4	4.1	5.6	4.1	5.8	4.1	6.1	4.1
	31	4.6	3.6	5.1	3.9	5.4	4.1	5.6	4.1	5.8	4.1	6.1	4.1
	33	4.6	3.6	5.1	3.9	5.4	4.1	5.6	4.1	5.8	4.1	6.1	4.1
	35	4.6	3.6	5.1	3.9	5.4	4.1	5.6	4.1	5.8	4.1	6.1	4.1
	37	4.5	3.5	4.9	3.8	5.3	4.0	5.4	4.0	5.6	4.0	5.9	3.9
	39	4.3	3.4	4.7	3.6	5.0	3.8	5.2	3.8	5.3	3.8	5.7	3.8
	40	4.1	3.3	4.6	3.5	4.9	3.7	5.0	3.7	5.2	3.7	5.5	3.7
	42	3.8	3.0	4.3	3.2	4.5	3.4	4.7	3.4	4.8	3.4	5.1	3.4
	44	3.5	2.8	3.9	2.9	4.1	3.1	4.3	3.1	4.4	3.1	4.6	3.1
	46	3.1	2.4	3.4	2.6	3.7	2.8	3.8	2.8	3.9	2.8	4.1	2.7

# Sensible capacity table



## Slim Duct Type ( MMD-AP\_\_\_\_4SPH-E )

TC : Total capacity [kW] SHC : Sensible capacity [kW]

unit size	outdoor air temp. °CDB	indoor air temp.													
		14°CWB		16°CWB		18°CWB		19°CWB		20°CWB		22°CWB			
		20°CDB		23°CDB		26°CDB		27°CDB		28°CDB		30°CDB			
		TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC		
024	10	5.8	4.3	6.4	4.5	6.9	4.8	7.1	4.8	7.3	4.8	7.7	4.8	8.1	4.6
	12	5.8	4.3	6.4	4.5	6.9	4.8	7.1	4.8	7.3	4.8	7.7	4.8	8.1	4.6
	14	5.8	4.3	6.4	4.5	6.9	4.8	7.1	4.8	7.3	4.8	7.7	4.8	8.1	4.6
	16	5.8	4.3	6.4	4.5	6.9	4.8	7.1	4.8	7.3	4.8	7.7	4.8	8.1	4.6
	18	5.8	4.3	6.4	4.5	6.9	4.8	7.1	4.8	7.3	4.8	7.7	4.8	8.1	4.6
	20	5.8	4.3	6.4	4.5	6.9	4.8	7.1	4.8	7.3	4.8	7.7	4.8	8.1	4.6
	21	5.8	4.3	6.4	4.5	6.9	4.8	7.1	4.8	7.3	4.8	7.7	4.8	8.1	4.6
	23	5.8	4.3	6.4	4.5	6.9	4.8	7.1	4.8	7.3	4.8	7.7	4.8	8.1	4.6
	25	5.8	4.3	6.4	4.5	6.9	4.8	7.1	4.8	7.3	4.8	7.7	4.8	8.1	4.6
	27	5.8	4.3	6.4	4.5	6.9	4.8	7.1	4.8	7.3	4.8	7.7	4.8	8.1	4.6
	29	5.8	4.3	6.4	4.5	6.9	4.8	7.1	4.8	7.3	4.8	7.7	4.8	8.1	4.6
	31	5.8	4.3	6.4	4.5	6.9	4.8	7.1	4.8	7.3	4.8	7.7	4.8	8.1	4.6
	33	5.8	4.3	6.4	4.5	6.9	4.8	7.1	4.8	7.3	4.8	7.7	4.8	8.1	4.6
	35	5.8	4.3	6.4	4.5	6.9	4.8	7.1	4.8	7.3	4.8	7.7	4.8	8.1	4.6
	37	5.7	4.1	6.3	4.4	6.7	4.7	6.9	4.7	7.1	4.7	7.5	4.6	7.9	4.5
	39	5.4	3.9	6.0	4.2	6.4	4.5	6.6	4.4	6.8	4.4	7.2	4.4	7.5	4.3
	40	5.2	3.8	5.8	4.1	6.2	4.3	6.4	4.3	6.6	4.3	7.0	4.3	7.3	4.2
	42	4.9	3.6	5.4	3.8	5.8	4.0	5.9	4.0	6.1	4.0	6.5	4.0	6.8	3.9
	44	4.4	3.2	4.9	3.5	5.2	3.7	5.4	3.7	5.6	3.7	5.9	3.6	6.2	3.5
	46	3.9	2.9	4.3	3.0	4.6	3.2	4.8	3.2	4.9	3.2	5.2	3.2	5.4	3.1
027	10	6.6	4.8	7.3	5.1	7.8	5.4	8.0	5.4	8.2	5.4	8.7	5.3	9.1	5.2
	12	6.6	4.8	7.3	5.1	7.8	5.4	8.0	5.4	8.2	5.4	8.7	5.3	9.1	5.2
	14	6.6	4.8	7.3	5.1	7.8	5.4	8.0	5.4	8.2	5.4	8.7	5.3	9.1	5.2
	16	6.6	4.8	7.3	5.1	7.8	5.4	8.0	5.4	8.2	5.4	8.7	5.3	9.1	5.2
	18	6.6	4.8	7.3	5.1	7.8	5.4	8.0	5.4	8.2	5.4	8.7	5.3	9.1	5.2
	20	6.6	4.8	7.3	5.1	7.8	5.4	8.0	5.4	8.2	5.4	8.7	5.3	9.1	5.2
	21	6.6	4.8	7.3	5.1	7.8	5.4	8.0	5.4	8.2	5.4	8.7	5.3	9.1	5.2
	23	6.6	4.8	7.3	5.1	7.8	5.4	8.0	5.4	8.2	5.4	8.7	5.3	9.1	5.2
	25	6.6	4.8	7.3	5.1	7.8	5.4	8.0	5.4	8.2	5.4	8.7	5.3	9.1	5.2
	27	6.6	4.8	7.3	5.1	7.8	5.4	8.0	5.4	8.2	5.4	8.7	5.3	9.1	5.2
	29	6.6	4.8	7.3	5.1	7.8	5.4	8.0	5.4	8.2	5.4	8.7	5.3	9.1	5.2
	31	6.6	4.8	7.3	5.1	7.8	5.4	8.0	5.4	8.2	5.4	8.7	5.3	9.1	5.2
	33	6.6	4.8	7.3	5.1	7.8	5.4	8.0	5.4	8.2	5.4	8.7	5.3	9.1	5.2
	35	6.6	4.8	7.3	5.1	7.8	5.4	8.0	5.4	8.2	5.4	8.7	5.3	9.1	5.2
	37	6.4	4.6	7.0	4.9	7.5	5.3	7.8	5.2	8.0	5.2	8.5	5.2	8.8	5.1
	39	6.1	4.4	6.7	4.7	7.2	5.0	7.4	5.0	7.6	5.0	8.1	5.0	8.5	4.8
	40	5.9	4.3	6.5	4.6	7.0	4.9	7.2	4.9	7.4	4.9	7.8	4.8	8.2	4.7
	42	5.5	4.0	6.1	4.3	6.5	4.5	6.7	4.5	6.9	4.5	7.3	4.5	7.6	4.4
	44	5.0	3.6	5.5	3.9	5.9	4.1	6.1	4.1	6.3	4.1	6.6	4.1	6.9	4.0
	46	4.4	3.2	4.9	3.4	5.2	3.6	5.4	3.6	5.5	3.6	5.9	3.6	6.1	3.5

# Sensible capacity table



## Under Ceiling Type ( MMC-AP \_\_\_\_ 7HP-E )

TC : Total capacity [kW] SHC : Sensible capacity [kW]

unit size	outdoor air temp. °CDB	indoor air temp.											
		14°CWB		16°CWB		18°CWB		19°CWB		20°CWB		22°CWB	
		20°CDB		23°CDB		26°CDB		27°CDB		28°CDB		30°CDB	
		TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
015	10	3.7	3.0	4.1	3.2	4.4	3.4	4.5	3.4	4.6	3.4	4.9	3.4
	12	3.7	3.0	4.1	3.2	4.4	3.4	4.5	3.4	4.6	3.4	4.9	3.4
	14	3.7	3.0	4.1	3.2	4.4	3.4	4.5	3.4	4.6	3.4	4.9	3.4
	16	3.7	3.0	4.1	3.2	4.4	3.4	4.5	3.4	4.6	3.4	4.9	3.4
	18	3.7	3.0	4.1	3.2	4.4	3.4	4.5	3.4	4.6	3.4	4.9	3.4
	20	3.7	3.0	4.1	3.2	4.4	3.4	4.5	3.4	4.6	3.4	4.9	3.4
	21	3.7	3.0	4.1	3.2	4.4	3.4	4.5	3.4	4.6	3.4	4.9	3.4
	23	3.7	3.0	4.1	3.2	4.4	3.4	4.5	3.4	4.6	3.4	4.9	3.4
	25	3.7	3.0	4.1	3.2	4.4	3.4	4.5	3.4	4.6	3.4	4.9	3.4
	27	3.7	3.0	4.1	3.2	4.4	3.4	4.5	3.4	4.6	3.4	4.9	3.4
	29	3.7	3.0	4.1	3.2	4.4	3.4	4.5	3.4	4.6	3.4	4.9	3.4
	31	3.7	3.0	4.1	3.2	4.4	3.4	4.5	3.4	4.6	3.4	4.9	3.4
	33	3.7	3.0	4.1	3.2	4.4	3.4	4.5	3.4	4.6	3.4	4.9	3.4
	35	3.7	3.0	4.1	3.2	4.4	3.4	4.5	3.4	4.6	3.4	4.9	3.4
	37	3.6	2.9	4.0	3.1	4.2	3.3	4.4	3.3	4.5	3.3	4.8	3.3
	39	3.4	2.8	3.8	3.0	4.0	3.2	4.2	3.2	4.3	3.2	4.5	3.1
	40	3.3	2.7	3.7	2.9	3.9	3.1	4.1	3.1	4.2	3.1	4.4	3.0
	42	3.1	2.5	3.4	2.7	3.7	2.9	3.8	2.8	3.9	2.8	4.1	2.8
	44	2.8	2.3	3.1	2.4	3.3	2.6	3.4	2.6	3.5	2.6	3.7	2.6
	46	2.5	2.0	2.7	2.2	2.9	2.3	3.0	2.3	3.1	2.3	3.3	2.3
018	10	4.6	3.7	5.1	3.9	5.4	4.2	5.6	4.2	5.8	4.1	6.1	4.1
	12	4.6	3.7	5.1	3.9	5.4	4.2	5.6	4.2	5.8	4.1	6.1	4.1
	14	4.6	3.7	5.1	3.9	5.4	4.2	5.6	4.2	5.8	4.1	6.1	4.1
	16	4.6	3.7	5.1	3.9	5.4	4.2	5.6	4.2	5.8	4.1	6.1	4.1
	18	4.6	3.7	5.1	3.9	5.4	4.2	5.6	4.2	5.8	4.1	6.1	4.1
	20	4.6	3.7	5.1	3.9	5.4	4.2	5.6	4.2	5.8	4.1	6.1	4.1
	21	4.6	3.7	5.1	3.9	5.4	4.2	5.6	4.2	5.8	4.1	6.1	4.1
	23	4.6	3.7	5.1	3.9	5.4	4.2	5.6	4.2	5.8	4.1	6.1	4.1
	25	4.6	3.7	5.1	3.9	5.4	4.2	5.6	4.2	5.8	4.1	6.1	4.1
	27	4.6	3.7	5.1	3.9	5.4	4.2	5.6	4.2	5.8	4.1	6.1	4.1
	29	4.6	3.7	5.1	3.9	5.4	4.2	5.6	4.2	5.8	4.1	6.1	4.1
	31	4.6	3.7	5.1	3.9	5.4	4.2	5.6	4.2	5.8	4.1	6.1	4.1
	33	4.6	3.7	5.1	3.9	5.4	4.2	5.6	4.2	5.8	4.1	6.1	4.1
	35	4.6	3.7	5.1	3.9	5.4	4.2	5.6	4.2	5.8	4.1	6.1	4.1
	37	4.5	3.6	4.9	3.8	5.3	4.0	5.4	4.0	5.6	4.0	5.9	4.0
	39	4.3	3.4	4.7	3.6	5.0	3.9	5.2	3.8	5.3	3.8	5.7	3.8
	40	4.1	3.3	4.6	3.5	4.9	3.7	5.0	3.7	5.2	3.7	5.5	3.7
	42	3.8	3.1	4.3	3.3	4.5	3.5	4.7	3.5	4.8	3.5	5.1	3.4
	44	3.5	2.8	3.9	3.0	4.1	3.2	4.3	3.2	4.4	3.2	4.6	3.1
	46	3.1	2.5	3.4	2.6	3.7	2.8	3.8	2.8	3.9	2.8	4.1	2.8
024	10	5.8	4.7	6.4	5.0	6.9	5.3	7.1	5.3	7.3	5.3	7.7	5.3
	12	5.8	4.7	6.4	5.0	6.9	5.3	7.1	5.3	7.3	5.3	7.7	5.3
	14	5.8	4.7	6.4	5.0	6.9	5.3	7.1	5.3	7.3	5.3	7.7	5.3
	16	5.8	4.7	6.4	5.0	6.9	5.3	7.1	5.3	7.3	5.3	7.7	5.3
	18	5.8	4.7	6.4	5.0	6.9	5.3	7.1	5.3	7.3	5.3	7.7	5.3
	20	5.8	4.7	6.4	5.0	6.9	5.3	7.1	5.3	7.3	5.3	7.7	5.3
	21	5.8	4.7	6.4	5.0	6.9	5.3	7.1	5.3	7.3	5.3	7.7	5.3
	23	5.8	4.7	6.4	5.0	6.9	5.3	7.1	5.3	7.3	5.3	7.7	5.3
	25	5.8	4.7	6.4	5.0	6.9	5.3	7.1	5.3	7.3	5.3	7.7	5.3
	27	5.8	4.7	6.4	5.0	6.9	5.3	7.1	5.3	7.3	5.3	7.7	5.3
	29	5.8	4.7	6.4	5.0	6.9	5.3	7.1	5.3	7.3	5.3	7.7	5.3
	31	5.8	4.7	6.4	5.0	6.9	5.3	7.1	5.3	7.3	5.3	7.7	5.3
	33	5.8	4.7	6.4	5.0	6.9	5.3	7.1	5.3	7.3	5.3	7.7	5.3
	35	5.8	4.7	6.4	5.0	6.9	5.3	7.1	5.3	7.3	5.3	7.7	5.3
	37	5.7	4.6	6.3	4.9	6.7	5.2	6.9	5.1	7.1	5.1	7.5	5.1
	39	5.4	4.4	6.0	4.6	6.4	4.9	6.6	4.9	6.8	4.9	7.2	4.9
	40	5.2	4.2	5.8	4.5	6.2	4.8	6.4	4.8	6.6	4.8	7.0	4.7
	42	4.9	3.9	5.4	4.2	5.8	4.5	5.9	4.4	6.1	4.4	6.5	4.4
	44	4.4	3.6	4.9	3.8	5.2	4.0	5.4	4.0	5.6	4.0	5.9	4.0
	46	3.9	3.2	4.3	3.4	4.6	3.6	4.8	3.6	4.9	3.6	5.2	3.5

# Sensible capacity table



**Under Ceiling Type ( MMC-AP 7HP-E )**

TC : Total capacity [kW] SHC : Sensible capacity [kW]

unit size	outdoor air temp. °CDB	indoor air temp.													
		14°CWB		16°CWB		18°CWB		19°CWB		20°CWB		22°CWB		24°CWB	
		20°CDB	23°CDB	26°CDB	27°CDB	28°CDB	30°CDB	32°CDB	TC	SHC	TC	SHC	TC	SHC	TC
027	10	6.6	5.1	7.3	5.5	7.8	5.8	8.0	5.8	8.2	5.8	8.7	5.7	9.1	5.6
	12	6.6	5.1	7.3	5.5	7.8	5.8	8.0	5.8	8.2	5.8	8.7	5.7	9.1	5.6
	14	6.6	5.1	7.3	5.5	7.8	5.8	8.0	5.8	8.2	5.8	8.7	5.7	9.1	5.6
	16	6.6	5.1	7.3	5.5	7.8	5.8	8.0	5.8	8.2	5.8	8.7	5.7	9.1	5.6
	18	6.6	5.1	7.3	5.5	7.8	5.8	8.0	5.8	8.2	5.8	8.7	5.7	9.1	5.6
	20	6.6	5.1	7.3	5.5	7.8	5.8	8.0	5.8	8.2	5.8	8.7	5.7	9.1	5.6
	21	6.6	5.1	7.3	5.5	7.8	5.8	8.0	5.8	8.2	5.8	8.7	5.7	9.1	5.6
	23	6.6	5.1	7.3	5.5	7.8	5.8	8.0	5.8	8.2	5.8	8.7	5.7	9.1	5.6
	25	6.6	5.1	7.3	5.5	7.8	5.8	8.0	5.8	8.2	5.8	8.7	5.7	9.1	5.6
	27	6.6	5.1	7.3	5.5	7.8	5.8	8.0	5.8	8.2	5.8	8.7	5.7	9.1	5.6
	29	6.6	5.1	7.3	5.5	7.8	5.8	8.0	5.8	8.2	5.8	8.7	5.7	9.1	5.6
	31	6.6	5.1	7.3	5.5	7.8	5.8	8.0	5.8	8.2	5.8	8.7	5.7	9.1	5.6
	33	6.6	5.1	7.3	5.5	7.8	5.8	8.0	5.8	8.2	5.8	8.7	5.7	9.1	5.6
	35	6.6	5.1	7.3	5.5	7.8	5.8	8.0	5.8	8.2	5.8	8.7	5.7	9.1	5.6
	37	6.4	5.0	7.0	5.3	7.5	5.6	7.8	5.6	8.0	5.6	8.5	5.6	8.8	5.4
	39	6.1	4.8	6.7	5.1	7.2	5.4	7.4	5.4	7.6	5.4	8.1	5.3	8.5	5.2
	40	5.9	4.6	6.5	4.9	7.0	5.2	7.2	5.2	7.4	5.2	7.8	5.2	8.2	5.1
	42	5.5	4.3	6.1	4.6	6.5	4.9	6.7	4.9	6.9	4.9	7.3	4.8	7.6	4.7
	44	5.0	3.9	5.5	4.2	5.9	4.4	6.1	4.4	6.3	4.4	6.6	4.4	6.9	4.3
	46	4.4	3.5	4.9	3.7	5.2	3.9	5.4	3.9	5.5	3.9	5.9	3.9	6.1	3.8
036	10	9.2	7.3	10.2	7.7	10.9	8.2	11.2	8.2	11.5	8.2	12.2	8.1	12.8	7.9
	12	9.2	7.3	10.2	7.7	10.9	8.2	11.2	8.2	11.5	8.2	12.2	8.1	12.8	7.9
	14	9.2	7.3	10.2	7.7	10.9	8.2	11.2	8.2	11.5	8.2	12.2	8.1	12.8	7.9
	16	9.2	7.3	10.2	7.7	10.9	8.2	11.2	8.2	11.5	8.2	12.2	8.1	12.8	7.9
	18	9.2	7.3	10.2	7.7	10.9	8.2	11.2	8.2	11.5	8.2	12.2	8.1	12.8	7.9
	20	9.2	7.3	10.2	7.7	10.9	8.2	11.2	8.2	11.5	8.2	12.2	8.1	12.8	7.9
	21	9.2	7.3	10.2	7.7	10.9	8.2	11.2	8.2	11.5	8.2	12.2	8.1	12.8	7.9
	23	9.2	7.3	10.2	7.7	10.9	8.2	11.2	8.2	11.5	8.2	12.2	8.1	12.8	7.9
	25	9.2	7.3	10.2	7.7	10.9	8.2	11.2	8.2	11.5	8.2	12.2	8.1	12.8	7.9
	27	9.2	7.3	10.2	7.7	10.9	8.2	11.2	8.2	11.5	8.2	12.2	8.1	12.8	7.9
	29	9.2	7.3	10.2	7.7	10.9	8.2	11.2	8.2	11.5	8.2	12.2	8.1	12.8	7.9
	31	9.2	7.3	10.2	7.7	10.9	8.2	11.2	8.2	11.5	8.2	12.2	8.1	12.8	7.9
	33	9.2	7.3	10.2	7.7	10.9	8.2	11.2	8.2	11.5	8.2	12.2	8.1	12.8	7.9
	35	9.2	7.3	10.2	7.7	10.9	8.2	11.2	8.2	11.5	8.2	12.2	8.1	12.8	7.9
	37	8.9	7.1	9.9	7.5	10.5	8.0	10.9	8.0	11.2	8.0	11.8	7.9	12.4	7.7
	39	8.5	6.7	9.4	7.2	10.1	7.6	10.4	7.6	10.7	7.6	11.3	7.5	11.8	7.4
	40	8.3	6.5	9.2	7.0	9.8	7.4	10.1	7.4	10.4	7.4	11.0	7.3	11.5	7.1
	42	7.7	6.1	8.5	6.5	9.1	6.9	9.4	6.9	9.7	6.9	10.2	6.8	10.7	6.6
	44	7.0	5.5	7.7	5.9	8.3	6.3	8.5	6.2	8.8	6.2	9.3	6.2	9.7	6.0
	46	6.2	4.9	6.8	5.2	7.3	5.5	7.5	5.5	7.8	5.5	8.2	5.5	8.6	5.3
048	10	11.5	8.8	12.7	9.3	13.6	9.9	14.0	9.9	14.4	9.9	15.3	9.8	16.0	9.6
	12	11.5	8.8	12.7	9.3	13.6	9.9	14.0	9.9	14.4	9.9	15.3	9.8	16.0	9.6
	14	11.5	8.8	12.7	9.3	13.6	9.9	14.0	9.9	14.4	9.9	15.3	9.8	16.0	9.6
	16	11.5	8.8	12.7	9.3	13.6	9.9	14.0	9.9	14.4	9.9	15.3	9.8	16.0	9.6
	18	11.5	8.8	12.7	9.3	13.6	9.9	14.0	9.9	14.4	9.9	15.3	9.8	16.0	9.6
	20	11.5	8.8	12.7	9.3	13.6	9.9	14.0	9.9	14.4	9.9	15.3	9.8	16.0	9.6
	21	11.5	8.8	12.7	9.3	13.6	9.9	14.0	9.9	14.4	9.9	15.3	9.8	16.0	9.6
	23	11.5	8.8	12.7	9.3	13.6	9.9	14.0	9.9	14.4	9.9	15.3	9.8	16.0	9.6
	25	11.5	8.8	12.7	9.3	13.6	9.9	14.0	9.9	14.4	9.9	15.3	9.8	16.0	9.6
	27	11.5	8.8	12.7	9.3	13.6	9.9	14.0	9.9	14.4	9.9	15.3	9.8	16.0	9.6
	29	11.5	8.8	12.7	9.3	13.6	9.9	14.0	9.9	14.4	9.9	15.3	9.8	16.0	9.6
	31	11.5	8.8	12.7	9.3	13.6	9.9	14.0	9.9	14.4	9.9	15.3	9.8	16.0	9.6
	33	11.5	8.8	12.7	9.3	13.6	9.9	14.0	9.9	14.4	9.9	15.3	9.8	16.0	9.6
	35	11.5	8.8	12.7	9.3	13.6	9.9	14.0	9.9	14.4	9.9	15.3	9.8	16.0	9.6
	37	11.1	8.5	12.3	9.1	13.2	9.6	13.6	9.6	14.0	9.6	14.8	9.5	15.5	9.3
	39	10.7	8.1	11.8	8.7	12.6	9.2	13.0	9.2	13.4	9.2	14.1	9.1	14.8	8.9
	40	10.3	7.9	11.4	8.4	12.2	8.9	12.6	8.9	13.0	8.9	13.7	8.8	14.4	8.6
	42	9.6	7.3	10.6	7.8	11.4	8.3	11.7	8.3	12.1	8.3	12.8	8.2	13.4	8.0
	44	8.8	6.7	9.7	7.1	10.3	7.6	10.7	7.5	11.0	7.5	11.6	7.5	12.2	7.3
	46	7.7	5.9	8.5	6.3	9.1	6.7	9.4	6.7	9.7	6.7	10.3	6.6	10.7	6.4



## Sensible capacity table



### Under Ceiling Type ( MMC-AP \_\_\_\_ 7HP-E )

TC : Total capacity [kW] SHC : Sensible capacity [kW]

unit size	outdoor air temp. °CDB	indoor air temp.													
		14°CWB		16°CWB		18°CWB		19°CWB		20°CWB		22°CWB			
		20°CDB	23°CDB	26°CDB	27°CDB	28°CDB	30°CDB	32°CDB							
056	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	
	10	11.5	8.8	12.7	9.3	13.6	9.9	14.0	9.9	14.4	9.9	15.3	9.8	16.0	9.6
	12	11.5	8.8	12.7	9.3	13.6	9.9	14.0	9.9	14.4	9.9	15.3	9.8	16.0	9.6
	14	11.5	8.8	12.7	9.3	13.6	9.9	14.0	9.9	14.4	9.9	15.3	9.8	16.0	9.6
	16	11.5	8.8	12.7	9.3	13.6	9.9	14.0	9.9	14.4	9.9	15.3	9.8	16.0	9.6
	18	11.5	8.8	12.7	9.3	13.6	9.9	14.0	9.9	14.4	9.9	15.3	9.8	16.0	9.6
	20	11.5	8.8	12.7	9.3	13.6	9.9	14.0	9.9	14.4	9.9	15.3	9.8	16.0	9.6
	21	11.5	8.8	12.7	9.3	13.6	9.9	14.0	9.9	14.4	9.9	15.3	9.8	16.0	9.6
	23	11.5	8.8	12.7	9.3	13.6	9.9	14.0	9.9	14.4	9.9	15.3	9.8	16.0	9.6
	25	11.5	8.8	12.7	9.3	13.6	9.9	14.0	9.9	14.4	9.9	15.3	9.8	16.0	9.6
	27	11.5	8.8	12.7	9.3	13.6	9.9	14.0	9.9	14.4	9.9	15.3	9.8	16.0	9.6
	29	11.5	8.8	12.7	9.3	13.6	9.9	14.0	9.9	14.4	9.9	15.3	9.8	16.0	9.6
	31	11.5	8.8	12.7	9.3	13.6	9.9	14.0	9.9	14.4	9.9	15.3	9.8	16.0	9.6
	33	11.5	8.8	12.7	9.3	13.6	9.9	14.0	9.9	14.4	9.9	15.3	9.8	16.0	9.6
	35	13.1	9.9	14.5	10.6	15.5	11.2	16.0	11.2	16.5	11.2	17.4	11.1	18.2	10.8
	37	11.1	8.5	12.3	9.1	13.2	9.6	13.6	9.6	14.0	9.6	14.8	9.5	15.5	9.3
	39	10.7	8.1	11.8	8.7	12.6	9.2	13.0	9.2	13.4	9.2	14.1	9.1	14.8	8.9
	40	10.3	7.9	11.4	8.4	12.2	8.9	12.6	8.9	13.0	8.9	13.7	8.8	14.4	8.6
	42	9.6	7.3	10.6	7.8	11.4	8.3	11.7	8.3	12.1	8.3	12.8	8.2	13.4	8.0
	44	8.8	6.7	9.7	7.1	10.3	7.6	10.7	7.5	11.0	7.5	11.6	7.5	12.2	7.3
	46	7.7	5.9	8.5	6.3	9.1	6.7	9.4	6.7	9.7	6.7	10.3	6.6	10.7	6.4

# Sensible capacity table



## High Wall Type ( MMK-AP\_\_3H )

TC : Total capacity [kW] SHC : Sensible capacity [kW]

unit size	outdoor air temp. °CDB	indoor air temp.													
		14°CWB		16°CWB		18°CWB		19°CWB		20°CWB		22°CWB		24°CWB	
		20°CDB	23°CDB	26°CDB	27°CDB	28°CDB	30°CDB	32°CDB	TC	SHC	TC	SHC	TC	SHC	TC
007	10	1.8	1.5	2.0	1.6	2.1	1.7	2.2	1.7	2.3	1.7	2.4	1.7	2.5	1.6
	12	1.8	1.5	2.0	1.6	2.1	1.7	2.2	1.7	2.3	1.7	2.4	1.7	2.5	1.6
	14	1.8	1.5	2.0	1.6	2.1	1.7	2.2	1.7	2.3	1.7	2.4	1.7	2.5	1.6
	16	1.8	1.5	2.0	1.6	2.1	1.7	2.2	1.7	2.3	1.7	2.4	1.7	2.5	1.6
	18	1.8	1.5	2.0	1.6	2.1	1.7	2.2	1.7	2.3	1.7	2.4	1.7	2.5	1.6
	20	1.8	1.5	2.0	1.6	2.1	1.7	2.2	1.7	2.3	1.7	2.4	1.7	2.5	1.6
	21	1.8	1.5	2.0	1.6	2.1	1.7	2.2	1.7	2.3	1.7	2.4	1.7	2.5	1.6
	23	1.8	1.5	2.0	1.6	2.1	1.7	2.2	1.7	2.3	1.7	2.4	1.7	2.5	1.6
	25	1.8	1.5	2.0	1.6	2.1	1.7	2.2	1.7	2.3	1.7	2.4	1.7	2.5	1.6
	27	1.8	1.5	2.0	1.6	2.1	1.7	2.2	1.7	2.3	1.7	2.4	1.7	2.5	1.6
	29	1.8	1.5	2.0	1.6	2.1	1.7	2.2	1.7	2.3	1.7	2.4	1.7	2.5	1.6
	31	1.8	1.5	2.0	1.6	2.1	1.7	2.2	1.7	2.3	1.7	2.4	1.7	2.5	1.6
	33	1.8	1.5	2.0	1.6	2.1	1.7	2.2	1.7	2.3	1.7	2.4	1.7	2.5	1.6
	35	1.8	1.5	2.0	1.6	2.1	1.7	2.2	1.7	2.3	1.7	2.4	1.7	2.5	1.6
	37	1.8	1.5	1.9	1.6	2.1	1.7	2.1	1.6	2.2	1.6	2.3	1.6	2.4	1.6
	39	1.7	1.4	1.9	1.5	2.0	1.6	2.0	1.6	2.1	1.6	2.2	1.6	2.3	1.5
	40	1.6	1.4	1.8	1.4	1.9	1.5	2.0	1.5	2.0	1.5	2.2	1.5	2.3	1.5
	42	1.5	1.3	1.7	1.3	1.8	1.4	1.8	1.4	1.9	1.4	2.0	1.4	2.1	1.4
	44	1.4	1.1	1.5	1.2	1.6	1.3	1.7	1.3	1.7	1.3	1.8	1.3	1.9	1.3
	46	1.2	1.0	1.3	1.1	1.4	1.1	1.5	1.1	1.5	1.1	1.6	1.1	1.7	1.1
009	10	2.3	1.9	2.5	2.0	2.7	2.1	2.8	2.1	2.9	2.1	3.1	2.1	3.2	2.0
	12	2.3	1.9	2.5	2.0	2.7	2.1	2.8	2.1	2.9	2.1	3.1	2.1	3.2	2.0
	14	2.3	1.9	2.5	2.0	2.7	2.1	2.8	2.1	2.9	2.1	3.1	2.1	3.2	2.0
	16	2.3	1.9	2.5	2.0	2.7	2.1	2.8	2.1	2.9	2.1	3.1	2.1	3.2	2.0
	18	2.3	1.9	2.5	2.0	2.7	2.1	2.8	2.1	2.9	2.1	3.1	2.1	3.2	2.0
	20	2.3	1.9	2.5	2.0	2.7	2.1	2.8	2.1	2.9	2.1	3.1	2.1	3.2	2.0
	21	2.3	1.9	2.5	2.0	2.7	2.1	2.8	2.1	2.9	2.1	3.1	2.1	3.2	2.0
	23	2.3	1.9	2.5	2.0	2.7	2.1	2.8	2.1	2.9	2.1	3.1	2.1	3.2	2.0
	25	2.3	1.9	2.5	2.0	2.7	2.1	2.8	2.1	2.9	2.1	3.1	2.1	3.2	2.0
	27	2.3	1.9	2.5	2.0	2.7	2.1	2.8	2.1	2.9	2.1	3.1	2.1	3.2	2.0
	29	2.3	1.9	2.5	2.0	2.7	2.1	2.8	2.1	2.9	2.1	3.1	2.1	3.2	2.0
	31	2.3	1.9	2.5	2.0	2.7	2.1	2.8	2.1	2.9	2.1	3.1	2.1	3.2	2.0
	33	2.3	1.9	2.5	2.0	2.7	2.1	2.8	2.1	2.9	2.1	3.1	2.1	3.2	2.0
	35	2.3	1.9	2.5	2.0	2.7	2.1	2.8	2.1	2.9	2.1	3.1	2.1	3.2	2.0
	37	2.2	1.8	2.5	1.9	2.6	2.0	2.7	2.0	2.8	2.0	3.0	2.0	3.1	2.0
	39	2.1	1.7	2.4	1.8	2.5	2.0	2.6	1.9	2.7	1.9	2.8	1.9	3.0	1.9
	40	2.1	1.7	2.3	1.8	2.4	1.9	2.5	1.9	2.6	1.9	2.7	1.9	2.9	1.8
	42	1.9	1.6	2.1	1.7	2.3	1.8	2.3	1.8	2.4	1.8	2.6	1.7	2.7	1.7
	44	1.8	1.4	1.9	1.5	2.1	1.6	2.1	1.6	2.2	1.6	2.3	1.6	2.4	1.5
	46	1.5	1.3	1.7	1.3	1.8	1.4	1.9	1.4	1.9	1.4	2.1	1.4	2.1	1.4
012	10	3.0	2.3	3.3	2.5	3.5	2.6	3.6	2.6	3.7	2.6	3.9	2.6	4.1	2.5
	12	3.0	2.3	3.3	2.5	3.5	2.6	3.6	2.6	3.7	2.6	3.9	2.6	4.1	2.5
	14	3.0	2.3	3.3	2.5	3.5	2.6	3.6	2.6	3.7	2.6	3.9	2.6	4.1	2.5
	16	3.0	2.3	3.3	2.5	3.5	2.6	3.6	2.6	3.7	2.6	3.9	2.6	4.1	2.5
	18	3.0	2.3	3.3	2.5	3.5	2.6	3.6	2.6	3.7	2.6	3.9	2.6	4.1	2.5
	20	3.0	2.3	3.3	2.5	3.5	2.6	3.6	2.6	3.7	2.6	3.9	2.6	4.1	2.5
	21	3.0	2.3	3.3	2.5	3.5	2.6	3.6	2.6	3.7	2.6	3.9	2.6	4.1	2.5
	23	3.0	2.3	3.3	2.5	3.5	2.6	3.6	2.6	3.7	2.6	3.9	2.6	4.1	2.5
	25	3.0	2.3	3.3	2.5	3.5	2.6	3.6	2.6	3.7	2.6	3.9	2.6	4.1	2.5
	27	3.0	2.3	3.3	2.5	3.5	2.6	3.6	2.6	3.7	2.6	3.9	2.6	4.1	2.5
	29	3.0	2.3	3.3	2.5	3.5	2.6	3.6	2.6	3.7	2.6	3.9	2.6	4.1	2.5
	31	3.0	2.3	3.3	2.5	3.5	2.6	3.6	2.6	3.7	2.6	3.9	2.6	4.1	2.5
	33	3.0	2.3	3.3	2.5	3.5	2.6	3.6	2.6	3.7	2.6	3.9	2.6	4.1	2.5
	35	3.0	2.3	3.3	2.5	3.5	2.6	3.6	2.6	3.7	2.6	3.9	2.6	4.1	2.5
	37	2.9	2.2	3.2	2.4	3.4	2.5	3.5	2.5	3.6	2.5	3.8	2.5	4.0	2.4
	39	2.7	2.1	3.0	2.3	3.2	2.4	3.3	2.4	3.4	2.4	3.6	2.4	3.8	2.3
	40	2.7	2.1	2.9	2.2	3.1	2.3	3.2	2.3	3.3	2.3	3.5	2.3	3.7	2.3
	42	2.5	1.9	2.7	2.1	2.9	2.2	3.0	2.2	3.1	2.2	3.3	2.2	3.4	2.1
	44	2.3	1.8	2.5	1.9	2.7	2.0	2.7	2.0	2.8	2.0	3.0	2.0	3.1	1.9
	46	2.0	1.6	2.2	1.7	2.3	1.8	2.4	1.7	2.5	1.7	2.6	1.7	2.8	1.7

# Sensible capacity table



## High Wall Type ( MMK-AP\_\_3H )

TC : Total capacity [kW] SHC : Sensible capacity [kW]

unit size	outdoor air temp. °CDB	indoor air temp.												
		14°CWB		16°CWB		18°CWB		19°CWB		20°CWB		22°CWB		
		20°CDB	23°CDB	26°CDB	27°CDB	28°CDB	30°CDB	32°CDB						
015	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
	10	3.7	2.8	4.1	3.0	4.4	3.2	4.5	3.2	4.6	3.2	4.9	3.2	5.1
	12	3.7	2.8	4.1	3.0	4.4	3.2	4.5	3.2	4.6	3.2	4.9	3.2	5.1
	14	3.7	2.8	4.1	3.0	4.4	3.2	4.5	3.2	4.6	3.2	4.9	3.2	5.1
	16	3.7	2.8	4.1	3.0	4.4	3.2	4.5	3.2	4.6	3.2	4.9	3.2	5.1
	18	3.7	2.8	4.1	3.0	4.4	3.2	4.5	3.2	4.6	3.2	4.9	3.2	5.1
	20	3.7	2.8	4.1	3.0	4.4	3.2	4.5	3.2	4.6	3.2	4.9	3.2	5.1
	21	3.7	2.8	4.1	3.0	4.4	3.2	4.5	3.2	4.6	3.2	4.9	3.2	5.1
	23	3.7	2.8	4.1	3.0	4.4	3.2	4.5	3.2	4.6	3.2	4.9	3.2	5.1
	25	3.7	2.8	4.1	3.0	4.4	3.2	4.5	3.2	4.6	3.2	4.9	3.2	5.1
	27	3.7	2.8	4.1	3.0	4.4	3.2	4.5	3.2	4.6	3.2	4.9	3.2	5.1
	29	3.7	2.8	4.1	3.0	4.4	3.2	4.5	3.2	4.6	3.2	4.9	3.2	5.1
	31	3.7	2.8	4.1	3.0	4.4	3.2	4.5	3.2	4.6	3.2	4.9	3.2	5.1
	33	3.7	2.8	4.1	3.0	4.4	3.2	4.5	3.2	4.6	3.2	4.9	3.2	5.1
	35	3.7	2.8	4.1	3.0	4.4	3.2	4.5	3.2	4.6	3.2	4.9	3.2	5.1
	37	3.6	2.8	4.0	2.9	4.2	3.1	4.4	3.1	4.5	3.1	4.8	3.1	5.0
	39	3.4	2.6	3.8	2.8	4.0	3.0	4.2	3.0	4.3	3.0	4.5	2.9	4.8
	40	3.3	2.6	3.7	2.7	3.9	2.9	4.1	2.9	4.2	2.9	4.4	2.9	4.6
	42	3.1	2.4	3.4	2.5	3.7	2.7	3.8	2.7	3.9	2.7	4.1	2.7	4.3
	44	2.8	2.2	3.1	2.3	3.3	2.4	3.4	2.4	3.5	2.4	3.7	2.4	3.9
	46	2.5	1.9	2.7	2.0	2.9	2.2	3.0	2.2	3.1	2.2	3.3	2.1	3.4
018	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
	10	4.6	3.5	5.1	3.7	5.4	3.9	5.6	3.9	5.8	3.9	6.1	3.9	6.4
	12	4.6	3.5	5.1	3.7	5.4	3.9	5.6	3.9	5.8	3.9	6.1	3.9	6.4
	14	4.6	3.5	5.1	3.7	5.4	3.9	5.6	3.9	5.8	3.9	6.1	3.9	6.4
	16	4.6	3.5	5.1	3.7	5.4	3.9	5.6	3.9	5.8	3.9	6.1	3.9	6.4
	18	4.6	3.5	5.1	3.7	5.4	3.9	5.6	3.9	5.8	3.9	6.1	3.9	6.4
	20	4.6	3.5	5.1	3.7	5.4	3.9	5.6	3.9	5.8	3.9	6.1	3.9	6.4
	21	4.6	3.5	5.1	3.7	5.4	3.9	5.6	3.9	5.8	3.9	6.1	3.9	6.4
	23	4.6	3.5	5.1	3.7	5.4	3.9	5.6	3.9	5.8	3.9	6.1	3.9	6.4
	25	4.6	3.5	5.1	3.7	5.4	3.9	5.6	3.9	5.8	3.9	6.1	3.9	6.4
	27	4.6	3.5	5.1	3.7	5.4	3.9	5.6	3.9	5.8	3.9	6.1	3.9	6.4
	29	4.6	3.5	5.1	3.7	5.4	3.9	5.6	3.9	5.8	3.9	6.1	3.9	6.4
	31	4.6	3.5	5.1	3.7	5.4	3.9	5.6	3.9	5.8	3.9	6.1	3.9	6.4
	33	4.6	3.5	5.1	3.7	5.4	3.9	5.6	3.9	5.8	3.9	6.1	3.9	6.4
	35	4.6	3.5	5.1	3.7	5.4	3.9	5.6	3.9	5.8	3.9	6.1	3.9	6.4
	37	4.5	3.4	4.9	3.6	5.3	3.8	5.4	3.8	5.6	3.8	5.9	3.7	6.2
	39	4.3	3.2	4.7	3.4	5.0	3.6	5.2	3.6	5.3	3.6	5.7	3.6	5.9
	40	4.1	3.1	4.6	3.3	4.9	3.5	5.0	3.5	5.2	3.5	5.5	3.5	5.7
	42	3.8	2.9	4.3	3.1	4.5	3.3	4.7	3.3	4.8	3.3	5.1	3.2	5.3
	44	3.5	2.6	3.9	2.8	4.1	3.0	4.3	3.0	4.4	3.0	4.6	2.9	4.9
	46	3.1	2.3	3.4	2.5	3.7	2.6	3.8	2.6	3.9	2.6	4.1	2.6	4.3
024	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
	10	5.8	4.3	6.4	4.5	6.9	4.8	7.1	4.8	7.3	4.8	7.7	4.8	8.1
	12	5.8	4.3	6.4	4.5	6.9	4.8	7.1	4.8	7.3	4.8	7.7	4.8	8.1
	14	5.8	4.3	6.4	4.5	6.9	4.8	7.1	4.8	7.3	4.8	7.7	4.8	8.1
	16	5.8	4.3	6.4	4.5	6.9	4.8	7.1	4.8	7.3	4.8	7.7	4.8	8.1
	18	5.8	4.3	6.4	4.5	6.9	4.8	7.1	4.8	7.3	4.8	7.7	4.8	8.1
	20	5.8	4.3	6.4	4.5	6.9	4.8	7.1	4.8	7.3	4.8	7.7	4.8	8.1
	21	5.8	4.3	6.4	4.5	6.9	4.8	7.1	4.8	7.3	4.8	7.7	4.8	8.1
	23	5.8	4.3	6.4	4.5	6.9	4.8	7.1	4.8	7.3	4.8	7.7	4.8	8.1
	25	5.8	4.3	6.4	4.5	6.9	4.8	7.1	4.8	7.3	4.8	7.7	4.8	8.1
	27	5.8	4.3	6.4	4.5	6.9	4.8	7.1	4.8	7.3	4.8	7.7	4.8	8.1
	29	5.8	4.3	6.4	4.5	6.9	4.8	7.1	4.8	7.3	4.8	7.7	4.8	8.1
	31	5.8	4.3	6.4	4.5	6.9	4.8	7.1	4.8	7.3	4.8	7.7	4.8	8.1
	33	5.8	4.3	6.4	4.5	6.9	4.8	7.1	4.8	7.3	4.8	7.7	4.8	8.1
	35	5.8	4.3	6.4	4.5	6.9	4.8	7.1	4.8	7.3	4.8	7.7	4.8	8.1
	37	5.7	4.1	6.3	4.4	6.7	4.7	6.9	4.7	7.1	4.7	7.5	4.6	7.9
	39	5.4	3.9	6.0	4.2	6.4	4.5	6.6	4.4	6.8	4.4	7.2	4.4	7.5
	40	5.2	3.8	5.8	4.1	6.2	4.3	6.4	4.3	6.6	4.3	7.0	4.3	7.3
	42	4.9	3.6	5.4	3.8	5.8	4.0	5.9	4.0	6.1	4.0	6.5	4.0	6.8
	44	4.4	3.2	4.9	3.5	5.2	3.7	5.4	3.7	5.6	3.7	5.9	3.6	6.2
	46	3.9	2.9	4.3	3.0	4.6	3.2	4.8	3.2	4.9	3.2	5.2	3.2	5.4

# Sensible capacity table



## High Wall Type ( MMK-AP\_\_\_\_4MHP-E )

TC : Total capacity [kW] SHC : Sensible capacity [kW]

unit size	outdoor air temp. °CDB	indoor air temp.													
		14°CWB		16°CWB		18°CWB		19°CWB		20°CWB		22°CWB		24°CWB	
		20°CDB		23°CDB		26°CDB		27°CDB		28°CDB		30°CDB		32°CDB	
		TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
005	10	1.4	1.3	1.5	1.4	1.6	1.5	1.7	1.5	1.8	1.5	1.9	1.5	1.9	1.5
	12	1.4	1.3	1.5	1.4	1.6	1.5	1.7	1.5	1.8	1.5	1.9	1.5	1.9	1.5
	14	1.4	1.3	1.5	1.4	1.6	1.5	1.7	1.5	1.8	1.5	1.9	1.5	1.9	1.5
	16	1.4	1.3	1.5	1.4	1.6	1.5	1.7	1.5	1.8	1.5	1.9	1.5	1.9	1.5
	18	1.4	1.3	1.5	1.4	1.6	1.5	1.7	1.5	1.8	1.5	1.9	1.5	1.9	1.5
	20	1.4	1.3	1.5	1.4	1.6	1.5	1.7	1.5	1.8	1.5	1.9	1.5	1.9	1.5
	21	1.4	1.3	1.5	1.4	1.6	1.5	1.7	1.5	1.8	1.5	1.9	1.5	1.9	1.5
	23	1.4	1.3	1.5	1.4	1.6	1.5	1.7	1.5	1.8	1.5	1.9	1.5	1.9	1.5
	25	1.4	1.3	1.5	1.4	1.6	1.5	1.7	1.5	1.8	1.5	1.9	1.5	1.9	1.5
	27	1.4	1.3	1.5	1.4	1.6	1.5	1.7	1.5	1.8	1.5	1.9	1.5	1.9	1.5
	29	1.4	1.3	1.5	1.4	1.6	1.5	1.7	1.5	1.8	1.5	1.9	1.5	1.9	1.5
	31	1.4	1.3	1.5	1.4	1.6	1.5	1.7	1.5	1.8	1.5	1.9	1.5	1.9	1.5
	33	1.4	1.3	1.5	1.4	1.6	1.5	1.7	1.5	1.8	1.5	1.9	1.5	1.9	1.5
	35	1.4	1.3	1.5	1.4	1.6	1.5	1.7	1.5	1.8	1.5	1.9	1.5	1.9	1.5
	37	1.4	1.3	1.5	1.4	1.6	1.5	1.6	1.5	1.7	1.5	1.8	1.4	1.9	1.4
	39	1.3	1.2	1.4	1.3	1.5	1.4	1.6	1.4	1.6	1.4	1.7	1.4	1.8	1.3
	40	1.3	1.2	1.4	1.3	1.5	1.4	1.5	1.4	1.6	1.4	1.7	1.3	1.7	1.3
	42	1.2	1.1	1.3	1.2	1.4	1.3	1.4	1.3	1.5	1.3	1.6	1.2	1.6	1.2
	44	1.1	1.0	1.2	1.1	1.3	1.1	1.3	1.1	1.3	1.1	1.3	1.1	1.4	1.1
	46	0.9	0.9	1.0	1.0	1.1	1.0	1.1	1.0	1.2	1.0	1.2	1.0	1.3	1.0

# Sensible capacity table



## High Wall Type ( MMK-AP\_\_4MH-E )

TC : Total capacity [kW] SHC : Sensible capacity [kW]

unit size	outdoor air temp. °CDB	indoor air temp.													
		14°CWB		16°CWB		18°CWB		19°CWB		20°CWB		22°CWB		24°CWB	
		20°CDB	23°CDB	26°CDB	27°CDB	28°CDB	30°CDB	32°CDB	TC	SHC	TC	SHC	TC	SHC	
007	10	1.8	1.5	2.0	1.6	2.1	1.7	2.2	1.7	2.3	1.7	2.4	1.7	2.5	1.6
	12	1.8	1.5	2.0	1.6	2.1	1.7	2.2	1.7	2.3	1.7	2.4	1.7	2.5	1.6
	14	1.8	1.5	2.0	1.6	2.1	1.7	2.2	1.7	2.3	1.7	2.4	1.7	2.5	1.6
	16	1.8	1.5	2.0	1.6	2.1	1.7	2.2	1.7	2.3	1.7	2.4	1.7	2.5	1.6
	18	1.8	1.5	2.0	1.6	2.1	1.7	2.2	1.7	2.3	1.7	2.4	1.7	2.5	1.6
	20	1.8	1.5	2.0	1.6	2.1	1.7	2.2	1.7	2.3	1.7	2.4	1.7	2.5	1.6
	21	1.8	1.5	2.0	1.6	2.1	1.7	2.2	1.7	2.3	1.7	2.4	1.7	2.5	1.6
	23	1.8	1.5	2.0	1.6	2.1	1.7	2.2	1.7	2.3	1.7	2.4	1.7	2.5	1.6
	25	1.8	1.5	2.0	1.6	2.1	1.7	2.2	1.7	2.3	1.7	2.4	1.7	2.5	1.6
	27	1.8	1.5	2.0	1.6	2.1	1.7	2.2	1.7	2.3	1.7	2.4	1.7	2.5	1.6
	29	1.8	1.5	2.0	1.6	2.1	1.7	2.2	1.7	2.3	1.7	2.4	1.7	2.5	1.6
	31	1.8	1.5	2.0	1.6	2.1	1.7	2.2	1.7	2.3	1.7	2.4	1.7	2.5	1.6
	33	1.8	1.5	2.0	1.6	2.1	1.7	2.2	1.7	2.3	1.7	2.4	1.7	2.5	1.6
	35	1.8	1.5	2.0	1.6	2.1	1.7	2.2	1.7	2.3	1.7	2.4	1.7	2.5	1.6
	37	1.8	1.5	1.9	1.6	2.1	1.7	2.1	1.6	2.2	1.6	2.3	1.6	2.4	1.6
	39	1.7	1.4	1.9	1.5	2.0	1.6	2.0	1.6	2.1	1.6	2.2	1.6	2.3	1.5
	40	1.6	1.4	1.8	1.4	1.9	1.5	2.0	1.5	2.0	1.5	2.2	1.5	2.3	1.5
	42	1.5	1.3	1.7	1.3	1.8	1.4	1.8	1.4	1.9	1.4	2.0	1.4	2.1	1.4
	44	1.4	1.1	1.5	1.2	1.6	1.3	1.7	1.3	1.7	1.3	1.8	1.3	1.9	1.3
	46	1.2	1.0	1.3	1.1	1.4	1.1	1.5	1.1	1.5	1.1	1.6	1.1	1.7	1.1
009	10	2.3	1.9	2.5	2.0	2.7	2.1	2.8	2.1	2.9	2.1	3.1	2.1	3.2	2.0
	12	2.3	1.9	2.5	2.0	2.7	2.1	2.8	2.1	2.9	2.1	3.1	2.1	3.2	2.0
	14	2.3	1.9	2.5	2.0	2.7	2.1	2.8	2.1	2.9	2.1	3.1	2.1	3.2	2.0
	16	2.3	1.9	2.5	2.0	2.7	2.1	2.8	2.1	2.9	2.1	3.1	2.1	3.2	2.0
	18	2.3	1.9	2.5	2.0	2.7	2.1	2.8	2.1	2.9	2.1	3.1	2.1	3.2	2.0
	20	2.3	1.9	2.5	2.0	2.7	2.1	2.8	2.1	2.9	2.1	3.1	2.1	3.2	2.0
	21	2.3	1.9	2.5	2.0	2.7	2.1	2.8	2.1	2.9	2.1	3.1	2.1	3.2	2.0
	23	2.3	1.9	2.5	2.0	2.7	2.1	2.8	2.1	2.9	2.1	3.1	2.1	3.2	2.0
	25	2.3	1.9	2.5	2.0	2.7	2.1	2.8	2.1	2.9	2.1	3.1	2.1	3.2	2.0
	27	2.3	1.9	2.5	2.0	2.7	2.1	2.8	2.1	2.9	2.1	3.1	2.1	3.2	2.0
	29	2.3	1.9	2.5	2.0	2.7	2.1	2.8	2.1	2.9	2.1	3.1	2.1	3.2	2.0
	31	2.3	1.9	2.5	2.0	2.7	2.1	2.8	2.1	2.9	2.1	3.1	2.1	3.2	2.0
	33	2.3	1.9	2.5	2.0	2.7	2.1	2.8	2.1	2.9	2.1	3.1	2.1	3.2	2.0
	35	2.3	1.9	2.5	2.0	2.7	2.1	2.8	2.1	2.9	2.1	3.1	2.1	3.2	2.0
	37	2.2	1.8	2.5	1.9	2.6	2.0	2.7	2.0	2.8	2.0	3.0	2.0	3.1	2.0
	39	2.1	1.7	2.4	1.8	2.5	2.0	2.6	1.9	2.7	1.9	2.8	1.9	3.0	1.9
	40	2.1	1.7	2.3	1.8	2.4	1.9	2.5	1.9	2.6	1.9	2.7	1.9	2.9	1.8
	42	1.9	1.6	2.1	1.7	2.3	1.8	2.3	1.8	2.4	1.8	2.6	1.7	2.7	1.7
	44	1.8	1.4	1.9	1.5	2.1	1.6	2.1	1.6	2.2	1.6	2.3	1.6	2.4	1.5
	46	1.5	1.3	1.7	1.3	1.8	1.4	1.9	1.4	1.9	1.4	2.1	1.4	2.1	1.4
012	10	3.0	2.3	3.3	2.5	3.5	2.6	3.6	2.6	3.7	2.6	3.9	2.6	4.1	2.5
	12	3.0	2.3	3.3	2.5	3.5	2.6	3.6	2.6	3.7	2.6	3.9	2.6	4.1	2.5
	14	3.0	2.3	3.3	2.5	3.5	2.6	3.6	2.6	3.7	2.6	3.9	2.6	4.1	2.5
	16	3.0	2.3	3.3	2.5	3.5	2.6	3.6	2.6	3.7	2.6	3.9	2.6	4.1	2.5
	18	3.0	2.3	3.3	2.5	3.5	2.6	3.6	2.6	3.7	2.6	3.9	2.6	4.1	2.5
	20	3.0	2.3	3.3	2.5	3.5	2.6	3.6	2.6	3.7	2.6	3.9	2.6	4.1	2.5
	21	3.0	2.3	3.3	2.5	3.5	2.6	3.6	2.6	3.7	2.6	3.9	2.6	4.1	2.5
	23	3.0	2.3	3.3	2.5	3.5	2.6	3.6	2.6	3.7	2.6	3.9	2.6	4.1	2.5
	25	3.0	2.3	3.3	2.5	3.5	2.6	3.6	2.6	3.7	2.6	3.9	2.6	4.1	2.5
	27	3.0	2.3	3.3	2.5	3.5	2.6	3.6	2.6	3.7	2.6	3.9	2.6	4.1	2.5
	29	3.0	2.3	3.3	2.5	3.5	2.6	3.6	2.6	3.7	2.6	3.9	2.6	4.1	2.5
	31	3.0	2.3	3.3	2.5	3.5	2.6	3.6	2.6	3.7	2.6	3.9	2.6	4.1	2.5
	33	3.0	2.3	3.3	2.5	3.5	2.6	3.6	2.6	3.7	2.6	3.9	2.6	4.1	2.5
	35	3.0	2.3	3.3	2.5	3.5	2.6	3.6	2.6	3.7	2.6	3.9	2.6	4.1	2.5
	37	2.9	2.2	3.2	2.4	3.4	2.5	3.5	2.5	3.6	2.5	3.8	2.5	4.0	2.4
	39	2.7	2.1	3.0	2.3	3.2	2.4	3.3	2.4	3.4	2.4	3.6	2.4	3.8	2.3
	40	2.7	2.1	2.9	2.2	3.1	2.3	3.2	2.3	3.3	2.3	3.5	2.3	3.7	2.3
	42	2.5	1.9	2.7	2.1	2.9	2.2	3.0	2.2	3.1	2.2	3.3	2.2	3.4	2.1
	44	2.3	1.8	2.5	1.9	2.7	2.0	2.7	2.0	2.8	2.0	3.0	2.0	3.1	1.9
	46	2.0	1.6	2.2	1.7	2.3	1.8	2.4	1.7	2.5	1.7	2.6	1.7	2.8	1.7

# Sensible capacity table



## Floor Standing Concealed Type ( MML-AP 4BH-E )

TC : Total capacity [kW] SHC : Sensible capacity [kW]

unit size	outdoor air temp. °CDB	indoor air temp.													
		14°CWB		16°CWB		18°CWB		19°CWB		20°CWB		22°CWB		24°CWB	
		20°CDB	23°CDB	26°CDB	27°CDB	28°CDB	30°CDB	32°CDB	TC	SHC	TC	SHC	TC	SHC	TC
007	10	1.8	1.4	2.0	1.5	2.1	1.6	2.2	1.6	2.3	1.6	2.4	1.6	2.5	1.5
	12	1.8	1.4	2.0	1.5	2.1	1.6	2.2	1.6	2.3	1.6	2.4	1.6	2.5	1.5
	14	1.8	1.4	2.0	1.5	2.1	1.6	2.2	1.6	2.3	1.6	2.4	1.6	2.5	1.5
	16	1.8	1.4	2.0	1.5	2.1	1.6	2.2	1.6	2.3	1.6	2.4	1.6	2.5	1.5
	18	1.8	1.4	2.0	1.5	2.1	1.6	2.2	1.6	2.3	1.6	2.4	1.6	2.5	1.5
	20	1.8	1.4	2.0	1.5	2.1	1.6	2.2	1.6	2.3	1.6	2.4	1.6	2.5	1.5
	21	1.8	1.4	2.0	1.5	2.1	1.6	2.2	1.6	2.3	1.6	2.4	1.6	2.5	1.5
	23	1.8	1.4	2.0	1.5	2.1	1.6	2.2	1.6	2.3	1.6	2.4	1.6	2.5	1.5
	25	1.8	1.4	2.0	1.5	2.1	1.6	2.2	1.6	2.3	1.6	2.4	1.6	2.5	1.5
	27	1.8	1.4	2.0	1.5	2.1	1.6	2.2	1.6	2.3	1.6	2.4	1.6	2.5	1.5
	29	1.8	1.4	2.0	1.5	2.1	1.6	2.2	1.6	2.3	1.6	2.4	1.6	2.5	1.5
	31	1.8	1.4	2.0	1.5	2.1	1.6	2.2	1.6	2.3	1.6	2.4	1.6	2.5	1.5
	33	1.8	1.4	2.0	1.5	2.1	1.6	2.2	1.6	2.3	1.6	2.4	1.6	2.5	1.5
	35	1.8	1.4	2.0	1.5	2.1	1.6	2.2	1.6	2.3	1.6	2.4	1.6	2.5	1.5
	37	1.8	1.4	1.9	1.5	2.1	1.6	2.1	1.6	2.2	1.6	2.3	1.5	2.4	1.5
	39	1.7	1.3	1.9	1.4	2.0	1.5	2.0	1.5	2.1	1.5	2.2	1.5	2.3	1.4
	40	1.6	1.3	1.8	1.4	1.9	1.4	2.0	1.4	2.0	1.4	2.2	1.4	2.3	1.4
	42	1.5	1.2	1.7	1.3	1.8	1.3	1.8	1.3	1.9	1.3	2.0	1.3	2.1	1.3
	44	1.4	1.1	1.5	1.2	1.6	1.2	1.7	1.2	1.7	1.2	1.8	1.2	1.9	1.2
	46	1.2	1.0	1.3	1.0	1.4	1.1	1.5	1.1	1.5	1.1	1.6	1.1	1.7	1.0
009	10	2.3	1.8	2.5	1.9	2.7	2.0	2.8	2.0	2.9	2.0	3.1	2.0	3.2	1.9
	12	2.3	1.8	2.5	1.9	2.7	2.0	2.8	2.0	2.9	2.0	3.1	2.0	3.2	1.9
	14	2.3	1.8	2.5	1.9	2.7	2.0	2.8	2.0	2.9	2.0	3.1	2.0	3.2	1.9
	16	2.3	1.8	2.5	1.9	2.7	2.0	2.8	2.0	2.9	2.0	3.1	2.0	3.2	1.9
	18	2.3	1.8	2.5	1.9	2.7	2.0	2.8	2.0	2.9	2.0	3.1	2.0	3.2	1.9
	20	2.3	1.8	2.5	1.9	2.7	2.0	2.8	2.0	2.9	2.0	3.1	2.0	3.2	1.9
	21	2.3	1.8	2.5	1.9	2.7	2.0	2.8	2.0	2.9	2.0	3.1	2.0	3.2	1.9
	23	2.3	1.8	2.5	1.9	2.7	2.0	2.8	2.0	2.9	2.0	3.1	2.0	3.2	1.9
	25	2.3	1.8	2.5	1.9	2.7	2.0	2.8	2.0	2.9	2.0	3.1	2.0	3.2	1.9
	27	2.3	1.8	2.5	1.9	2.7	2.0	2.8	2.0	2.9	2.0	3.1	2.0	3.2	1.9
	29	2.3	1.8	2.5	1.9	2.7	2.0	2.8	2.0	2.9	2.0	3.1	2.0	3.2	1.9
	31	2.3	1.8	2.5	1.9	2.7	2.0	2.8	2.0	2.9	2.0	3.1	2.0	3.2	1.9
	33	2.3	1.8	2.5	1.9	2.7	2.0	2.8	2.0	2.9	2.0	3.1	2.0	3.2	1.9
	35	2.3	1.8	2.5	1.9	2.7	2.0	2.8	2.0	2.9	2.0	3.1	2.0	3.2	1.9
	37	2.2	1.7	2.5	1.8	2.6	1.9	2.7	1.9	2.8	1.9	3.0	1.9	3.1	1.9
	39	2.1	1.6	2.4	1.8	2.5	1.9	2.6	1.9	2.7	1.9	2.8	1.8	3.0	1.8
	40	2.1	1.6	2.3	1.7	2.4	1.8	2.5	1.8	2.6	1.8	2.7	1.8	2.9	1.7
	42	1.9	1.5	2.1	1.6	2.3	1.7	2.3	1.7	2.4	1.7	2.6	1.7	2.7	1.6
	44	1.8	1.4	1.9	1.4	2.1	1.5	2.1	1.5	2.2	1.5	2.3	1.5	2.4	1.5
	46	1.5	1.2	1.7	1.3	1.8	1.3	1.9	1.3	1.9	1.3	2.1	1.3	2.1	1.3
012	10	3.0	2.1	3.3	2.3	3.5	2.4	3.6	2.4	3.7	2.4	3.9	2.4	4.1	2.3
	12	3.0	2.1	3.3	2.3	3.5	2.4	3.6	2.4	3.7	2.4	3.9	2.4	4.1	2.3
	14	3.0	2.1	3.3	2.3	3.5	2.4	3.6	2.4	3.7	2.4	3.9	2.4	4.1	2.3
	16	3.0	2.1	3.3	2.3	3.5	2.4	3.6	2.4	3.7	2.4	3.9	2.4	4.1	2.3
	18	3.0	2.1	3.3	2.3	3.5	2.4	3.6	2.4	3.7	2.4	3.9	2.4	4.1	2.3
	20	3.0	2.1	3.3	2.3	3.5	2.4	3.6	2.4	3.7	2.4	3.9	2.4	4.1	2.3
	21	3.0	2.1	3.3	2.3	3.5	2.4	3.6	2.4	3.7	2.4	3.9	2.4	4.1	2.3
	23	3.0	2.1	3.3	2.3	3.5	2.4	3.6	2.4	3.7	2.4	3.9	2.4	4.1	2.3
	25	3.0	2.1	3.3	2.3	3.5	2.4	3.6	2.4	3.7	2.4	3.9	2.4	4.1	2.3
	27	3.0	2.1	3.3	2.3	3.5	2.4	3.6	2.4	3.7	2.4	3.9	2.4	4.1	2.3
	29	3.0	2.1	3.3	2.3	3.5	2.4	3.6	2.4	3.7	2.4	3.9	2.4	4.1	2.3
	31	3.0	2.1	3.3	2.3	3.5	2.4	3.6	2.4	3.7	2.4	3.9	2.4	4.1	2.3
	33	3.0	2.1	3.3	2.3	3.5	2.4	3.6	2.4	3.7	2.4	3.9	2.4	4.1	2.3
	35	3.0	2.1	3.3	2.3	3.5	2.4	3.6	2.4	3.7	2.4	3.9	2.4	4.1	2.3
	37	2.9	2.1	3.2	2.2	3.4	2.3	3.5	2.3	3.6	2.3	3.8	2.3	4.0	2.3
	39	2.7	2.0	3.0	2.1	3.2	2.2	3.3	2.2	3.4	2.2	3.6	2.2	3.8	2.2
	40	2.7	1.9	2.9	2.0	3.1	2.2	3.2	2.2	3.3	2.2	3.5	2.1	3.7	2.1
	42	2.5	1.8	2.7	1.9	2.9	2.0	3.0	2.0	3.1	2.0	3.3	2.0	3.4	1.9
	44	2.3	1.6	2.5	1.7	2.7	1.8	2.7	1.8	2.8	1.8	3.0	1.8	3.1	1.8
	46	2.0	1.4	2.2	1.5	2.3	1.6	2.4	1.6	2.5	1.6	2.6	1.6	2.8	1.6

# Sensible capacity table



## Floor Standing Concealed Type ( MML-AP 4BH-E )

TC : Total capacity [kW] SHC : Sensible capacity [kW]

unit size	outdoor air temp. °CDB	indoor air temp.													
		14°CWB		16°CWB		18°CWB		19°CWB		20°CWB		22°CWB			
		20°CDB	23°CDB	26°CDB	27°CDB	28°CDB	30°CDB	32°CDB							
015	10	3.7	2.9	4.1	3.1	4.4	3.3	4.5	3.3	4.6	3.3	4.9	3.3	5.1	3.2
	12	3.7	2.9	4.1	3.1	4.4	3.3	4.5	3.3	4.6	3.3	4.9	3.3	5.1	3.2
	14	3.7	2.9	4.1	3.1	4.4	3.3	4.5	3.3	4.6	3.3	4.9	3.3	5.1	3.2
	16	3.7	2.9	4.1	3.1	4.4	3.3	4.5	3.3	4.6	3.3	4.9	3.3	5.1	3.2
	18	3.7	2.9	4.1	3.1	4.4	3.3	4.5	3.3	4.6	3.3	4.9	3.3	5.1	3.2
	20	3.7	2.9	4.1	3.1	4.4	3.3	4.5	3.3	4.6	3.3	4.9	3.3	5.1	3.2
	21	3.7	2.9	4.1	3.1	4.4	3.3	4.5	3.3	4.6	3.3	4.9	3.3	5.1	3.2
	23	3.7	2.9	4.1	3.1	4.4	3.3	4.5	3.3	4.6	3.3	4.9	3.3	5.1	3.2
	25	3.7	2.9	4.1	3.1	4.4	3.3	4.5	3.3	4.6	3.3	4.9	3.3	5.1	3.2
	27	3.7	2.9	4.1	3.1	4.4	3.3	4.5	3.3	4.6	3.3	4.9	3.3	5.1	3.2
	29	3.7	2.9	4.1	3.1	4.4	3.3	4.5	3.3	4.6	3.3	4.9	3.3	5.1	3.2
	31	3.7	2.9	4.1	3.1	4.4	3.3	4.5	3.3	4.6	3.3	4.9	3.3	5.1	3.2
	33	3.7	2.9	4.1	3.1	4.4	3.3	4.5	3.3	4.6	3.3	4.9	3.3	5.1	3.2
	35	3.7	2.9	4.1	3.1	4.4	3.3	4.5	3.3	4.6	3.3	4.9	3.3	5.1	3.2
	37	3.6	2.8	4.0	3.0	4.2	3.2	4.4	3.2	4.5	3.2	4.8	3.2	5.0	3.1
	39	3.4	2.7	3.8	2.9	4.0	3.1	4.2	3.1	4.3	3.1	4.5	3.0	4.8	3.0
	40	3.3	2.6	3.7	2.8	3.9	3.0	4.1	3.0	4.2	3.0	4.4	2.9	4.6	2.9
	42	3.1	2.4	3.4	2.6	3.7	2.8	3.8	2.8	3.9	2.8	4.1	2.7	4.3	2.7
	44	2.8	2.2	3.1	2.4	3.3	2.5	3.4	2.5	3.5	2.5	3.7	2.5	3.9	2.4
	46	2.5	2.0	2.7	2.1	2.9	2.2	3.0	2.2	3.1	2.2	3.3	2.2	3.4	2.1
018	10	4.6	3.4	5.1	3.6	5.4	3.8	5.6	3.8	5.8	3.8	6.1	3.8	6.4	3.7
	12	4.6	3.4	5.1	3.6	5.4	3.8	5.6	3.8	5.8	3.8	6.1	3.8	6.4	3.7
	14	4.6	3.4	5.1	3.6	5.4	3.8	5.6	3.8	5.8	3.8	6.1	3.8	6.4	3.7
	16	4.6	3.4	5.1	3.6	5.4	3.8	5.6	3.8	5.8	3.8	6.1	3.8	6.4	3.7
	18	4.6	3.4	5.1	3.6	5.4	3.8	5.6	3.8	5.8	3.8	6.1	3.8	6.4	3.7
	20	4.6	3.4	5.1	3.6	5.4	3.8	5.6	3.8	5.8	3.8	6.1	3.8	6.4	3.7
	21	4.6	3.4	5.1	3.6	5.4	3.8	5.6	3.8	5.8	3.8	6.1	3.8	6.4	3.7
	23	4.6	3.4	5.1	3.6	5.4	3.8	5.6	3.8	5.8	3.8	6.1	3.8	6.4	3.7
	25	4.6	3.4	5.1	3.6	5.4	3.8	5.6	3.8	5.8	3.8	6.1	3.8	6.4	3.7
	27	4.6	3.4	5.1	3.6	5.4	3.8	5.6	3.8	5.8	3.8	6.1	3.8	6.4	3.7
	29	4.6	3.4	5.1	3.6	5.4	3.8	5.6	3.8	5.8	3.8	6.1	3.8	6.4	3.7
	31	4.6	3.4	5.1	3.6	5.4	3.8	5.6	3.8	5.8	3.8	6.1	3.8	6.4	3.7
	33	4.6	3.4	5.1	3.6	5.4	3.8	5.6	3.8	5.8	3.8	6.1	3.8	6.4	3.7
	35	4.6	3.4	5.1	3.6	5.4	3.8	5.6	3.8	5.8	3.8	6.1	3.8	6.4	3.7
	37	4.5	3.3	4.9	3.5	5.3	3.7	5.4	3.7	5.6	3.7	5.9	3.7	6.2	3.6
	39	4.3	3.1	4.7	3.3	5.0	3.5	5.2	3.5	5.3	3.5	5.7	3.5	5.9	3.4
	40	4.1	3.0	4.6	3.2	4.9	3.4	5.0	3.4	5.2	3.4	5.5	3.4	5.7	3.3
	42	3.8	2.8	4.3	3.0	4.5	3.2	4.7	3.2	4.8	3.2	5.1	3.2	5.3	3.1
	44	3.5	2.6	3.9	2.7	4.1	2.9	4.3	2.9	4.4	2.9	4.6	2.9	4.9	2.8
	46	3.1	2.3	3.4	2.4	3.7	2.6	3.8	2.6	3.9	2.6	4.1	2.5	4.3	2.5
024	10	5.8	4.2	6.4	4.4	6.9	4.7	7.1	4.7	7.3	4.7	7.7	4.7	8.1	4.5
	12	5.8	4.2	6.4	4.4	6.9	4.7	7.1	4.7	7.3	4.7	7.7	4.7	8.1	4.5
	14	5.8	4.2	6.4	4.4	6.9	4.7	7.1	4.7	7.3	4.7	7.7	4.7	8.1	4.5
	16	5.8	4.2	6.4	4.4	6.9	4.7	7.1	4.7	7.3	4.7	7.7	4.7	8.1	4.5
	18	5.8	4.2	6.4	4.4	6.9	4.7	7.1	4.7	7.3	4.7	7.7	4.7	8.1	4.5
	20	5.8	4.2	6.4	4.4	6.9	4.7	7.1	4.7	7.3	4.7	7.7	4.7	8.1	4.5
	21	5.8	4.2	6.4	4.4	6.9	4.7	7.1	4.7	7.3	4.7	7.7	4.7	8.1	4.5
	23	5.8	4.2	6.4	4.4	6.9	4.7	7.1	4.7	7.3	4.7	7.7	4.7	8.1	4.5
	25	5.8	4.2	6.4	4.4	6.9	4.7	7.1	4.7	7.3	4.7	7.7	4.7	8.1	4.5
	27	5.8	4.2	6.4	4.4	6.9	4.7	7.1	4.7	7.3	4.7	7.7	4.7	8.1	4.5
	29	5.8	4.2	6.4	4.4	6.9	4.7	7.1	4.7	7.3	4.7	7.7	4.7	8.1	4.5
	31	5.8	4.2	6.4	4.4	6.9	4.7	7.1	4.7	7.3	4.7	7.7	4.7	8.1	4.5
	33	5.8	4.2	6.4	4.4	6.9	4.7	7.1	4.7	7.3	4.7	7.7	4.7	8.1	4.5
	35	5.8	4.2	6.4	4.4	6.9	4.7	7.1	4.7	7.3	4.7	7.7	4.7	8.1	4.5
	37	5.7	4.0	6.3	4.3	6.7	4.6	6.9	4.6	7.1	4.6	7.5	4.5	7.9	4.4
	39	5.4	3.9	6.0	4.1	6.4	4.4	6.6	4.4	6.8	4.4	7.2	4.3	7.5	4.2
	40	5.2	3.8	5.8	4.0	6.2	4.2	6.4	4.2	6.6	4.2	7.0	4.2	7.3	4.1
	42	4.9	3.5	5.4	3.7	5.8	3.9	5.9	3.9	6.1	3.9	6.5	3.9	6.8	3.8
	44	4.4	3.2	4.9	3.4	5.2	3.6	5.4	3.6	5.6	3.6	5.9	3.5	6.2	3.5
	46	3.9	2.8	4.3	3.0	4.6	3.2	4.8	3.2	4.9	3.2	5.2	3.1	5.4	3.1

# Sensible capacity table



## Floor Standing Cabinet Type ( MML-AP \_\_\_\_ 4H-E )

TC : Total capacity [kW] SHC : Sensible capacity [kW]

unit size	outdoor air temp. °CDB	indoor air temp.													
		14°CWB		16°CWB		18°CWB		19°CWB		20°CWB		22°CWB			
		20°CDB	23°CDB	26°CDB	27°CDB	28°CDB	30°CDB	32°CDB							
007	10	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	12	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	14	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	16	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	18	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	20	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	21	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	23	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	25	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	27	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	29	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	31	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	33	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	35	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	37	1.8	1.5	1.9	1.6	2.1	1.8	2.1	1.7	2.2	1.7	2.3	1.7	2.4	1.7
	39	1.7	1.5	1.9	1.6	2.0	1.7	2.0	1.7	2.1	1.7	2.2	1.7	2.3	1.6
	40	1.6	1.4	1.8	1.5	1.9	1.6	2.0	1.6	2.0	1.6	2.2	1.6	2.3	1.6
	42	1.5	1.3	1.7	1.4	1.8	1.5	1.8	1.5	1.9	1.5	2.0	1.5	2.1	1.5
	44	1.4	1.2	1.5	1.3	1.6	1.4	1.7	1.4	1.7	1.4	1.8	1.4	1.9	1.3
	46	1.2	1.1	1.3	1.1	1.4	1.2	1.5	1.2	1.5	1.2	1.6	1.2	1.7	1.2
009	10	2.3	1.9	2.5	2.0	2.7	2.1	2.8	2.1	2.9	2.1	3.1	2.1	3.2	2.0
	12	2.3	1.9	2.5	2.0	2.7	2.1	2.8	2.1	2.9	2.1	3.1	2.1	3.2	2.0
	14	2.3	1.9	2.5	2.0	2.7	2.1	2.8	2.1	2.9	2.1	3.1	2.1	3.2	2.0
	16	2.3	1.9	2.5	2.0	2.7	2.1	2.8	2.1	2.9	2.1	3.1	2.1	3.2	2.0
	18	2.3	1.9	2.5	2.0	2.7	2.1	2.8	2.1	2.9	2.1	3.1	2.1	3.2	2.0
	20	2.3	1.9	2.5	2.0	2.7	2.1	2.8	2.1	2.9	2.1	3.1	2.1	3.2	2.0
	21	2.3	1.9	2.5	2.0	2.7	2.1	2.8	2.1	2.9	2.1	3.1	2.1	3.2	2.0
	23	2.3	1.9	2.5	2.0	2.7	2.1	2.8	2.1	2.9	2.1	3.1	2.1	3.2	2.0
	25	2.3	1.9	2.5	2.0	2.7	2.1	2.8	2.1	2.9	2.1	3.1	2.1	3.2	2.0
	27	2.3	1.9	2.5	2.0	2.7	2.1	2.8	2.1	2.9	2.1	3.1	2.1	3.2	2.0
	29	2.3	1.9	2.5	2.0	2.7	2.1	2.8	2.1	2.9	2.1	3.1	2.1	3.2	2.0
	31	2.3	1.9	2.5	2.0	2.7	2.1	2.8	2.1	2.9	2.1	3.1	2.1	3.2	2.0
	33	2.3	1.9	2.5	2.0	2.7	2.1	2.8	2.1	2.9	2.1	3.1	2.1	3.2	2.0
	35	2.3	1.9	2.5	2.0	2.7	2.1	2.8	2.1	2.9	2.1	3.1	2.1	3.2	2.0
	37	2.2	1.8	2.5	1.9	2.6	2.0	2.7	2.0	2.8	2.0	3.0	2.0	3.1	2.0
	39	2.1	1.7	2.4	1.8	2.5	2.0	2.6	1.9	2.7	1.9	2.8	1.9	3.0	1.9
	40	2.1	1.7	2.3	1.8	2.4	1.9	2.5	1.9	2.6	1.9	2.7	1.9	2.9	1.8
	42	1.9	1.6	2.1	1.7	2.3	1.8	2.3	1.8	2.4	1.8	2.6	1.7	2.7	1.7
	44	1.8	1.4	1.9	1.5	2.1	1.6	2.1	1.6	2.2	1.6	2.3	1.6	2.4	1.5
	46	1.5	1.3	1.7	1.3	1.8	1.4	1.9	1.4	1.9	1.4	2.1	1.4	2.1	1.4
012	10	3.0	2.6	3.3	2.7	3.5	2.9	3.6	2.9	3.7	2.9	3.9	2.9	4.1	2.8
	12	3.0	2.6	3.3	2.7	3.5	2.9	3.6	2.9	3.7	2.9	3.9	2.9	4.1	2.8
	14	3.0	2.6	3.3	2.7	3.5	2.9	3.6	2.9	3.7	2.9	3.9	2.9	4.1	2.8
	16	3.0	2.6	3.3	2.7	3.5	2.9	3.6	2.9	3.7	2.9	3.9	2.9	4.1	2.8
	18	3.0	2.6	3.3	2.7	3.5	2.9	3.6	2.9	3.7	2.9	3.9	2.9	4.1	2.8
	20	3.0	2.6	3.3	2.7	3.5	2.9	3.6	2.9	3.7	2.9	3.9	2.9	4.1	2.8
	21	3.0	2.6	3.3	2.7	3.5	2.9	3.6	2.9	3.7	2.9	3.9	2.9	4.1	2.8
	23	3.0	2.6	3.3	2.7	3.5	2.9	3.6	2.9	3.7	2.9	3.9	2.9	4.1	2.8
	25	3.0	2.6	3.3	2.7	3.5	2.9	3.6	2.9	3.7	2.9	3.9	2.9	4.1	2.8
	27	3.0	2.6	3.3	2.7	3.5	2.9	3.6	2.9	3.7	2.9	3.9	2.9	4.1	2.8
	29	3.0	2.6	3.3	2.7	3.5	2.9	3.6	2.9	3.7	2.9	3.9	2.9	4.1	2.8
	31	3.0	2.6	3.3	2.7	3.5	2.9	3.6	2.9	3.7	2.9	3.9	2.9	4.1	2.8
	33	3.0	2.6	3.3	2.7	3.5	2.9	3.6	2.9	3.7	2.9	3.9	2.9	4.1	2.8
	35	3.0	2.6	3.3	2.7	3.5	2.9	3.6	2.9	3.7	2.9	3.9	2.9	4.1	2.8
	37	2.9	2.5	3.2	2.7	3.4	2.8	3.5	2.8	3.6	2.8	3.8	2.8	4.0	2.7
	39	2.7	2.4	3.0	2.5	3.2	2.7	3.3	2.7	3.4	2.7	3.6	2.7	3.8	2.6
	40	2.7	2.3	2.9	2.5	3.1	2.6	3.2	2.6	3.3	2.6	3.5	2.6	3.7	2.5
	42	2.5	2.2	2.7	2.3	2.9	2.4	3.0	2.4	3.1	2.4	3.3	2.4	3.4	2.3
	44	2.3	2.0	2.5	2.1	2.7	2.2	2.7	2.2	2.8	2.2	3.0	2.2	3.1	2.1
	46	2.0	1.7	2.2	1.8	2.3	2.0	2.4	2.0	2.5	1.9	2.6	1.9	2.8	1.9

# Sensible capacity table



## Floor Standing Cabinet Type ( MML-AP \_\_\_\_ 4H-E )

TC : Total capacity [kW] SHC : Sensible capacity [kW]

unit size	outdoor air temp. °CDB	indoor air temp.													
		14°CWB		16°CWB		18°CWB		19°CWB		20°CWB		22°CWB		24°CWB	
		20°CDB	23°CDB	26°CDB	27°CDB	28°CDB	30°CDB	32°CDB	TC	SHC	TC	SHC	TC	SHC	TC
015	10	3.7	3.2	4.1	3.4	4.4	3.6	4.5	3.6	4.6	3.6	4.9	3.6	5.1	3.5
	12	3.7	3.2	4.1	3.4	4.4	3.6	4.5	3.6	4.6	3.6	4.9	3.6	5.1	3.5
	14	3.7	3.2	4.1	3.4	4.4	3.6	4.5	3.6	4.6	3.6	4.9	3.6	5.1	3.5
	16	3.7	3.2	4.1	3.4	4.4	3.6	4.5	3.6	4.6	3.6	4.9	3.6	5.1	3.5
	18	3.7	3.2	4.1	3.4	4.4	3.6	4.5	3.6	4.6	3.6	4.9	3.6	5.1	3.5
	20	3.7	3.2	4.1	3.4	4.4	3.6	4.5	3.6	4.6	3.6	4.9	3.6	5.1	3.5
	21	3.7	3.2	4.1	3.4	4.4	3.6	4.5	3.6	4.6	3.6	4.9	3.6	5.1	3.5
	23	3.7	3.2	4.1	3.4	4.4	3.6	4.5	3.6	4.6	3.6	4.9	3.6	5.1	3.5
	25	3.7	3.2	4.1	3.4	4.4	3.6	4.5	3.6	4.6	3.6	4.9	3.6	5.1	3.5
	27	3.7	3.2	4.1	3.4	4.4	3.6	4.5	3.6	4.6	3.6	4.9	3.6	5.1	3.5
	29	3.7	3.2	4.1	3.4	4.4	3.6	4.5	3.6	4.6	3.6	4.9	3.6	5.1	3.5
	31	3.7	3.2	4.1	3.4	4.4	3.6	4.5	3.6	4.6	3.6	4.9	3.6	5.1	3.5
	33	3.7	3.2	4.1	3.4	4.4	3.6	4.5	3.6	4.6	3.6	4.9	3.6	5.1	3.5
	35	3.7	3.2	4.1	3.4	4.4	3.6	4.5	3.6	4.6	3.6	4.9	3.6	5.1	3.5
	37	3.6	3.1	4.0	3.3	4.2	3.5	4.4	3.5	4.5	3.5	4.8	3.5	5.0	3.4
	39	3.4	3.0	3.8	3.2	4.0	3.3	4.2	3.3	4.3	3.3	4.5	3.3	4.8	3.2
	40	3.3	2.9	3.7	3.1	3.9	3.2	4.1	3.2	4.2	3.2	4.4	3.2	4.6	3.1
	42	3.1	2.7	3.4	2.8	3.7	3.0	3.8	3.0	3.9	3.0	4.1	3.0	4.3	2.9
	44	2.8	2.4	3.1	2.6	3.3	2.7	3.4	2.7	3.5	2.7	3.7	2.7	3.9	2.7
	46	2.5	2.1	2.7	2.3	2.9	2.4	3.0	2.4	3.1	2.4	3.3	2.4	3.4	2.3
018	10	4.6	3.8	5.1	4.1	5.4	4.3	5.6	4.3	5.8	4.3	6.1	4.3	6.4	4.2
	12	4.6	3.8	5.1	4.1	5.4	4.3	5.6	4.3	5.8	4.3	6.1	4.3	6.4	4.2
	14	4.6	3.8	5.1	4.1	5.4	4.3	5.6	4.3	5.8	4.3	6.1	4.3	6.4	4.2
	16	4.6	3.8	5.1	4.1	5.4	4.3	5.6	4.3	5.8	4.3	6.1	4.3	6.4	4.2
	18	4.6	3.8	5.1	4.1	5.4	4.3	5.6	4.3	5.8	4.3	6.1	4.3	6.4	4.2
	20	4.6	3.8	5.1	4.1	5.4	4.3	5.6	4.3	5.8	4.3	6.1	4.3	6.4	4.2
	21	4.6	3.8	5.1	4.1	5.4	4.3	5.6	4.3	5.8	4.3	6.1	4.3	6.4	4.2
	23	4.6	3.8	5.1	4.1	5.4	4.3	5.6	4.3	5.8	4.3	6.1	4.3	6.4	4.2
	25	4.6	3.8	5.1	4.1	5.4	4.3	5.6	4.3	5.8	4.3	6.1	4.3	6.4	4.2
	27	4.6	3.8	5.1	4.1	5.4	4.3	5.6	4.3	5.8	4.3	6.1	4.3	6.4	4.2
	29	4.6	3.8	5.1	4.1	5.4	4.3	5.6	4.3	5.8	4.3	6.1	4.3	6.4	4.2
	31	4.6	3.8	5.1	4.1	5.4	4.3	5.6	4.3	5.8	4.3	6.1	4.3	6.4	4.2
	33	4.6	3.8	5.1	4.1	5.4	4.3	5.6	4.3	5.8	4.3	6.1	4.3	6.4	4.2
	35	4.6	3.8	5.1	4.1	5.4	4.3	5.6	4.3	5.8	4.3	6.1	4.3	6.4	4.2
	37	4.5	3.7	4.9	3.9	5.3	4.2	5.4	4.2	5.6	4.2	5.9	4.1	6.2	4.0
	39	4.3	3.5	4.7	3.8	5.0	4.0	5.2	4.0	5.3	4.0	5.7	3.9	5.9	3.9
	40	4.1	3.4	4.6	3.7	4.9	3.9	5.0	3.9	5.2	3.9	5.5	3.8	5.7	3.7
	42	3.8	3.2	4.3	3.4	4.5	3.6	4.7	3.6	4.8	3.6	5.1	3.6	5.3	3.5
	44	3.5	2.9	3.9	3.1	4.1	3.3	4.3	3.3	4.4	3.3	4.6	3.2	4.9	3.2
	46	3.1	2.6	3.4	2.7	3.7	2.9	3.8	2.9	3.9	2.9	4.1	2.9	4.3	2.8
024	10	5.8	4.6	6.4	4.9	6.9	5.2	7.1	5.2	7.3	5.2	7.7	5.2	8.1	5.0
	12	5.8	4.6	6.4	4.9	6.9	5.2	7.1	5.2	7.3	5.2	7.7	5.2	8.1	5.0
	14	5.8	4.6	6.4	4.9	6.9	5.2	7.1	5.2	7.3	5.2	7.7	5.2	8.1	5.0
	16	5.8	4.6	6.4	4.9	6.9	5.2	7.1	5.2	7.3	5.2	7.7	5.2	8.1	5.0
	18	5.8	4.6	6.4	4.9	6.9	5.2	7.1	5.2	7.3	5.2	7.7	5.2	8.1	5.0
	20	5.8	4.6	6.4	4.9	6.9	5.2	7.1	5.2	7.3	5.2	7.7	5.2	8.1	5.0
	21	5.8	4.6	6.4	4.9	6.9	5.2	7.1	5.2	7.3	5.2	7.7	5.2	8.1	5.0
	23	5.8	4.6	6.4	4.9	6.9	5.2	7.1	5.2	7.3	5.2	7.7	5.2	8.1	5.0
	25	5.8	4.6	6.4	4.9	6.9	5.2	7.1	5.2	7.3	5.2	7.7	5.2	8.1	5.0
	27	5.8	4.6	6.4	4.9	6.9	5.2	7.1	5.2	7.3	5.2	7.7	5.2	8.1	5.0
	29	5.8	4.6	6.4	4.9	6.9	5.2	7.1	5.2	7.3	5.2	7.7	5.2	8.1	5.0
	31	5.8	4.6	6.4	4.9	6.9	5.2	7.1	5.2	7.3	5.2	7.7	5.2	8.1	5.0
	33	5.8	4.6	6.4	4.9	6.9	5.2	7.1	5.2	7.3	5.2	7.7	5.2	8.1	5.0
	35	5.8	4.6	6.4	4.9	6.9	5.2	7.1	5.2	7.3	5.2	7.7	5.2	8.1	5.0
	37	5.7	4.5	6.3	4.8	6.7	5.1	6.9	5.0	7.1	5.0	7.5	5.0	7.9	4.9
	39	5.4	4.3	6.0	4.6	6.4	4.8	6.6	4.8	6.8	4.8	7.2	4.8	7.5	4.7
	40	5.2	4.2	5.8	4.4	6.2	4.7	6.4	4.7	6.6	4.7	7.0	4.6	7.3	4.5
	42	4.9	3.9	5.4	4.1	5.8	4.4	5.9	4.4	6.1	4.4	6.5	4.3	6.8	4.2
	44	4.4	3.5	4.9	3.7	5.2	4.0	5.4	4.0	5.6	4.0	5.9	3.9	6.2	3.8
	46	3.9	3.1	4.3	3.3	4.6	3.5	4.8	3.5	4.9	3.5	5.2	3.5	5.4	3.4

# Sensible capacity table



## Floor standing Type ( MMF-AP 6H-E )

TC : Total capacity [kW] SHC : Sensible capacity [kW]

unit size	outdoor air temp. °CDB	Indoor air temp.													
		14°CWB		16°CWB		18°CWB		19°CWB		20°CWB		22°CWB		24°CWB	
		20°CDB	23°CDB	26°CDB	27°CDB	28°CDB	30°CDB	32°CDB	TC	SHC	TC	SHC	TC	SHC	TC
015	10	3.7	3.1	4.1	3.3	4.4	3.5	4.5	3.5	4.6	3.5	4.9	3.5	5.1	3.4
	12	3.7	3.1	4.1	3.3	4.4	3.5	4.5	3.5	4.6	3.5	4.9	3.5	5.1	3.4
	14	3.7	3.1	4.1	3.3	4.4	3.5	4.5	3.5	4.6	3.5	4.9	3.5	5.1	3.4
	16	3.7	3.1	4.1	3.3	4.4	3.5	4.5	3.5	4.6	3.5	4.9	3.5	5.1	3.4
	18	3.7	3.1	4.1	3.3	4.4	3.5	4.5	3.5	4.6	3.5	4.9	3.5	5.1	3.4
	20	3.7	3.1	4.1	3.3	4.4	3.5	4.5	3.5	4.6	3.5	4.9	3.5	5.1	3.4
	21	3.7	3.1	4.1	3.3	4.4	3.5	4.5	3.5	4.6	3.5	4.9	3.5	5.1	3.4
	23	3.7	3.1	4.1	3.3	4.4	3.5	4.5	3.5	4.6	3.5	4.9	3.5	5.1	3.4
	25	3.7	3.1	4.1	3.3	4.4	3.5	4.5	3.5	4.6	3.5	4.9	3.5	5.1	3.4
	27	3.7	3.1	4.1	3.3	4.4	3.5	4.5	3.5	4.6	3.5	4.9	3.5	5.1	3.4
	29	3.7	3.1	4.1	3.3	4.4	3.5	4.5	3.5	4.6	3.5	4.9	3.5	5.1	3.4
	31	3.7	3.1	4.1	3.3	4.4	3.5	4.5	3.5	4.6	3.5	4.9	3.5	5.1	3.4
	33	3.7	3.1	4.1	3.3	4.4	3.5	4.5	3.5	4.6	3.5	4.9	3.5	5.1	3.4
	35	3.7	3.1	4.1	3.3	4.4	3.5	4.5	3.5	4.6	3.5	4.9	3.5	5.1	3.4
	37	3.6	3.0	4.0	3.2	4.2	3.4	4.4	3.4	4.5	3.4	4.8	3.4	5.0	3.3
	39	3.4	2.9	3.8	3.1	4.0	3.3	4.2	3.2	4.3	3.2	4.5	3.2	4.8	3.1
	40	3.3	2.8	3.7	3.0	3.9	3.2	4.1	3.2	4.2	3.2	4.4	3.1	4.6	3.0
	42	3.1	2.6	3.4	2.8	3.7	2.9	3.8	2.9	3.9	2.9	4.1	2.9	4.3	2.8
	44	2.8	2.4	3.1	2.5	3.3	2.7	3.4	2.7	3.5	2.7	3.7	2.6	3.9	2.6
	46	2.5	2.1	2.7	2.2	2.9	2.4	3.0	2.4	3.1	2.4	3.3	2.3	3.4	2.3
018	10	4.6	3.6	5.1	3.9	5.4	4.1	5.6	4.1	5.8	4.1	6.1	4.1	6.4	4.0
	12	4.6	3.6	5.1	3.9	5.4	4.1	5.6	4.1	5.8	4.1	6.1	4.1	6.4	4.0
	14	4.6	3.6	5.1	3.9	5.4	4.1	5.6	4.1	5.8	4.1	6.1	4.1	6.4	4.0
	16	4.6	3.6	5.1	3.9	5.4	4.1	5.6	4.1	5.8	4.1	6.1	4.1	6.4	4.0
	18	4.6	3.6	5.1	3.9	5.4	4.1	5.6	4.1	5.8	4.1	6.1	4.1	6.4	4.0
	20	4.6	3.6	5.1	3.9	5.4	4.1	5.6	4.1	5.8	4.1	6.1	4.1	6.4	4.0
	21	4.6	3.6	5.1	3.9	5.4	4.1	5.6	4.1	5.8	4.1	6.1	4.1	6.4	4.0
	23	4.6	3.6	5.1	3.9	5.4	4.1	5.6	4.1	5.8	4.1	6.1	4.1	6.4	4.0
	25	4.6	3.6	5.1	3.9	5.4	4.1	5.6	4.1	5.8	4.1	6.1	4.1	6.4	4.0
	27	4.6	3.6	5.1	3.9	5.4	4.1	5.6	4.1	5.8	4.1	6.1	4.1	6.4	4.0
	29	4.6	3.6	5.1	3.9	5.4	4.1	5.6	4.1	5.8	4.1	6.1	4.1	6.4	4.0
	31	4.6	3.6	5.1	3.9	5.4	4.1	5.6	4.1	5.8	4.1	6.1	4.1	6.4	4.0
	33	4.6	3.6	5.1	3.9	5.4	4.1	5.6	4.1	5.8	4.1	6.1	4.1	6.4	4.0
	35	4.6	3.6	5.1	3.9	5.4	4.1	5.6	4.1	5.8	4.1	6.1	4.1	6.4	4.0
	37	4.5	3.5	4.9	3.8	5.3	4.0	5.4	4.0	5.6	4.0	5.9	3.9	6.2	3.8
	39	4.3	3.4	4.7	3.6	5.0	3.8	5.2	3.8	5.3	3.8	5.7	3.8	5.9	3.7
	40	4.1	3.3	4.6	3.5	4.9	3.7	5.0	3.7	5.2	3.7	5.5	3.7	5.7	3.6
	42	3.8	3.0	4.3	3.2	4.5	3.4	4.7	3.4	4.8	3.4	5.1	3.4	5.3	3.3
	44	3.5	2.8	3.9	2.9	4.1	3.1	4.3	3.1	4.4	3.1	4.6	3.1	4.9	3.0
	46	3.1	2.4	3.4	2.6	3.7	2.8	3.8	2.8	3.9	2.8	4.1	2.7	4.3	2.7
024	10	5.8	4.9	6.4	5.2	6.9	5.5	7.1	5.5	7.3	5.5	7.7	5.4	8.1	5.3
	12	5.8	4.9	6.4	5.2	6.9	5.5	7.1	5.5	7.3	5.5	7.7	5.4	8.1	5.3
	14	5.8	4.9	6.4	5.2	6.9	5.5	7.1	5.5	7.3	5.5	7.7	5.4	8.1	5.3
	16	5.8	4.9	6.4	5.2	6.9	5.5	7.1	5.5	7.3	5.5	7.7	5.4	8.1	5.3
	18	5.8	4.9	6.4	5.2	6.9	5.5	7.1	5.5	7.3	5.5	7.7	5.4	8.1	5.3
	20	5.8	4.9	6.4	5.2	6.9	5.5	7.1	5.5	7.3	5.5	7.7	5.4	8.1	5.3
	21	5.8	4.9	6.4	5.2	6.9	5.5	7.1	5.5	7.3	5.5	7.7	5.4	8.1	5.3
	23	5.8	4.9	6.4	5.2	6.9	5.5	7.1	5.5	7.3	5.5	7.7	5.4	8.1	5.3
	25	5.8	4.9	6.4	5.2	6.9	5.5	7.1	5.5	7.3	5.5	7.7	5.4	8.1	5.3
	27	5.8	4.9	6.4	5.2	6.9	5.5	7.1	5.5	7.3	5.5	7.7	5.4	8.1	5.3
	29	5.8	4.9	6.4	5.2	6.9	5.5	7.1	5.5	7.3	5.5	7.7	5.4	8.1	5.3
	31	5.8	4.9	6.4	5.2	6.9	5.5	7.1	5.5	7.3	5.5	7.7	5.4	8.1	5.3
	33	5.8	4.9	6.4	5.2	6.9	5.5	7.1	5.5	7.3	5.5	7.7	5.4	8.1	5.3
	35	5.8	4.9	6.4	5.2	6.9	5.5	7.1	5.5	7.3	5.5	7.7	5.4	8.1	5.3
	37	5.7	4.7	6.3	5.0	6.7	5.4	6.9	5.3	7.1	5.3	7.5	5.3	7.9	5.2
	39	5.4	4.5	6.0	4.8	6.4	5.1	6.6	5.1	6.8	5.1	7.2	5.0	7.5	4.9
	40	5.2	4.4	5.8	4.7	6.2	5.0	6.4	5.0	6.6	5.0	7.0	4.9	7.3	4.8
	42	4.9	4.1	5.4	4.3	5.8	4.6	5.9	4.6	6.1	4.6	6.5	4.6	6.8	4.5
	44	4.4	3.7	4.9	4.0	5.2	4.2	5.4	4.2	5.6	4.2	5.9	4.1	6.2	4.1
	46	3.9	3.3	4.3	3.5	4.6	3.7	4.8	3.7	4.9	3.7	5.2	3.7	5.4	3.6

# Sensible capacity table



## Floor standing Type ( MMF-AP 6H-E )

TC : Total capacity [kW] SHC : Sensible capacity [kW]

unit size	outdoor air temp. °CDB	indoor air temp.													
		14°CWB		16°CWB		18°CWB		19°CWB		20°CWB		22°CWB		24°CWB	
		20°CDB		23°CDB		26°CDB		27°CDB		28°CDB		30°CDB		32°CDB	
		TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
027	10	6.6	5.2	7.3	5.6	7.8	5.9	8.0	5.9	8.2	5.9	8.7	5.8	9.1	5.7
	12	6.6	5.2	7.3	5.6	7.8	5.9	8.0	5.9	8.2	5.9	8.7	5.8	9.1	5.7
	14	6.6	5.2	7.3	5.6	7.8	5.9	8.0	5.9	8.2	5.9	8.7	5.8	9.1	5.7
	16	6.6	5.2	7.3	5.6	7.8	5.9	8.0	5.9	8.2	5.9	8.7	5.8	9.1	5.7
	18	6.6	5.2	7.3	5.6	7.8	5.9	8.0	5.9	8.2	5.9	8.7	5.8	9.1	5.7
	20	6.6	5.2	7.3	5.6	7.8	5.9	8.0	5.9	8.2	5.9	8.7	5.8	9.1	5.7
	21	6.6	5.2	7.3	5.6	7.8	5.9	8.0	5.9	8.2	5.9	8.7	5.8	9.1	5.7
	23	6.6	5.2	7.3	5.6	7.8	5.9	8.0	5.9	8.2	5.9	8.7	5.8	9.1	5.7
	25	6.6	5.2	7.3	5.6	7.8	5.9	8.0	5.9	8.2	5.9	8.7	5.8	9.1	5.7
	27	6.6	5.2	7.3	5.6	7.8	5.9	8.0	5.9	8.2	5.9	8.7	5.8	9.1	5.7
	29	6.6	5.2	7.3	5.6	7.8	5.9	8.0	5.9	8.2	5.9	8.7	5.8	9.1	5.7
	31	6.6	5.2	7.3	5.6	7.8	5.9	8.0	5.9	8.2	5.9	8.7	5.8	9.1	5.7
	33	6.6	5.2	7.3	5.6	7.8	5.9	8.0	5.9	8.2	5.9	8.7	5.8	9.1	5.7
	35	6.6	5.2	7.3	5.6	7.8	5.9	8.0	5.9	8.2	5.9	8.7	5.8	9.1	5.7
	37	6.4	5.1	7.0	5.4	7.5	5.7	7.8	5.7	8.0	5.7	8.5	5.7	8.8	5.5
	39	6.1	4.8	6.7	5.2	7.2	5.5	7.4	5.5	7.6	5.5	8.1	5.4	8.5	5.3
	40	5.9	4.7	6.5	5.0	7.0	5.3	7.2	5.3	7.4	5.3	7.8	5.3	8.2	5.1
	42	5.5	4.4	6.1	4.7	6.5	5.0	6.7	4.9	6.9	4.9	7.3	4.9	7.6	4.8
	44	5.0	4.0	5.5	4.2	5.9	4.5	6.1	4.5	6.3	4.5	6.6	4.5	6.9	4.3
	46	4.4	3.5	4.9	3.7	5.2	4.0	5.4	4.0	5.5	4.0	5.9	3.9	6.1	3.8
036	10	9.2	7.5	10.2	8.0	10.9	8.5	11.2	8.5	11.5	8.5	12.2	8.4	12.8	8.2
	12	9.2	7.5	10.2	8.0	10.9	8.5	11.2	8.5	11.5	8.5	12.2	8.4	12.8	8.2
	14	9.2	7.5	10.2	8.0	10.9	8.5	11.2	8.5	11.5	8.5	12.2	8.4	12.8	8.2
	16	9.2	7.5	10.2	8.0	10.9	8.5	11.2	8.5	11.5	8.5	12.2	8.4	12.8	8.2
	18	9.2	7.5	10.2	8.0	10.9	8.5	11.2	8.5	11.5	8.5	12.2	8.4	12.8	8.2
	20	9.2	7.5	10.2	8.0	10.9	8.5	11.2	8.5	11.5	8.5	12.2	8.4	12.8	8.2
	21	9.2	7.5	10.2	8.0	10.9	8.5	11.2	8.5	11.5	8.5	12.2	8.4	12.8	8.2
	23	9.2	7.5	10.2	8.0	10.9	8.5	11.2	8.5	11.5	8.5	12.2	8.4	12.8	8.2
	25	9.2	7.5	10.2	8.0	10.9	8.5	11.2	8.5	11.5	8.5	12.2	8.4	12.8	8.2
	27	9.2	7.5	10.2	8.0	10.9	8.5	11.2	8.5	11.5	8.5	12.2	8.4	12.8	8.2
	29	9.2	7.5	10.2	8.0	10.9	8.5	11.2	8.5	11.5	8.5	12.2	8.4	12.8	8.2
	31	9.2	7.5	10.2	8.0	10.9	8.5	11.2	8.5	11.5	8.5	12.2	8.4	12.8	8.2
	33	9.2	7.5	10.2	8.0	10.9	8.5	11.2	8.5	11.5	8.5	12.2	8.4	12.8	8.2
	35	9.2	7.5	10.2	8.0	10.9	8.5	11.2	8.5	11.5	8.5	12.2	8.4	12.8	8.2
	37	8.9	7.3	9.9	7.8	10.5	8.3	10.9	8.2	11.2	8.2	11.8	8.2	12.4	8.0
	39	8.5	7.0	9.4	7.4	10.1	7.9	10.4	7.9	10.7	7.9	11.3	7.8	11.8	7.6
	40	8.3	6.8	9.2	7.2	9.8	7.7	10.1	7.7	10.4	7.7	11.0	7.6	11.5	7.4
	42	7.7	6.3	8.5	6.7	9.1	7.1	9.4	7.1	9.7	7.1	10.2	7.1	10.7	6.9
	44	7.0	5.7	7.7	6.1	8.3	6.5	8.5	6.5	8.8	6.5	9.3	6.4	9.7	6.3
	46	6.2	5.1	6.8	5.4	7.3	5.7	7.5	5.7	7.8	5.7	8.2	5.7	8.6	5.5
048	10	11.5	9.0	12.7	9.6	13.6	10.2	14.0	10.2	14.4	10.2	15.3	10.1	16.0	9.9
	12	11.5	9.0	12.7	9.6	13.6	10.2	14.0	10.2	14.4	10.2	15.3	10.1	16.0	9.9
	14	11.5	9.0	12.7	9.6	13.6	10.2	14.0	10.2	14.4	10.2	15.3	10.1	16.0	9.9
	16	11.5	9.0	12.7	9.6	13.6	10.2	14.0	10.2	14.4	10.2	15.3	10.1	16.0	9.9
	18	11.5	9.0	12.7	9.6	13.6	10.2	14.0	10.2	14.4	10.2	15.3	10.1	16.0	9.9
	20	11.5	9.0	12.7	9.6	13.6	10.2	14.0	10.2	14.4	10.2	15.3	10.1	16.0	9.9
	21	11.5	9.0	12.7	9.6	13.6	10.2	14.0	10.2	14.4	10.2	15.3	10.1	16.0	9.9
	23	11.5	9.0	12.7	9.6	13.6	10.2	14.0	10.2	14.4	10.2	15.3	10.1	16.0	9.9
	25	11.5	9.0	12.7	9.6	13.6	10.2	14.0	10.2	14.4	10.2	15.3	10.1	16.0	9.9
	27	11.5	9.0	12.7	9.6	13.6	10.2	14.0	10.2	14.4	10.2	15.3	10.1	16.0	9.9
	29	11.5	9.0	12.7	9.6	13.6	10.2	14.0	10.2	14.4	10.2	15.3	10.1	16.0	9.9
	31	11.5	9.0	12.7	9.6	13.6	10.2	14.0	10.2	14.4	10.2	15.3	10.1	16.0	9.9
	33	11.5	9.0	12.7	9.6	13.6	10.2	14.0	10.2	14.4	10.2	15.3	10.1	16.0	9.9
	35	11.5	9.0	12.7	9.6	13.6	10.2	14.0	10.2	14.4	10.2	15.3	10.1	16.0	9.9
	37	11.1	8.8	12.3	9.3	13.2	9.9	13.6	9.9	14.0	9.9	14.8	9.8	15.5	9.6
	39	10.7	8.4	11.8	8.9	12.6	9.5	13.0	9.5	13.4	9.5	14.1	9.4	14.8	9.1
	40	10.3	8.1	11.4	8.7	12.2	9.2	12.6	9.2	13.0	9.2	13.7	9.1	14.4	8.9
	42	9.6	7.6	10.6	8.1	11.4	8.6	11.7	8.5	12.1	8.5	12.8	8.5	13.4	8.3
	44	8.8	6.9	9.7	7.3	10.3	7.8	10.7	7.8	11.0	7.8	11.6	7.7	12.2	7.5
	46	7.7	6.1	8.5	6.5	9.1	6.9	9.4	6.9	9.7	6.9	10.3	6.8	10.7	6.6



**Floor standing Type ( MMF-AP 6H-E )**

TC : Total capacity [kW] SHC : Sensible capacity [kW]

unit size	outdoor air temp. °CDB	indoor air temp.													
		14°CWB		16°CWB		18°CWB		19°CWB		20°CWB		22°CWB		24°CWB	
		20°CDB	23°CDB	26°CDB	27°CDB	28°CDB	30°CDB	32°CDB	TC	SHC	TC	SHC	TC	SHC	
056	10	13.1	10.1	14.5	10.8	15.5	11.4	16.0	11.4	16.5	11.4	17.4	11.3	18.2	11.0
	12	13.1	10.1	14.5	10.8	15.5	11.4	16.0	11.4	16.5	11.4	17.4	11.3	18.2	11.0
	14	13.1	10.1	14.5	10.8	15.5	11.4	16.0	11.4	16.5	11.4	17.4	11.3	18.2	11.0
	16	13.1	10.1	14.5	10.8	15.5	11.4	16.0	11.4	16.5	11.4	17.4	11.3	18.2	11.0
	18	13.1	10.1	14.5	10.8	15.5	11.4	16.0	11.4	16.5	11.4	17.4	11.3	18.2	11.0
	20	13.1	10.1	14.5	10.8	15.5	11.4	16.0	11.4	16.5	11.4	17.4	11.3	18.2	11.0
	21	13.1	10.1	14.5	10.8	15.5	11.4	16.0	11.4	16.5	11.4	17.4	11.3	18.2	11.0
	23	13.1	10.1	14.5	10.8	15.5	11.4	16.0	11.4	16.5	11.4	17.4	11.3	18.2	11.0
	25	13.1	10.1	14.5	10.8	15.5	11.4	16.0	11.4	16.5	11.4	17.4	11.3	18.2	11.0
	27	13.1	10.1	14.5	10.8	15.5	11.4	16.0	11.4	16.5	11.4	17.4	11.3	18.2	11.0
	29	13.1	10.1	14.5	10.8	15.5	11.4	16.0	11.4	16.5	11.4	17.4	11.3	18.2	11.0
	31	13.1	10.1	14.5	10.8	15.5	11.4	16.0	11.4	16.5	11.4	17.4	11.3	18.2	11.0
	33	13.1	10.1	14.5	10.8	15.5	11.4	16.0	11.4	16.5	11.4	17.4	11.3	18.2	11.0
	35	13.1	10.1	14.5	10.8	15.5	11.4	16.0	11.4	16.5	11.4	17.4	11.3	18.2	11.0
	37	12.7	9.8	14.1	10.4	15.1	11.1	15.5	11.1	16.0	11.1	16.9	11.0	17.7	10.7
	39	12.2	9.4	13.5	10.0	14.4	10.6	14.8	10.6	15.3	10.6	16.2	10.5	16.9	10.2
	40	11.8	9.1	13.1	9.7	14.0	10.3	14.4	10.3	14.8	10.3	15.7	10.2	16.4	9.9
	42	11.0	8.5	12.2	9.0	13.0	9.6	13.4	9.5	13.8	9.5	14.6	9.5	15.3	9.2
	44	10.0	7.7	11.1	8.2	11.8	8.7	12.2	8.7	12.5	8.7	13.3	8.6	13.9	8.4
	46	8.8	6.8	9.8	7.2	10.4	7.7	10.8	7.7	11.1	7.7	11.7	7.6	12.3	7.4

# Sensible capacity table



## Console Type ( MML-AP \_\_\_\_ 4NH-E )

TC : Total capacity [kW] SHC : Sensible capacity [kW]

unit size	outdoor air temp. °CDB	indoor air temp.													
		14°CWB		16°CWB		18°CWB		19°CWB		20°CWB		22°CWB			
		20°CDB	23°CDB	26°CDB	27°CDB	28°CDB	30°CDB	32°CDB							
007	10	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	12	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	14	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	16	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	18	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	20	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	21	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	23	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	25	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	27	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	29	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	31	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	33	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	35	1.8	1.6	2.0	1.7	2.1	1.8	2.2	1.8	2.3	1.8	2.4	1.8	2.5	1.7
	37	1.8	1.5	1.9	1.6	2.1	1.8	2.1	1.7	2.2	1.7	2.3	1.7	2.4	1.7
	39	1.7	1.5	1.9	1.6	2.0	1.7	2.0	1.7	2.1	1.7	2.2	1.7	2.3	1.6
	40	1.6	1.4	1.8	1.5	1.9	1.6	2.0	1.6	2.0	1.6	2.2	1.6	2.3	1.6
	42	1.5	1.3	1.7	1.4	1.8	1.5	1.8	1.5	1.9	1.5	2.0	1.5	2.1	1.5
	44	1.4	1.2	1.5	1.3	1.6	1.4	1.7	1.4	1.7	1.4	1.8	1.4	1.9	1.3
	46	1.2	1.1	1.3	1.1	1.4	1.2	1.5	1.2	1.5	1.2	1.6	1.2	1.7	1.2
009	10	2.3	1.9	2.5	2.0	2.7	2.1	2.8	2.1	2.9	2.1	3.1	2.1	3.2	2.0
	12	2.3	1.9	2.5	2.0	2.7	2.1	2.8	2.1	2.9	2.1	3.1	2.1	3.2	2.0
	14	2.3	1.9	2.5	2.0	2.7	2.1	2.8	2.1	2.9	2.1	3.1	2.1	3.2	2.0
	16	2.3	1.9	2.5	2.0	2.7	2.1	2.8	2.1	2.9	2.1	3.1	2.1	3.2	2.0
	18	2.3	1.9	2.5	2.0	2.7	2.1	2.8	2.1	2.9	2.1	3.1	2.1	3.2	2.0
	20	2.3	1.9	2.5	2.0	2.7	2.1	2.8	2.1	2.9	2.1	3.1	2.1	3.2	2.0
	21	2.3	1.9	2.5	2.0	2.7	2.1	2.8	2.1	2.9	2.1	3.1	2.1	3.2	2.0
	23	2.3	1.9	2.5	2.0	2.7	2.1	2.8	2.1	2.9	2.1	3.1	2.1	3.2	2.0
	25	2.3	1.9	2.5	2.0	2.7	2.1	2.8	2.1	2.9	2.1	3.1	2.1	3.2	2.0
	27	2.3	1.9	2.5	2.0	2.7	2.1	2.8	2.1	2.9	2.1	3.1	2.1	3.2	2.0
	29	2.3	1.9	2.5	2.0	2.7	2.1	2.8	2.1	2.9	2.1	3.1	2.1	3.2	2.0
	31	2.3	1.9	2.5	2.0	2.7	2.1	2.8	2.1	2.9	2.1	3.1	2.1	3.2	2.0
	33	2.3	1.9	2.5	2.0	2.7	2.1	2.8	2.1	2.9	2.1	3.1	2.1	3.2	2.0
	35	2.3	1.9	2.5	2.0	2.7	2.1	2.8	2.1	2.9	2.1	3.1	2.1	3.2	2.0
	37	2.2	1.8	2.5	1.9	2.6	2.0	2.7	2.0	2.8	2.0	3.0	2.0	3.1	2.0
	39	2.1	1.7	2.4	1.8	2.5	2.0	2.6	1.9	2.7	1.9	2.8	1.9	3.0	1.9
	40	2.1	1.7	2.3	1.8	2.4	1.9	2.5	1.9	2.6	1.9	2.7	1.9	2.9	1.8
	42	1.9	1.6	2.1	1.7	2.3	1.8	2.3	1.8	2.4	1.8	2.6	1.7	2.7	1.7
	44	1.8	1.4	1.9	1.5	2.1	1.6	2.1	1.6	2.2	1.6	2.3	1.6	2.4	1.5
	46	1.5	1.3	1.7	1.3	1.8	1.4	1.9	1.4	1.9	1.4	2.1	1.4	2.1	1.4
012	10	3.0	2.3	3.3	2.5	3.5	2.6	3.6	2.6	3.7	2.6	3.9	2.6	4.1	2.5
	12	3.0	2.3	3.3	2.5	3.5	2.6	3.6	2.6	3.7	2.6	3.9	2.6	4.1	2.5
	14	3.0	2.3	3.3	2.5	3.5	2.6	3.6	2.6	3.7	2.6	3.9	2.6	4.1	2.5
	16	3.0	2.3	3.3	2.5	3.5	2.6	3.6	2.6	3.7	2.6	3.9	2.6	4.1	2.5
	18	3.0	2.3	3.3	2.5	3.5	2.6	3.6	2.6	3.7	2.6	3.9	2.6	4.1	2.5
	20	3.0	2.3	3.3	2.5	3.5	2.6	3.6	2.6	3.7	2.6	3.9	2.6	4.1	2.5
	21	3.0	2.3	3.3	2.5	3.5	2.6	3.6	2.6	3.7	2.6	3.9	2.6	4.1	2.5
	23	3.0	2.3	3.3	2.5	3.5	2.6	3.6	2.6	3.7	2.6	3.9	2.6	4.1	2.5
	25	3.0	2.3	3.3	2.5	3.5	2.6	3.6	2.6	3.7	2.6	3.9	2.6	4.1	2.5
	27	3.0	2.3	3.3	2.5	3.5	2.6	3.6	2.6	3.7	2.6	3.9	2.6	4.1	2.5
	29	3.0	2.3	3.3	2.5	3.5	2.6	3.6	2.6	3.7	2.6	3.9	2.6	4.1	2.5
	31	3.0	2.3	3.3	2.5	3.5	2.6	3.6	2.6	3.7	2.6	3.9	2.6	4.1	2.5
	33	3.0	2.3	3.3	2.5	3.5	2.6	3.6	2.6	3.7	2.6	3.9	2.6	4.1	2.5
	35	3.0	2.3	3.3	2.5	3.5	2.6	3.6	2.6	3.7	2.6	3.9	2.6	4.1	2.5
	37	2.9	2.2	3.2	2.4	3.4	2.5	3.5	2.5	3.6	2.5	3.8	2.5	4.0	2.4
	39	2.7	2.1	3.0	2.3	3.2	2.4	3.3	2.4	3.4	2.4	3.6	2.4	3.8	2.3
	40	2.7	2.1	2.9	2.2	3.1	2.3	3.2	2.3	3.3	2.3	3.5	2.3	3.7	2.3
	42	2.5	1.9	2.7	2.1	2.9	2.2	3.0	2.2	3.1	2.2	3.3	2.2	3.4	2.1
	44	2.3	1.8	2.5	1.9	2.7	2.0	2.7	2.0	2.8	2.0	3.0	2.0	3.1	1.9
	46	2.0	1.6	2.2	1.7	2.3	1.8	2.4	1.7	2.5	1.7	2.6	1.7	2.8	1.7

# Sensible capacity table



## Console Type ( MML-AP\_\_4NH-E )

TC : Total capacity [kW] SHC : Sensible capacity [kW]

unit size	outdoor air temp. °CDB	indoor air temp.													
		14°CWB		16°CWB		18°CWB		19°CWB		20°CWB		22°CWB			
		20°CDB	23°CDB	26°CDB	27°CDB	28°CDB	30°CDB	32°CDB							
015	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	
	10	3.7	2.9	4.1	3.1	4.4	3.3	4.5	3.3	4.6	3.3	4.9	3.3	5.1	3.2
	12	3.7	2.9	4.1	3.1	4.4	3.3	4.5	3.3	4.6	3.3	4.9	3.3	5.1	3.2
	14	3.7	2.9	4.1	3.1	4.4	3.3	4.5	3.3	4.6	3.3	4.9	3.3	5.1	3.2
	16	3.7	2.9	4.1	3.1	4.4	3.3	4.5	3.3	4.6	3.3	4.9	3.3	5.1	3.2
	18	3.7	2.9	4.1	3.1	4.4	3.3	4.5	3.3	4.6	3.3	4.9	3.3	5.1	3.2
	20	3.7	2.9	4.1	3.1	4.4	3.3	4.5	3.3	4.6	3.3	4.9	3.3	5.1	3.2
	21	3.7	2.9	4.1	3.1	4.4	3.3	4.5	3.3	4.6	3.3	4.9	3.3	5.1	3.2
	23	3.7	2.9	4.1	3.1	4.4	3.3	4.5	3.3	4.6	3.3	4.9	3.3	5.1	3.2
	25	3.7	2.9	4.1	3.1	4.4	3.3	4.5	3.3	4.6	3.3	4.9	3.3	5.1	3.2
	27	3.7	2.9	4.1	3.1	4.4	3.3	4.5	3.3	4.6	3.3	4.9	3.3	5.1	3.2
	29	3.7	2.9	4.1	3.1	4.4	3.3	4.5	3.3	4.6	3.3	4.9	3.3	5.1	3.2
	31	3.7	2.9	4.1	3.1	4.4	3.3	4.5	3.3	4.6	3.3	4.9	3.3	5.1	3.2
	33	3.7	2.9	4.1	3.1	4.4	3.3	4.5	3.3	4.6	3.3	4.9	3.3	5.1	3.2
	35	3.7	2.9	4.1	3.1	4.4	3.3	4.5	3.3	4.6	3.3	4.9	3.3	5.1	3.2
	37	3.6	2.8	4.0	3.0	4.2	3.2	4.4	3.2	4.5	3.2	4.8	3.2	5.0	3.1
	39	3.4	2.7	3.8	2.9	4.0	3.1	4.2	3.1	4.3	3.1	4.5	3.0	4.8	3.0
	40	3.3	2.6	3.7	2.8	3.9	3.0	4.1	3.0	4.2	3.0	4.4	2.9	4.6	2.9
	42	3.1	2.4	3.4	2.6	3.7	2.8	3.8	2.8	3.9	2.8	4.1	2.7	4.3	2.7
	44	2.8	2.2	3.1	2.4	3.3	2.5	3.4	2.5	3.5	2.5	3.7	2.5	3.9	2.4
	46	2.5	2.0	2.7	2.1	2.9	2.2	3.0	2.2	3.1	2.2	3.3	2.2	3.4	2.1
018	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	
	10	4.6	3.5	5.1	3.7	5.4	3.9	5.6	3.9	5.8	3.9	6.1	3.9	6.4	3.8
	12	4.6	3.5	5.1	3.7	5.4	3.9	5.6	3.9	5.8	3.9	6.1	3.9	6.4	3.8
	14	4.6	3.5	5.1	3.7	5.4	3.9	5.6	3.9	5.8	3.9	6.1	3.9	6.4	3.8
	16	4.6	3.5	5.1	3.7	5.4	3.9	5.6	3.9	5.8	3.9	6.1	3.9	6.4	3.8
	18	4.6	3.5	5.1	3.7	5.4	3.9	5.6	3.9	5.8	3.9	6.1	3.9	6.4	3.8
	20	4.6	3.5	5.1	3.7	5.4	3.9	5.6	3.9	5.8	3.9	6.1	3.9	6.4	3.8
	21	4.6	3.5	5.1	3.7	5.4	3.9	5.6	3.9	5.8	3.9	6.1	3.9	6.4	3.8
	23	4.6	3.5	5.1	3.7	5.4	3.9	5.6	3.9	5.8	3.9	6.1	3.9	6.4	3.8
	25	4.6	3.5	5.1	3.7	5.4	3.9	5.6	3.9	5.8	3.9	6.1	3.9	6.4	3.8
	27	4.6	3.5	5.1	3.7	5.4	3.9	5.6	3.9	5.8	3.9	6.1	3.9	6.4	3.8
	29	4.6	3.5	5.1	3.7	5.4	3.9	5.6	3.9	5.8	3.9	6.1	3.9	6.4	3.8
	31	4.6	3.5	5.1	3.7	5.4	3.9	5.6	3.9	5.8	3.9	6.1	3.9	6.4	3.8
	33	4.6	3.5	5.1	3.7	5.4	3.9	5.6	3.9	5.8	3.9	6.1	3.9	6.4	3.8
	35	4.6	3.5	5.1	3.7	5.4	3.9	5.6	3.9	5.8	3.9	6.1	3.9	6.4	3.8
	37	4.5	3.4	4.9	3.6	5.3	3.8	5.4	3.8	5.6	3.8	5.9	3.7	6.2	3.7
	39	4.3	3.2	4.7	3.4	5.0	3.6	5.2	3.6	5.3	3.6	5.7	3.6	5.9	3.5
	40	4.1	3.1	4.6	3.3	4.9	3.5	5.0	3.5	5.2	3.5	5.5	3.5	5.7	3.4
	42	3.8	2.9	4.3	3.1	4.5	3.3	4.7	3.3	4.8	3.3	5.1	3.2	5.3	3.2
	44	3.5	2.6	3.9	2.8	4.1	3.0	4.3	3.0	4.4	3.0	4.6	2.9	4.9	2.9
	46	3.1	2.3	3.4	2.5	3.7	2.6	3.8	2.6	3.9	2.6	4.1	2.6	4.3	2.5

---

---

## **SMMS-e Engineering Data Book**

**Model name:**

**MMY-MAP\_6HT8P-E**

**September, 2015 Full version**